
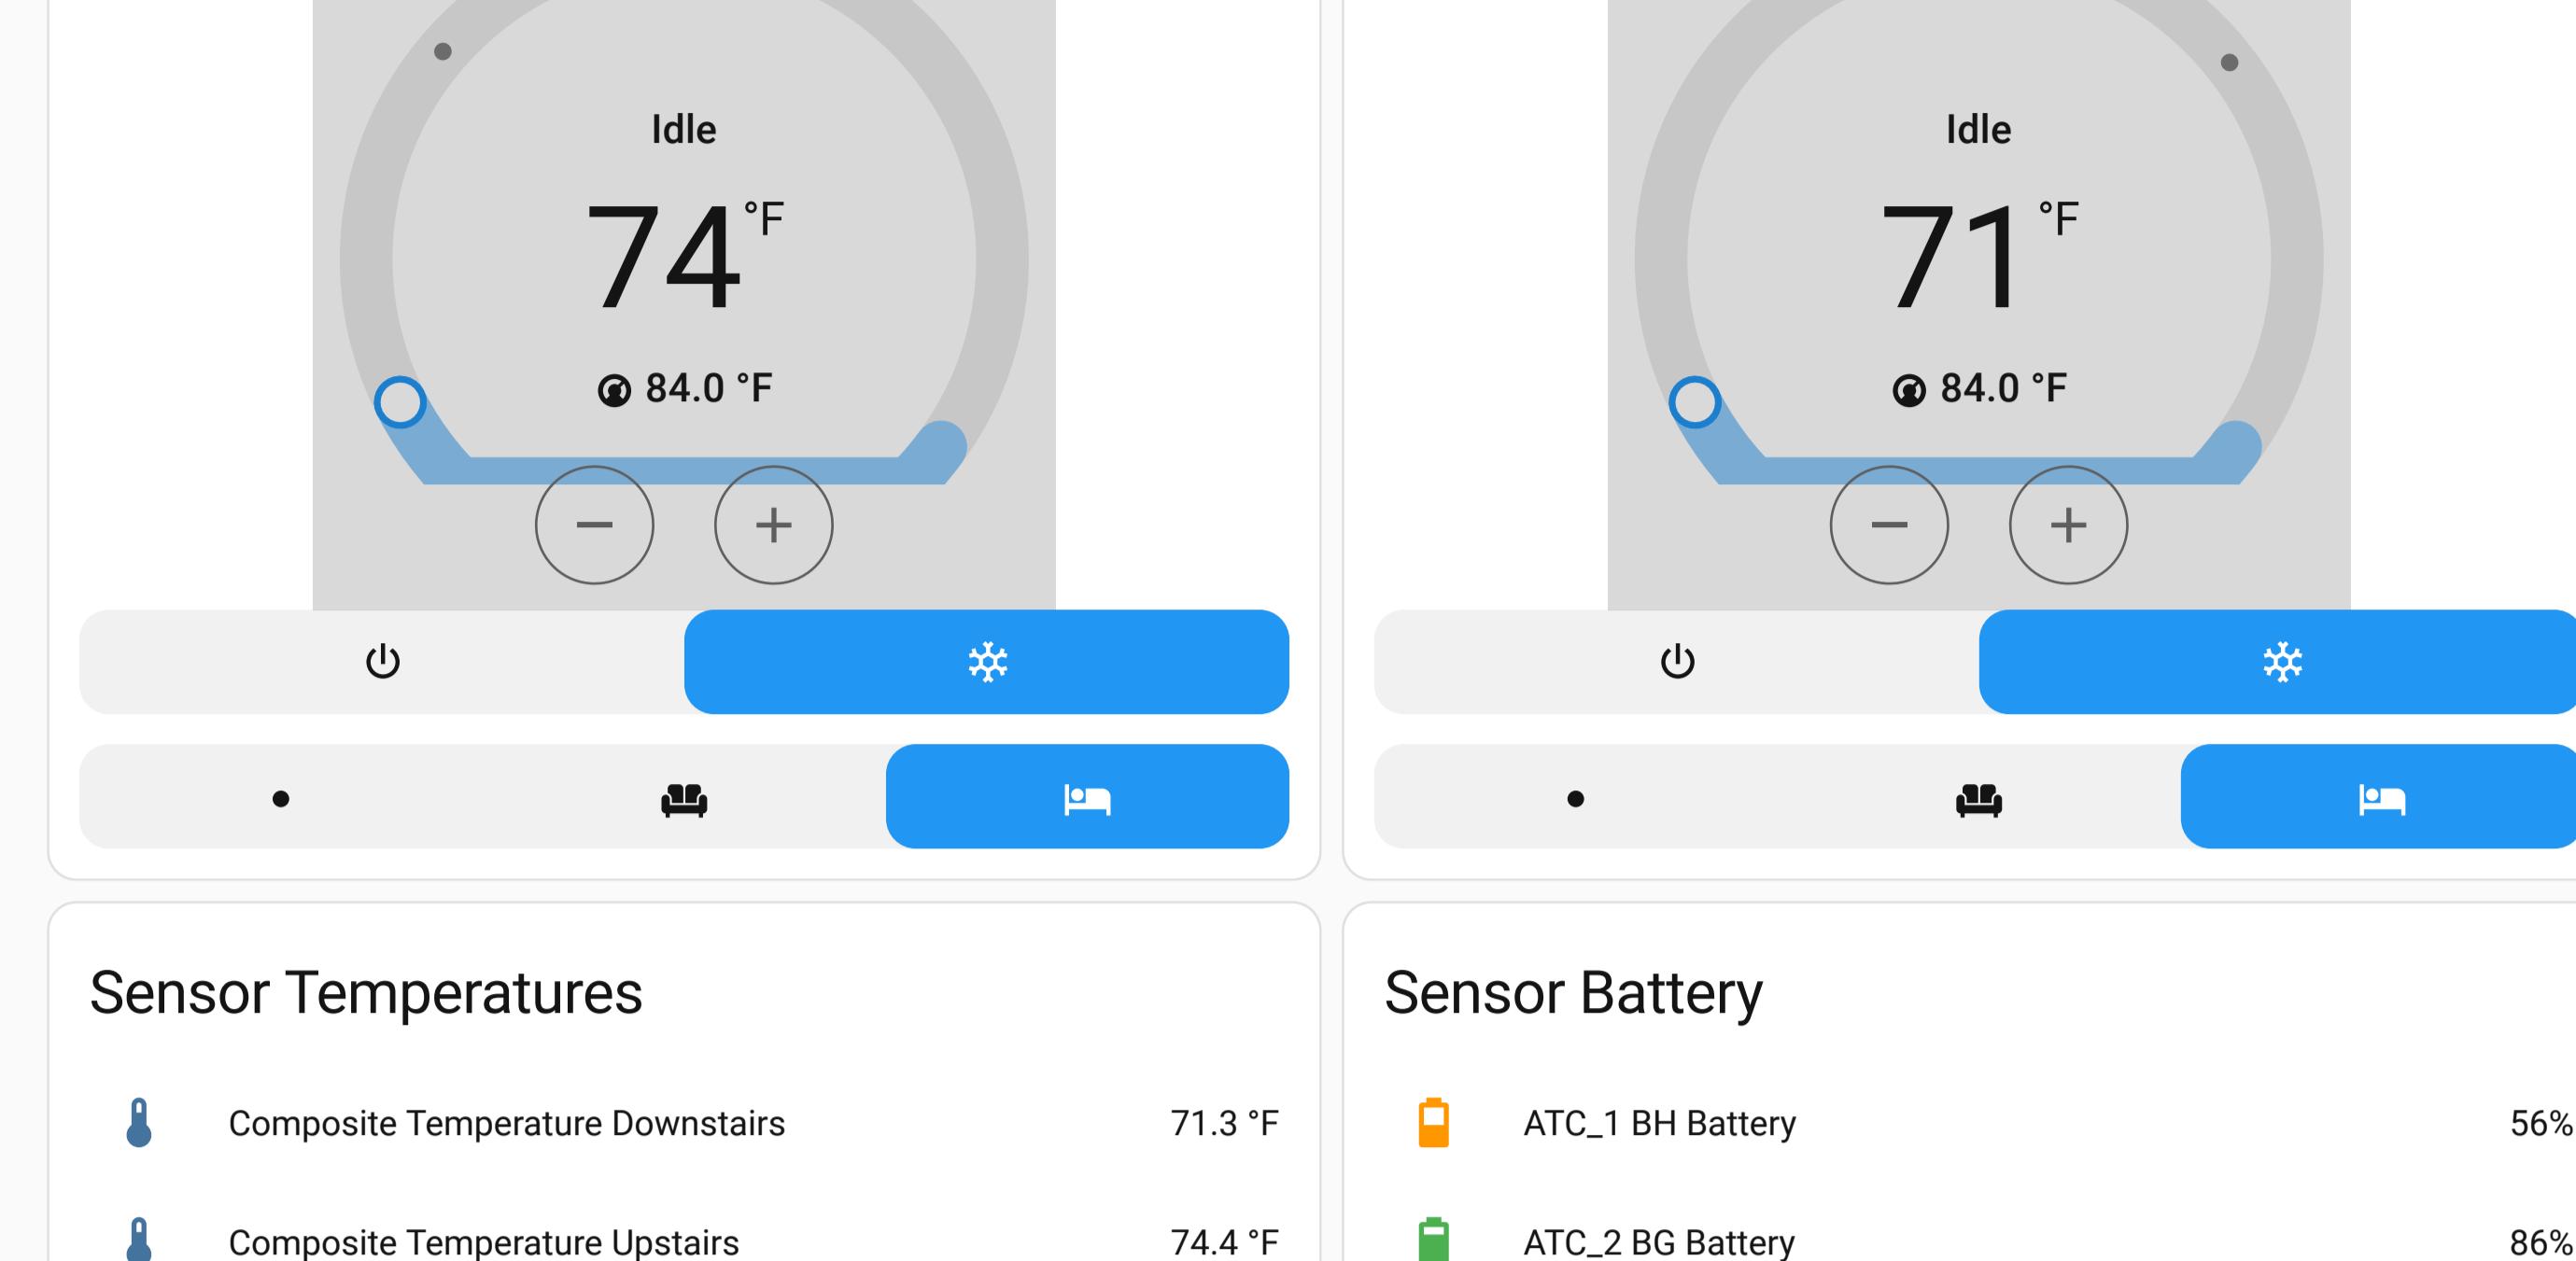


- Overview
- Appliances
- HVAC**
- Sensors & Switches
- WiFi
- Energy
- Activity
- History
- ESPHome Builder
- Filebrowser
- HACS
- Media
- Terminal

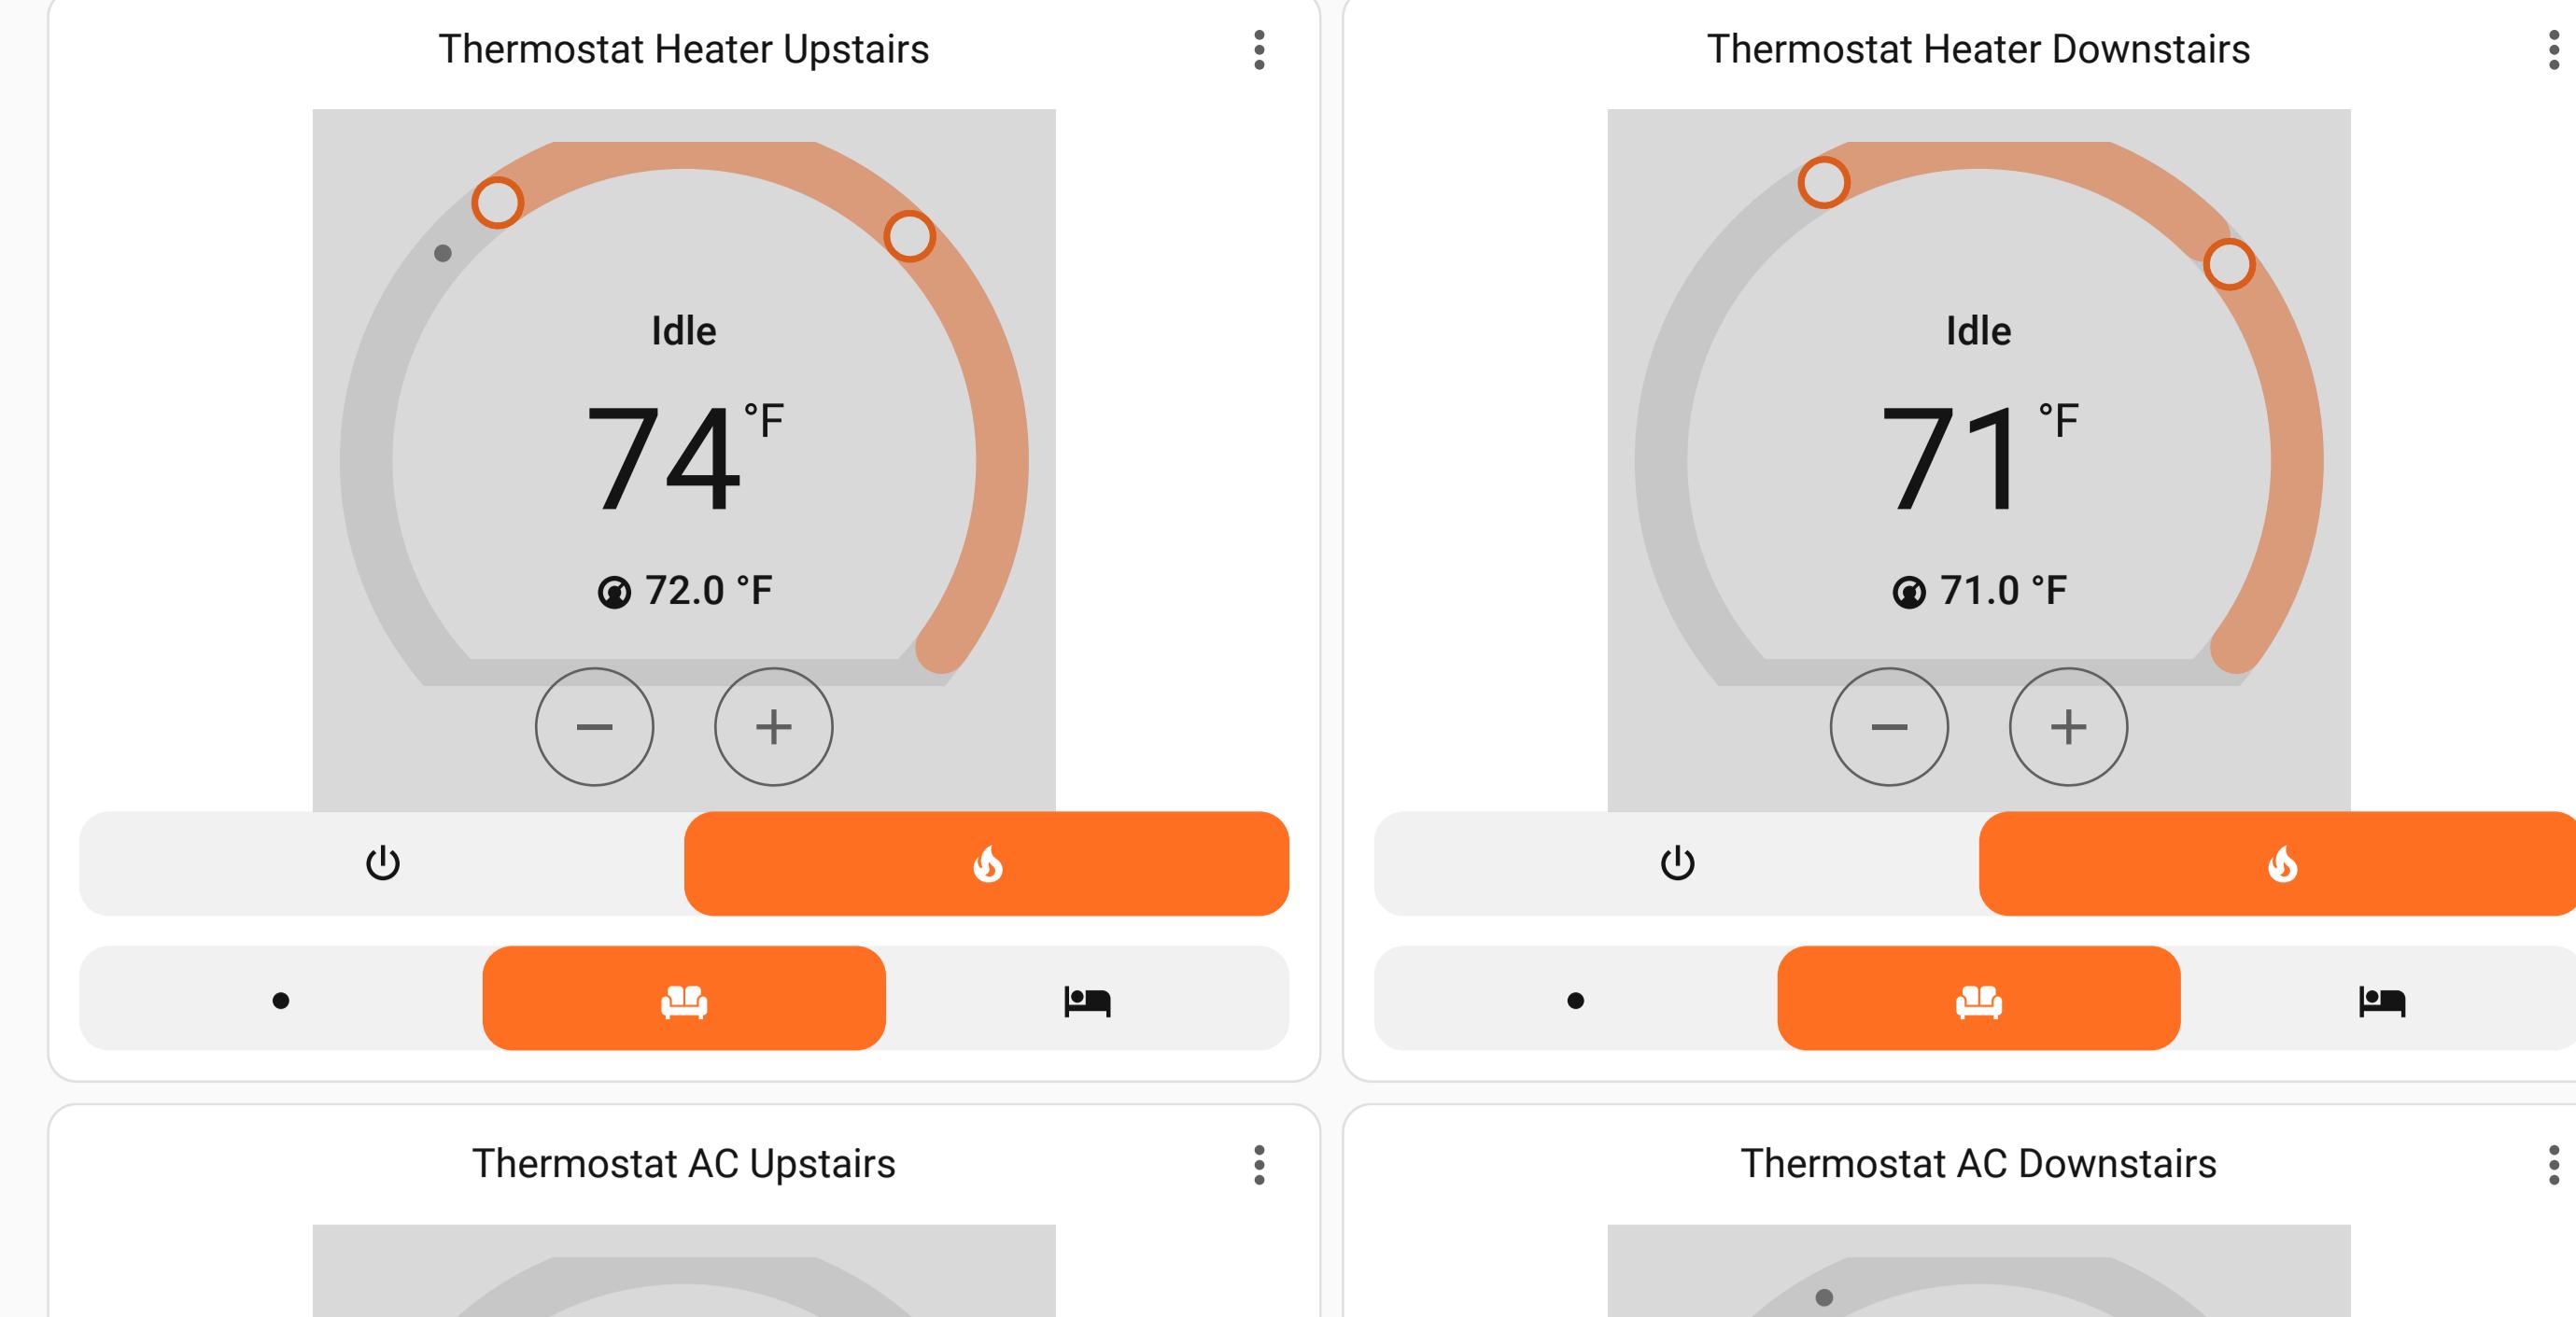

Sensor Temperatures





Composite Temperature Downstairs	71.3 °F
Composite Temperature Upstairs	74.4 °F
ATC_1 BH Temperature	72.3 °F
ATC_2 BG Temperature	72.1 °F
ATC_3 BM Temperature	74.4 °F
ATC_4 FR Temperature	71.3 °F
ATC_5 LR Temperature	69.9 °F
ATC_6 D Temperature	70.1 °F
ATC_7 BS Temperature	71.2 °F
ATC_8 UB Temperature	69.2 °F
ATC_9 O Temperature	63.5 °F

Sensor Battery

ATC_1 BH Battery	56%
ATC_2 BG Battery	86%
ATC_3 BM Battery	56%
ATC_4 FR Battery	48%
ATC_5 LR Battery	70%
ATC_6 D Battery	89%
ATC_7 BS Battery	64%
ATC_8 UB Battery	90%
ATC_9 O Battery	90%

Zone HVAC Controller

HVAC Cycle State	Off
HVAC Zone State	All
Relay 1 (Heat)	<input type="checkbox"/>
Relay 2 (Cool)	<input type="checkbox"/>
Relay 3 (Fan)	<input type="checkbox"/>
Relay 4	<input type="checkbox"/>
Relay 5	<input type="checkbox"/>
Relay 6	<input type="checkbox"/>
Relay 7 (Close Upstairs Zone)	<input type="checkbox"/>
Relay 8 (Close Downstairs Zone)	<input type="checkbox"/>
Test LED	<input type="checkbox"/>
HVAC Daily Heat Stats	2h 2m
HVAC Daily Cool Stats	0h

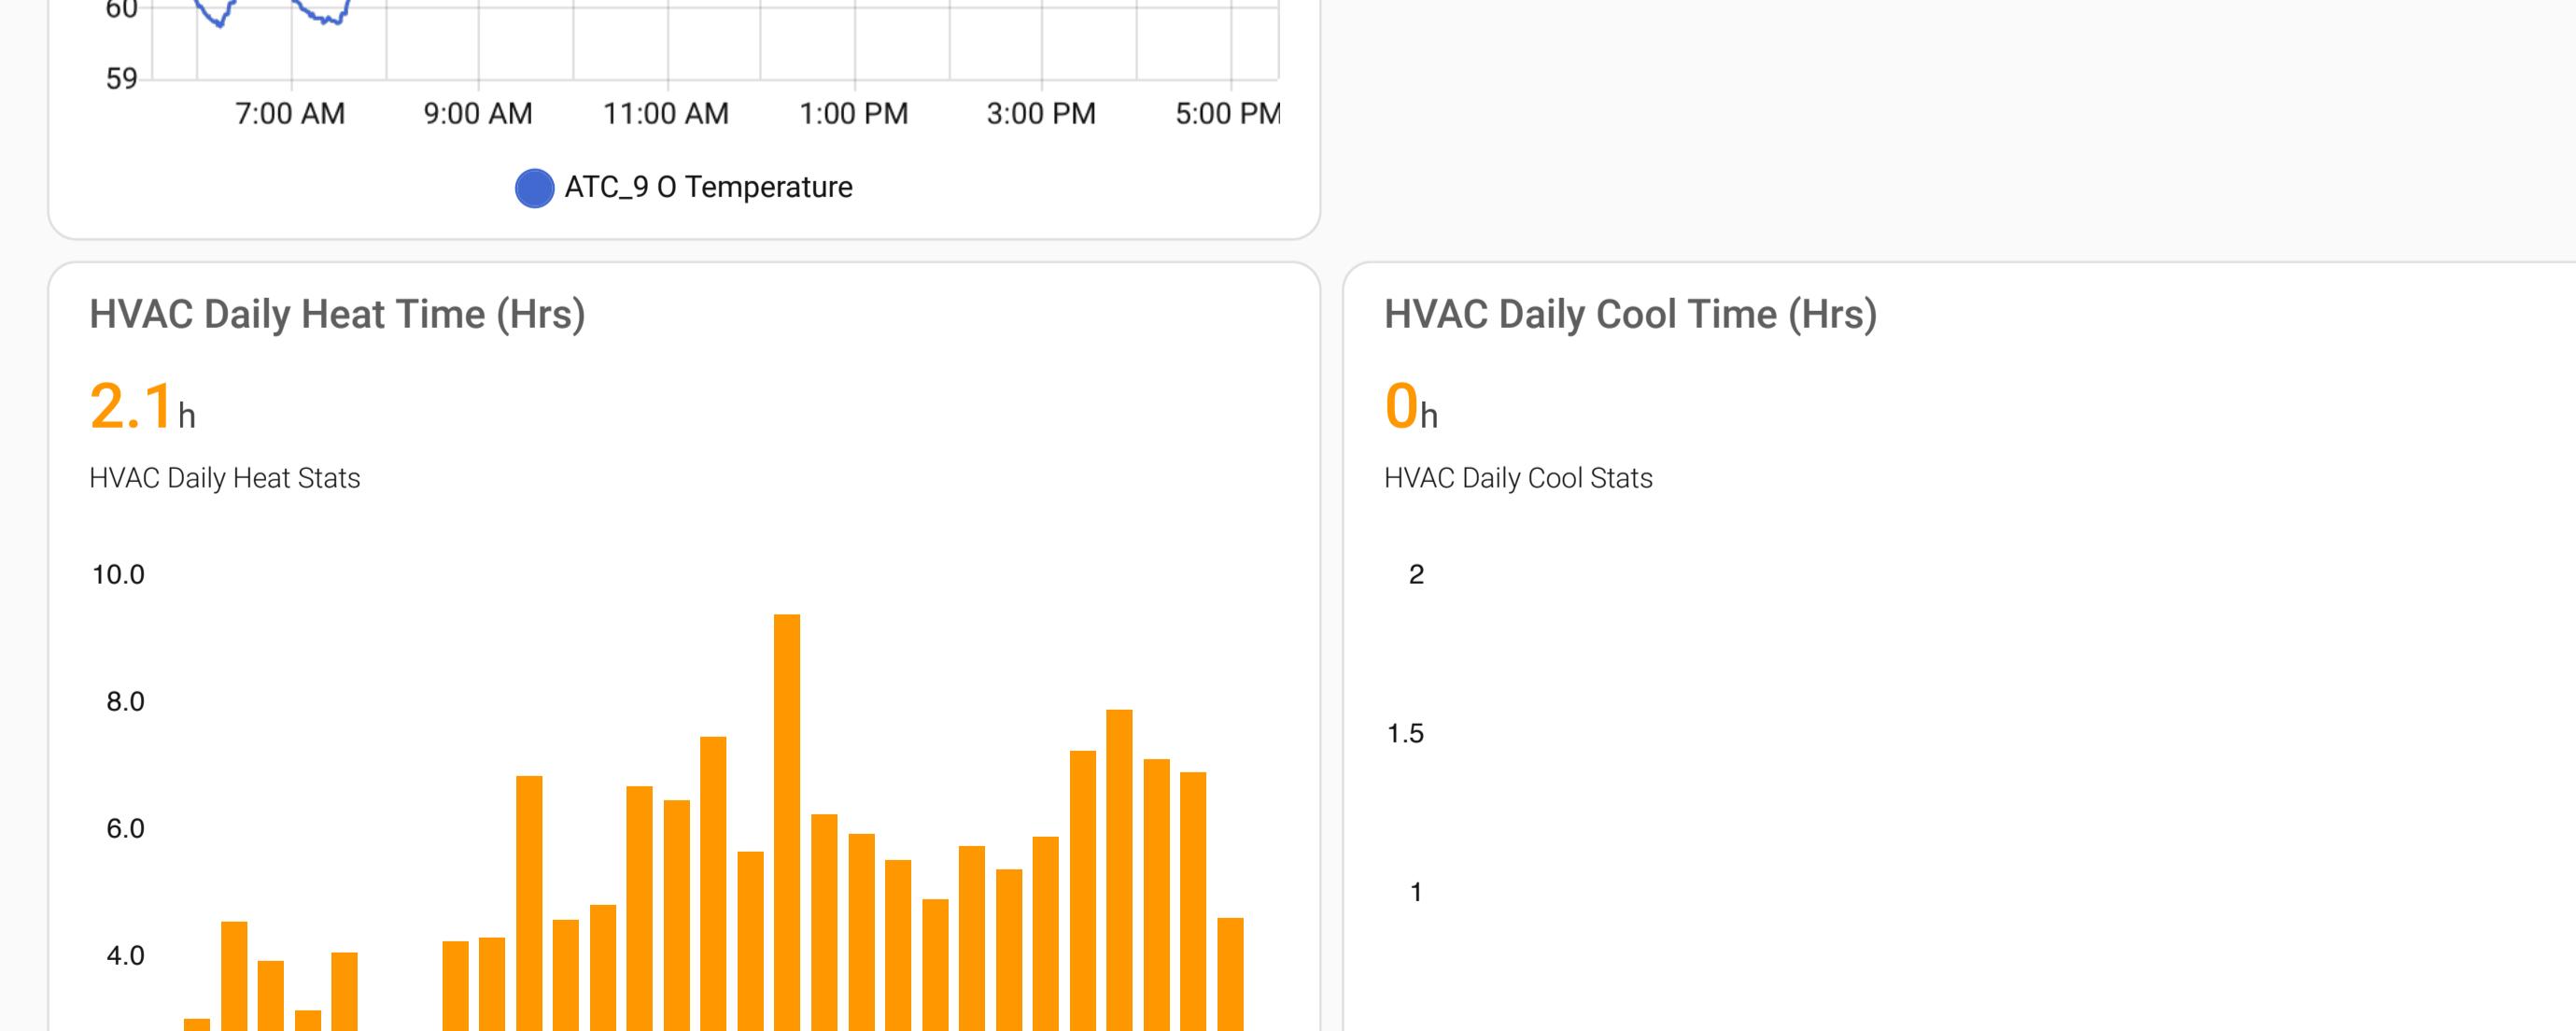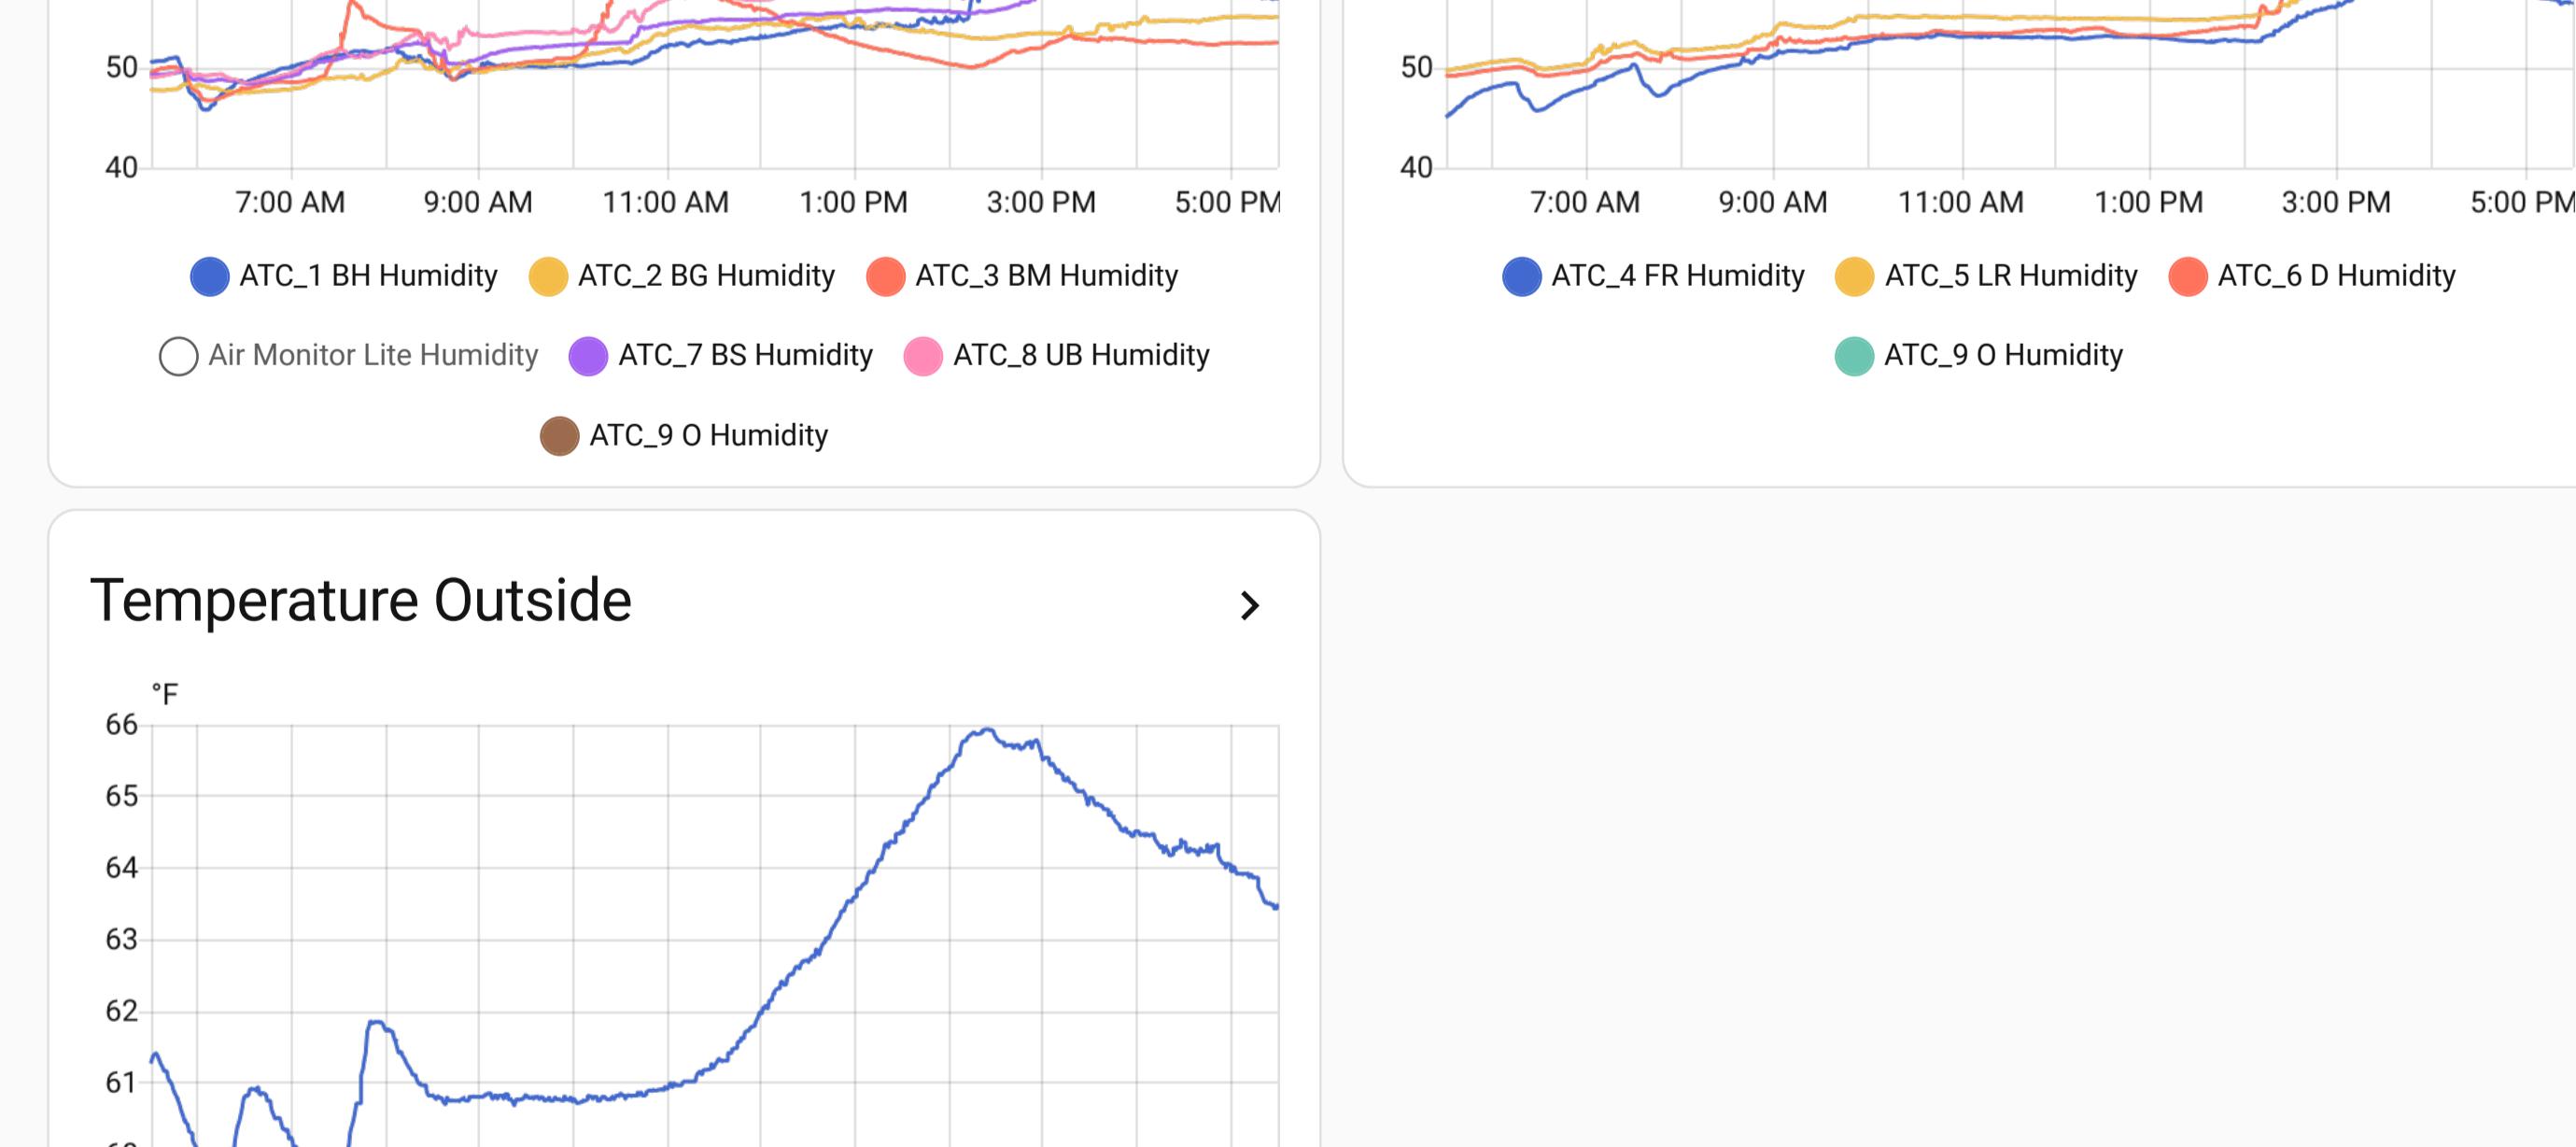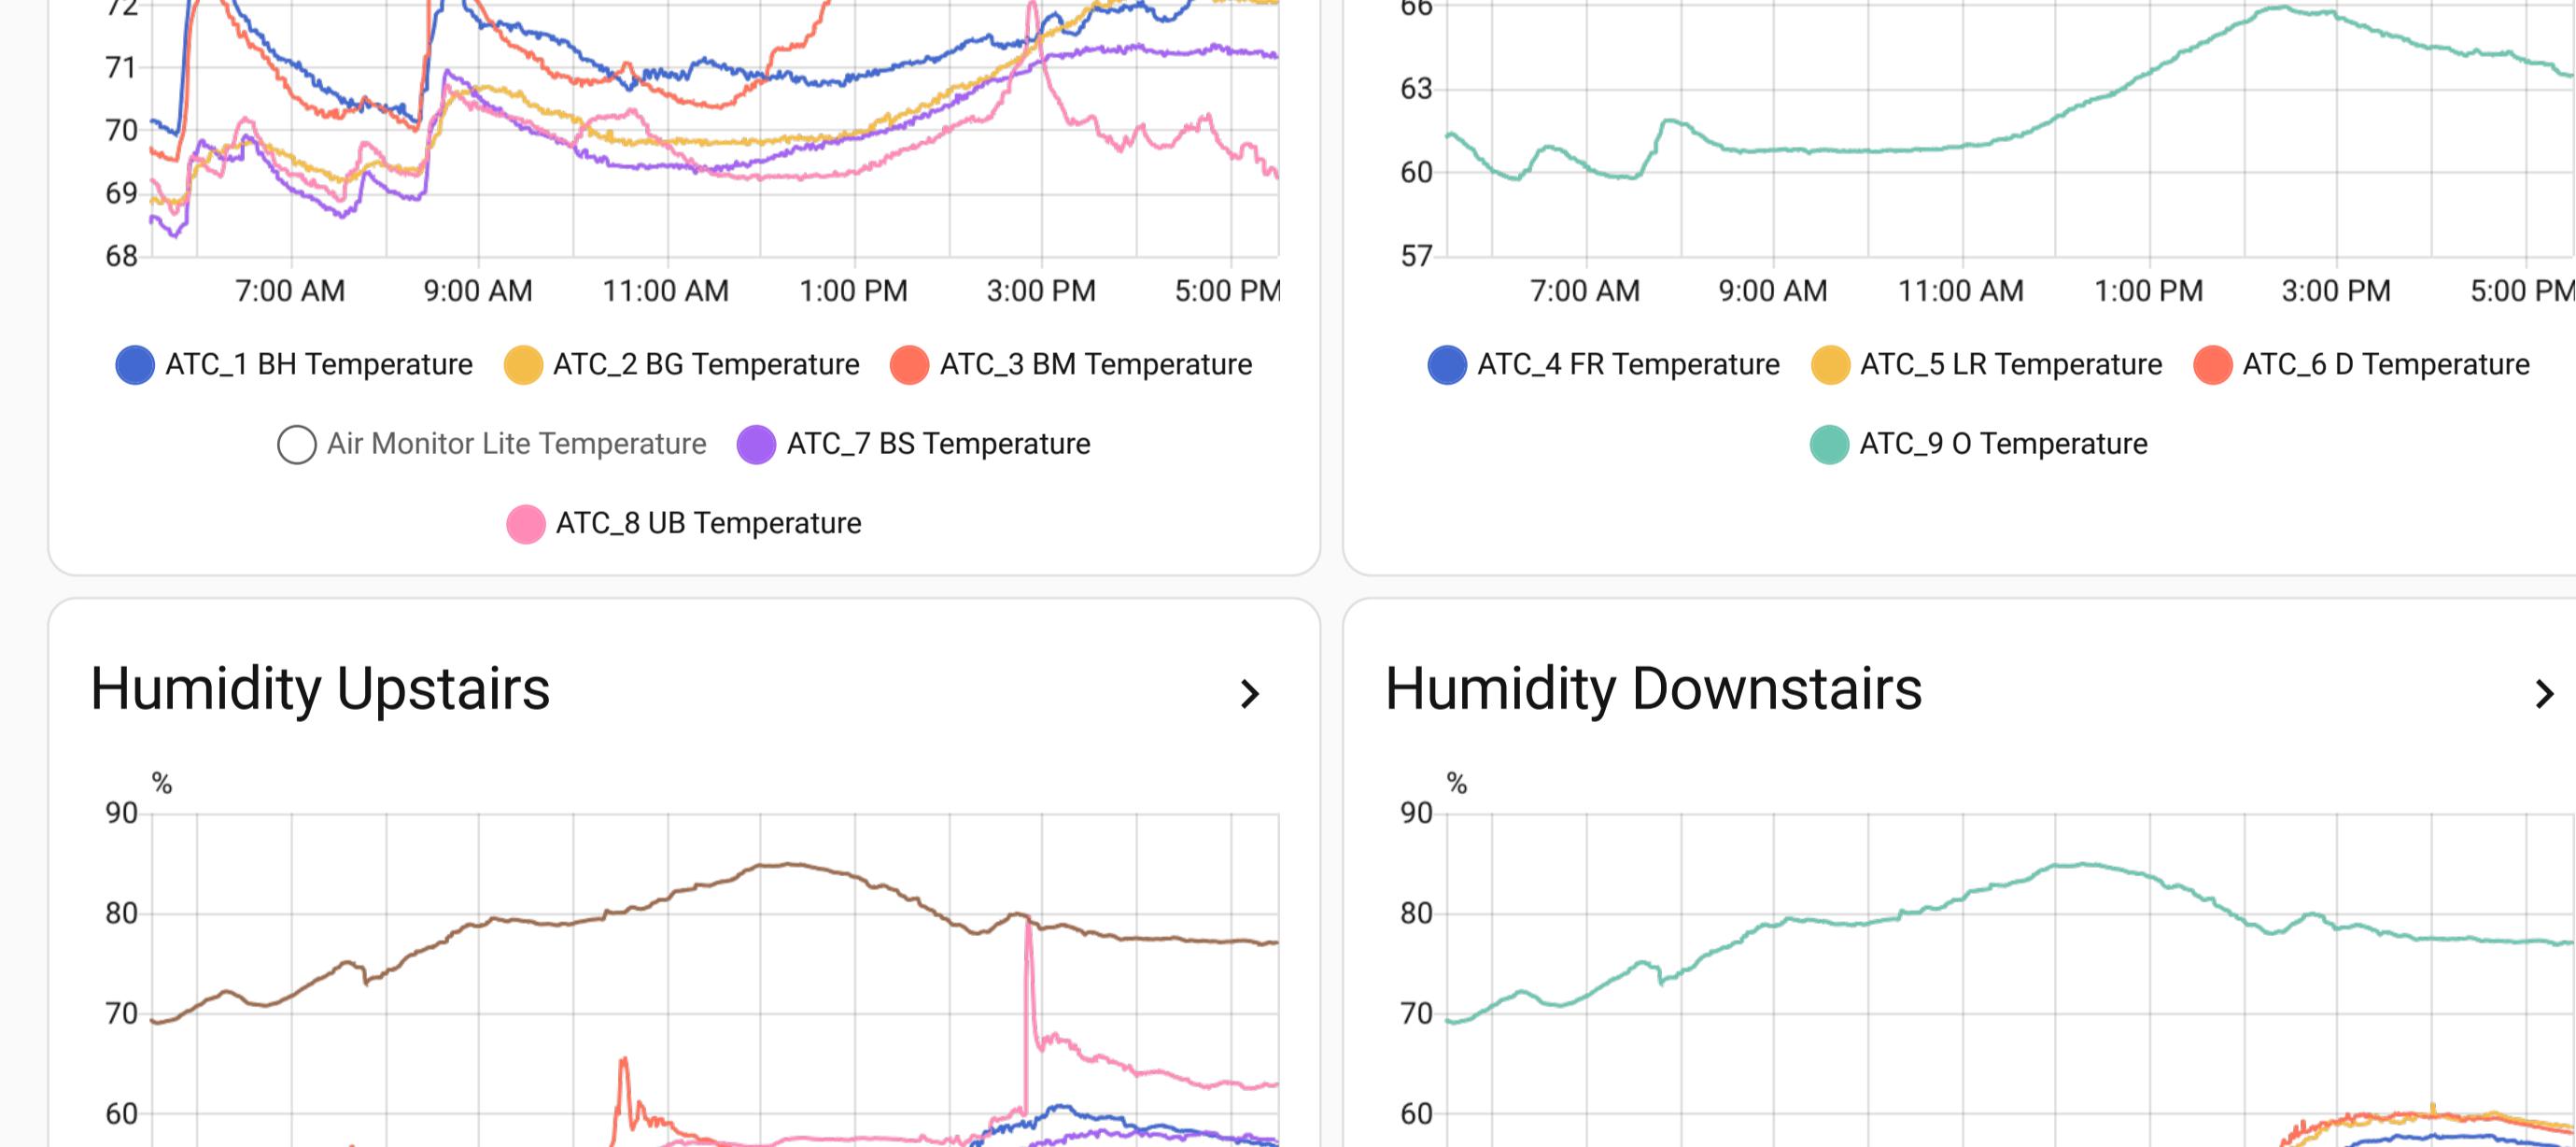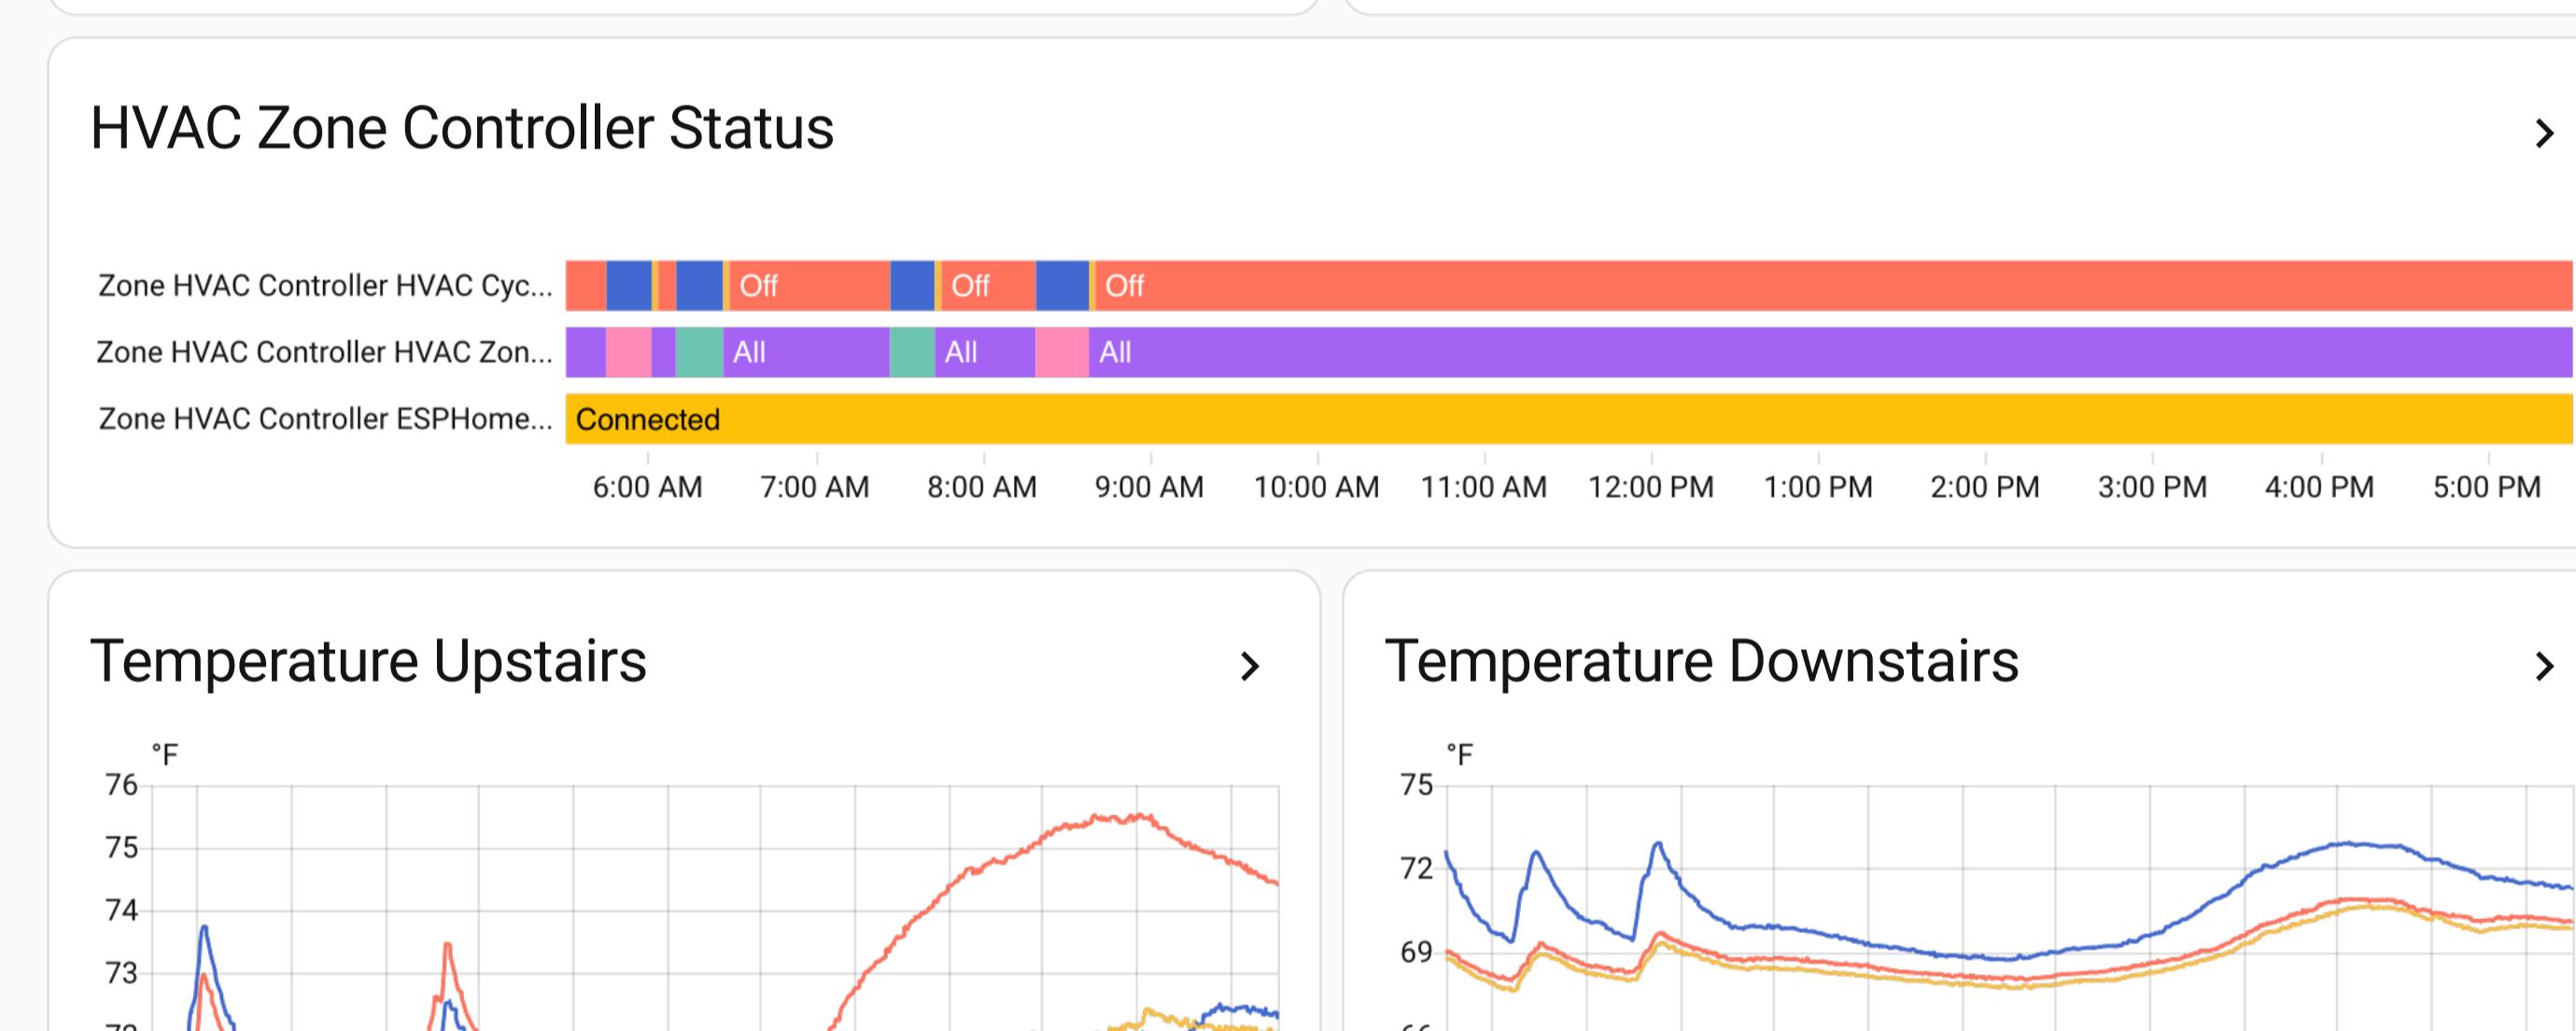

- Developer tools
- Settings
- Notifications