



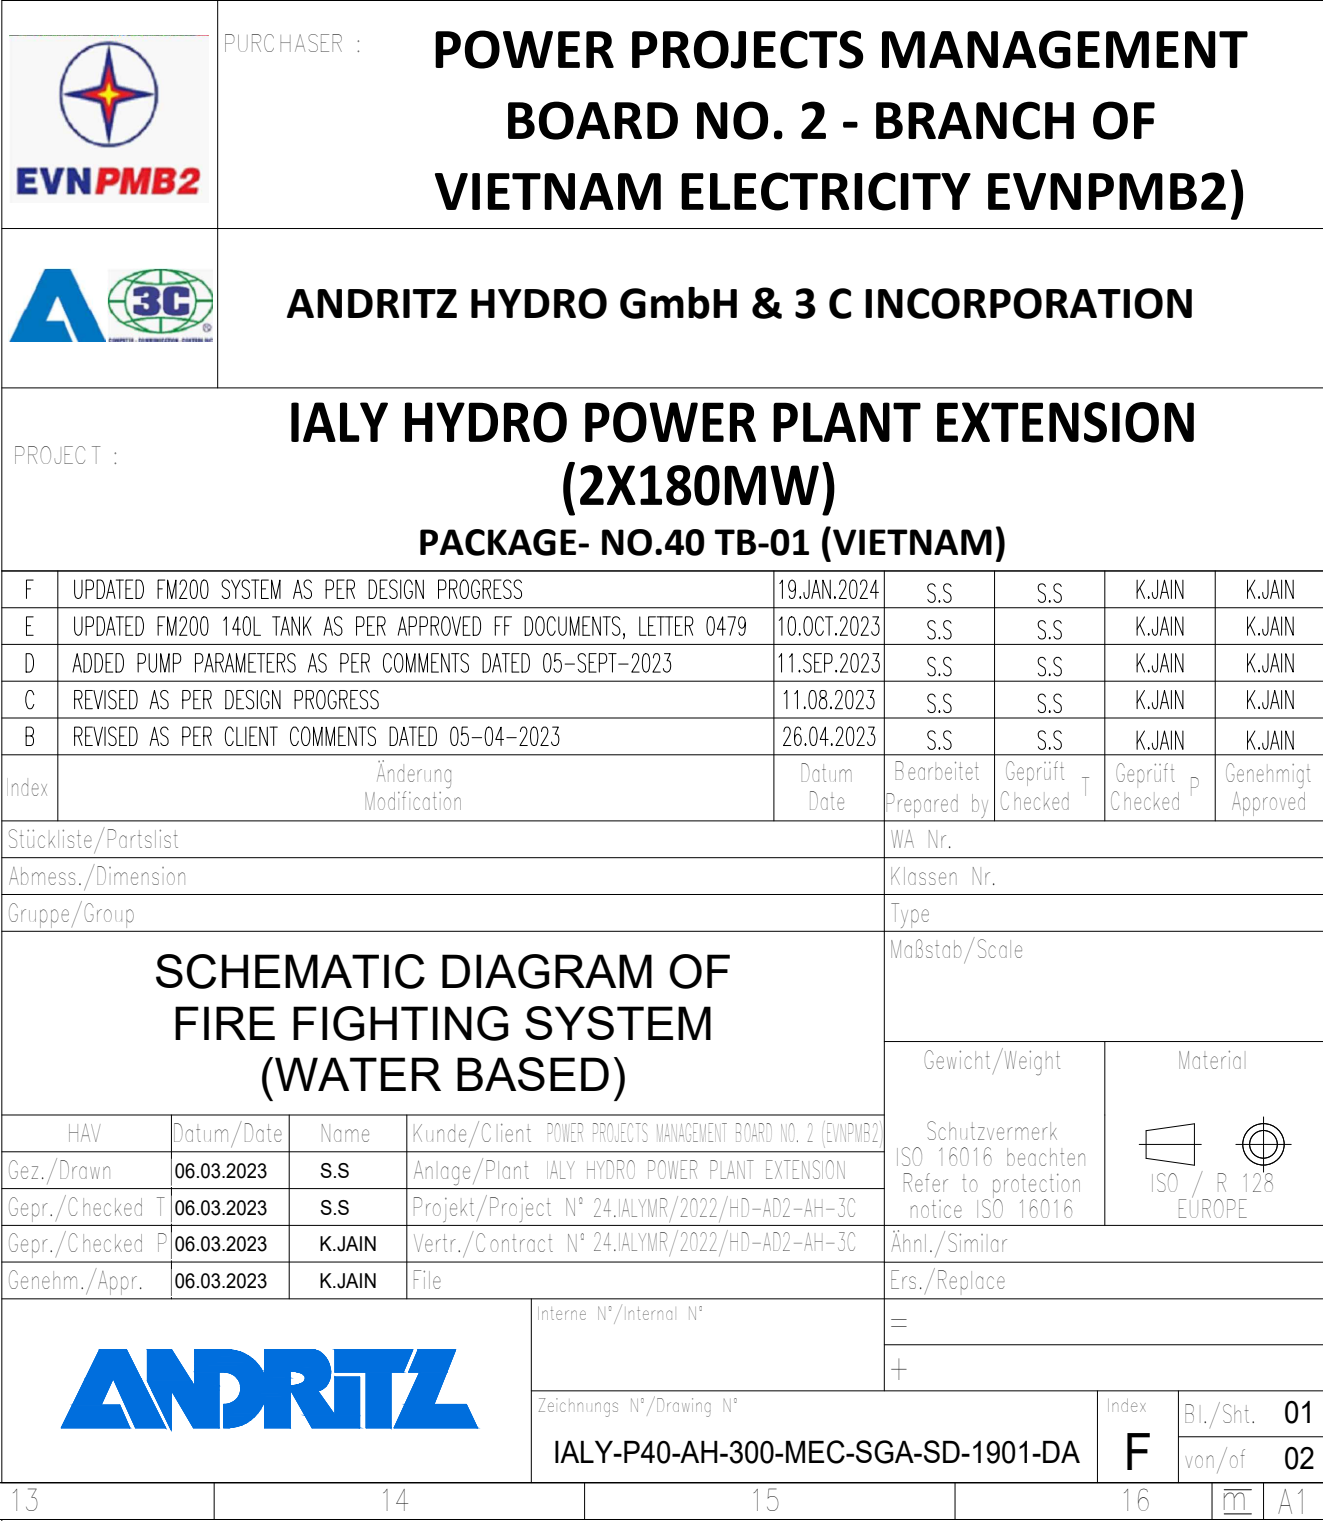

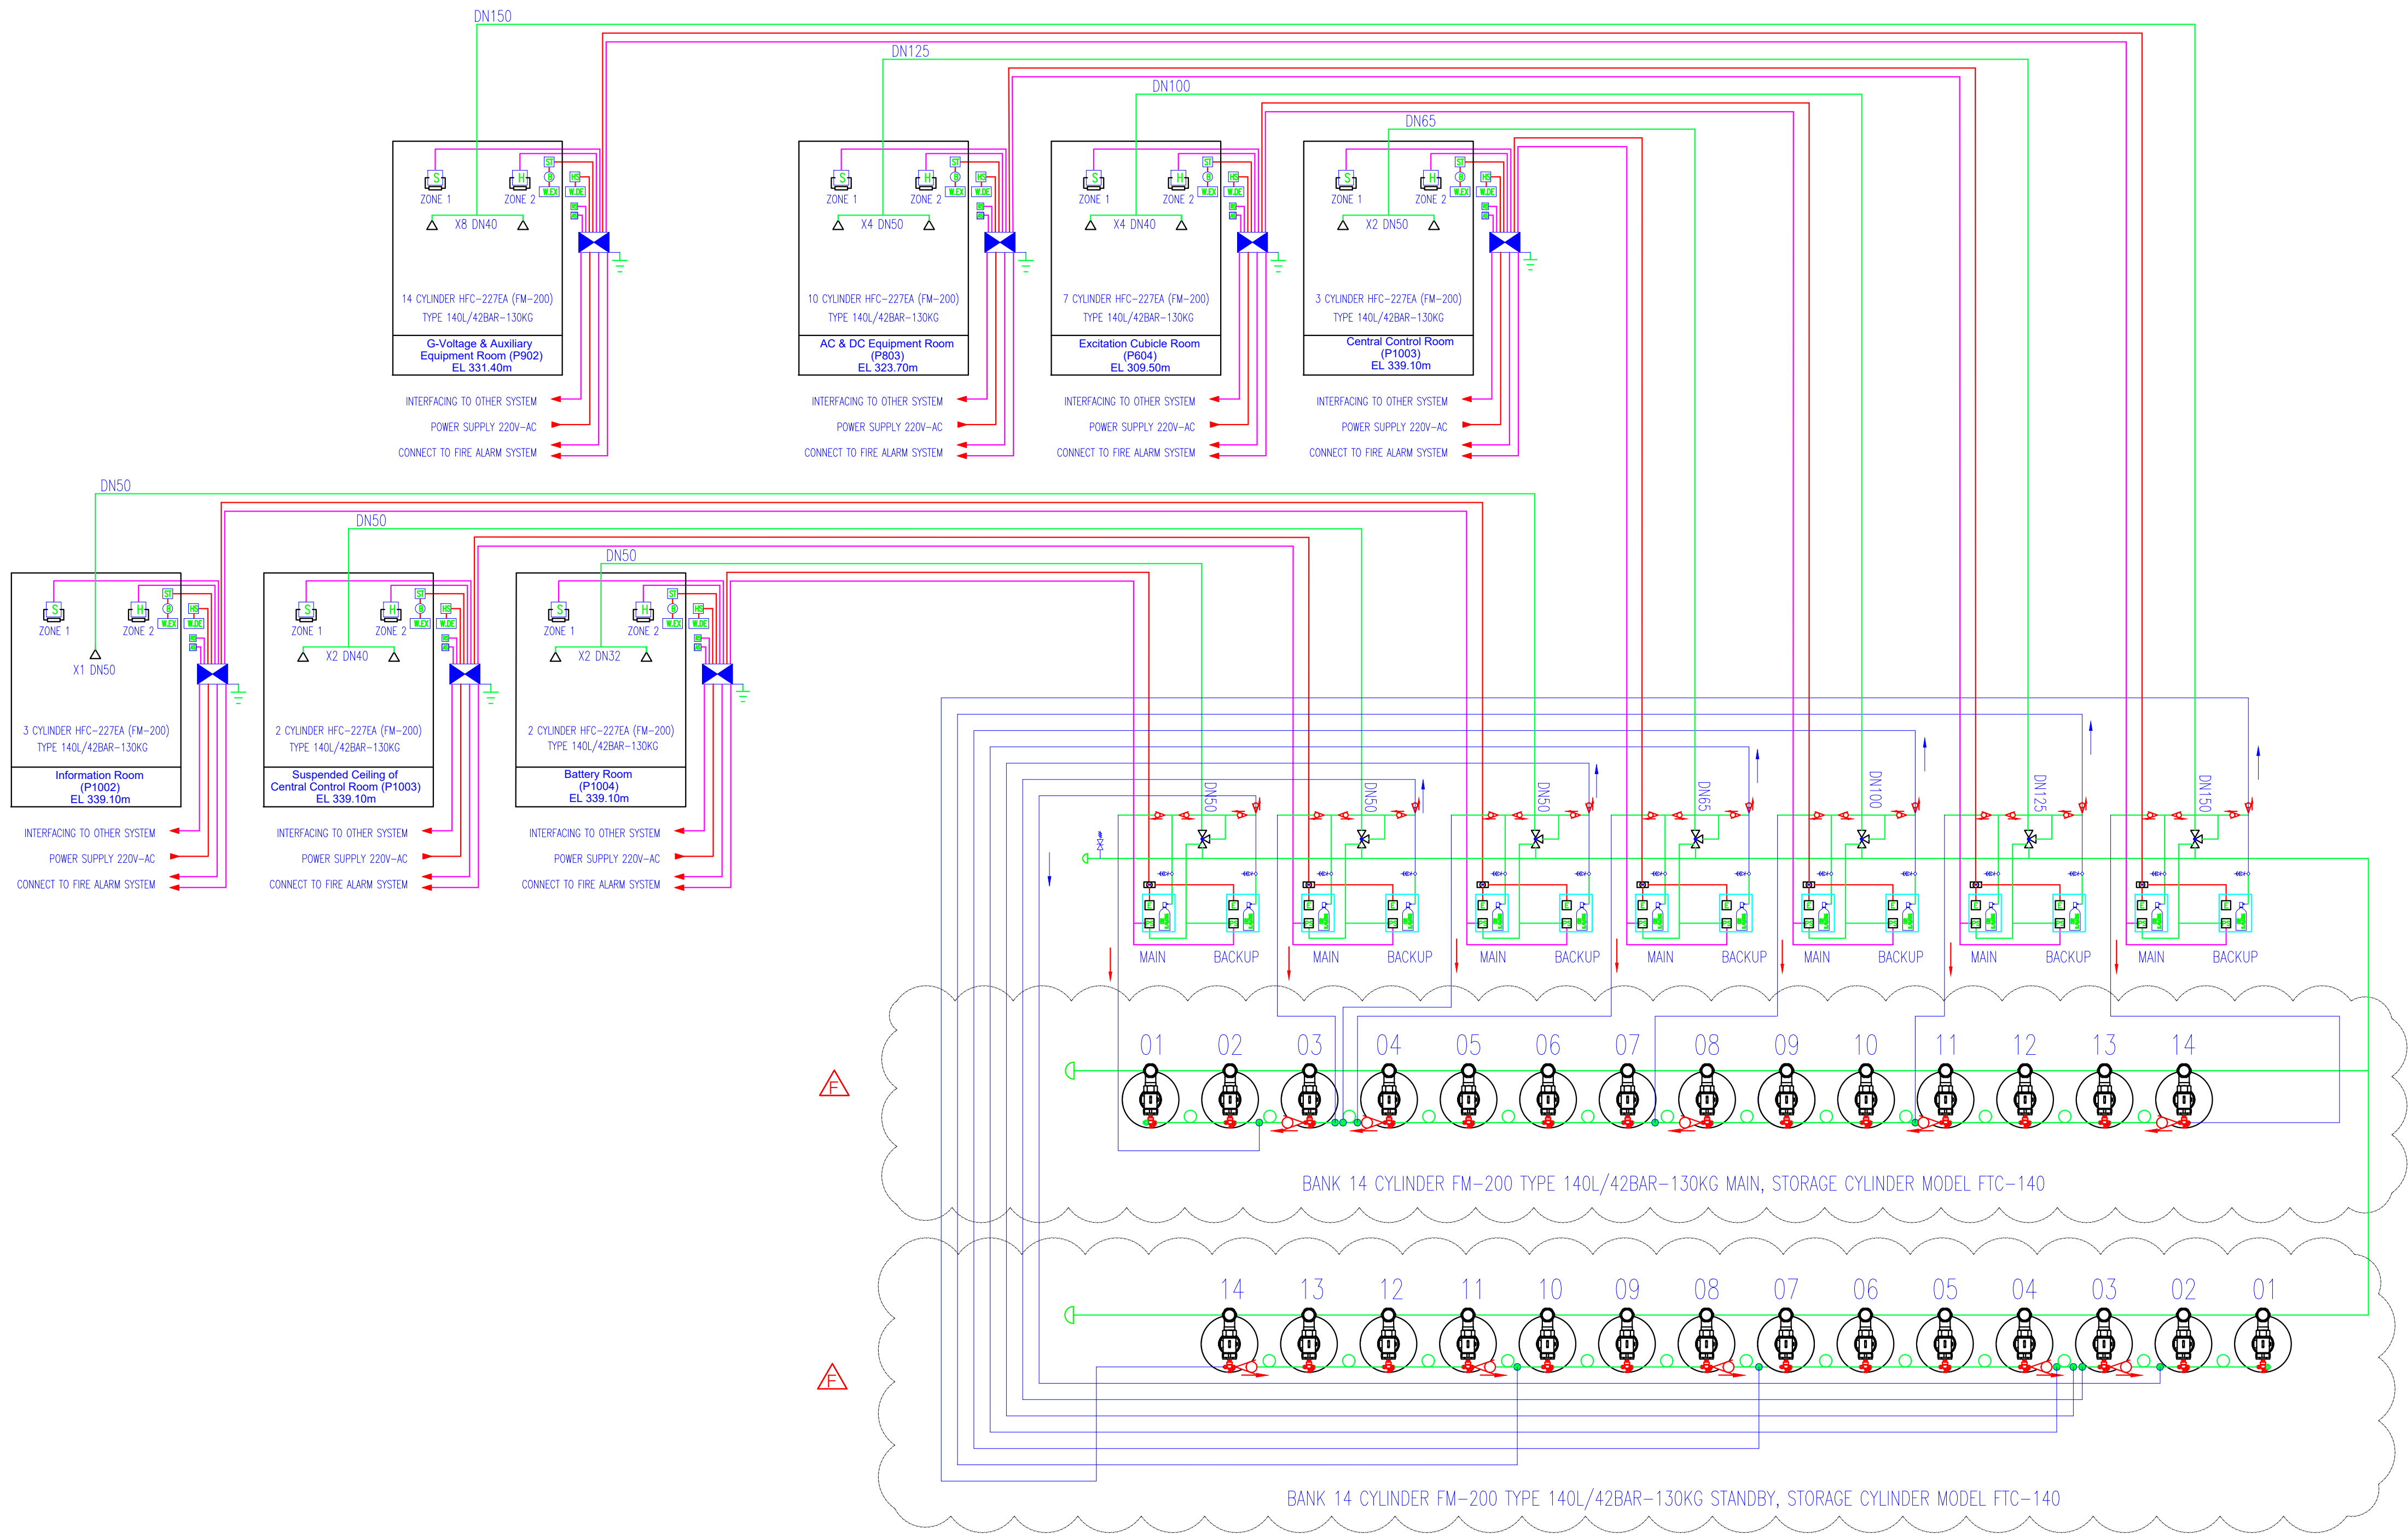

- NOTES:
1. WORKING PRESSURE = 25 BAR
 2. DESIGN PRESSURE = 25 BAR
 3. THE MOC OF FM200 GAS PIPES ARE AS FOLLOWS:
 - PIPES WILL BE GALVANIZED SEAMLESS CARBON STEEL AS PER ASTM A53/A106 SCH 40.
 - FLANGES SHALL BE SEAMLESS GALVANIZED CARBON STEEL AS PER ASTM A105, DIMENSION AS PER ANSI B16.5
 - FITTINGS SHALL BE SEAMLESS GALVANIZED CARBON STEEL AS PER ASTM A234 WPB BUTT WELDED AS PER ANSI B16.4.

SCHEMATIC DIAGRAM OF FM-200 SYSTEM WITH ZONE SELECTED VALVE

STT	LEGENDS	DESCRIPTION
01		FM200 LOCAL CONTROL PANEL
02		SMOKE DETECTOR
03		HEAT DETECTOR
04		PAUSE RELEASE GAS BUTTON
05		ACTIVE RELEASE GAS BUTTON
06		BELL ALARM RELEASE GAS
07		STROBE LIGHT ALARM RELEASE GAS
08		COMBINATION OF HORN & STROBE
09		EVACUATION WARNING PANEL
10		DO NOT ENTER WARNING PANEL
11		SIGNAL CABLE 2X1.5MM2 FIRE RETARDANT, ARMURED
12		POWER CABLE 2X2.5MM2 FIRE RETARDANT
13		ACTIVATING DIRECTION
14		SWITCH TO CHANGE ELECTRICAL VALVE
15		FROM MAIN CYLINDER TO STANDBY CYLINDER
16		FM-200 CYLINDER, PRESSURE 42BAR
17		ACTIVATING VALVE BY GAS
18		ACTIVATING PANEL 1 LITER
19		COPPER WITH ONE WAY VALVE, TEE
20		COPPER PIPING
21		COPPER PIPE CONNECT CYLINDER
22		ZONE SELECTED VALVE
23		PRESSURE SAFETY VALVE 20A
24		AIR SAFETY VALVE 8A
25		ONE WAY VALVE 8A
26		PLUG FOR ACTIVATING PIPE
27		NOZZLE 360°
28		MAIN PIPE SCH40

PURCHASER :
POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)

ANDRITZ HYDRO GmbH & 3 C INCORPORATION

PROJECT :
ITALY HYDRO POWER PLANT EXTENSION (2X180MW)
PACKAGE- NO.40 TB-01 (VIETNAM)

F	UPDATED FM200 SYSTEM AS PER DESIGN PROGRESS	19.JAN.2024	S.S	S.S	K.JAIN	K.JAIN
E	UPDATED FM200 140L TANK AS PER APPROVED FF DOCUMENTS, LETTER 0479	10.OCT.2023	S.S	S.S	K.JAIN	K.JAIN
D	ADDED PUMP PARAMETERS AS PER COMMENTS DATED 05-SEPT-2023	11.SEP.2023	S.S	S.S	K.JAIN	K.JAIN
C	REVISED AS PER DESIGN PROGRESS	11.O8.2023	S.S	S.S	K.JAIN	K.JAIN
B	REVISED AS PER CLIENT COMMENTS DATED 05-04-2023	26.04.2023	S.S	S.S	K.JAIN	K.JAIN

Index	Änderung	Datum	Bearbeitet	Geprüft	Geprüft	Genehmigt
	Modification	Date	Prepared by	Checked	Checked	Approved

Stückliste/Partlist	WA Nr.
Abmess./Dimension	Klassen Nr.
Gruppe/Group	Type
Maßstab/Scale	
Gewicht/Weight	
Material	

SCHEMATIC DIAGRAM OF FIRE FIGHTING SYSTEM (FM-200)

HAW	Datum/Date	Name	Kunde/Client	POWER PROJECTS MANAGEMENT BOARD NO.2 (EVNPMB2)	Schutzvermerk
Gez./Drawn	06.03.2023	S.S	Anlage/Plant	ITALY HYDRO POWER PLANT EXTENSION	ISO 16016 beachten
Gepr./Checked	06.03.2023	S.S	Projek/Project	N° 24/JANUAR/2022/HB-02-AH-3C	Refer to protection notice ISO 16016
Gepr./Checked	06.03.2023	K.JAIN	Ventri./Contract	N° 24/JANUAR/2022/HB-02-AH-3C	Ähnl./Similar
Genehm./Appr.	06.03.2023	K.JAIN	File		Ers./Replace

Interne N°/Internal N°	=
Zeichnungs N°/Drawing N°	+
Index	Bl./Sht.
	von/of
ITALY-P40-AH-300-MEC-SGA-SD-1901-DA	
F	02