



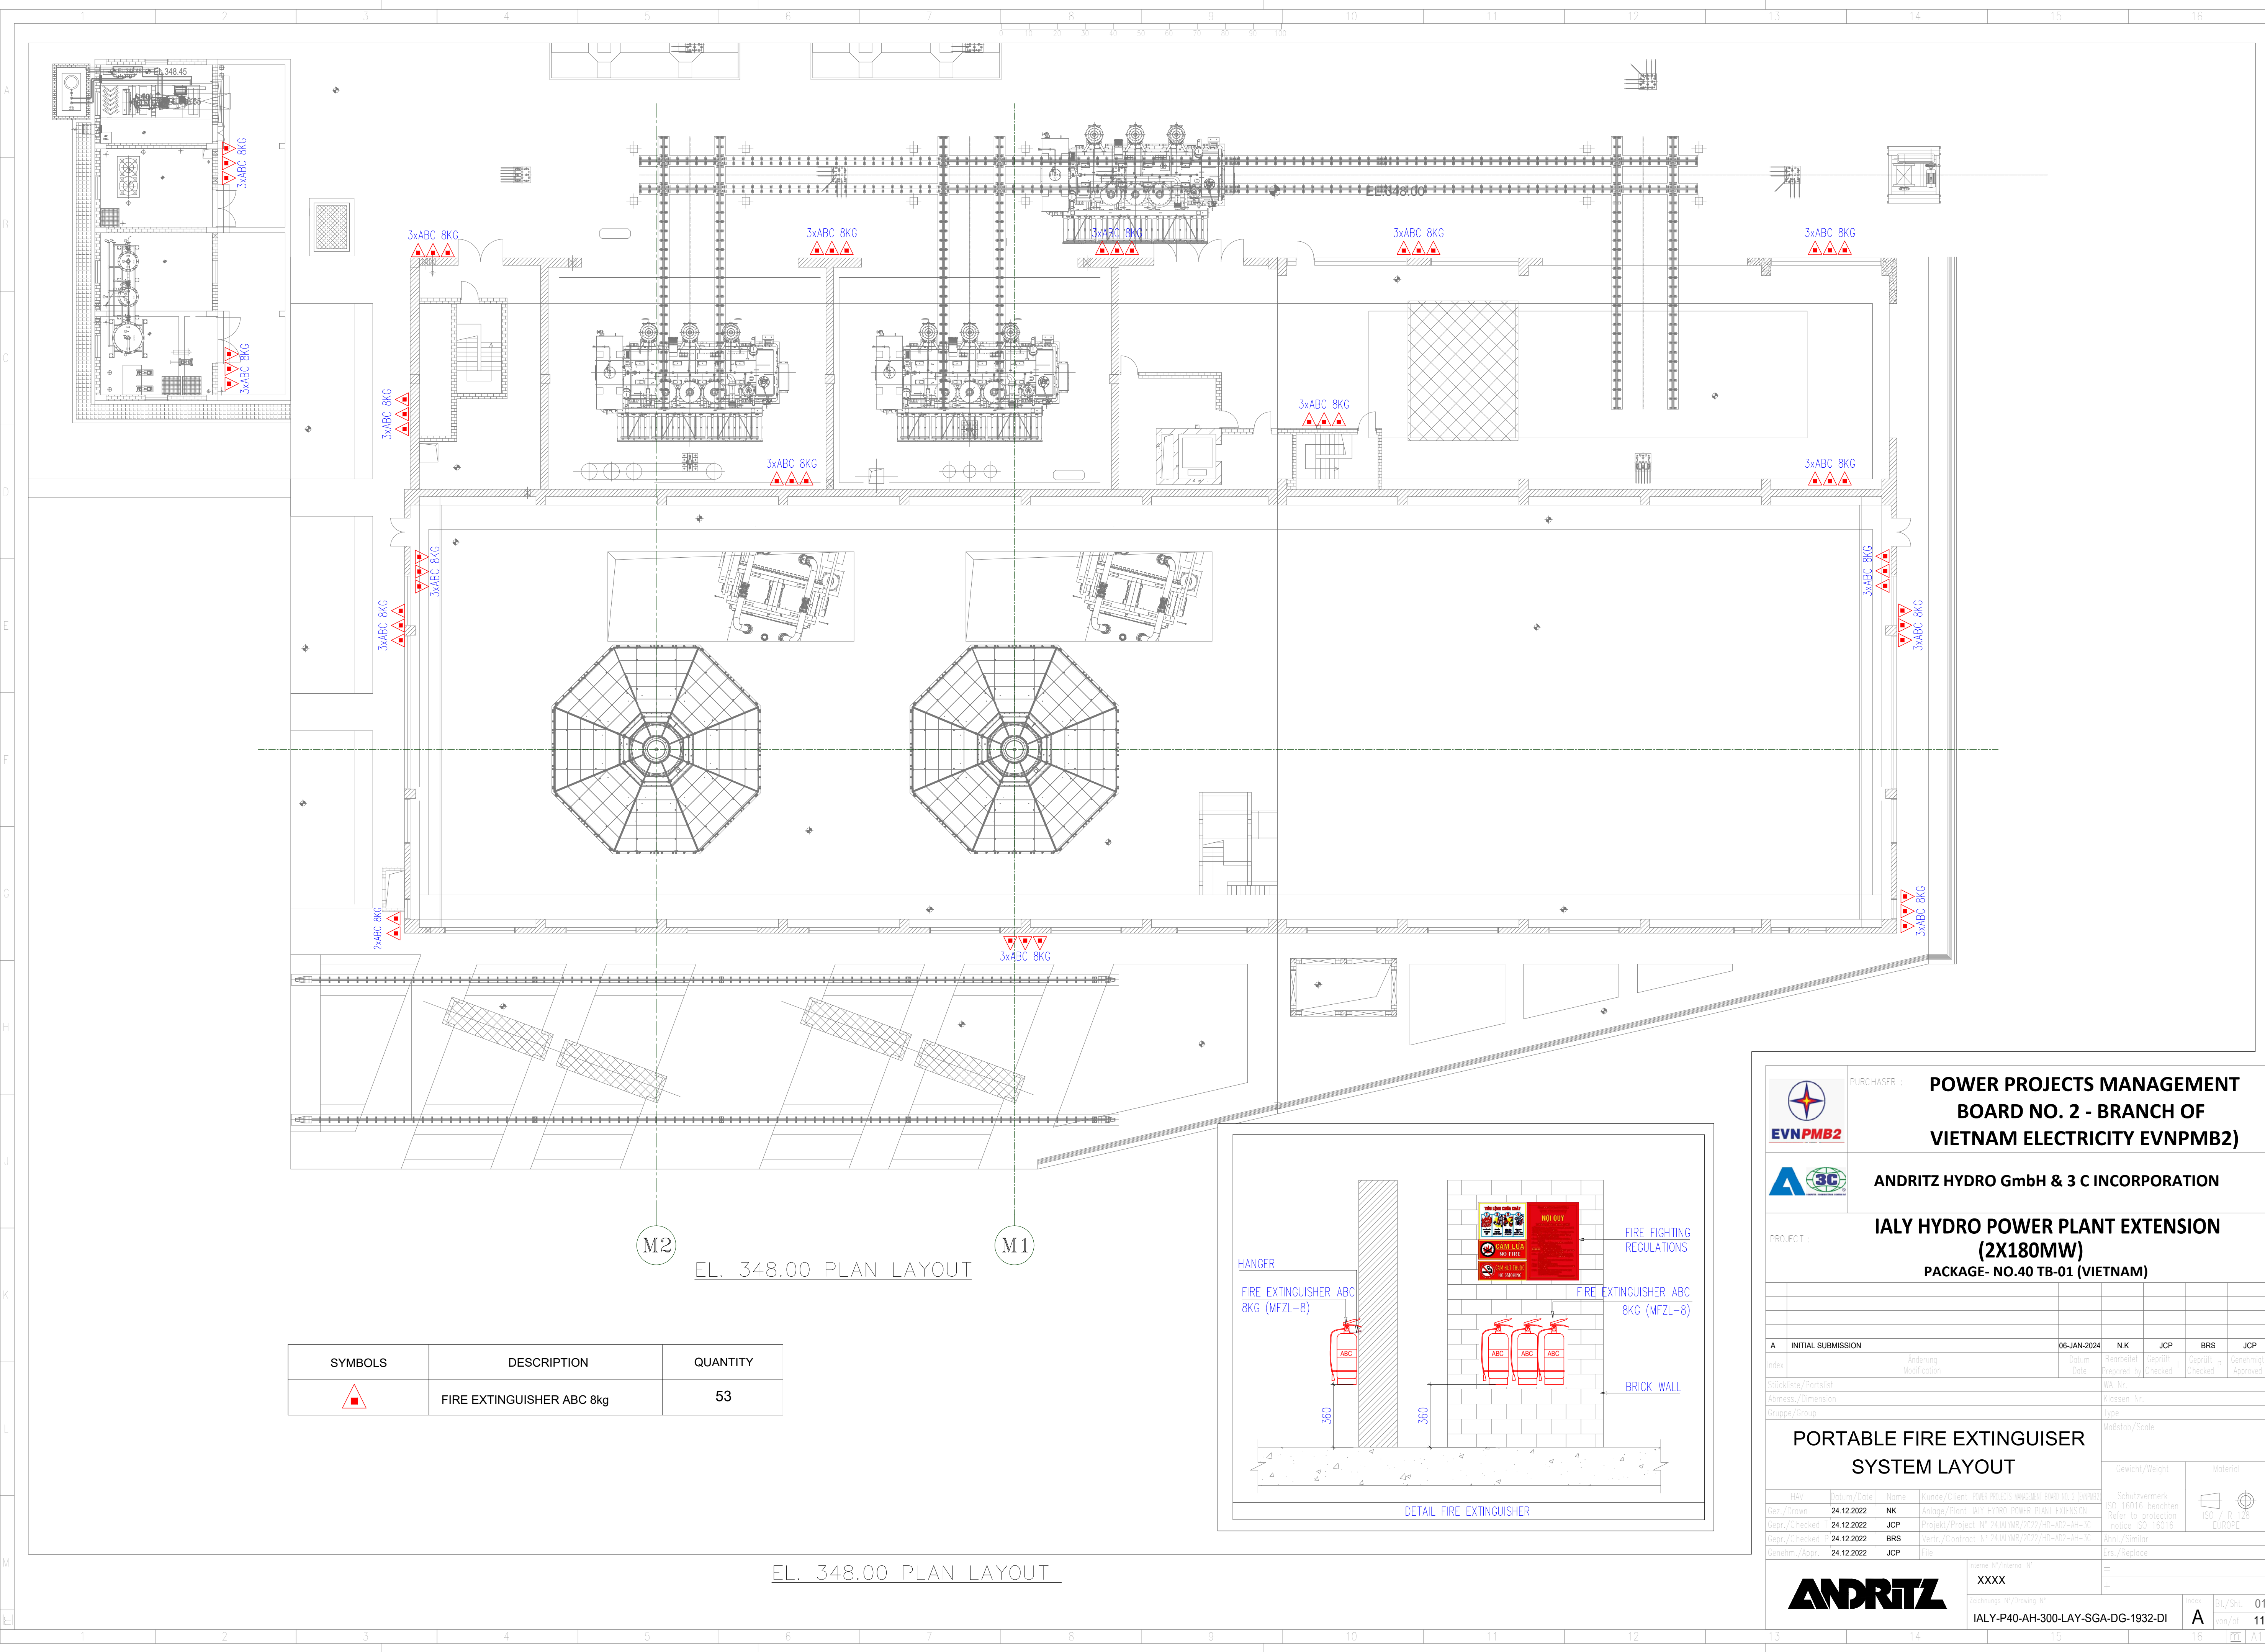

SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER ABC 8kg	53

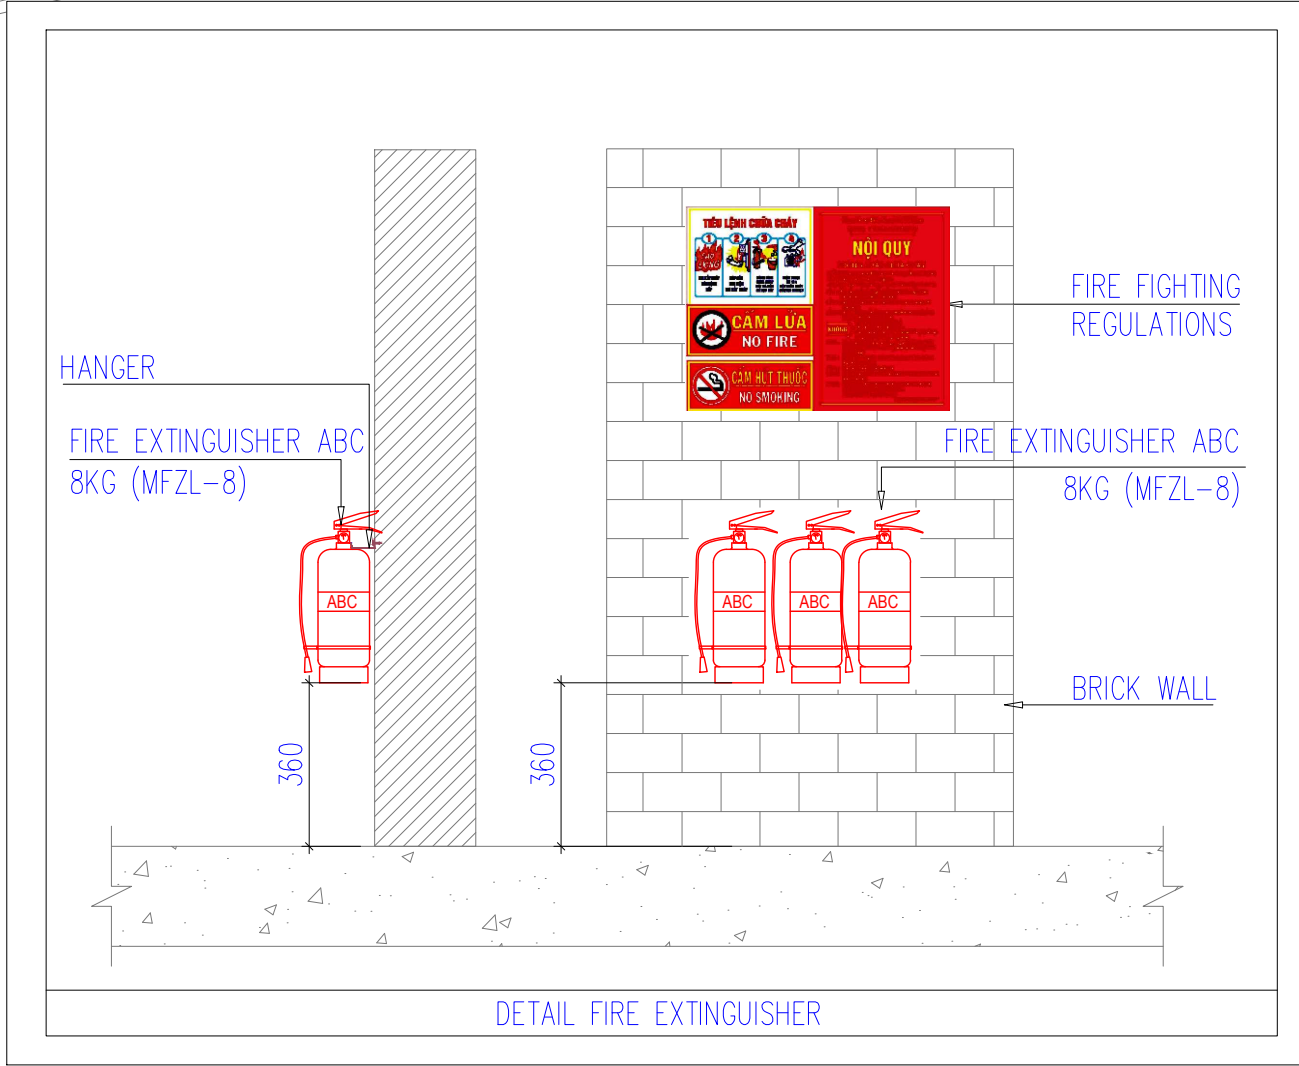

POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)

ANDRITZ HYDRO GmbH & 3 C INCORPORATION

ITALY HYDRO POWER PLANT EXTENSION (2X180MW)

PACKAGE- NO.40 TB-01 (VIETNAM)

PROJECT :

A	INITIAL SUBMISSION	06-JAN-2024	NK	JCP	BRS	JCP
Index	Revising Modification	Datum/Date	Revised by	Checked by	Checked by	Checked by
Stückliste/Partlist			WA Nr.			
Abmess./Dimension			Klassen Nr.			
Gruppe/Group			Type			
			Maßstab/Scale			
			Gewicht/Weight			
			Material			

PORTABLE FIRE EXTINGUISHER SYSTEM LAYOUT

HAV	Datum/Date	Name	Kunde/Client	POWER PROJECTS MANAGEMENT BOARD NO. 2 (EVN PMB2)	Schutzvermerk
Gez./Drawn	24.12.2022	NK	Anlage/Plant	ITALY HYDRO POWER PLANT EXTENSION	ISO 18016 beachten
Gepr./Checked	24.12.2022	JCP	Projekt/Project	N° 24-ALVNR/2022/HB-402-AH-3C	Refer to protection notice ISO 18016
Gepr./Checked	24.12.2022	BRS	Vertr./Contract	N° 24-ALVNR/2022/HB-402-AH-3C	Änd./Similar
Genehm./Appr.	24.12.2022	JCP	File		Ers./Replace

Internale W/Internale W/XXXX


Sachnungs Nr./Drawing N°ITALY-P40-AH-300-LAY-SGA-DG-1932-DI

indexA

Bl./Sht.01

von/vf11


AT

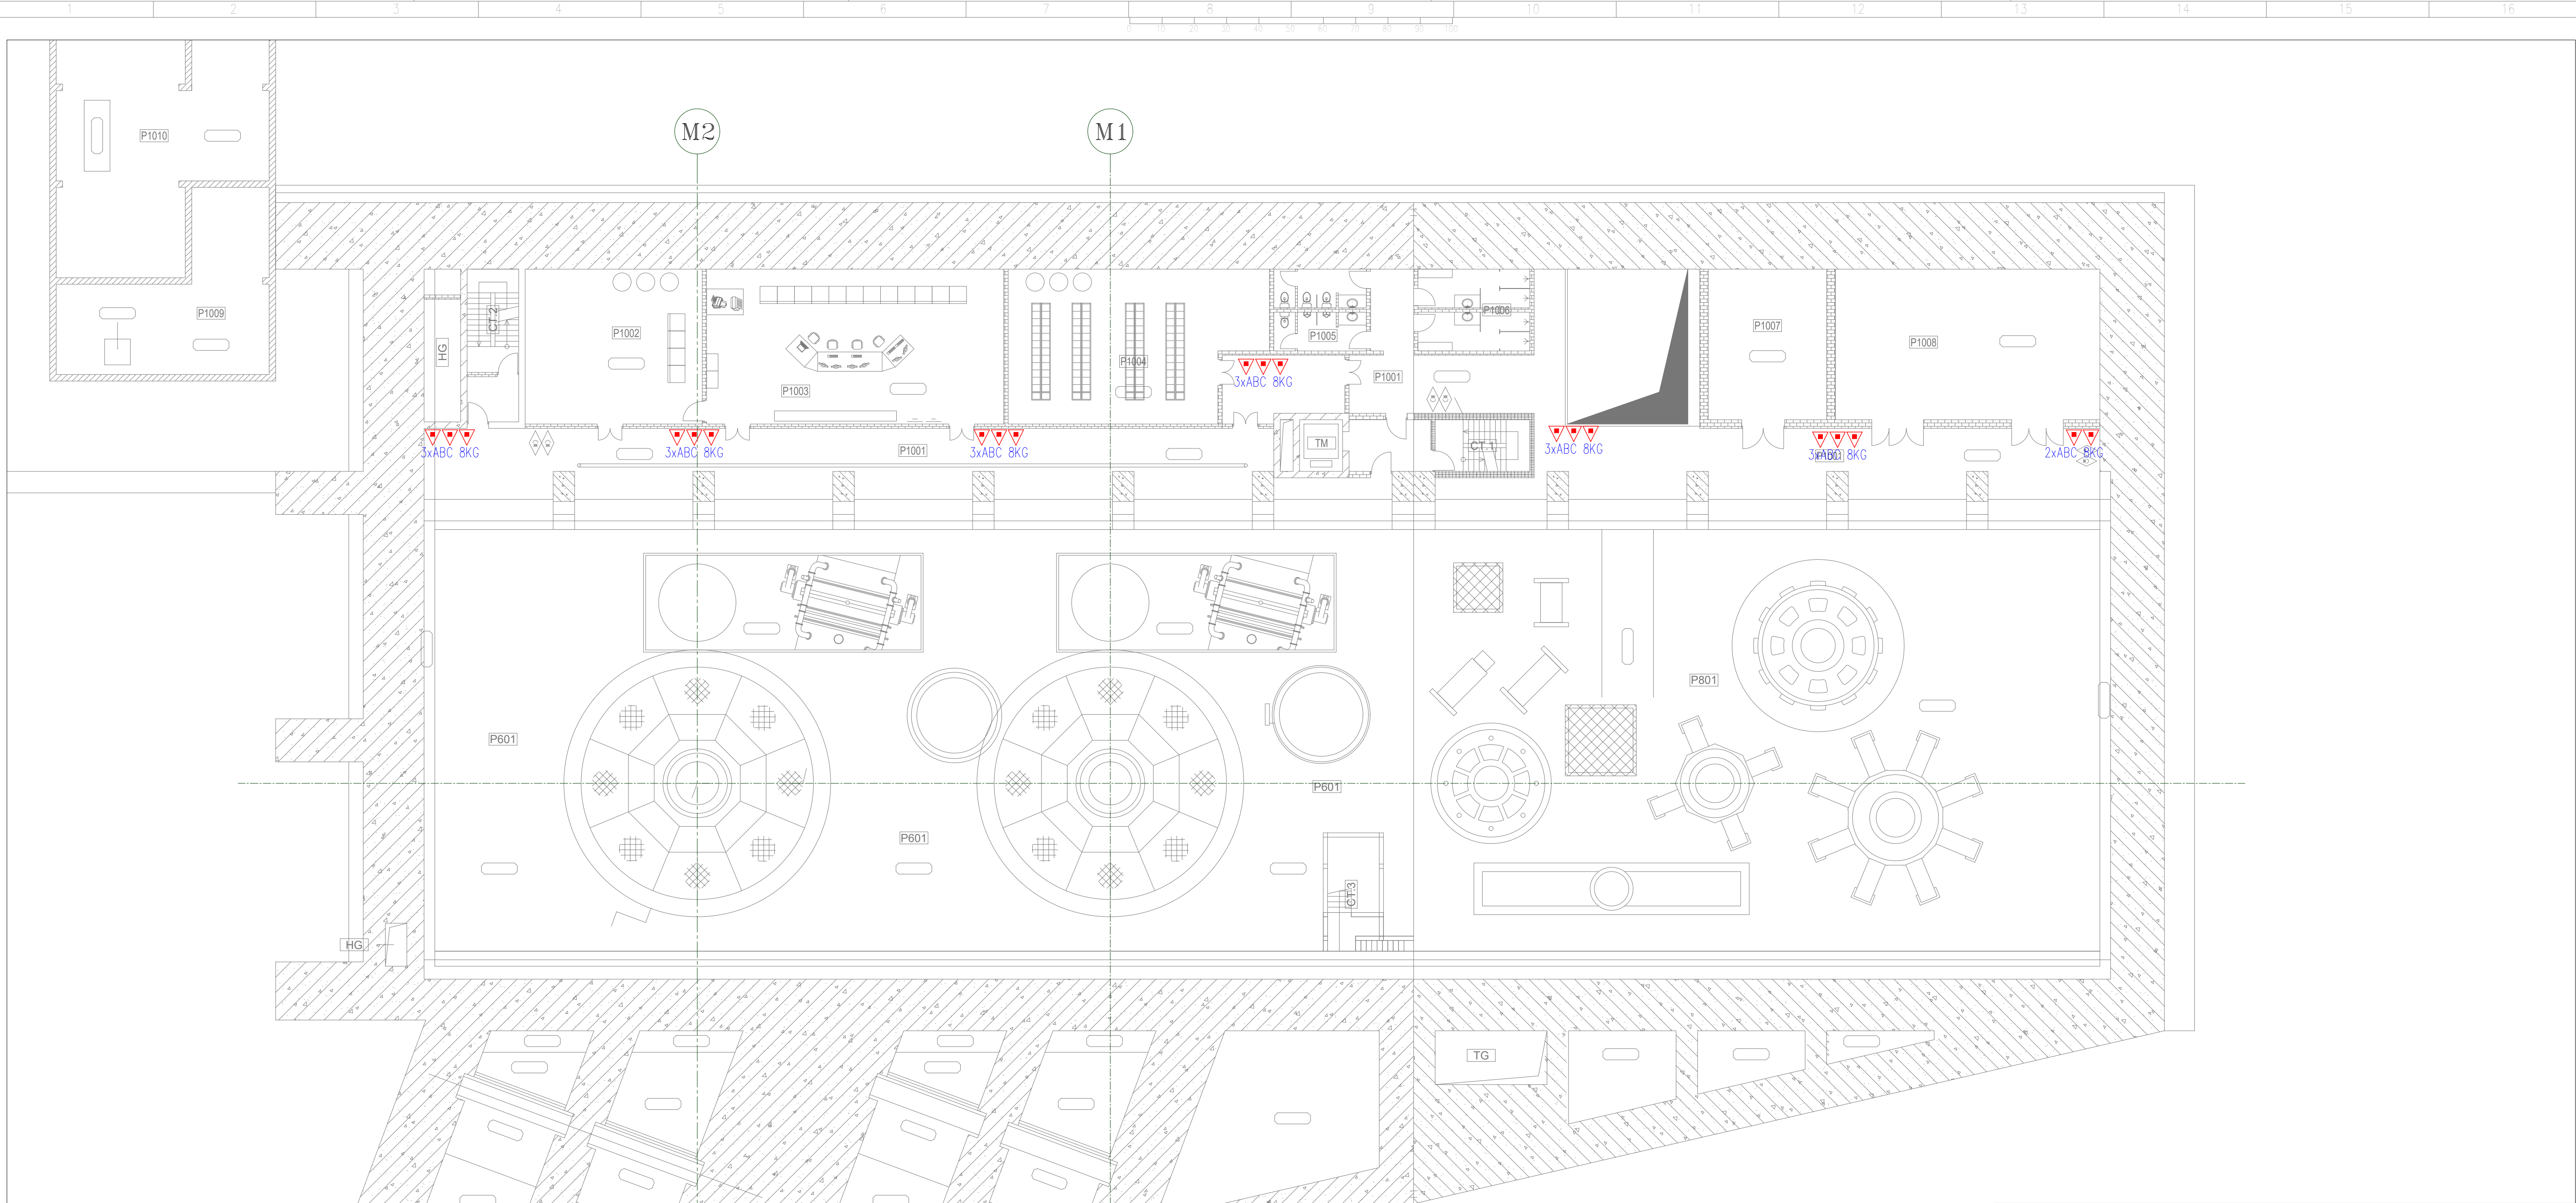

EL. 339.10 PLAN LAYOUT

LEGEND:

SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER ABC 8kg	20

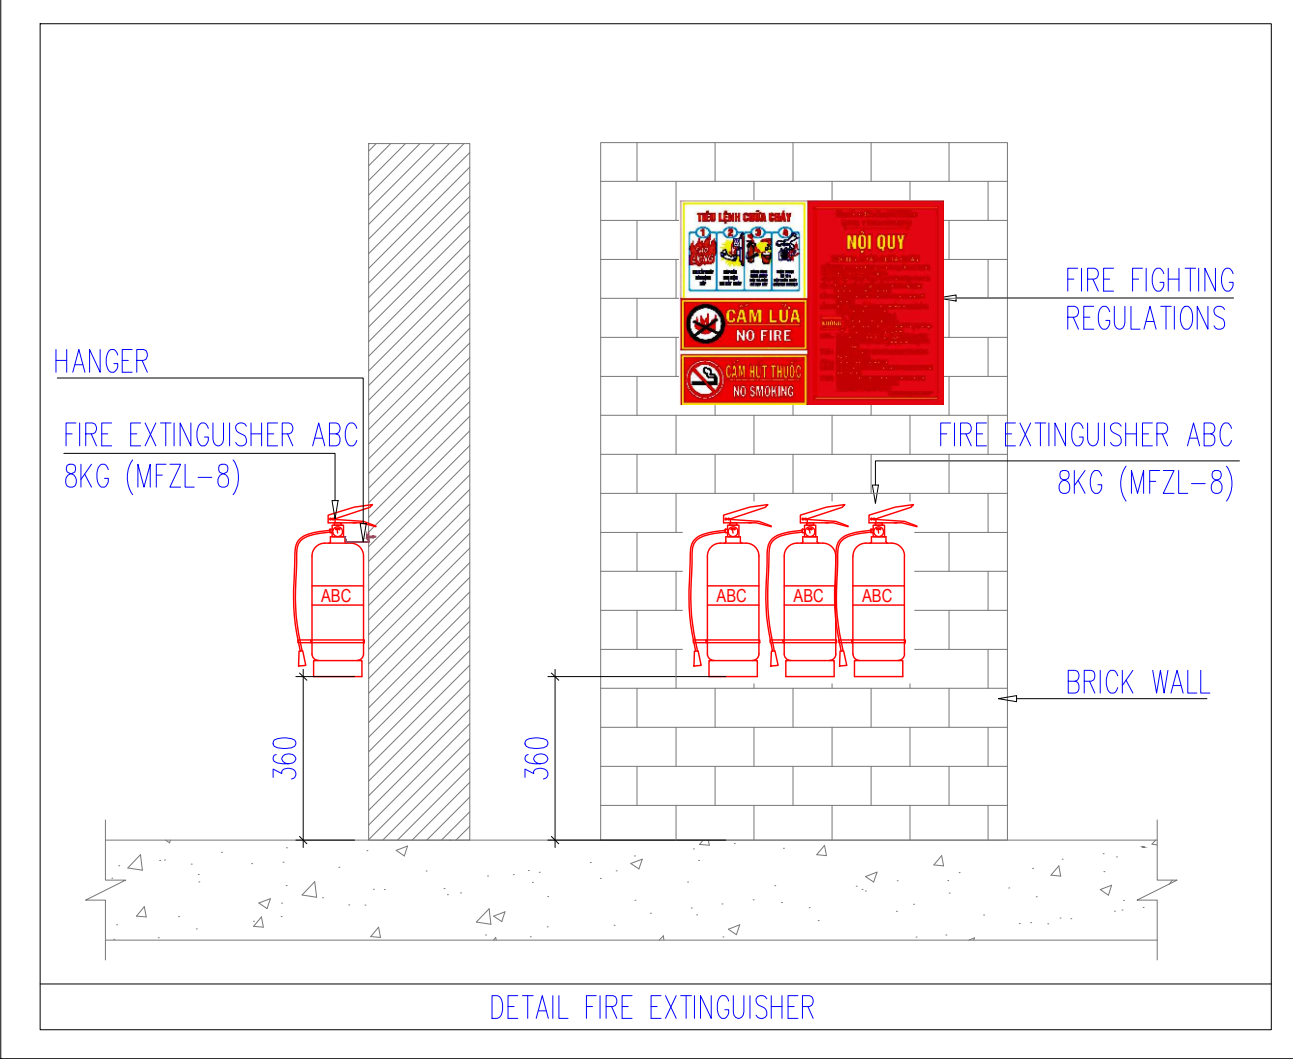

EL. 339.10 PLAN LAYOUT

PURCHASER : **POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)**

ANDRITZ HYDRO GmbH & 3 C INCORPORATION

ITALY HYDRO POWER PLANT EXTENSION (2X180MW)

PACKAGE- NO.40 TB-01 (VIETNAM)

PROJECT :

A	INITIAL SUBMISSION	06-JAN-2024	NK	JCP	BRS	JCP
Index	Änderung / Modification	Datum / Date	Bereitstellt / Prepared by	Geprüft / Checked	Geprüft / Checked	Genehmigt / Approved
Stückliste/Partlist	WA-Nr.			Klassen-Nr.		
Abmess./Dimension	Type			Maßstab/Scale		
Gruppe/Group	Gewicht/Weight			Material		

PORTABLE FIRE EXTINGUISHER SYSTEM LAYOUT

HAV	Datum/Date	Name	Kunde/Client	POWER PROJECTS MANAGEMENT BOARD NO. 2 (EVNPMB2)	Schutzvermerk ISO 18016 beachten Refer to protection notice ISO 18016	
Gez./Drawn	24.12.2022	NK	Anlage/Plant	ITALY HYDRO POWER PLANT EXTENSION		
Gepr./Checked	24.12.2022	JCP	Projekt/Project	N° 24-ALYMR/2022/H0-A02-AH-3C		
Gepr./Checked	24.12.2022	BRS	Vertr./Contract	N° 24-ALYMR/2022/H0-A02-AH-3C		
Genehm./Appr.	24.12.2022	JCP	File		Ers./Replace	

Internale W/Internale W°

XXXX

Sachnungs N°/Drawing N°

ITALY-P40-AH-300-LAY-SGA-DG-1932-DI

index


Bl./Sht.

02

von/vf


11

AT

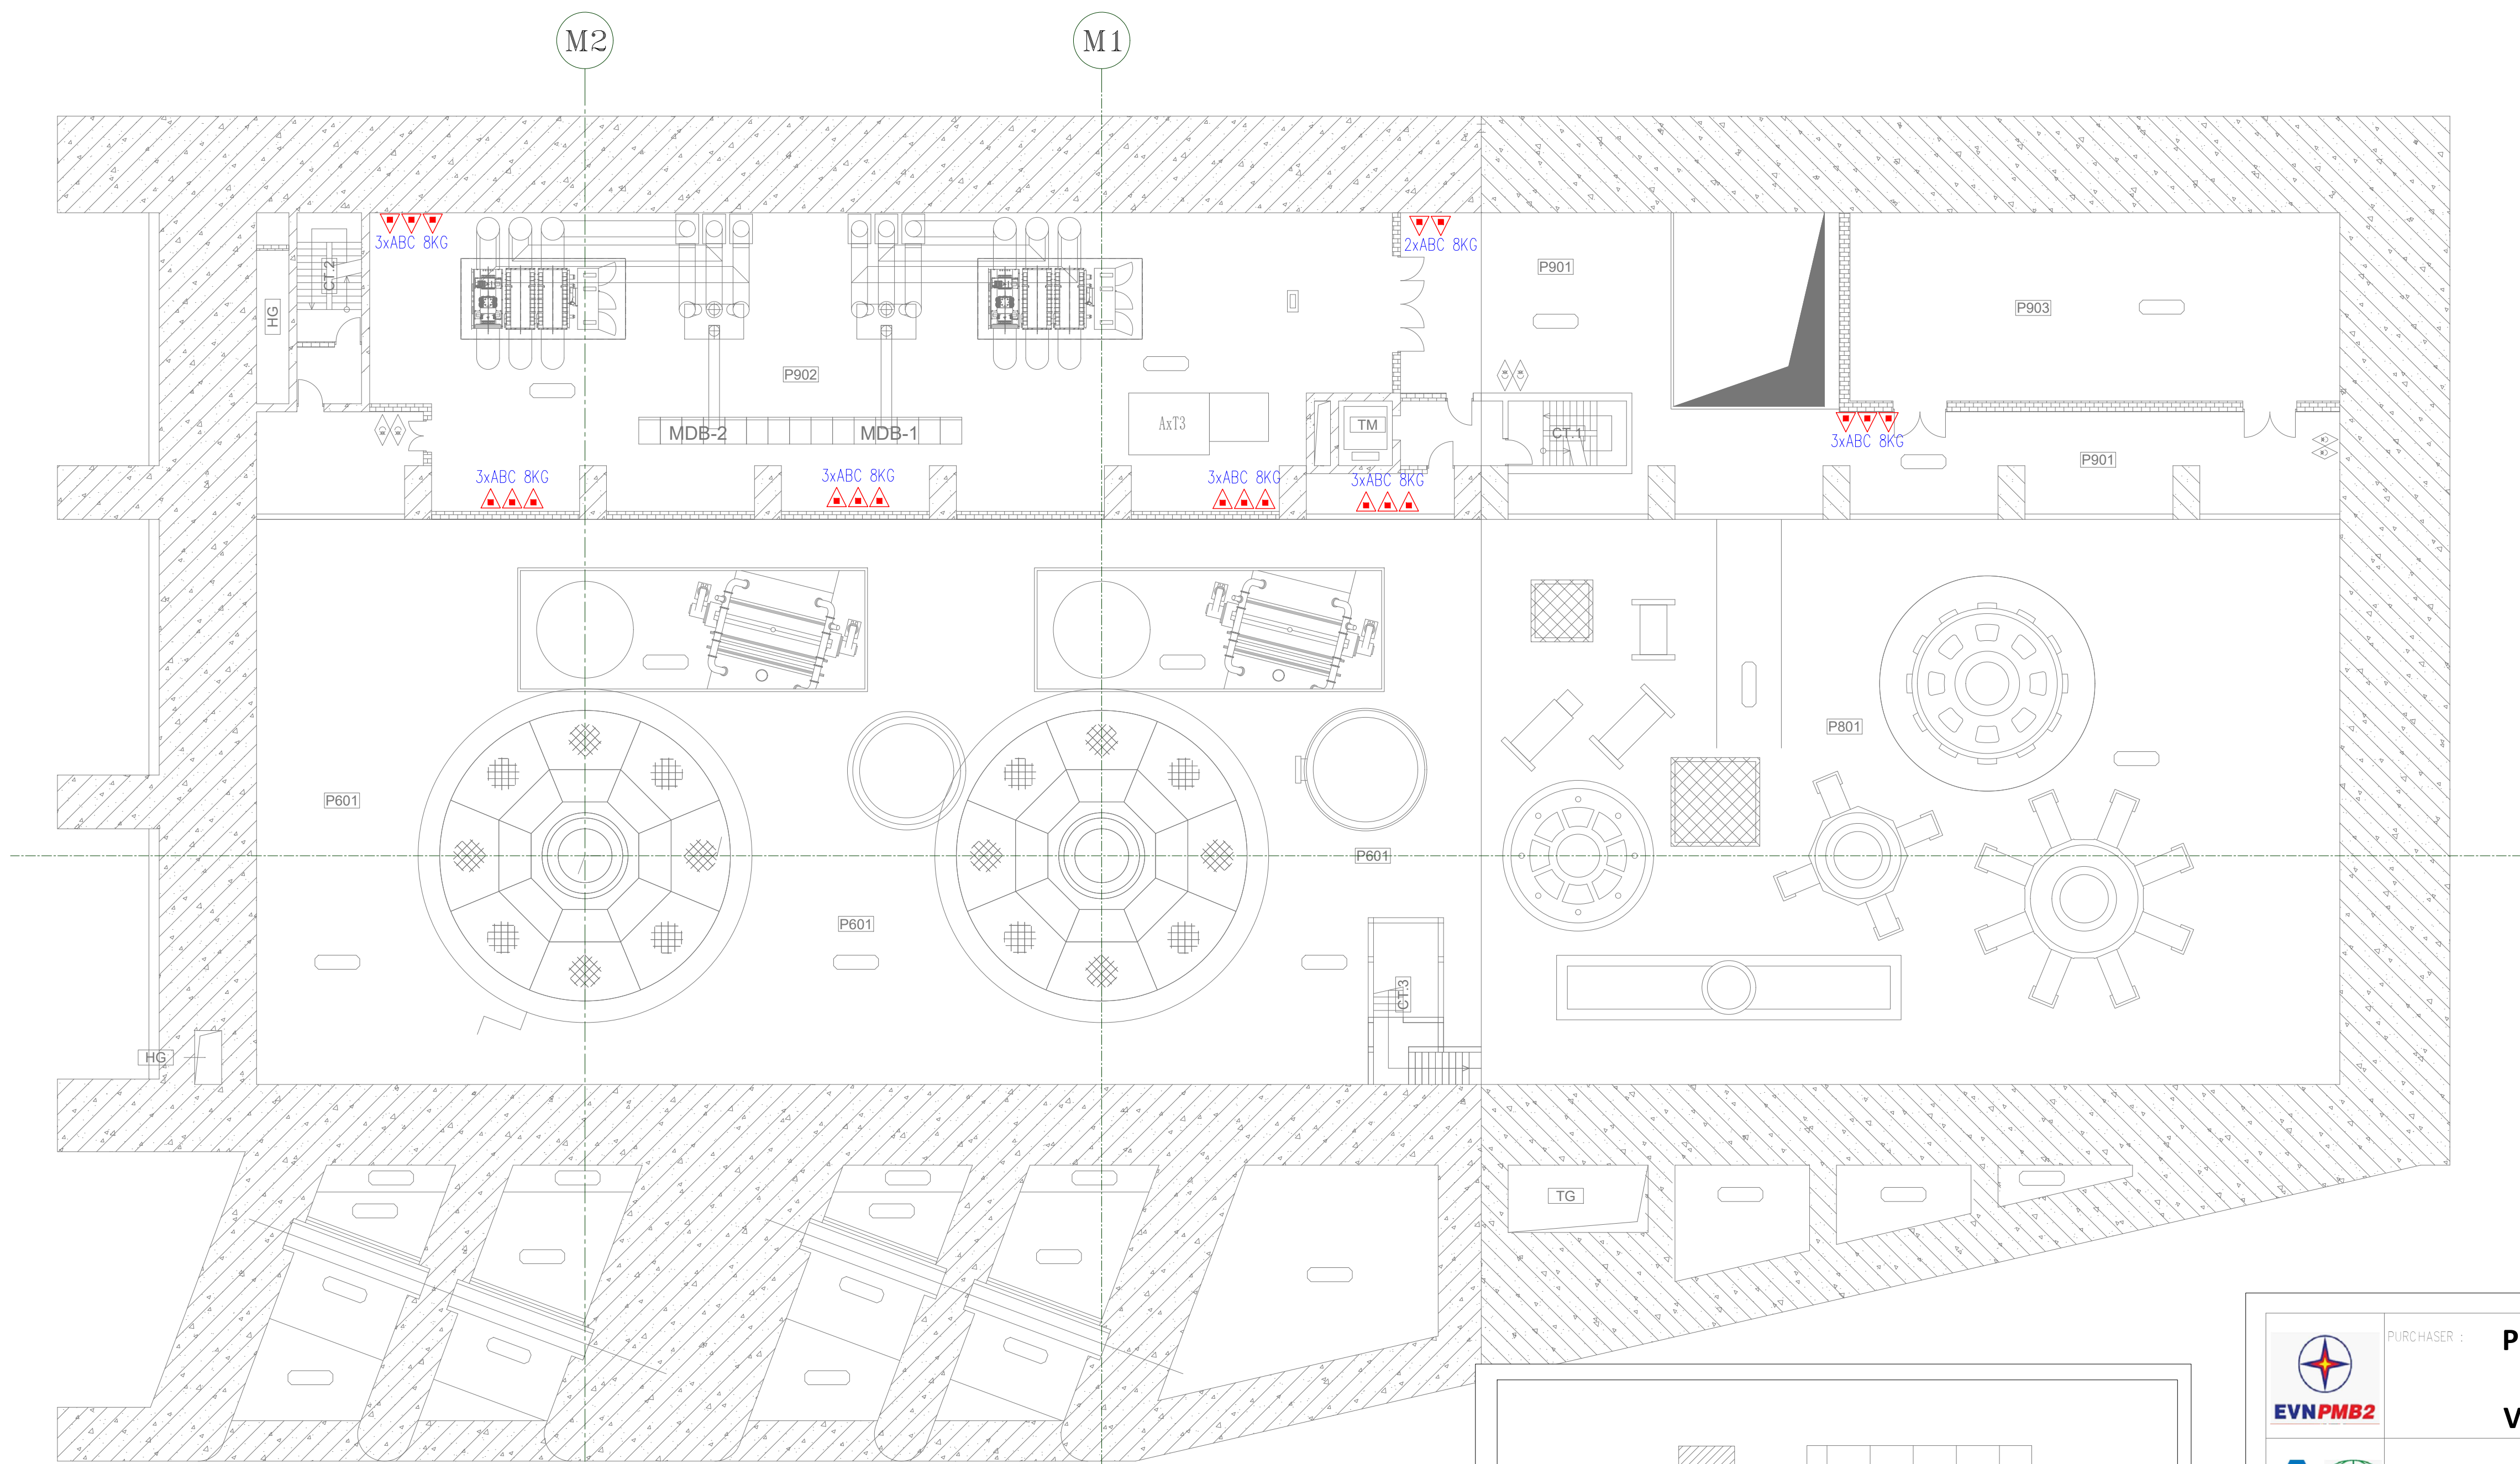

EL. 331.40 PLAN LAYOUT

SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER ABC 8kg (MFZL-8)	20

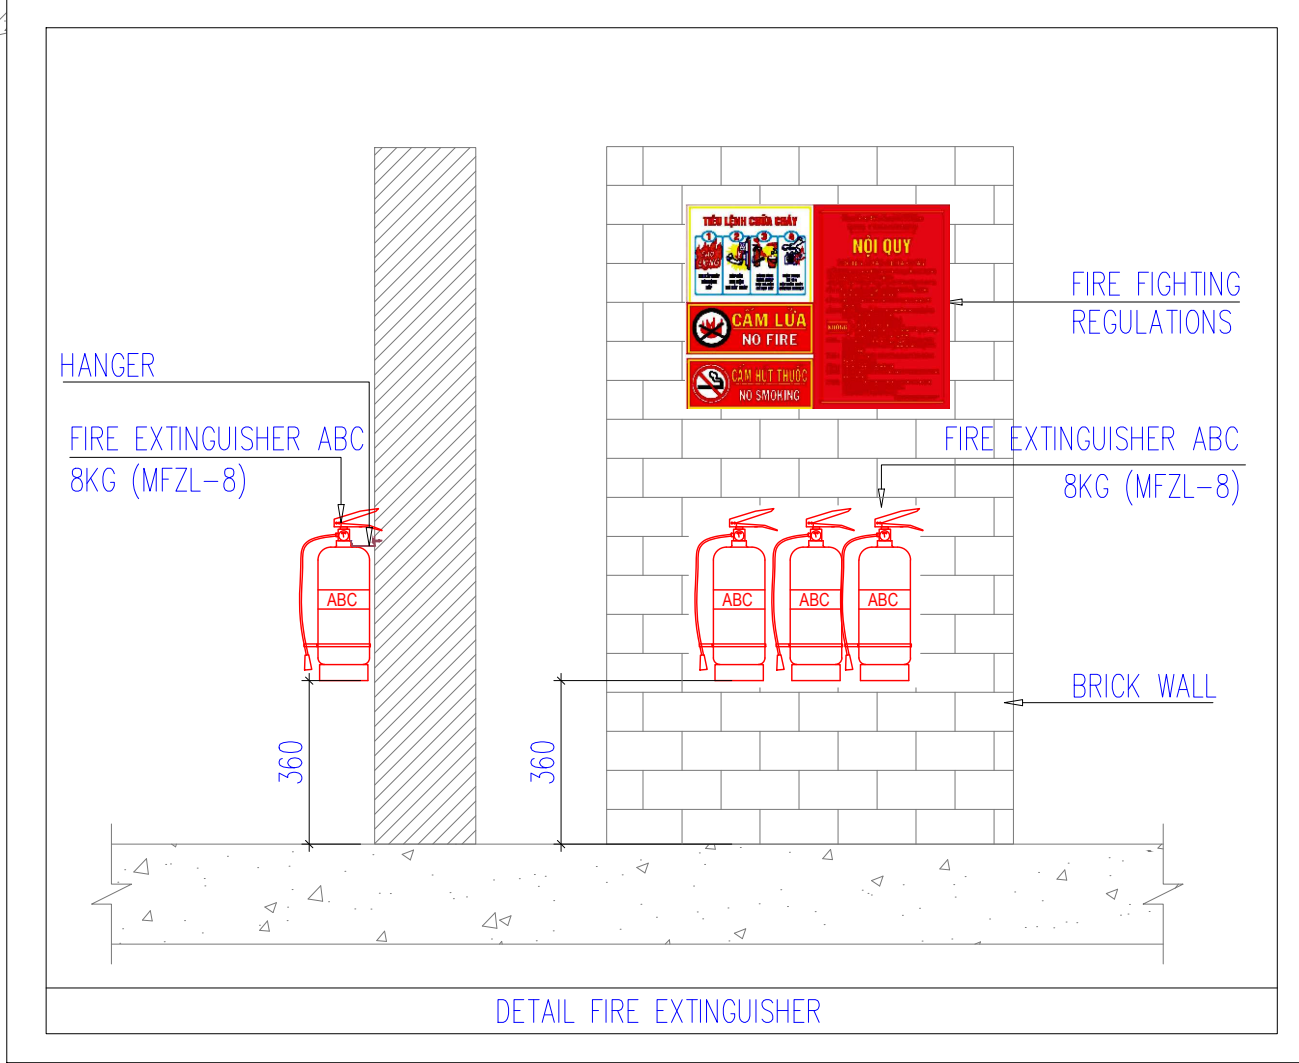

EL. 331.40 PLAN LAYOUT



PURCHASER :

POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)

ANDRITZ HYDRO GmbH & 3 C INCORPORATION

PROJECT :

ITALY HYDRO POWER PLANT EXTENSION (2X180MW) PACKAGE- NO.40 TB-01 (VIETNAM)

A	INITIAL SUBMISSION	06-JAN-2024	NK	JCP	BRS	JCP
Index	Revisi Modification	Datum Date	Revised by	Checked by	Checked by	Approved by
Stacklist/Partlist	WA Nr.		Klassen Nr.			
Address/Dimension	Type		Mod/Tab/Scale			
Gruppe/Group	Gewicht/Weight		Material			

HAV

24.12.2022

NK

Gepr./Drawn

24.12.2022

JCP

Gepr./Checked

24.12.2022

BRS

Gepr./Checked

24.12.2022

JCP

Datum/Date

24.12.2022

24.12.2022

24.12.2022

Name

24.12.2022

24.12.2022

24.12.2022

Kunde/Client

24.12.2022

24.12.2022

24.12.2022

Anlage/Plant

24.12.2022

24.12.2022

24.12.2022

Projekt/Project

24.12.2022

24.12.2022

24.12.2022

Vertr./Contract

24.12.2022

24.12.2022

24.12.2022

File

24.12.2022

24.12.2022

24.12.2022

Intern Nr./Internal N°

XXXX

24.12.2022

24.12.2022

Schutzvermerk

ISO 18016 beachten

Refer to protection notice ISO 18016

Änder./Similar

Ers./Replace

+



ISO 18016

EUROPE

ANDRITZ

Index

Bl./Sht.

03

Zeichnungs Nr./Drawing N°

ITALY-P40-AH-300-LAY-SGA-DG-1932-DI

Index


Bl./Sht.

03



Index

Bl./Sht.

11

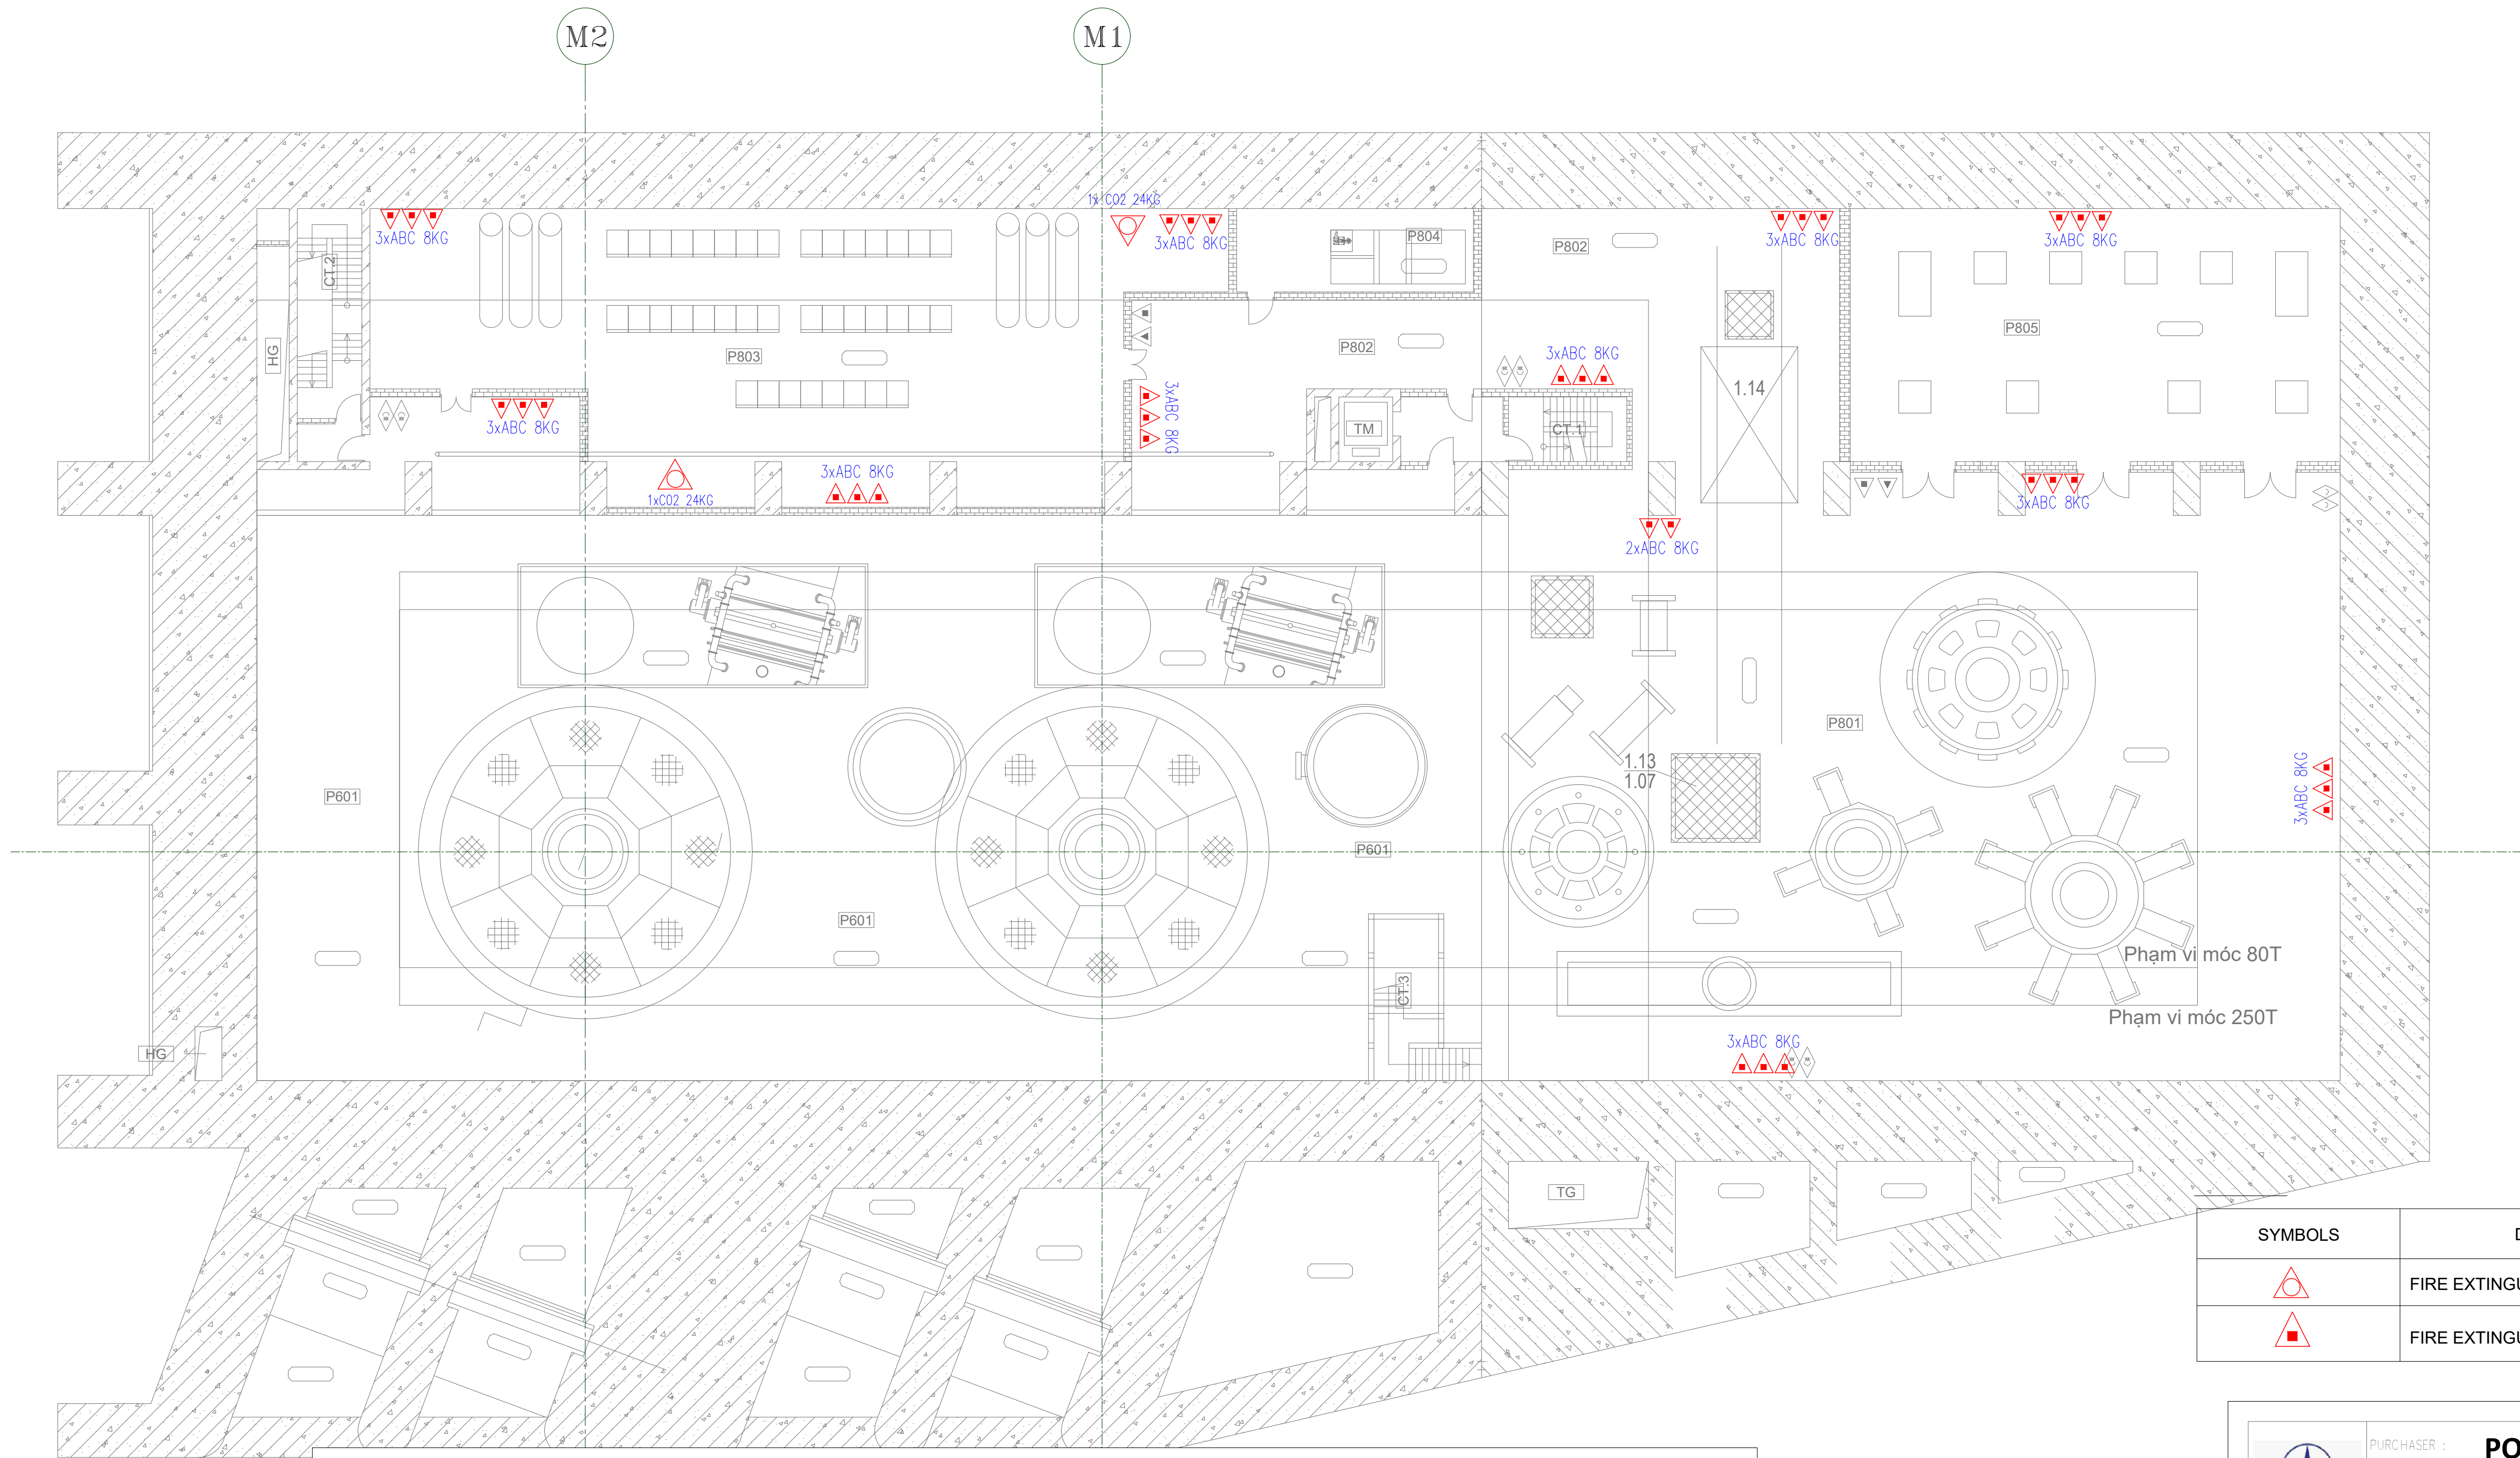

SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER CO2 24kg (MT-24)	2
	FIRE EXTINGUISHER ABC 8kg (MFZL-8)	35

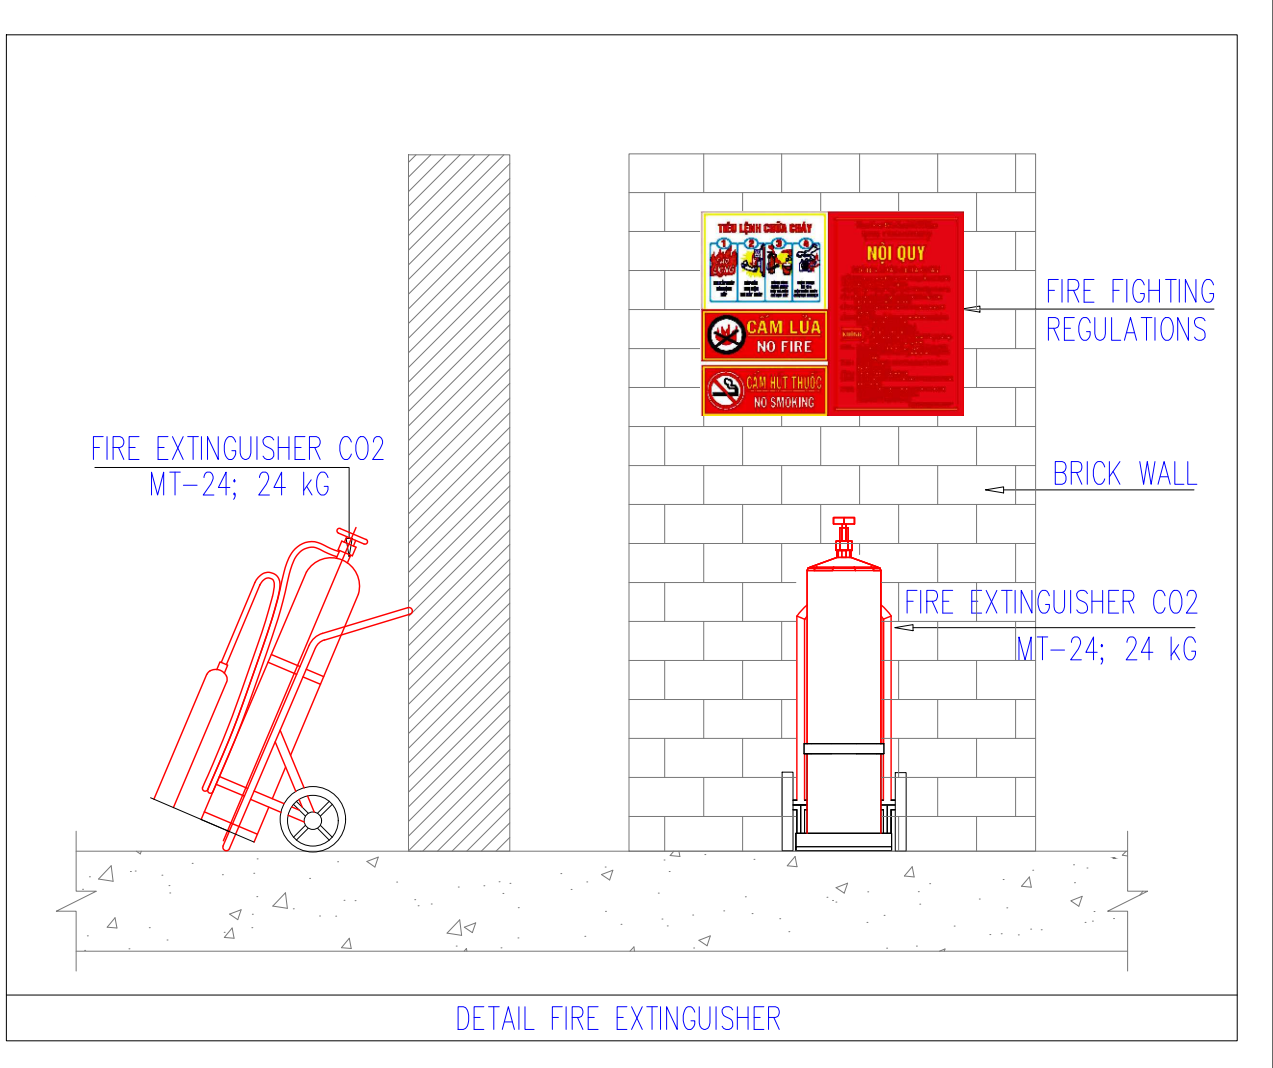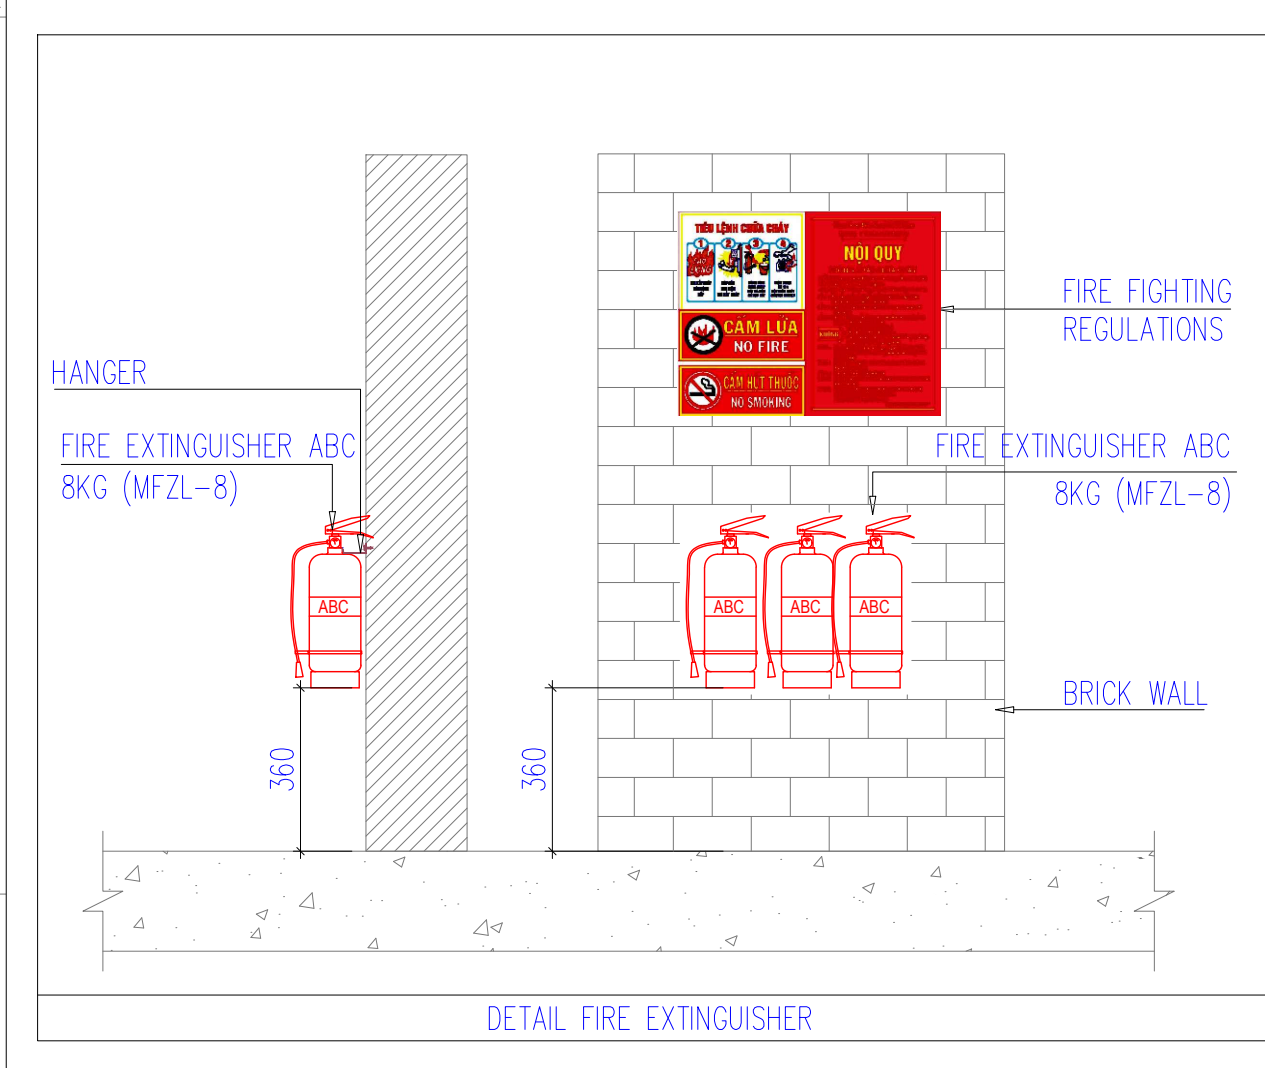

EL. 323.70 PLAN LAYOUT

PURCHASER : **POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)**


ANDRITZ HYDRO GmbH & 3 C INCORPORATION

ITALY HYDRO POWER PLANT EXTENSION (2X180MW)
PACKAGE- NO.40 TB-01 (VIETNAM)

PROJECT :


A	INITIAL SUBMISSION	06-JAN-2024	NK	JCP	BRS	JCP																															
Index	Revisi Modification	Datum Date	Revised by	Checked by	Approved by	Approved by																															
Stückliste/Partlist	WA. Nr.					Schutzvermerk ISO 18018 beachten Refer to protection notice ISO 18018																															
Abmess./Dimension	Klassen. Nr.																																				
Gruppe/Group	Type																																				
PORTABLE FIRE EXTINGUISHER SYSTEM LAYOUT						Maßstab/Scale																															
<table border="1"> <tr> <td>HAU</td> <td>Datum/Date</td> <td>Name</td> <td>Kunde/Client</td> <td>PROJ. PROJEKT MANAGEMENT BOARD NO. 2 (EVNPM2)</td> </tr> <tr> <td>Gez./Drawn</td> <td>24.12.2022</td> <td>NK</td> <td>Anlage/Plant</td> <td>ITALY HYDRO POWER PLANT EXTENSION</td> </tr> <tr> <td>Gepr./Checked</td> <td>24.12.2022</td> <td>JCP</td> <td>Projekt/Project</td> <td>N° 24-ALYMR/2022/HB-A02-AH-3C</td> </tr> <tr> <td>Gepr./Checked</td> <td>24.12.2022</td> <td>BRS</td> <td>Vertr./Contract</td> <td>N° 24-ALYMR/2022/HB-A02-AH-3C</td> </tr> <tr> <td>Genehm./Appr.</td> <td>24.12.2022</td> <td>JCP</td> <td>File</td> <td></td> </tr> </table>						HAU	Datum/Date	Name	Kunde/Client	PROJ. PROJEKT MANAGEMENT BOARD NO. 2 (EVNPM2)	Gez./Drawn	24.12.2022	NK	Anlage/Plant	ITALY HYDRO POWER PLANT EXTENSION	Gepr./Checked	24.12.2022	JCP	Projekt/Project	N° 24-ALYMR/2022/HB-A02-AH-3C	Gepr./Checked	24.12.2022	BRS	Vertr./Contract	N° 24-ALYMR/2022/HB-A02-AH-3C	Genehm./Appr.	24.12.2022	JCP	File		<table border="1"> <tr> <td>Interna. W./Internat. W°</td> <td>XXXX</td> </tr> <tr> <td>Zeichnungs. W./Drawing. W°</td> <td></td> </tr> <tr> <td colspan="2">IALY-P40-AH-300-LAY-SGA-DG-1932-DI</td> </tr> </table>	Interna. W./Internat. W°	XXXX	Zeichnungs. W./Drawing. W°		IALY-P40-AH-300-LAY-SGA-DG-1932-DI	
HAU	Datum/Date	Name	Kunde/Client	PROJ. PROJEKT MANAGEMENT BOARD NO. 2 (EVNPM2)																																	
Gez./Drawn	24.12.2022	NK	Anlage/Plant	ITALY HYDRO POWER PLANT EXTENSION																																	
Gepr./Checked	24.12.2022	JCP	Projekt/Project	N° 24-ALYMR/2022/HB-A02-AH-3C																																	
Gepr./Checked	24.12.2022	BRS	Vertr./Contract	N° 24-ALYMR/2022/HB-A02-AH-3C																																	
Genehm./Appr.	24.12.2022	JCP	File																																		
Interna. W./Internat. W°	XXXX																																				
Zeichnungs. W./Drawing. W°																																					
IALY-P40-AH-300-LAY-SGA-DG-1932-DI																																					
<table border="1"> <tr> <td>Gewicht/Weight</td> <td>Material</td> </tr> <tr> <td></td> <td></td> </tr> </table>						Gewicht/Weight	Material			<table border="1"> <tr> <td>ISO 18018</td> <td>ISO 18018</td> </tr> <tr> <td>EUROPE</td> <td>EUROPE</td> </tr> </table>	ISO 18018	ISO 18018	EUROPE	EUROPE																							
Gewicht/Weight	Material																																				
ISO 18018	ISO 18018																																				
EUROPE	EUROPE																																				
<table border="1"> <tr> <td>HAU</td> <td>Datum/Date</td> <td>Name</td> <td>Kunde/Client</td> <td>PROJ. PROJEKT MANAGEMENT BOARD NO. 2 (EVNPM2)</td> </tr> <tr> <td>Gez./Drawn</td> <td>24.12.2022</td> <td>NK</td> <td>Anlage/Plant</td> <td>ITALY HYDRO POWER PLANT EXTENSION</td> </tr> <tr> <td>Gepr./Checked</td> <td>24.12.2022</td> <td>JCP</td> <td>Projekt/Project</td> <td>N° 24-ALYMR/2022/HB-A02-AH-3C</td> </tr> <tr> <td>Gepr./Checked</td> <td>24.12.2022</td> <td>BRS</td> <td>Vertr./Contract</td> <td>N° 24-ALYMR/2022/HB-A02-AH-3C</td> </tr> <tr> <td>Genehm./Appr.</td> <td>24.12.2022</td> <td>JCP</td> <td>File</td> <td></td> </tr> </table>						HAU	Datum/Date	Name	Kunde/Client	PROJ. PROJEKT MANAGEMENT BOARD NO. 2 (EVNPM2)	Gez./Drawn	24.12.2022	NK	Anlage/Plant	ITALY HYDRO POWER PLANT EXTENSION	Gepr./Checked	24.12.2022	JCP	Projekt/Project	N° 24-ALYMR/2022/HB-A02-AH-3C	Gepr./Checked	24.12.2022	BRS	Vertr./Contract	N° 24-ALYMR/2022/HB-A02-AH-3C	Genehm./Appr.	24.12.2022	JCP	File		<table border="1"> <tr> <td>Interna. W./Internat. W°</td> <td>XXXX</td> </tr> <tr> <td>Zeichnungs. W./Drawing. W°</td> <td></td> </tr> <tr> <td colspan="2">IALY-P40-AH-300-LAY-SGA-DG-1932-DI</td> </tr> </table>	Interna. W./Internat. W°	XXXX	Zeichnungs. W./Drawing. W°		IALY-P40-AH-300-LAY-SGA-DG-1932-DI	
HAU	Datum/Date	Name	Kunde/Client	PROJ. PROJEKT MANAGEMENT BOARD NO. 2 (EVNPM2)																																	
Gez./Drawn	24.12.2022	NK	Anlage/Plant	ITALY HYDRO POWER PLANT EXTENSION																																	
Gepr./Checked	24.12.2022	JCP	Projekt/Project	N° 24-ALYMR/2022/HB-A02-AH-3C																																	
Gepr./Checked	24.12.2022	BRS	Vertr./Contract	N° 24-ALYMR/2022/HB-A02-AH-3C																																	
Genehm./Appr.	24.12.2022	JCP	File																																		
Interna. W./Internat. W°	XXXX																																				
Zeichnungs. W./Drawing. W°																																					
IALY-P40-AH-300-LAY-SGA-DG-1932-DI																																					
<table border="1"> <tr> <td>Gewicht/Weight</td> <td>Material</td> </tr> <tr> <td></td> <td></td> </tr> </table>						Gewicht/Weight	Material			<table border="1"> <tr> <td>ISO 18018</td> <td>ISO 18018</td> </tr> <tr> <td>EUROPE</td> <td>EUROPE</td> </tr> </table>	ISO 18018	ISO 18018	EUROPE	EUROPE																							
Gewicht/Weight	Material																																				
ISO 18018	ISO 18018																																				
EUROPE	EUROPE																																				

Index	Bl./Sht.	04
Wp./of	11	

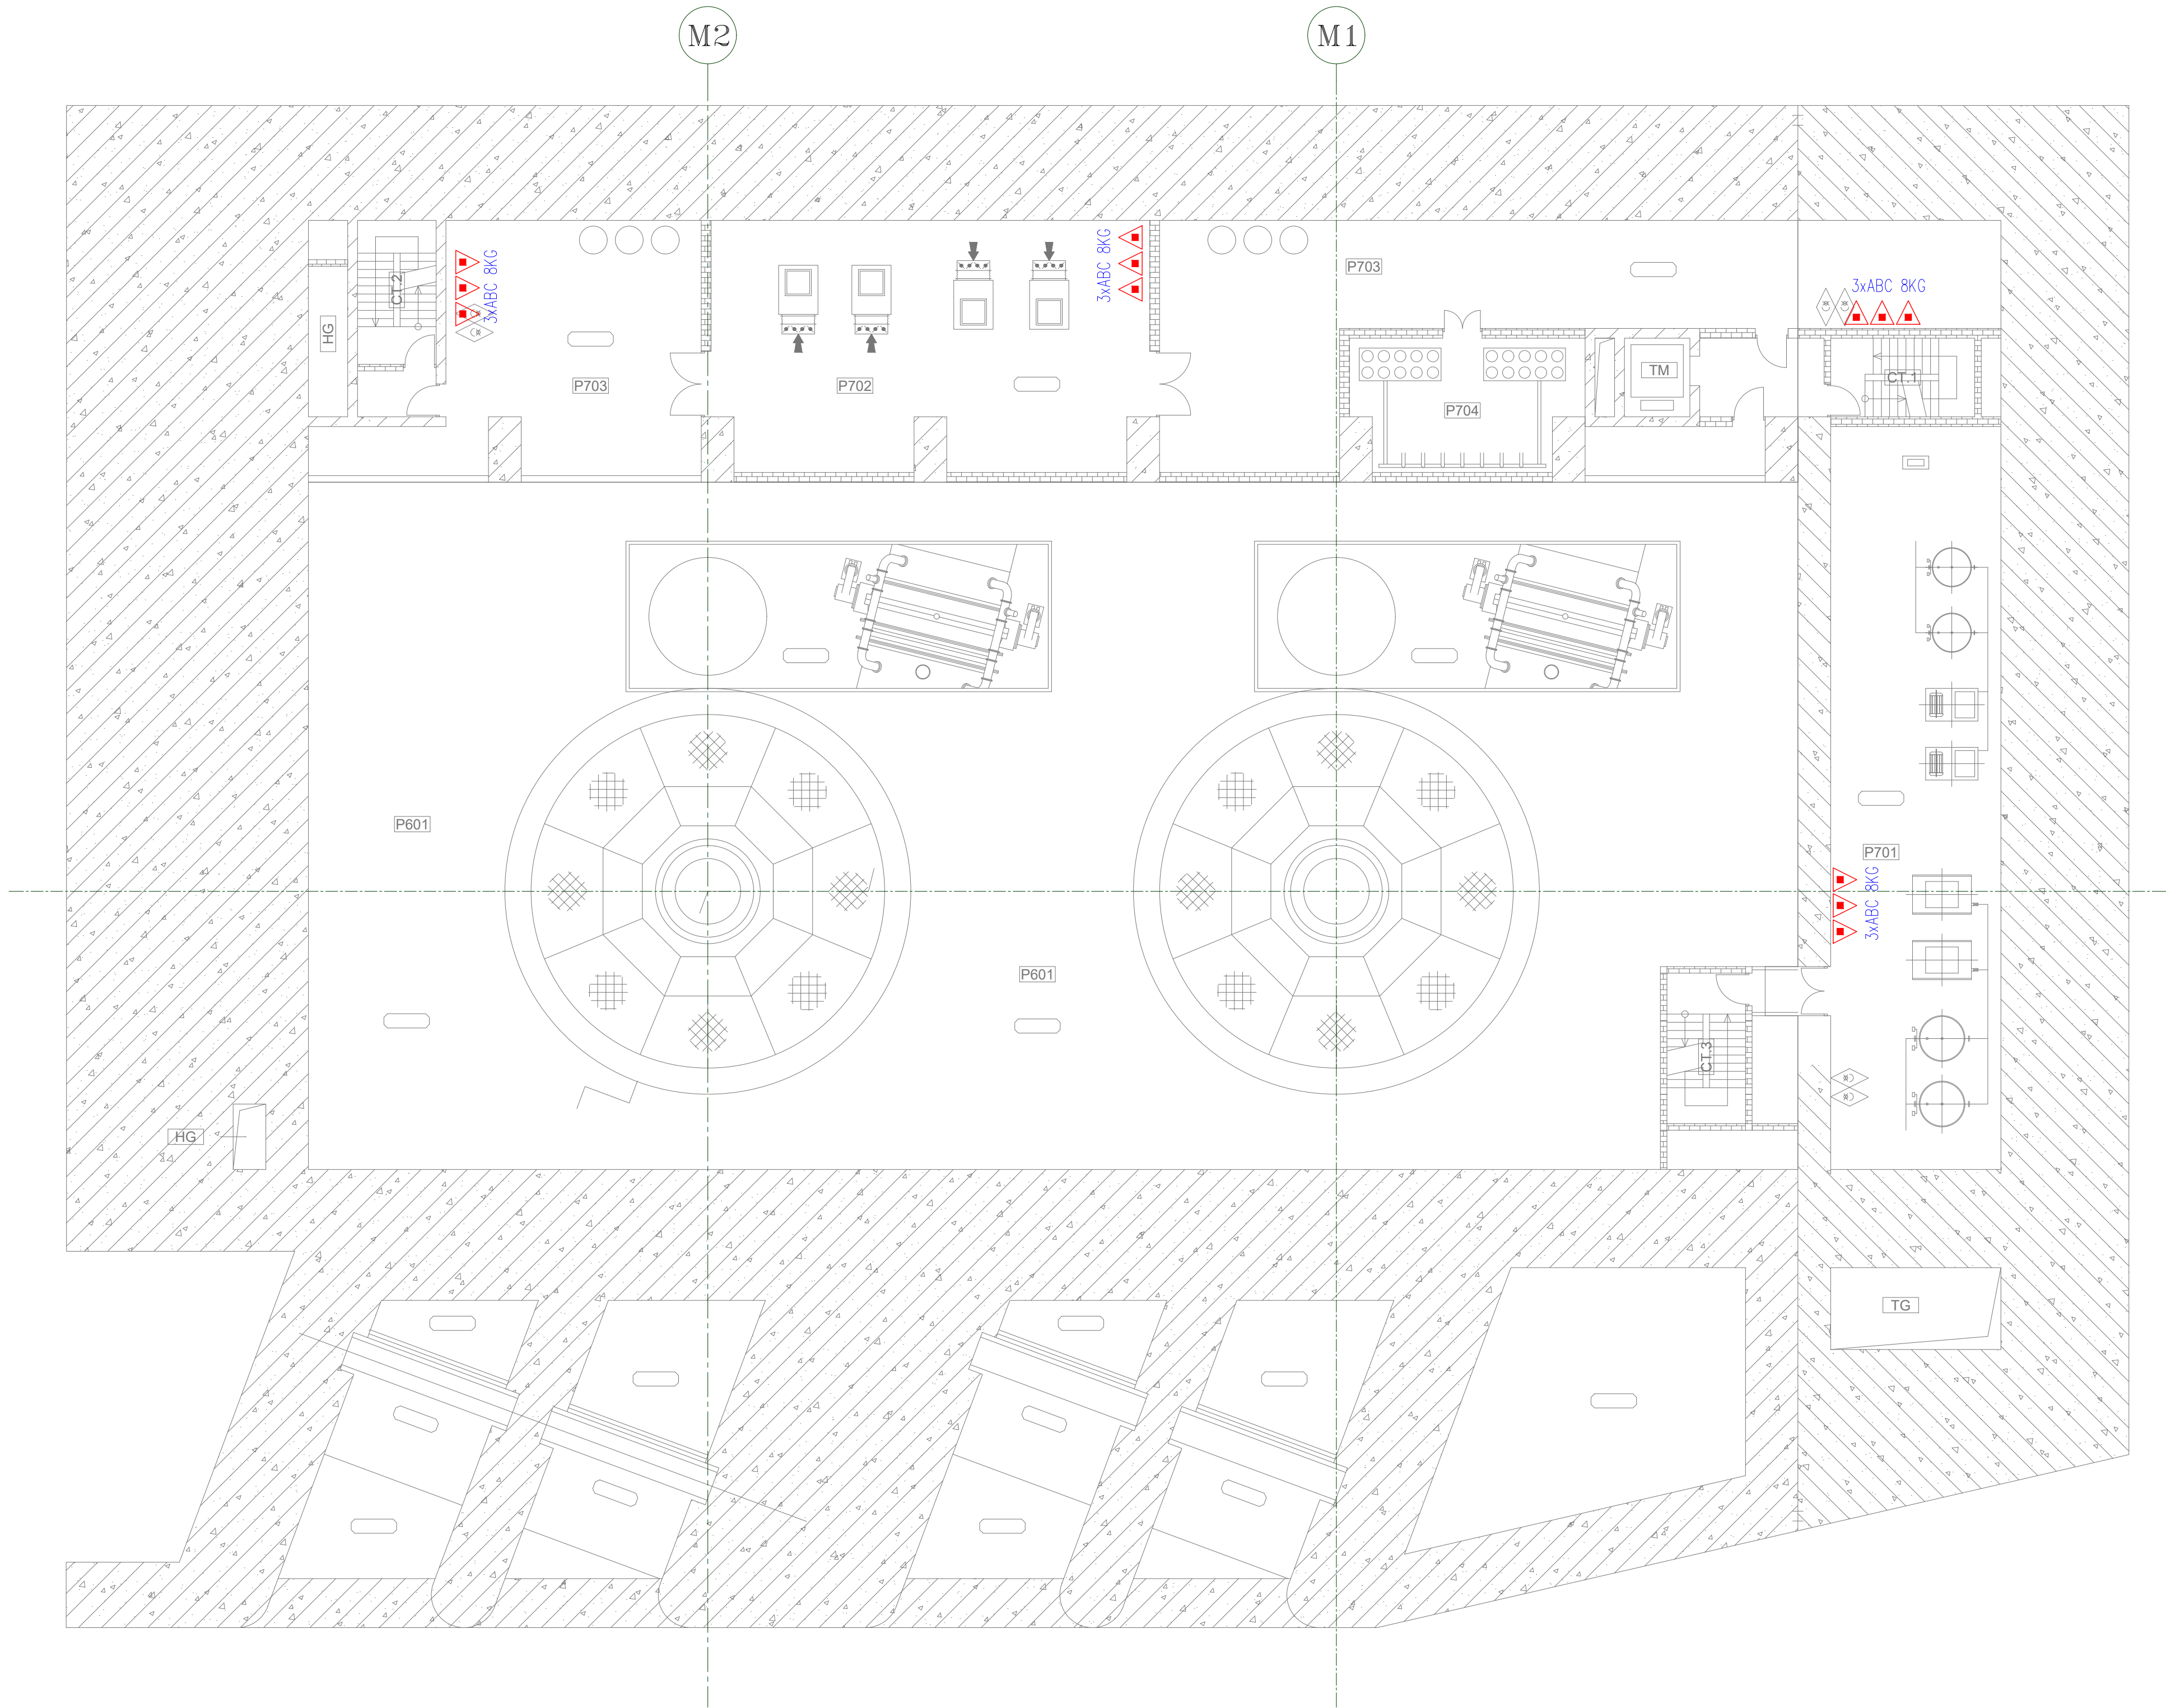

EL. 316.60 PLAN LAYOUT

EL. 316.60 PLAN LAYOUT

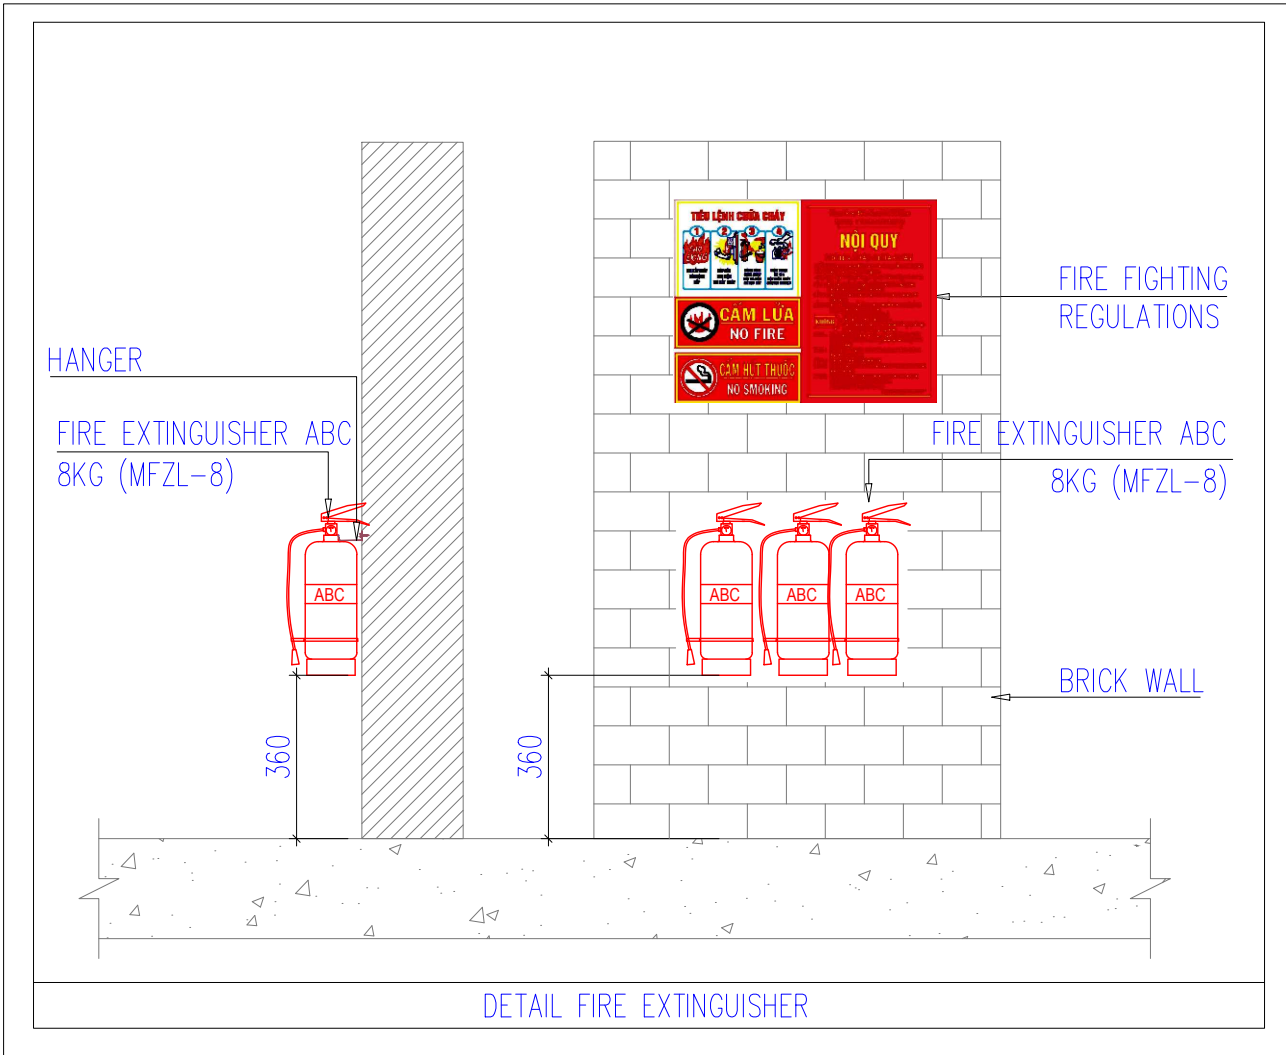

LEGEND:

SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER ABC 8kg (MFZL-8)	12

	PURCHASER : POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)																																																																																																																																																
	ANDRITZ HYDRO GmbH & 3 C INCORPORATION																																																																																																																																																
PROJECT : ITALY HYDRO POWER PLANT EXTENSION (2X180MW) PACKAGE- NO.40 TB-01 (VIETNAM)																																																																																																																																																	
<table><tr><td colspan="2">A</td><td colspan="2">INITIAL SUBMISSION</td><td>06-JAN-2024</td><td>NK</td><td>JCP</td><td>BRS</td><td>JCP</td></tr><tr><td>Index</td><td>Änderung</td><td>Datum/Date</td><td>Revised/Revised</td><td>Prepared by</td><td>Checked</td><td>Checked</td><td>Checked</td><td>Checked</td></tr><tr><td colspan="4">Stückliste/Partlist</td><td colspan="4">WA Nr.</td></tr><tr><td colspan="4">Abmess./Dimension</td><td colspan="4">Klassen Nr.</td></tr><tr><td colspan="4">Gruppe/Group</td><td colspan="4">Type</td></tr><tr><td colspan="4"></td><td colspan="4">Modell/Scale</td></tr><tr><td colspan="4"></td><td colspan="2">Gewicht/Weight</td><td colspan="2">Material</td></tr><tr><td colspan="4">HAV</td><td colspan="2">Datum/Date</td><td colspan="2">Name</td><td>Kunde/Customer</td></tr><tr><td colspan="4">Gepr./Drawn</td><td colspan="2">24.12.2022</td><td colspan="2">NK</td><td>Anlage/Plant</td></tr><tr><td colspan="4">Gepr./Checked</td><td colspan="2">24.12.2022</td><td colspan="2">JCP</td><td>Projekt/Project</td></tr><tr><td colspan="4">Gepr./Checked</td><td colspan="2">24.12.2022</td><td colspan="2">BRS</td><td>Vertr./Contract</td></tr><tr><td colspan="4">Genehm./Appr.</td><td colspan="2">24.12.2022</td><td colspan="2">JCP</td><td>File</td></tr><tr><td colspan="4"></td><td colspan="2">Internale W./Internal W.</td><td colspan="2">XXXX</td><td></td></tr><tr><td colspan="4"></td><td colspan="2">Zeichnungs Nr./Drawing Nr.</td><td colspan="2">ITALY-P40-AH-300-LAY-SGA-DG-1932-DI</td><td></td></tr><tr><td colspan="4"></td><td colspan="2">Index</td><td colspan="2">Bl./Shr.</td><td>05</td></tr><tr><td colspan="4"></td><td colspan="2">Ver./of</td><td colspan="2">11</td><td></td></tr></table>							A		INITIAL SUBMISSION		06-JAN-2024	NK	JCP	BRS	JCP	Index	Änderung	Datum/Date	Revised/Revised	Prepared by	Checked	Checked	Checked	Checked	Stückliste/Partlist				WA Nr.				Abmess./Dimension				Klassen Nr.				Gruppe/Group				Type								Modell/Scale								Gewicht/Weight		Material		HAV				Datum/Date		Name		Kunde/Customer	Gepr./Drawn				24.12.2022		NK		Anlage/Plant	Gepr./Checked				24.12.2022		JCP		Projekt/Project	Gepr./Checked				24.12.2022		BRS		Vertr./Contract	Genehm./Appr.				24.12.2022		JCP		File					Internale W./Internal W.		XXXX							Zeichnungs Nr./Drawing Nr.		ITALY-P40-AH-300-LAY-SGA-DG-1932-DI							Index		Bl./Shr.		05					Ver./of		11		
A		INITIAL SUBMISSION		06-JAN-2024	NK	JCP	BRS	JCP																																																																																																																																									
Index	Änderung	Datum/Date	Revised/Revised	Prepared by	Checked	Checked	Checked	Checked																																																																																																																																									
Stückliste/Partlist				WA Nr.																																																																																																																																													
Abmess./Dimension				Klassen Nr.																																																																																																																																													
Gruppe/Group				Type																																																																																																																																													
				Modell/Scale																																																																																																																																													
				Gewicht/Weight		Material																																																																																																																																											
HAV				Datum/Date		Name		Kunde/Customer																																																																																																																																									
Gepr./Drawn				24.12.2022		NK		Anlage/Plant																																																																																																																																									
Gepr./Checked				24.12.2022		JCP		Projekt/Project																																																																																																																																									
Gepr./Checked				24.12.2022		BRS		Vertr./Contract																																																																																																																																									
Genehm./Appr.				24.12.2022		JCP		File																																																																																																																																									
				Internale W./Internal W.		XXXX																																																																																																																																											
				Zeichnungs Nr./Drawing Nr.		ITALY-P40-AH-300-LAY-SGA-DG-1932-DI																																																																																																																																											
				Index		Bl./Shr.		05																																																																																																																																									
				Ver./of		11																																																																																																																																											




EL. 309.50 PLAN LAYOUT




SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER ABC 8kg (MFZL-8)	33

 EVN PMB2 VIETNAM ELECTRICITY	PURCHASER :		POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)																																																
	 ANDRITZ HYDRO GmbH & 3 C INCORPORATION	ANDRITZ HYDRO POWER PLANT EXTENSION (2X180MW) PACKAGE NO.40 TB-01 (VIETNAM)																																																	
PROJECT :																																																			
<table border="1"> <tr> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td> </tr> </table>																																																			
A INITIAL SUBMISSION				06-JAN-2024		N K		JCP		BRS		JCP																																							
Index		Änderung Modification		Datum Date		Bereitet Prepared by		Geprüft Checked		Geprüft Checked		Genehmigt Approved																																							
Stückliste/Portfolio				NW Nr.																																															
Abmess./Dimension				Klassen Nr.																																															
Gruppe/Group				Type																																															
PORTABLE FIRE EXTINGUISHER SYSTEM LAYOUT						Ministab/Scale																																													
						Gewicht/Weight		Material																																											
HW		Datum/Date		Name		Kunde/Client		PMB PROJECT MANAGEMENT BOARD NO. 2 (SGS)		Schutzvermerk (ISO 18016 beachten Refer to protection notice ISO 18016)																																									
Gez./Drawn		24.12.2022		NK		Anlage/Plant		WALY HYDRO POWER PLANT EXTENSION																																											
Gepr./Checked		24.12.2022		JCP		Projekt/Project		N° 24.04.08/2022/P-40-402-AH-35																																											
Gepr./Checked		24.12.2022		BRS		Vertr./Contract		N° 24.04.08/2022/P-40-402-AH-35		Än./Similar																																									
Genehm./Appr.		24.12.2022		JCP		File				Ers./Replace																																									
						Version 10/Informal N°		=																																											
						Zeichnungs 30/Drawings N°		+																																											
IALY-P40-AH-300-LAY-SGA-DG-1932-DI						Index		St./Sht.		06																																									
						A		von/of		11																																									

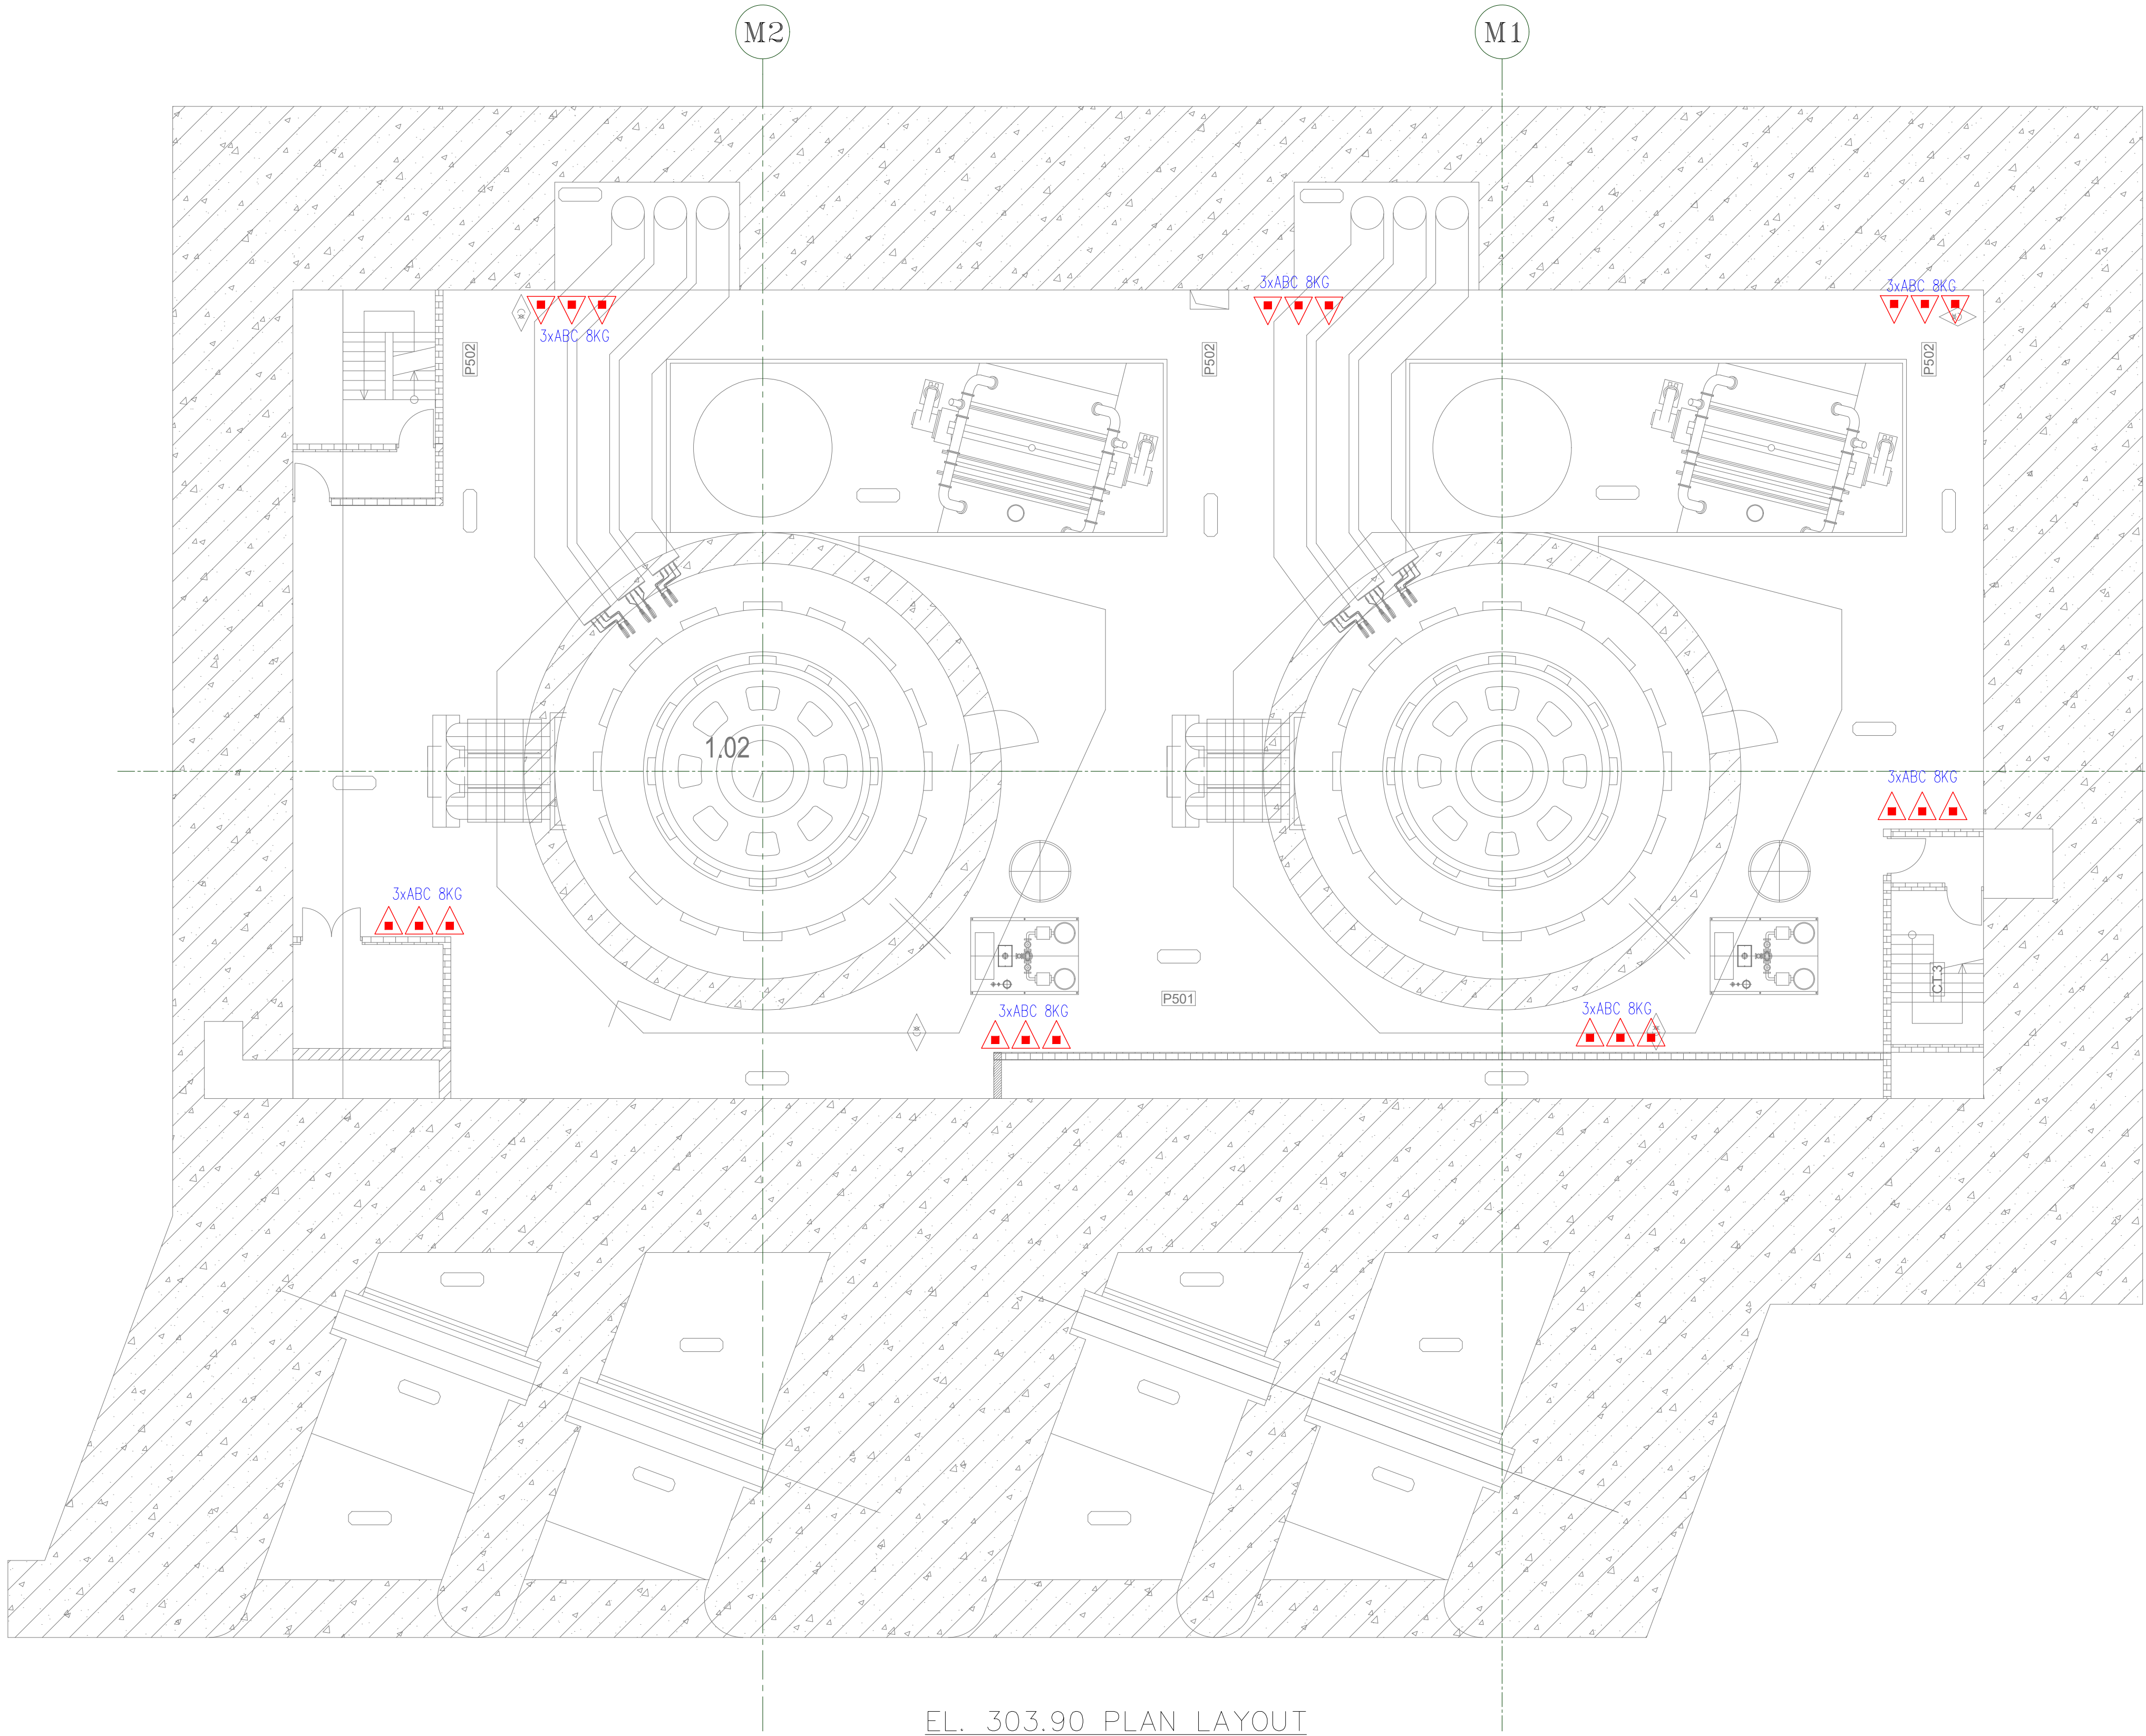

EL. 303.90 PLAN LAYOUT

EL. 303.90 PLAN LAYOUT

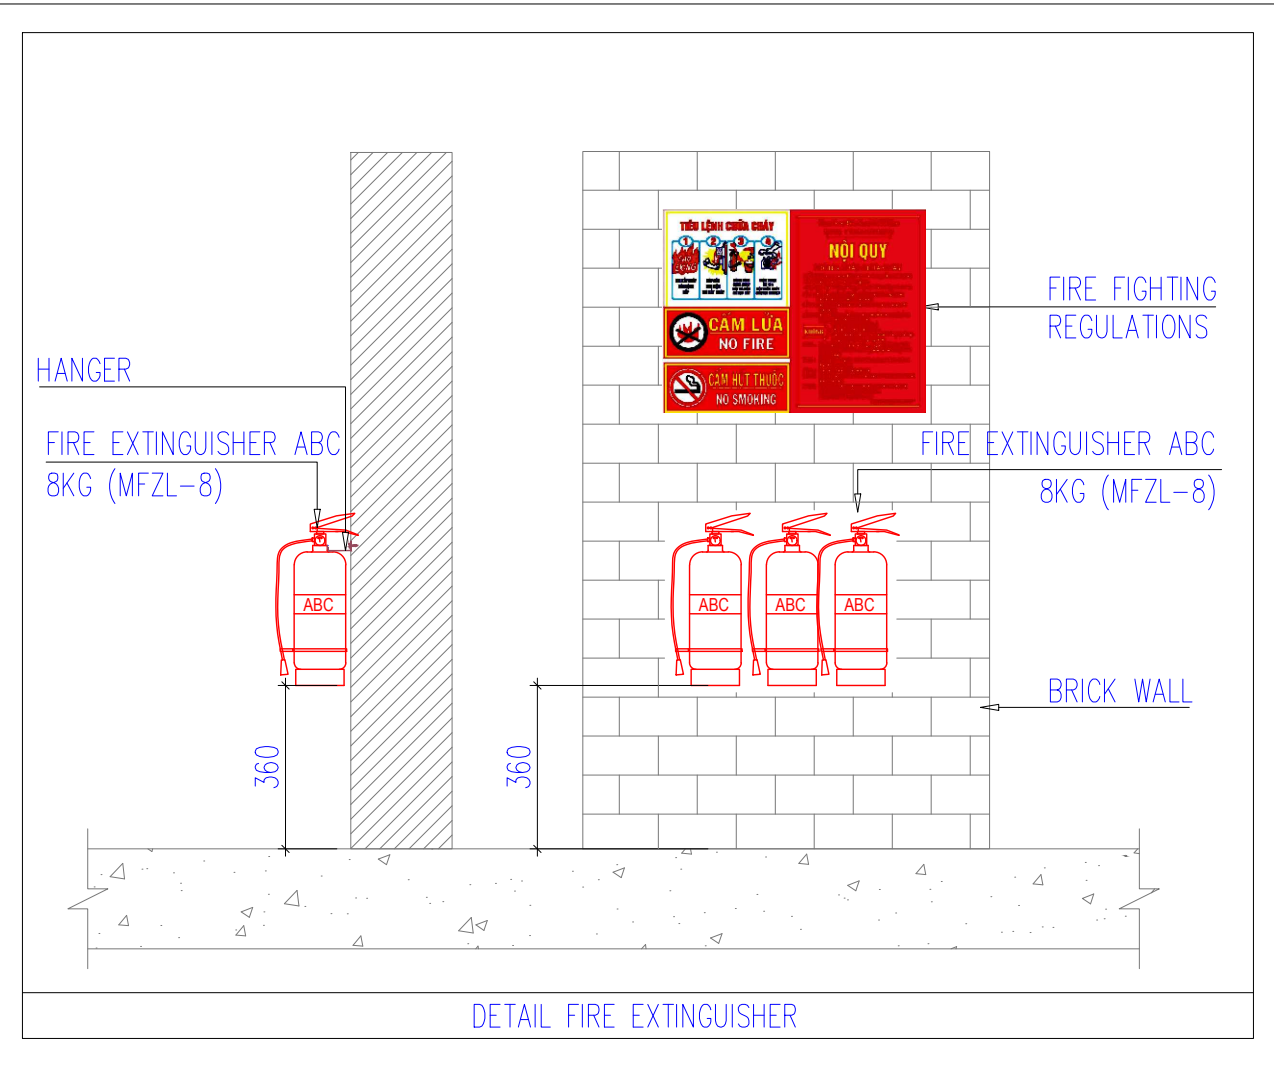

LEGEND:		
SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER ABC 8kg (MFZL-8)	21




PURCHASER :

POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)

ANDRITZ HYDRO GmbH & 3 C INCORPORATION


ITALY HYDRO POWER PLANT EXTENSION (2X180MW)
PACKAGE- NO.40 TB-01 (VIETNAM)

PROJECT :		06-JAN-2024		NK	JCP	BRS	JCP
Index	Revising Modification	Revision Date	Revised by	Checked by	Approved by	Checked by	Approved by
Stückliste/Partlist		WA. Nr.		Klassen Nr.			
Abmess./Dimension		Type		Modell/Scale			
Gruppe/Group		Gewicht/Weight		Material			
HAV	Datum/Date	Name	Kunde/Client	POWER PROJECTS MANAGEMENT BOARD NO. 2 (EVN)		Schutzvermerk	
Gez./Drawn	24.12.2022	NK	Anlage/Plant	ITALY HYDRO POWER PLANT EXTENSION		ISO 18016 beachten	
Gepr./Checked	24.12.2022	JCP	Projekt/Project	N° 24-ALYMR/2022/H0-A02-AH-3C		Refer to protection notice ISO 18016	
Gepr./Checked	24.12.2022	BRS	Vertr./Contract	N° 24-ALYMR/2022/H0-A02-AH-3C		Änder./Similar	
Genehm./Appr.	24.12.2022	JCP	File			Ers./Replace	
		Internale W./Internal W.		XXXX		=	
		Zeichnungs N°/Drawing N°		ITALY-P40-AH-300-LAY-SGA-DG-1932-DI		+	
		Index		Bl./Sht.		07	
		Ver./of		A		11	
						AT	

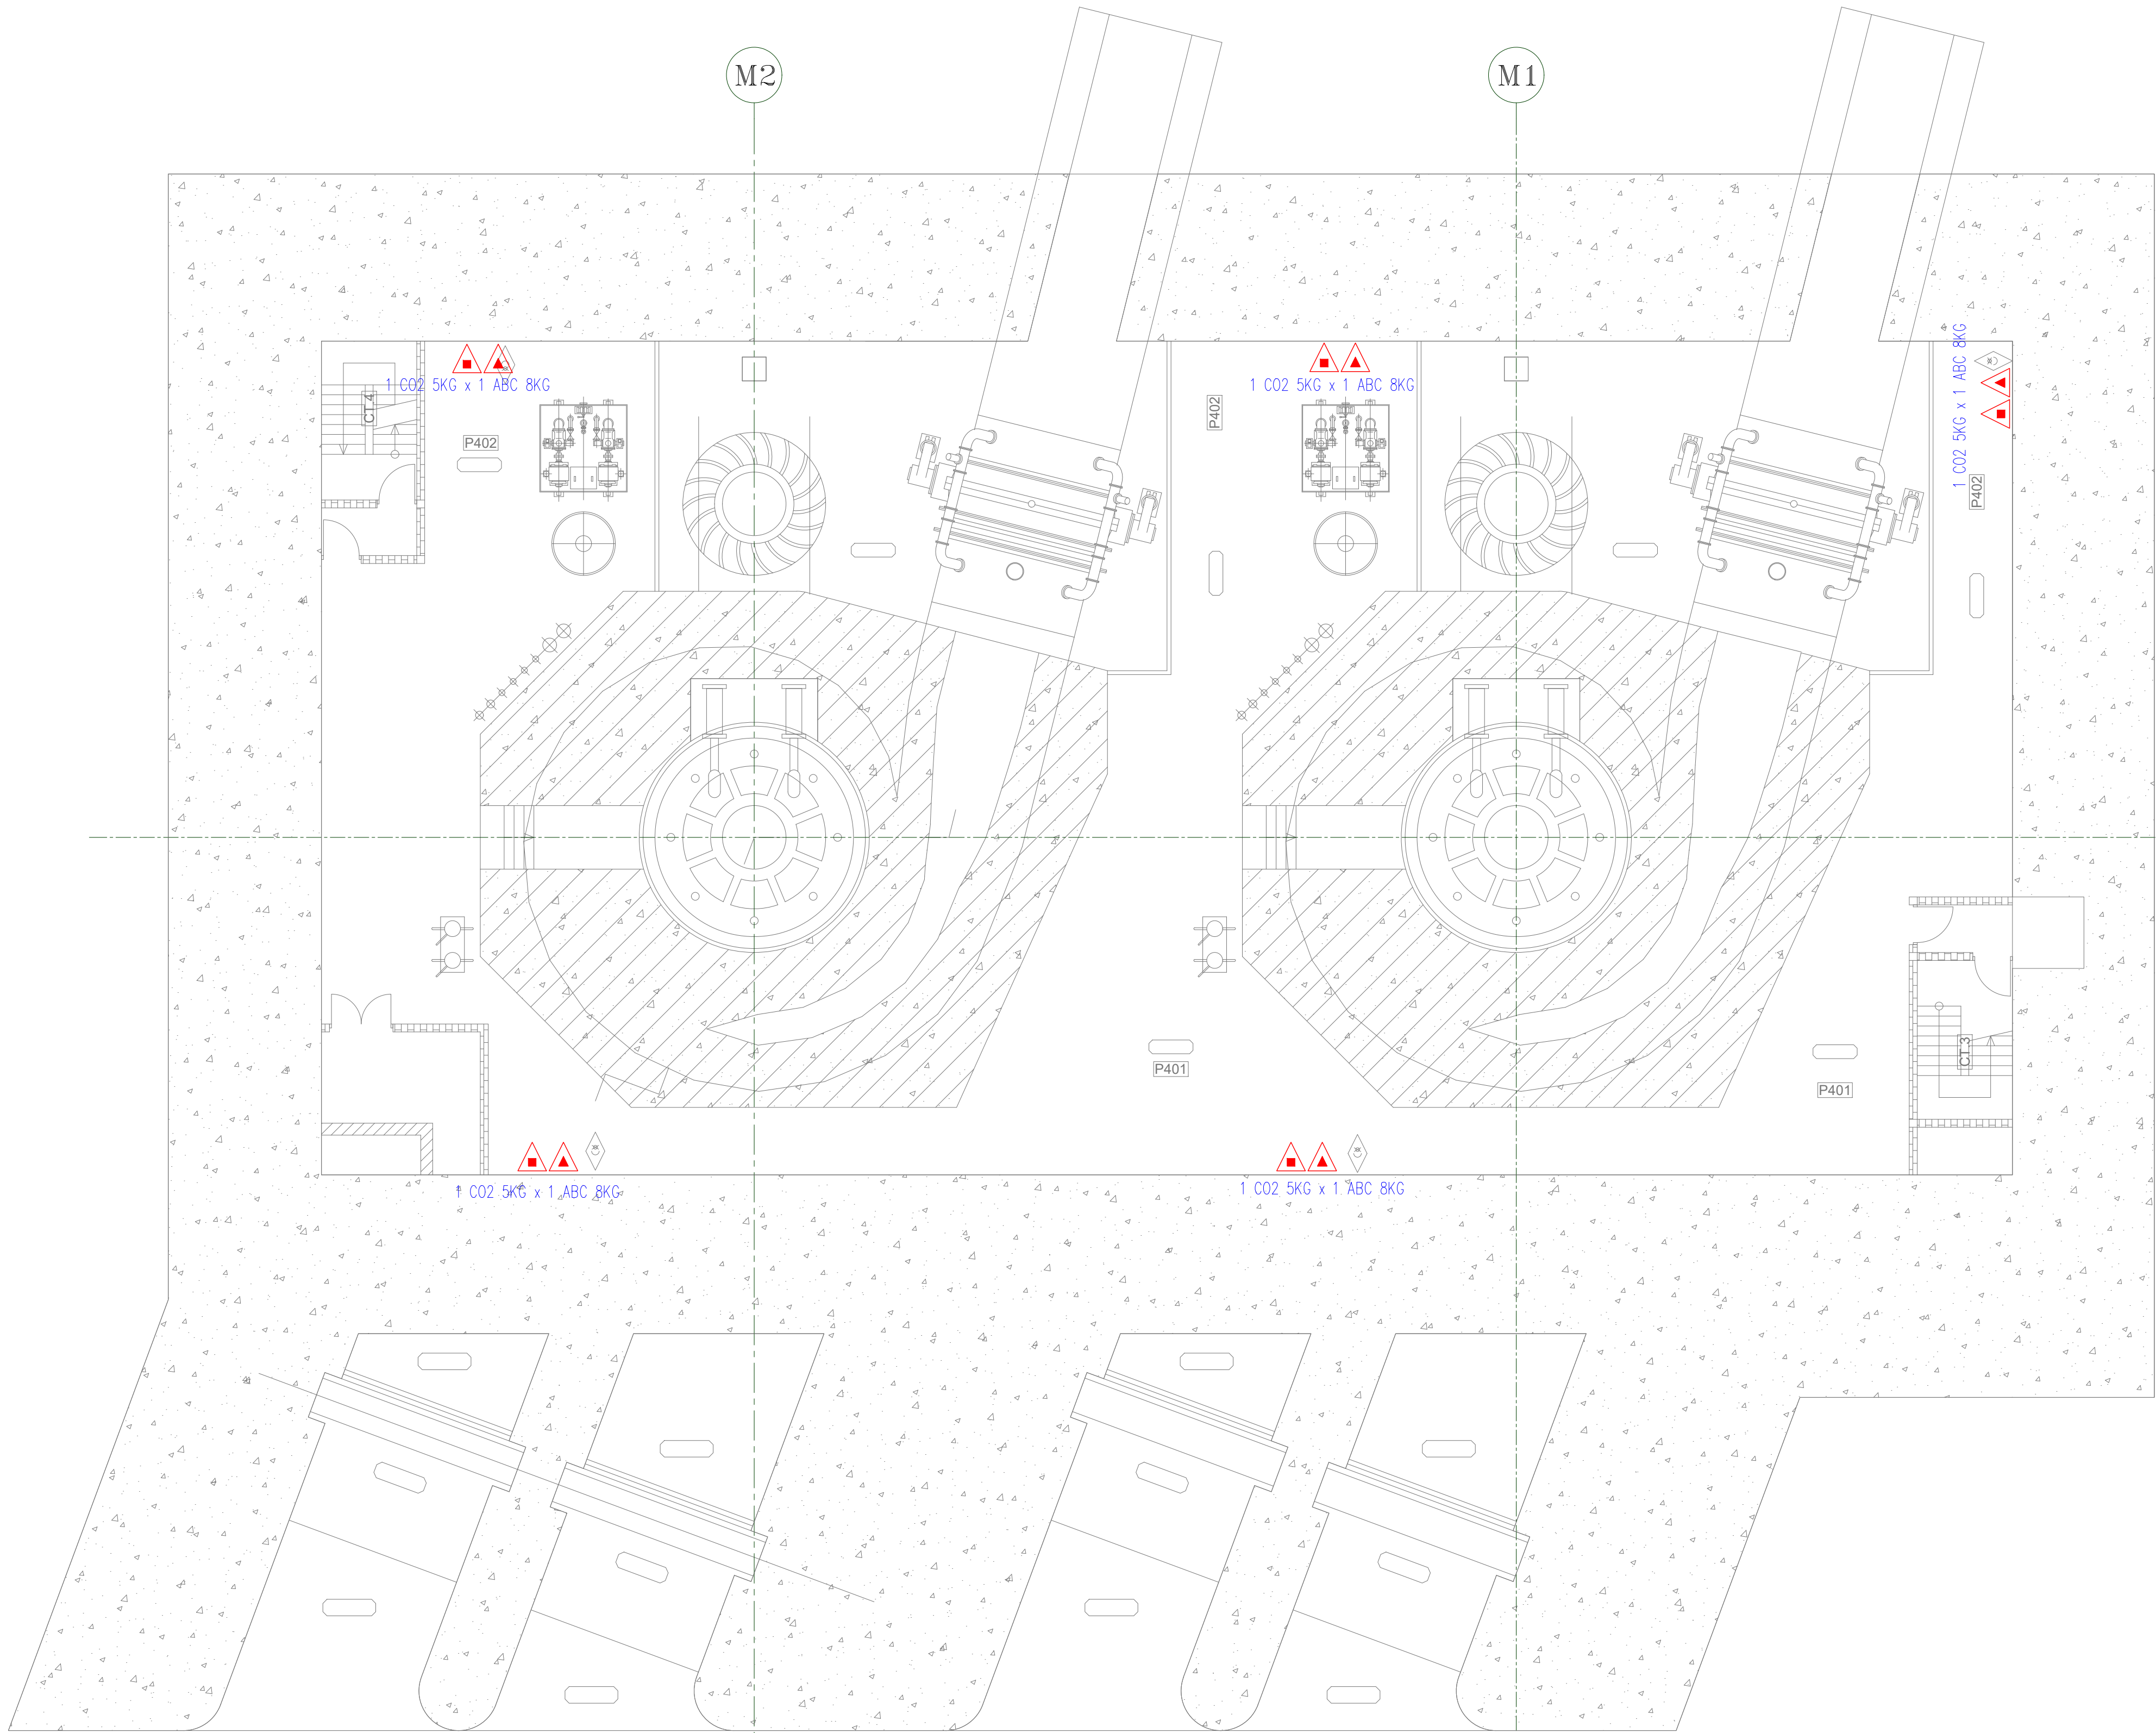

EL. 298.30 PLAN LAYOUT

EL. 298.30 PLAN LAYOUT

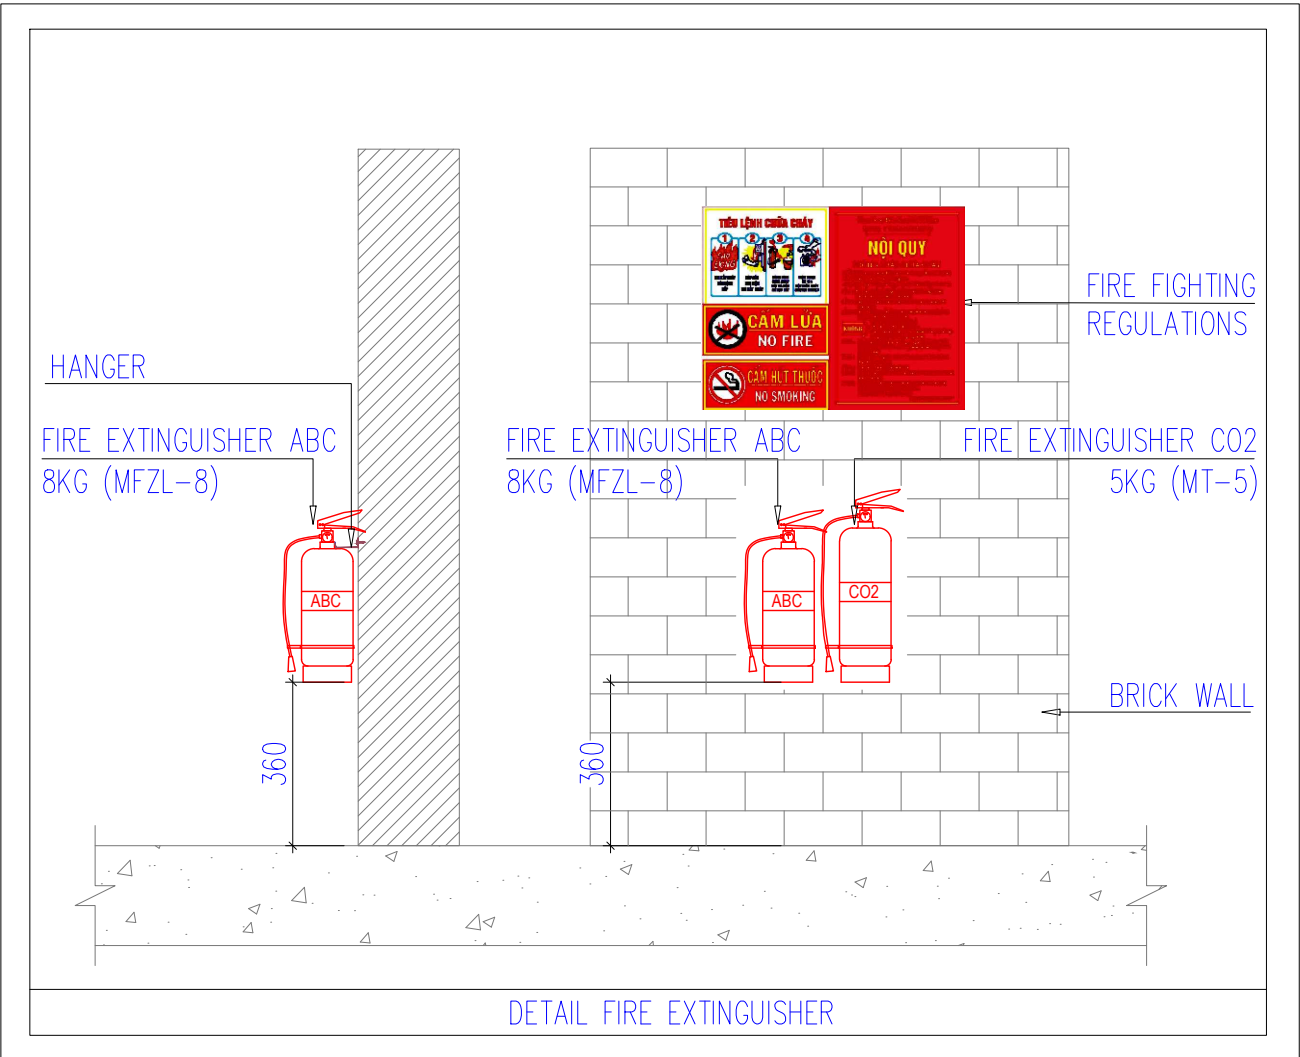

LEGEND:

SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER ABC 8kg (MFZL-8)	5
	FIRE EXTINGUISHER CO2 5kg (MT-5)	5


PURCHASER :
POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)


ANDRITZ HYDRO GmbH & 3 C INCORPORATION



PROJECT :
ITALY HYDRO POWER PLANT EXTENSION (2X180MW)
PACKAGE- NO.40 TB-01 (VIETNAM)

A	INITIAL SUBMISSION	06-JAN-2024	NK	JCP	BRS	JCP																													
Index	Revisi Modification	Datum Date	Revised by	Checked by	Checked by	Checked by																													
Stückliste/Partlist	WA. Nr.					Schutzvermerk ISO 18016 beachten Refer to protection notice ISO 18016																													
Abmess./Dimension	Klassen. Nr.																																		
Gruppe/Group	Type																																		
PORTABLE FIRE EXTINGUISHER SYSTEM LAYOUT						Maßstab/Scale																													
<table border="1"> <tr> <td>HAU</td> <td>Datum/Date</td> <td>Name</td> <td>Kunde/Client</td> <td>POWER PROJECTS MANAGEMENT BOARD NO. 2 (EVNPMB2)</td> </tr> <tr> <td>Gez./Drawn</td> <td>24.12.2022</td> <td>NK</td> <td>Anlage/Plant</td> <td>ITALY HYDRO POWER PLANT EXTENSION</td> </tr> <tr> <td>Gepr./Checked</td> <td>24.12.2022</td> <td>JCP</td> <td>Projekt/Project</td> <td>N° 24-ALYMR/2022/HB-402-AH-3C</td> </tr> <tr> <td>Gepr./Checked</td> <td>24.12.2022</td> <td>BRS</td> <td>Vertr./Contract</td> <td>N° 24-ALYMR/2022/HB-402-AH-3C</td> </tr> <tr> <td>Genehm./Appr.</td> <td>24.12.2022</td> <td>JCP</td> <td>File</td> <td></td> </tr> </table>						HAU	Datum/Date	Name	Kunde/Client	POWER PROJECTS MANAGEMENT BOARD NO. 2 (EVNPMB2)	Gez./Drawn	24.12.2022	NK	Anlage/Plant	ITALY HYDRO POWER PLANT EXTENSION	Gepr./Checked	24.12.2022	JCP	Projekt/Project	N° 24-ALYMR/2022/HB-402-AH-3C	Gepr./Checked	24.12.2022	BRS	Vertr./Contract	N° 24-ALYMR/2022/HB-402-AH-3C	Genehm./Appr.	24.12.2022	JCP	File		<table border="1"> <tr> <td>Internat. W./Internat. W°</td> <td>XXXX</td> </tr> <tr> <td>Zeichnungs. Nr./Drawing. N°</td> <td>ITALY-P40-AH-300-LAY-SGA-DG-1932-DI</td> </tr> </table>	Internat. W./Internat. W°	XXXX	Zeichnungs. Nr./Drawing. N°	ITALY-P40-AH-300-LAY-SGA-DG-1932-DI
HAU	Datum/Date	Name	Kunde/Client	POWER PROJECTS MANAGEMENT BOARD NO. 2 (EVNPMB2)																															
Gez./Drawn	24.12.2022	NK	Anlage/Plant	ITALY HYDRO POWER PLANT EXTENSION																															
Gepr./Checked	24.12.2022	JCP	Projekt/Project	N° 24-ALYMR/2022/HB-402-AH-3C																															
Gepr./Checked	24.12.2022	BRS	Vertr./Contract	N° 24-ALYMR/2022/HB-402-AH-3C																															
Genehm./Appr.	24.12.2022	JCP	File																																
Internat. W./Internat. W°	XXXX																																		
Zeichnungs. Nr./Drawing. N°	ITALY-P40-AH-300-LAY-SGA-DG-1932-DI																																		
						<table border="1"> <tr> <td>Index</td> <td>Bl./Shr.</td> <td>08</td> </tr> <tr> <td>von/vf</td> <td></td> <td>11</td> </tr> </table>	Index	Bl./Shr.	08	von/vf		11																							
Index	Bl./Shr.	08																																	
von/vf		11																																	



SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER ABC 8kg (MFZL-8)	6
	FIRE EXTINGUISHER CO2 5kg (MT-5)	6

 EVN PMB2		PURCHASER :		POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)				
		ANDRITZ HYDRO GmbH & 3 C INCORPORATION						
IALY HYDRO POWER PLANT EXTENSION (2X180MW) PACKAGE- NO.40 TB-01 (VIETNAM)								
PROJECT :								
A	INITIAL SUBMISSION			06-JAN-2024	N K	JCP	BRS	JCP
Index	Amending Modification			Datum Date	Revised Prepared by	Copied / Checked	Copied / Checked	Copied / Approved
Stichting/Portaal					Wk.-Nr.			
Afmeting/Dimensie					Klassen-Nr.			
Groep/Groep					Type			
					Modifich/Serie			
PORTABLE FIRE EXTINGUISHER SYSTEM LAYOUT					Gewicht/Weight		Material	
HAU	Datum/Date	Name	Kunde/Cient:	PWER PROJECTS MANAGEMENT BOARD NO. 2 (LHANG)		Schulzvermerk ISO 18016 beachten Refer to protection notice ISO 18016		  ISO / R 128 EUROPE
Gesz./Drawn	24.12.2022	NK	Anlage/Plant	IALY HYDRO POWER PLANT EXTENSION				
Gepr./Checked	24.12.2022	JCP	Projekt/Project	NO 24 ALWA/2022/HO-A02-WA-S				
Gepr./Checked	24.12.2022	BRS	Verrtr./Contract	No 24 ALWA/2022/HO-A02-WA-S		Ann./Similar		
Genehm./Appr.	24.12.2022	JCP	Verte.	File		Ers./Replace		
				Internete: N°/Internal: N°		=		
				XXXX		+		
				Technische: N°/Drawing: N°				
IALY-P40-AH-300-LAY-SGA-DG-1932-DI						nr/nr		S/L/Stat.
						A		von/of

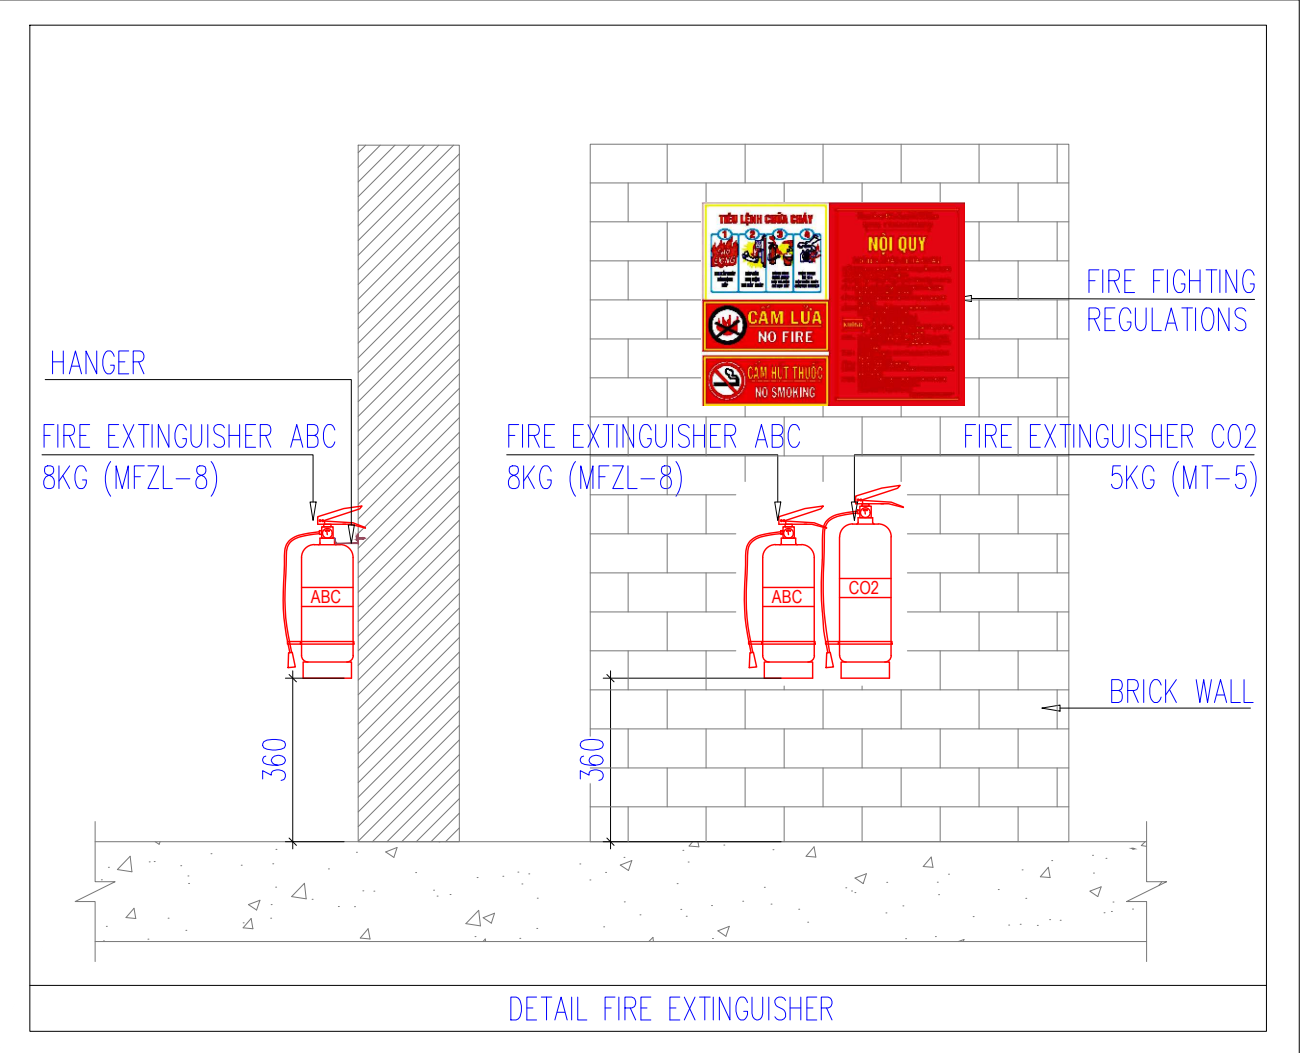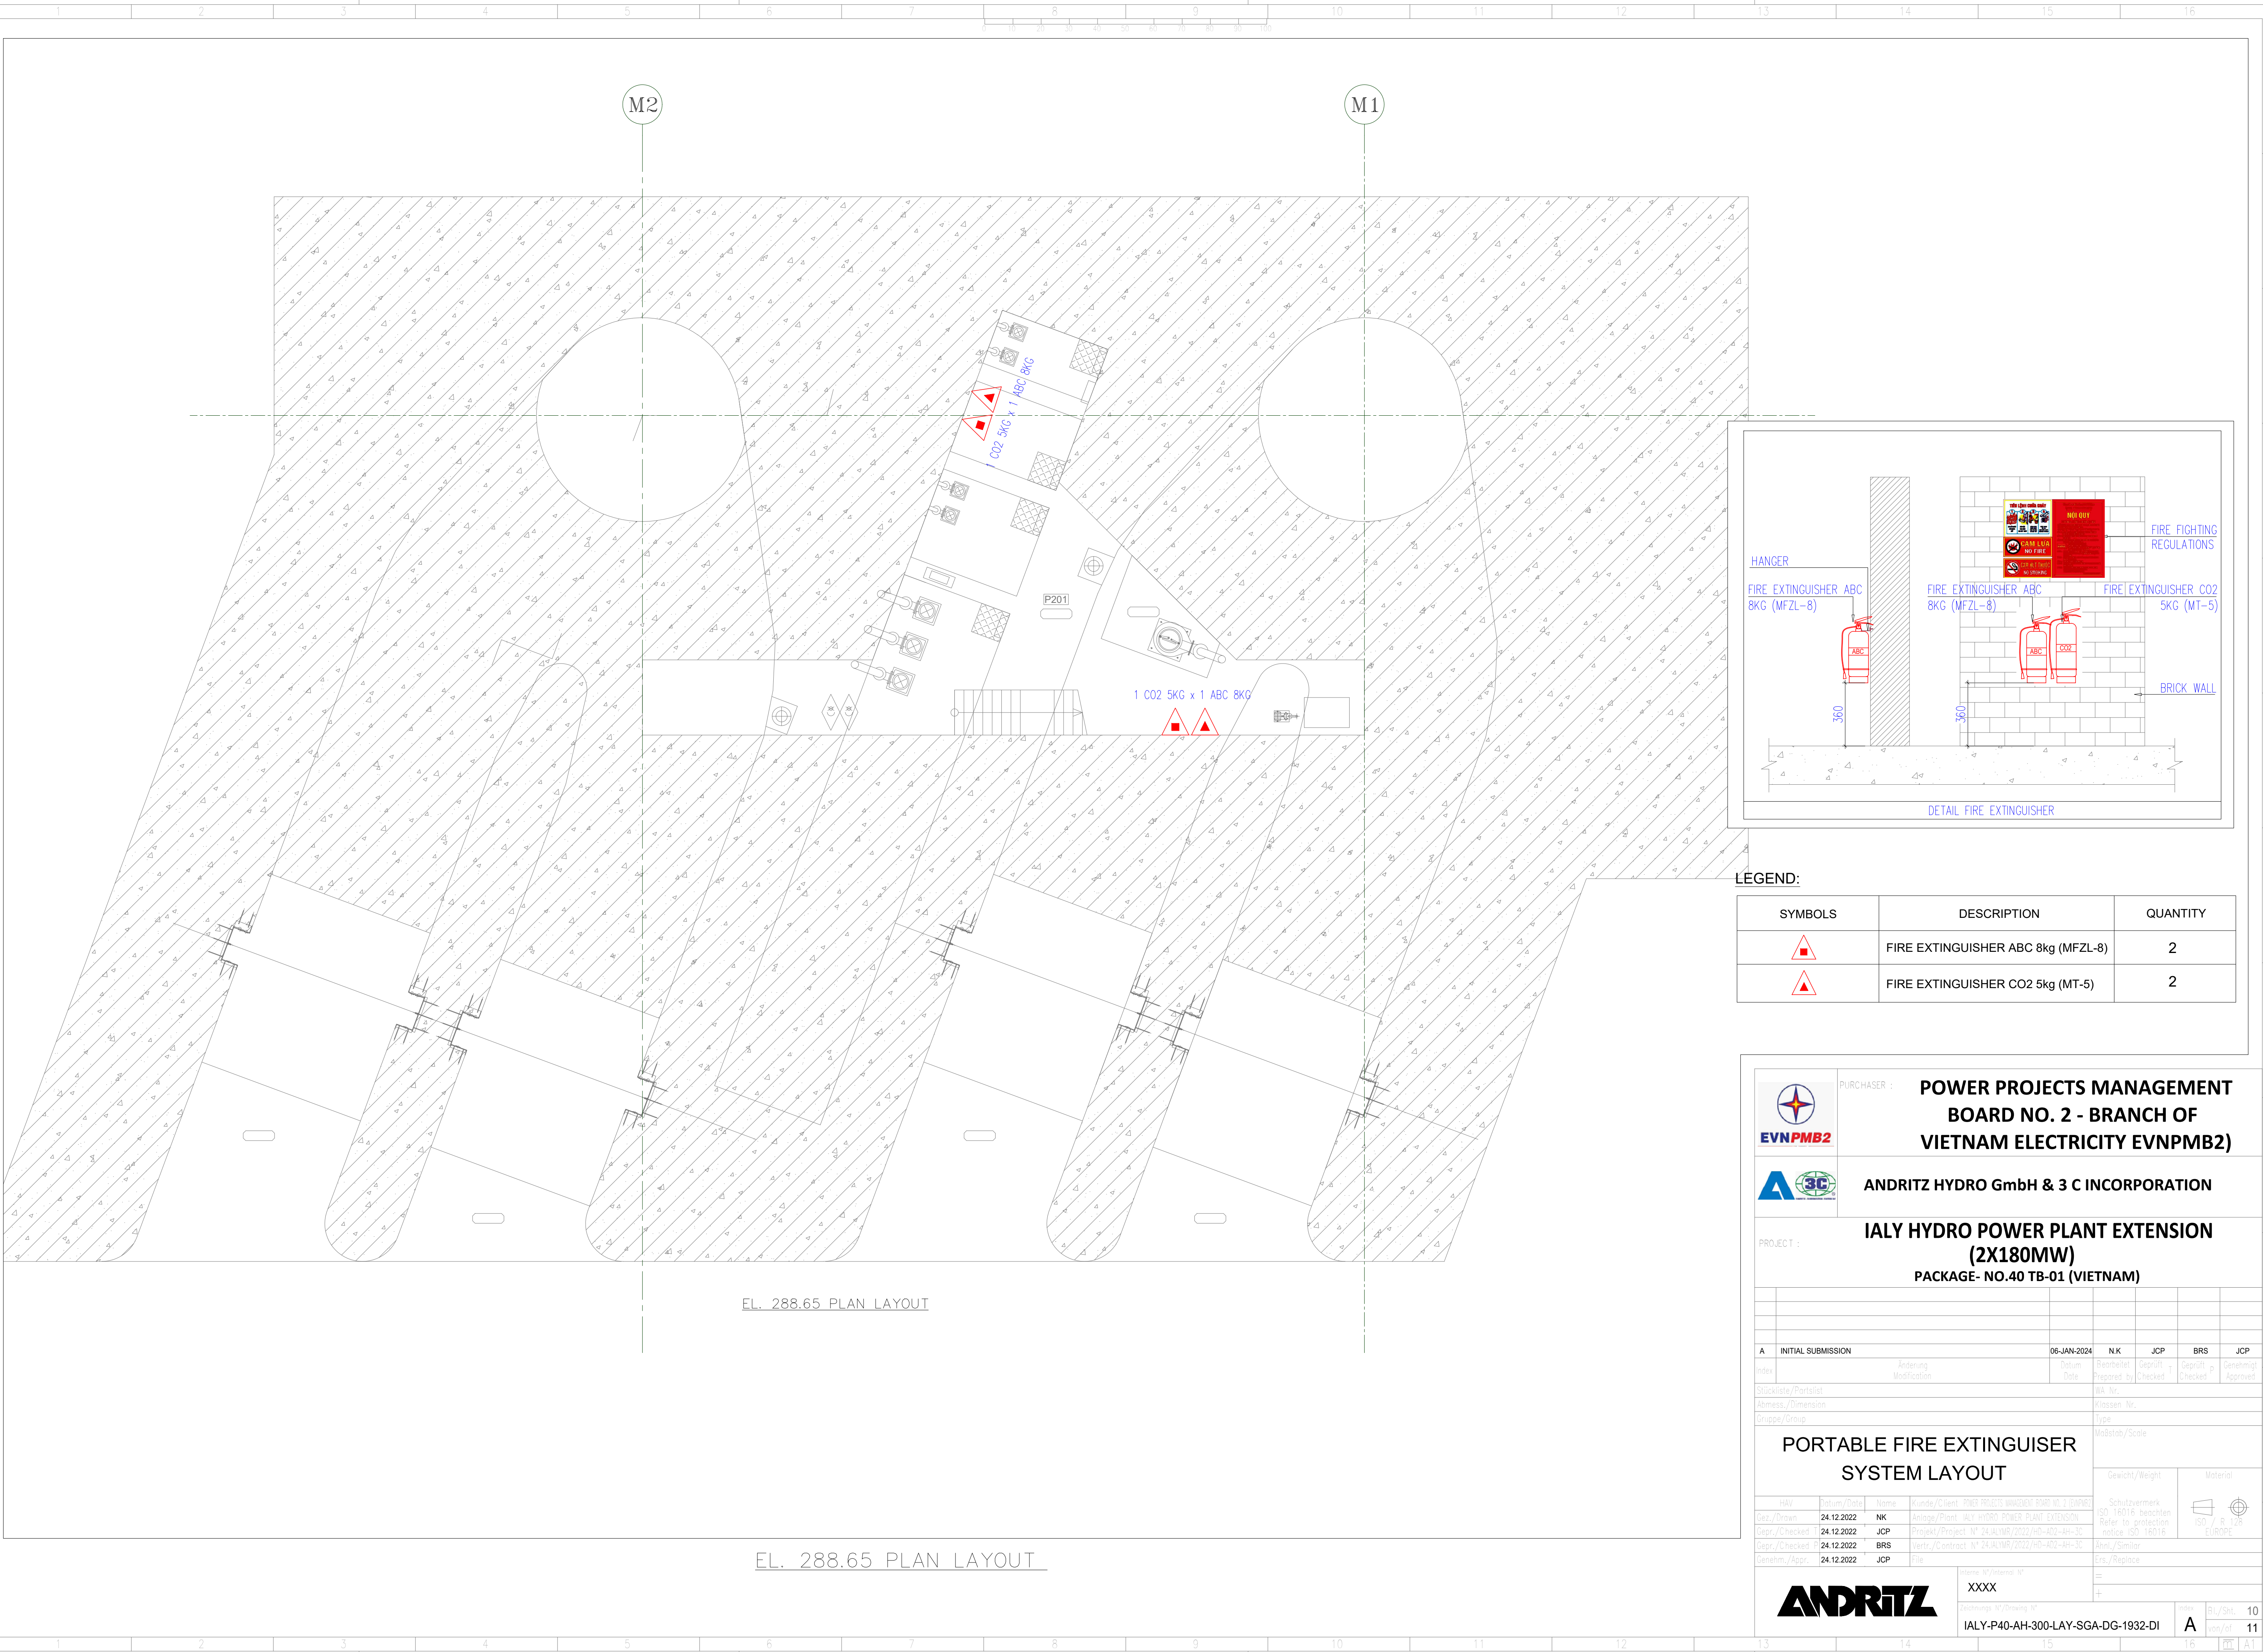

LEGEND:

SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER ABC 8kg (MFZL-8)	2
	FIRE EXTINGUISHER CO2 5kg (MT-5)	2

PURCHASER : **POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)**


ANDRITZ HYDRO GmbH & 3 C INCORPORATION

PROJECT :

ITALY HYDRO POWER PLANT EXTENSION (2X180MW)


PACKAGE- NO.40 TB-01 (VIETNAM)

A		INITIAL SUBMISSION		06-JAN-2024	NK	JCP	BRS	JCP
Index	Änderung	Modifikation	Datum	Date	Revised	Prepared by	Checked	Approved
Stückliste/Partlist				WA Nr.		Klassen Nr.		
Abmess./Dimension				Type		Mod/Str./Scale		
Gruppe/Group				Gewicht/Weight		Material		
HAV	Datum/Date	Name	Kunde/Client: POWER PROJECTS MANAGEMENT BOARD NO. 2 (EVNPMB2)			Schutzvermerk		
Gez./Drawn	24.12.2022	NK	Anlage/Plant: ITALY HYDRO POWER PLANT EXTENSION			ISO 18016 beachten		
Gepr./Checked	24.12.2022	JCP	Projekt/Project: N° 24-ALYWR/2022/H0-A02-AH-3C			Refer to protection notice ISO 18016		
Gepr./Checked	24.12.2022	BRS	Vertr./Contract: N° 24-ALYWR/2022/H0-A02-AH-3C			Änder./Similar		
Genehm./Appr.	24.12.2022	JCP	File			Ers./Replace		
Internat. W./Internat. W				XXXX		=		
Zeichnungs Nr./Drawing N°				XXXX		+		
ITALY-P40-AH-300-LAY-SGA-DG-1932-DI				Index		Bl./Sht. 10		
				A		von/vf 11		

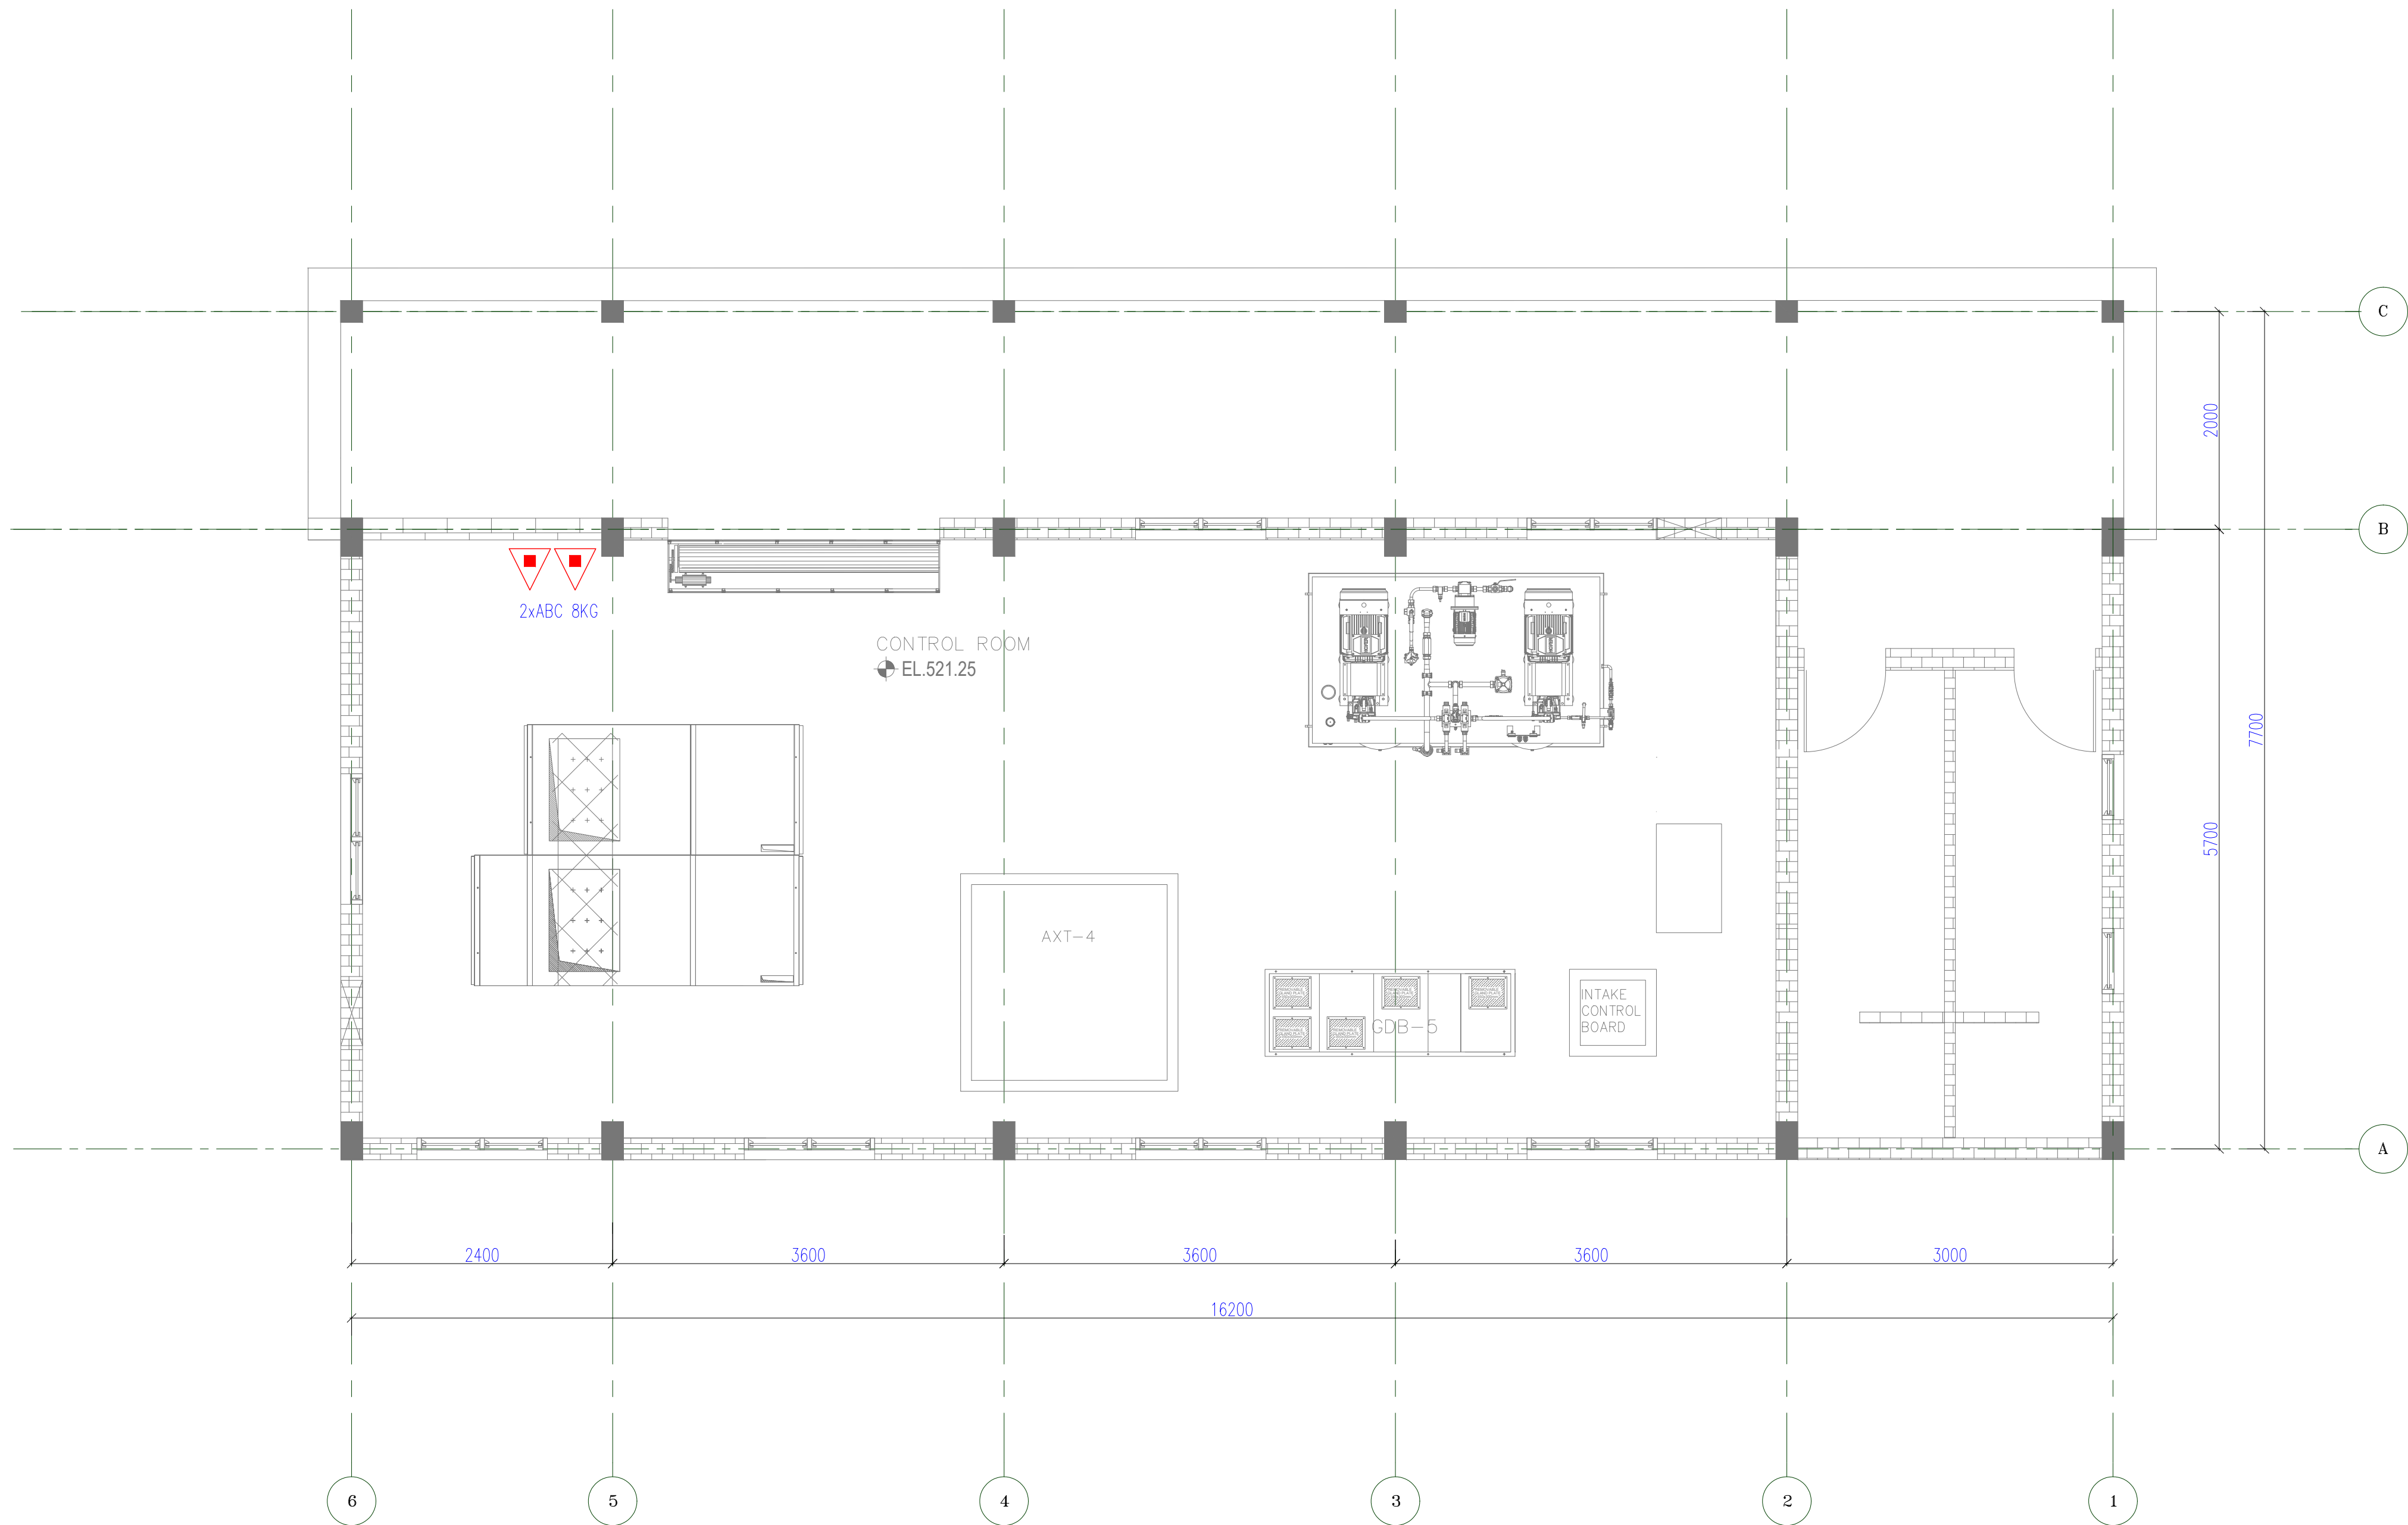

LEGEND:

SYMBOLS	DESCRIPTION	QUANTITY
	FIRE EXTINGUISHER ABC 8kg (MFZL-8)	2

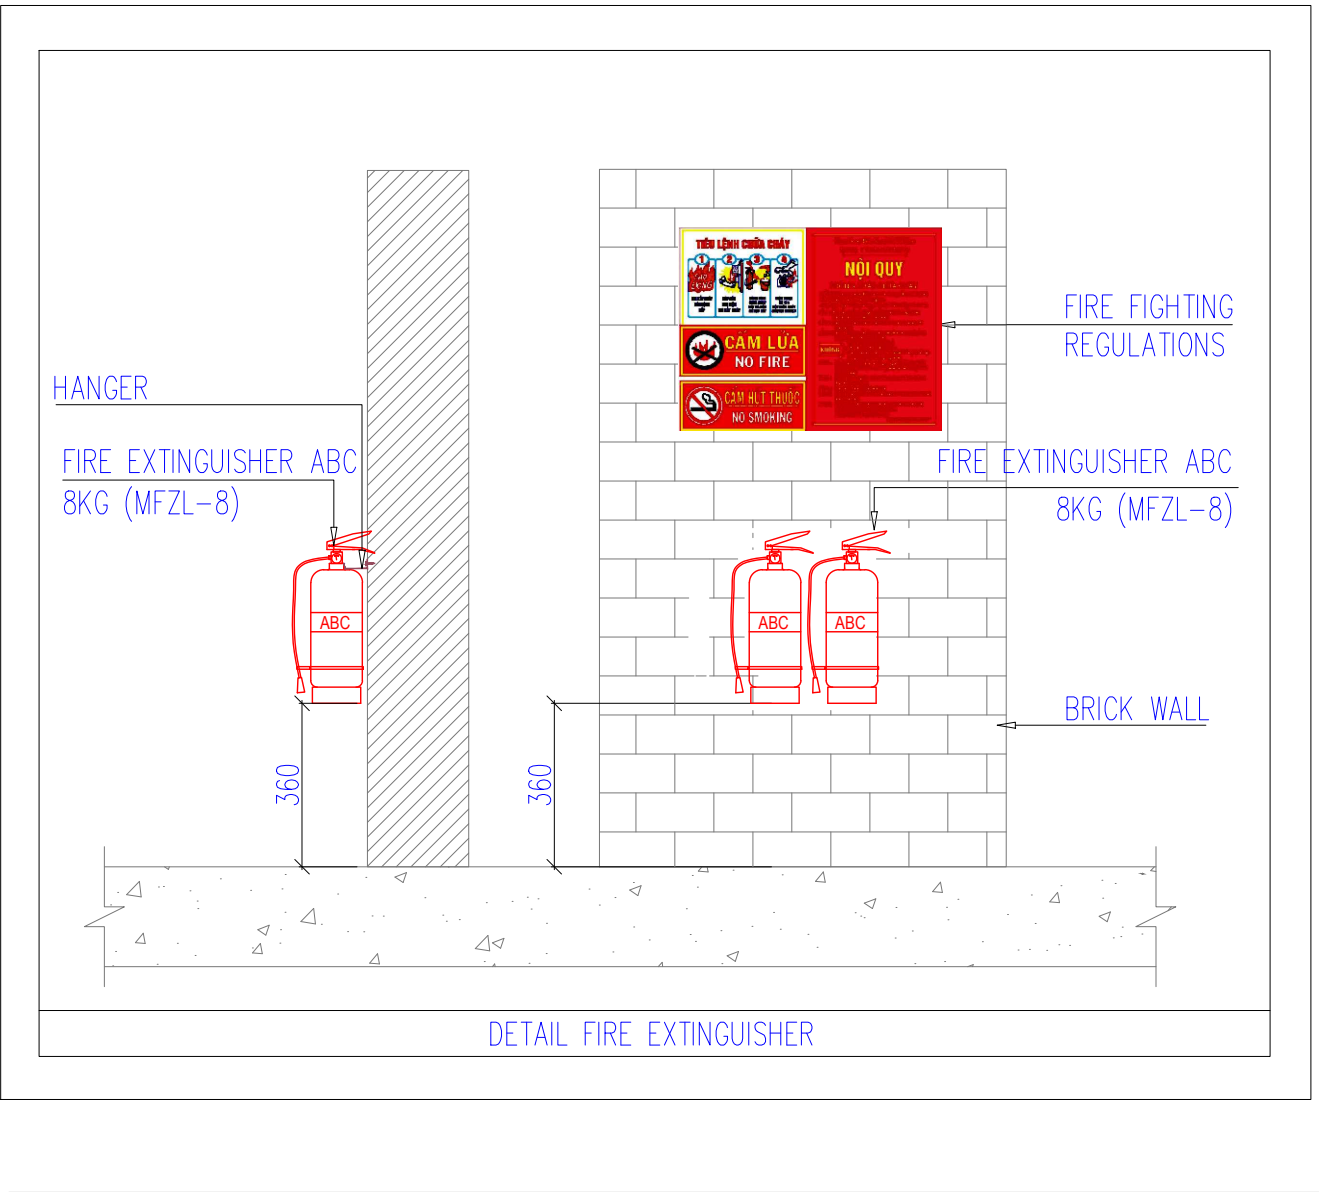

	PURCHASER : POWER PROJECTS MANAGEMENT BOARD NO. 2 - BRANCH OF VIETNAM ELECTRICITY EVNPMB2)																																															
	ANDRITZ HYDRO GmbH & 3 C INCORPORATION																																															
PROJECT : ITALY HYDRO POWER PLANT EXTENSION (2X180MW) PACKAGE- NO.40 TB-01 (VIETNAM)																																																
<table border="1"> <tr> <td colspan="2">A INITIAL SUBMISSION</td> <td>06-JAN-2024</td> <td>NK</td> <td>JCP</td> <td>BRS</td> <td>JCP</td> </tr> <tr> <td>Index</td> <td>Revising Modification</td> <td>Datum Date</td> <td>Revised by</td> <td>Checked by</td> <td>Checked by</td> <td>Checked by</td> </tr> <tr> <td colspan="3">Stückliste/Partlist</td> <td colspan="4">WA Nr.</td> </tr> <tr> <td colspan="3">Abmess./Dimension</td> <td colspan="4">Klassen Nr.</td> </tr> <tr> <td colspan="3">Gruppe/Group</td> <td colspan="4">Type</td> </tr> <tr> <td colspan="3"></td> <td colspan="4">Mod/Tab/Scale</td> </tr> </table>							A INITIAL SUBMISSION		06-JAN-2024	NK	JCP	BRS	JCP	Index	Revising Modification	Datum Date	Revised by	Checked by	Checked by	Checked by	Stückliste/Partlist			WA Nr.				Abmess./Dimension			Klassen Nr.				Gruppe/Group			Type							Mod/Tab/Scale			
A INITIAL SUBMISSION		06-JAN-2024	NK	JCP	BRS	JCP																																										
Index	Revising Modification	Datum Date	Revised by	Checked by	Checked by	Checked by																																										
Stückliste/Partlist			WA Nr.																																													
Abmess./Dimension			Klassen Nr.																																													
Gruppe/Group			Type																																													
			Mod/Tab/Scale																																													
<table border="1"> <tr> <td colspan="3"> PORTABLE FIRE EXTINGUISHER SYSTEM LAYOUT </td> <td colspan="2"> Gewicht/Weight = </td> <td colspan="2"> Material + </td> </tr> <tr> <td>HAU</td> <td>Datum/Date</td> <td>Name</td> <td colspan="2">Kunde/Cliet: POWER PROJECTS MANAGEMENT BOARD NO. 2 (EVNPMB2)</td> <td colspan="2">Schutzvermerk</td> </tr> <tr> <td>Gez./Drawn</td> <td>24.12.2022</td> <td>NK</td> <td colspan="2">Anlage/Plant: ITALY HYDRO POWER PLANT EXTENSION</td> <td colspan="2">ISO 18016 beachten</td> </tr> <tr> <td>Gepr./Checked</td> <td>24.12.2022</td> <td>JCP</td> <td colspan="2">Projekt/Project: N° 24-ALYWR/2022/H0-A02-AH-3C</td> <td colspan="2">Refer to protection notice ISO 18016</td> </tr> <tr> <td>Gepr./Checked</td> <td>24.12.2022</td> <td>BRS</td> <td colspan="2">Vertr./Contract: N° 24-ALYWR/2022/H0-A02-AH-3C</td> <td colspan="2">Änder./Similar</td> </tr> <tr> <td>Genehm./Appr.</td> <td>24.12.2022</td> <td>JCP</td> <td colspan="2">File</td> <td colspan="2">Ers./Replace</td> </tr> </table>							PORTABLE FIRE EXTINGUISHER SYSTEM LAYOUT			Gewicht/Weight =		Material +		HAU	Datum/Date	Name	Kunde/Cliet: POWER PROJECTS MANAGEMENT BOARD NO. 2 (EVNPMB2)		Schutzvermerk		Gez./Drawn	24.12.2022	NK	Anlage/Plant: ITALY HYDRO POWER PLANT EXTENSION		ISO 18016 beachten		Gepr./Checked	24.12.2022	JCP	Projekt/Project: N° 24-ALYWR/2022/H0-A02-AH-3C		Refer to protection notice ISO 18016		Gepr./Checked	24.12.2022	BRS	Vertr./Contract: N° 24-ALYWR/2022/H0-A02-AH-3C		Änder./Similar		Genehm./Appr.	24.12.2022	JCP	File		Ers./Replace	
PORTABLE FIRE EXTINGUISHER SYSTEM LAYOUT			Gewicht/Weight =		Material +																																											
HAU	Datum/Date	Name	Kunde/Cliet: POWER PROJECTS MANAGEMENT BOARD NO. 2 (EVNPMB2)		Schutzvermerk																																											
Gez./Drawn	24.12.2022	NK	Anlage/Plant: ITALY HYDRO POWER PLANT EXTENSION		ISO 18016 beachten																																											
Gepr./Checked	24.12.2022	JCP	Projekt/Project: N° 24-ALYWR/2022/H0-A02-AH-3C		Refer to protection notice ISO 18016																																											
Gepr./Checked	24.12.2022	BRS	Vertr./Contract: N° 24-ALYWR/2022/H0-A02-AH-3C		Änder./Similar																																											
Genehm./Appr.	24.12.2022	JCP	File		Ers./Replace																																											
			Intake W/Interna N° XXXX		= +																																											
			Zeichnungs N°/Drawing N° ITALY-P40-AH-300-LAY-SGA-DG-1932-DI		Index A																																											
					Bl./Shit: 11 von/vf: 11 AT																																											