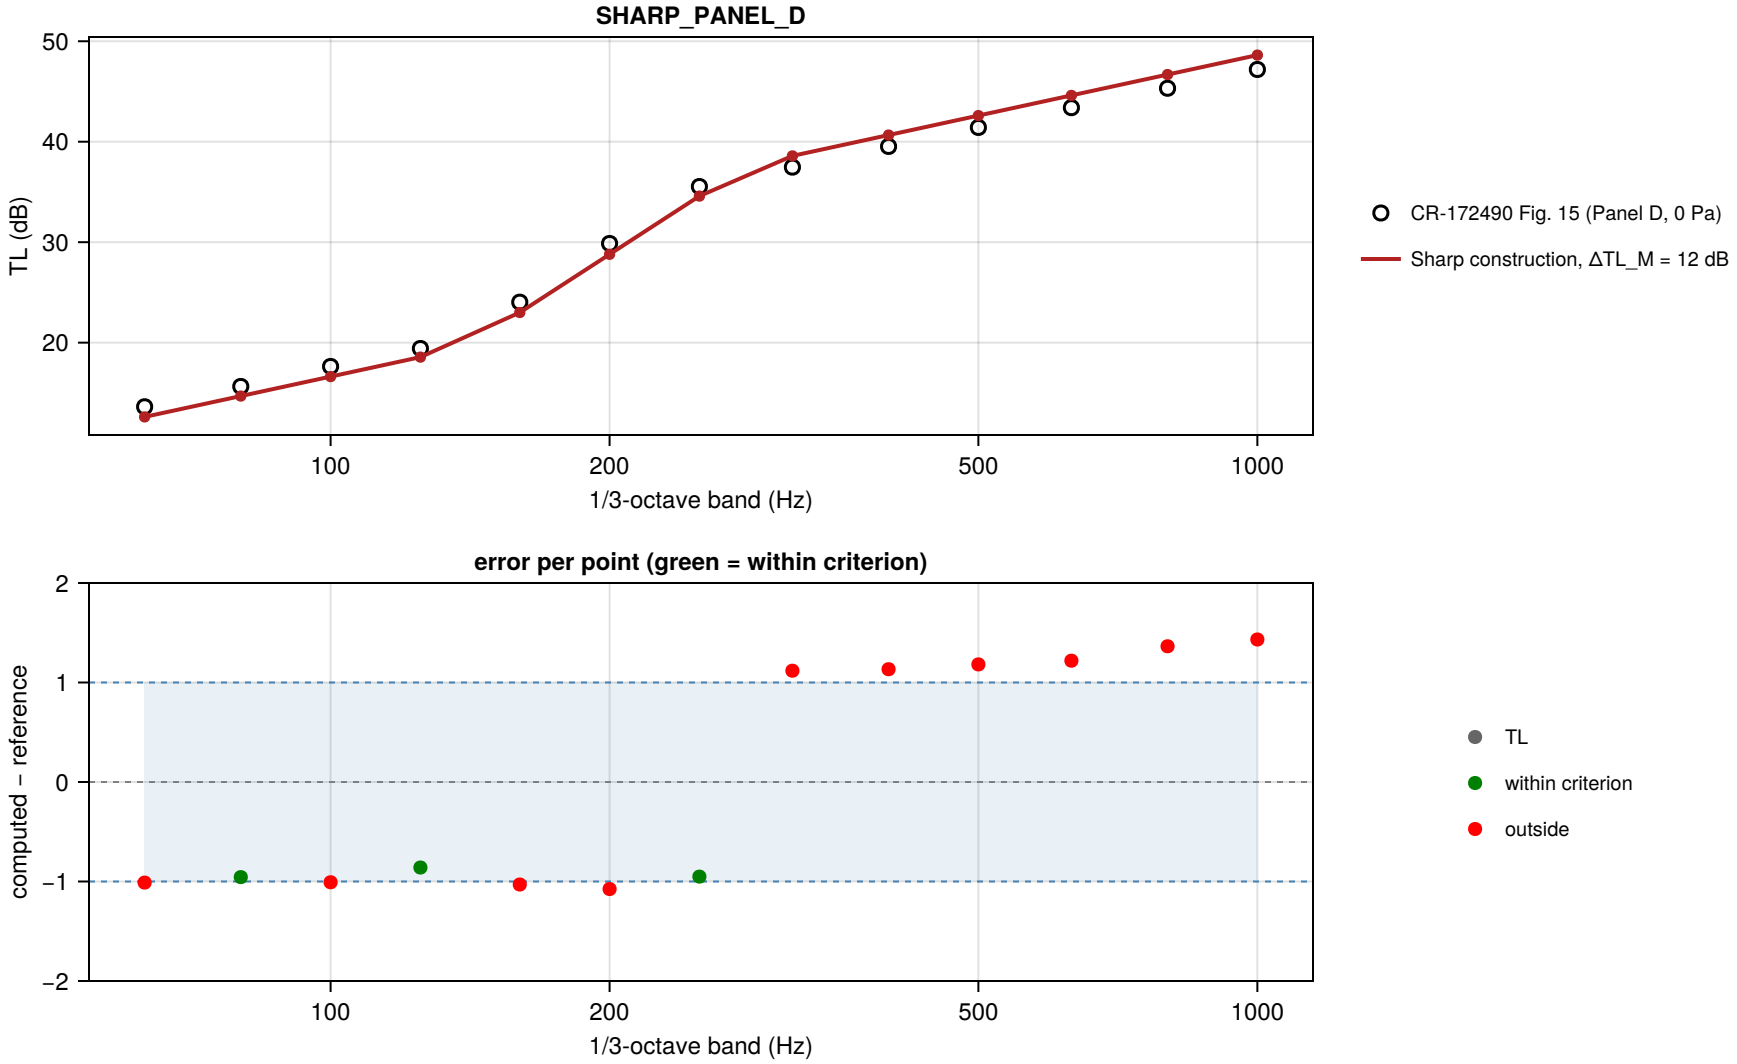
SHARP_PANEL_D
TL (dB)
50
40
30
20
100
200
500
1000
1/3-octave band (Hz)
CR-172490 Fig. 15 (Panel D, 0 Pa)
Sharp construction, ΔTL_M = 12 dB
error per point (green = within criterion)
computed − reference
2
1
0
−1
−2
100
200
500
1000
1/3-octave band (Hz)
TL
within criterion
outside