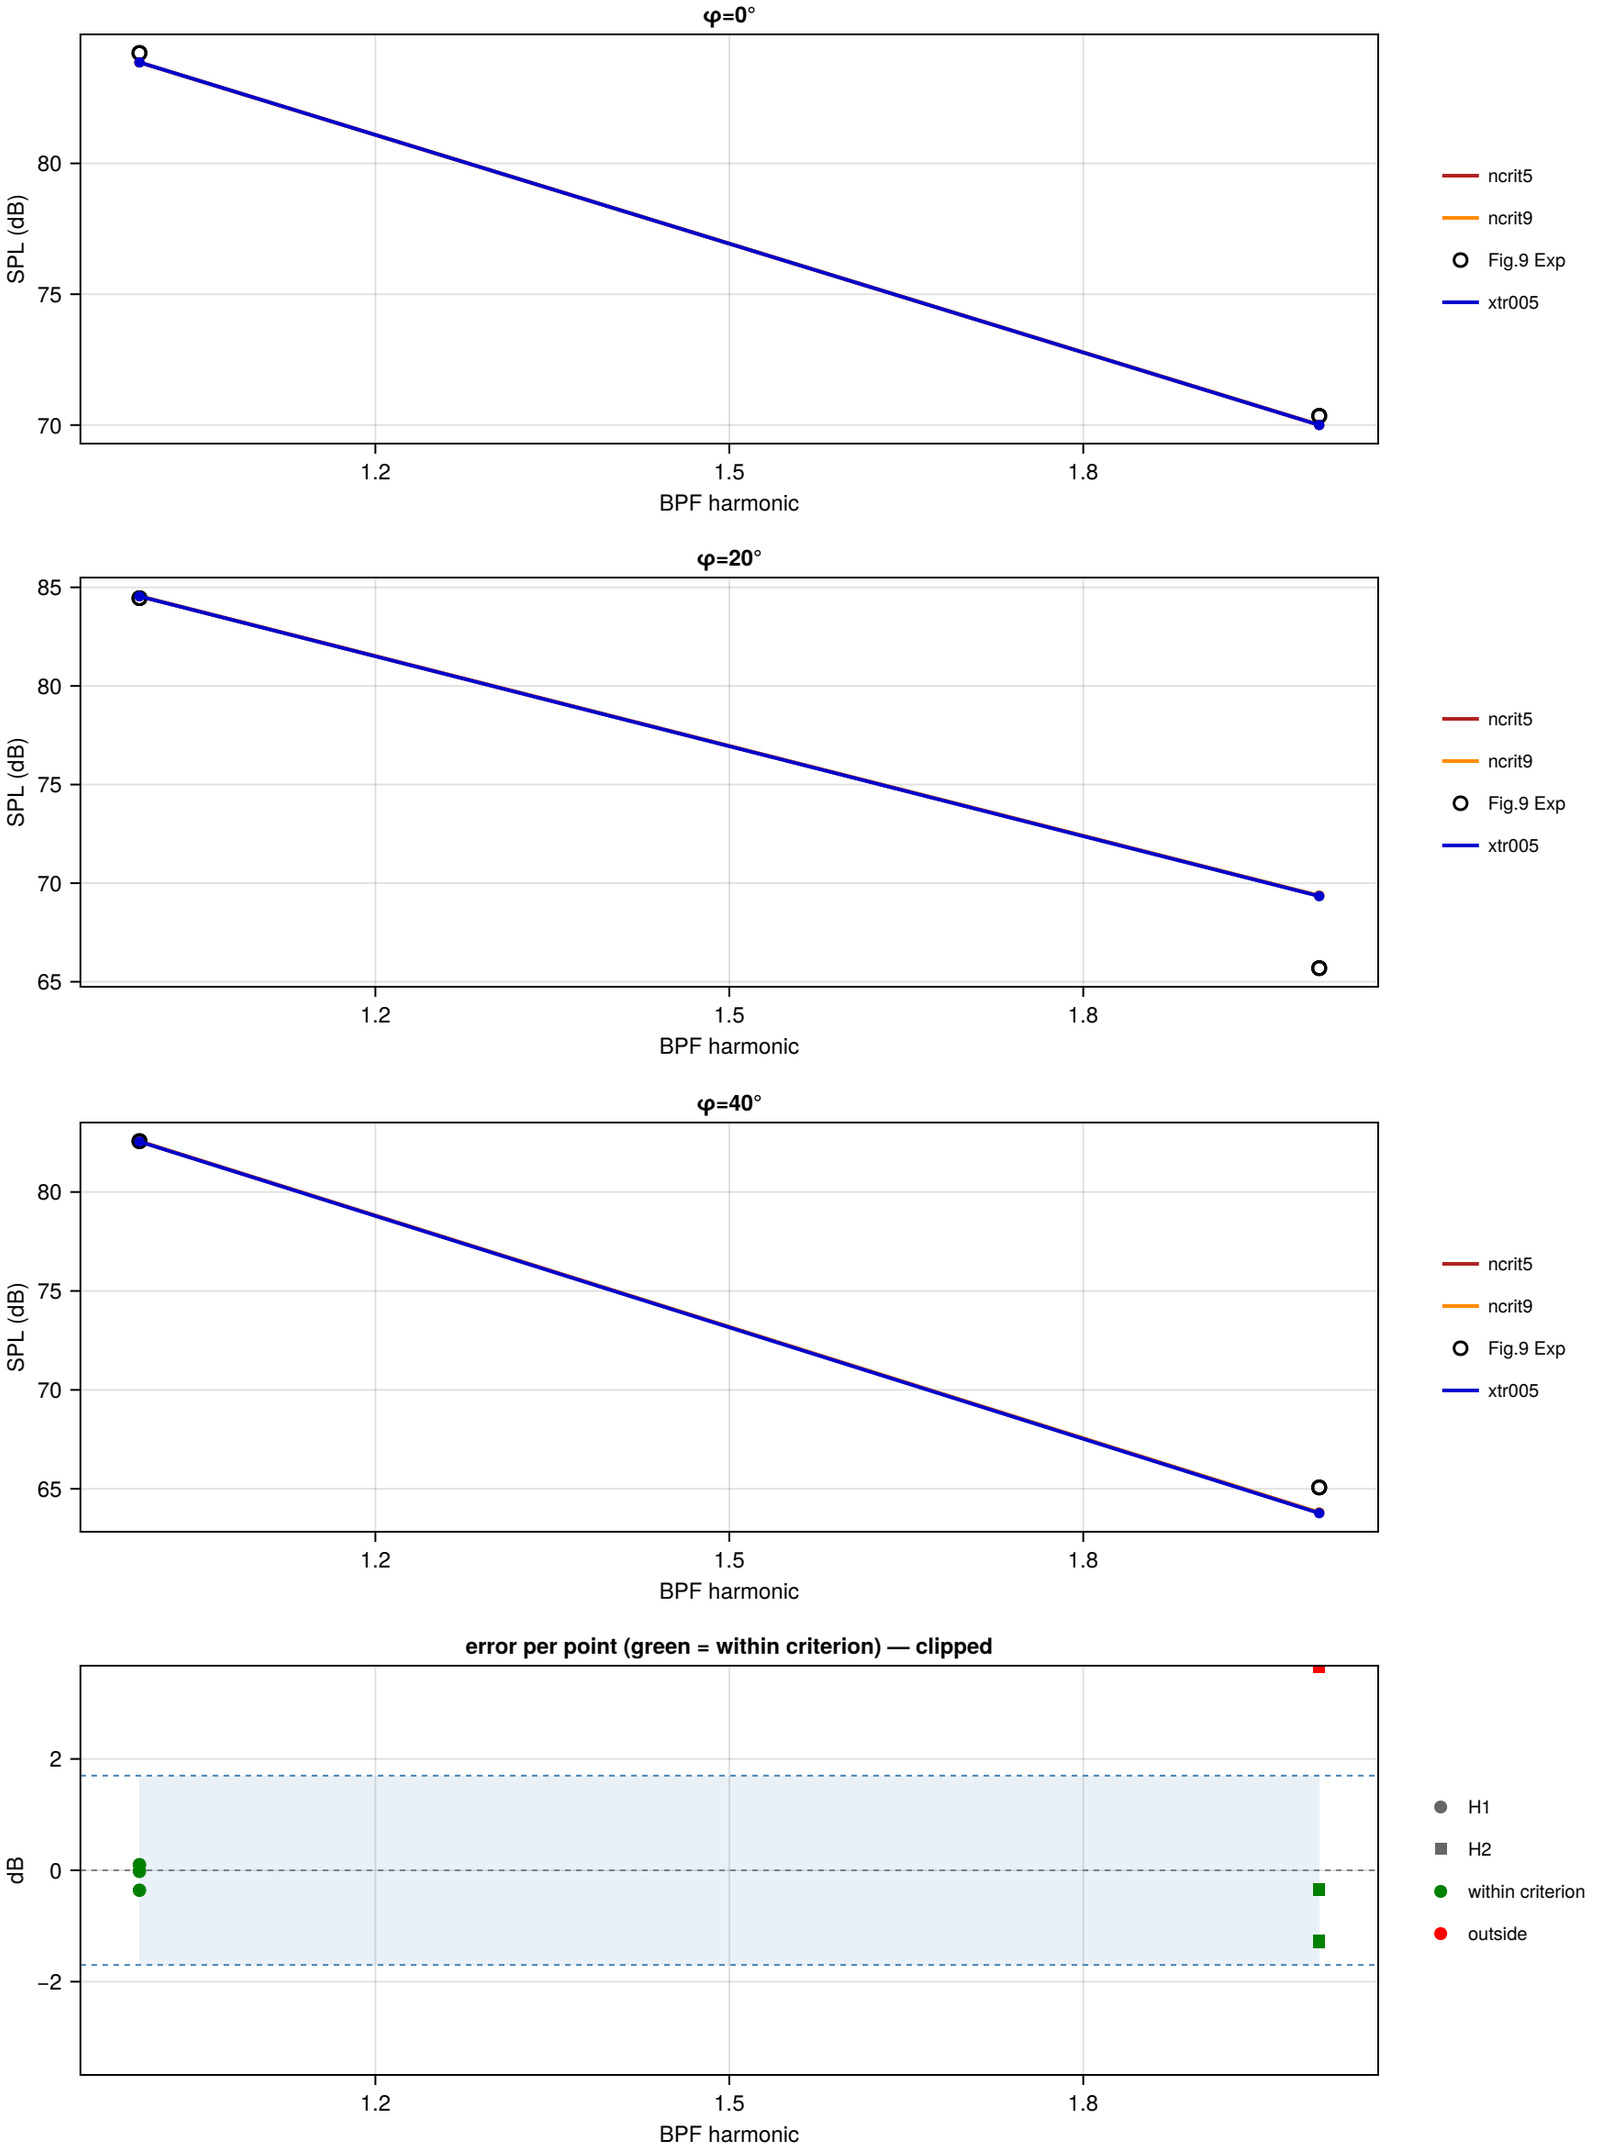
φ=0°
SPL (dB)
80
75
70
1.2
1.5
1.8
BPF harmonic
ncrit5
ncrit9
Fig.9 Exp
xtr005
φ=20°
SPL (dB)
85
80
75
70
65
1.2
1.5
1.8
BPF harmonic
ncrit5
ncrit9
Fig.9 Exp
xtr005
φ=40°
SPL (dB)
80
75
70
65
1.2
1.5
1.8
BPF harmonic
ncrit5
ncrit9
Fig.9 Exp
xtr005
error per point (green = within criterion) — clipped
dB
2
0
−2
1.2
1.5
1.8
BPF harmonic
H1
H2
within criterion
outside