



AutoScope Corporation
P.O. Box 2560 Mesa, Arizona 85114-2560 U.S.A.
Phone 602/947-2881 Fax 602/947-2881

REVISION	REV 1	DATE	10/1/88
BY	KAY	6/22/94	
DESCRIPTION	OBSERVATORY INPUT / OUTPUT		
DCS-200	DCS-53	DCS-53	3.0

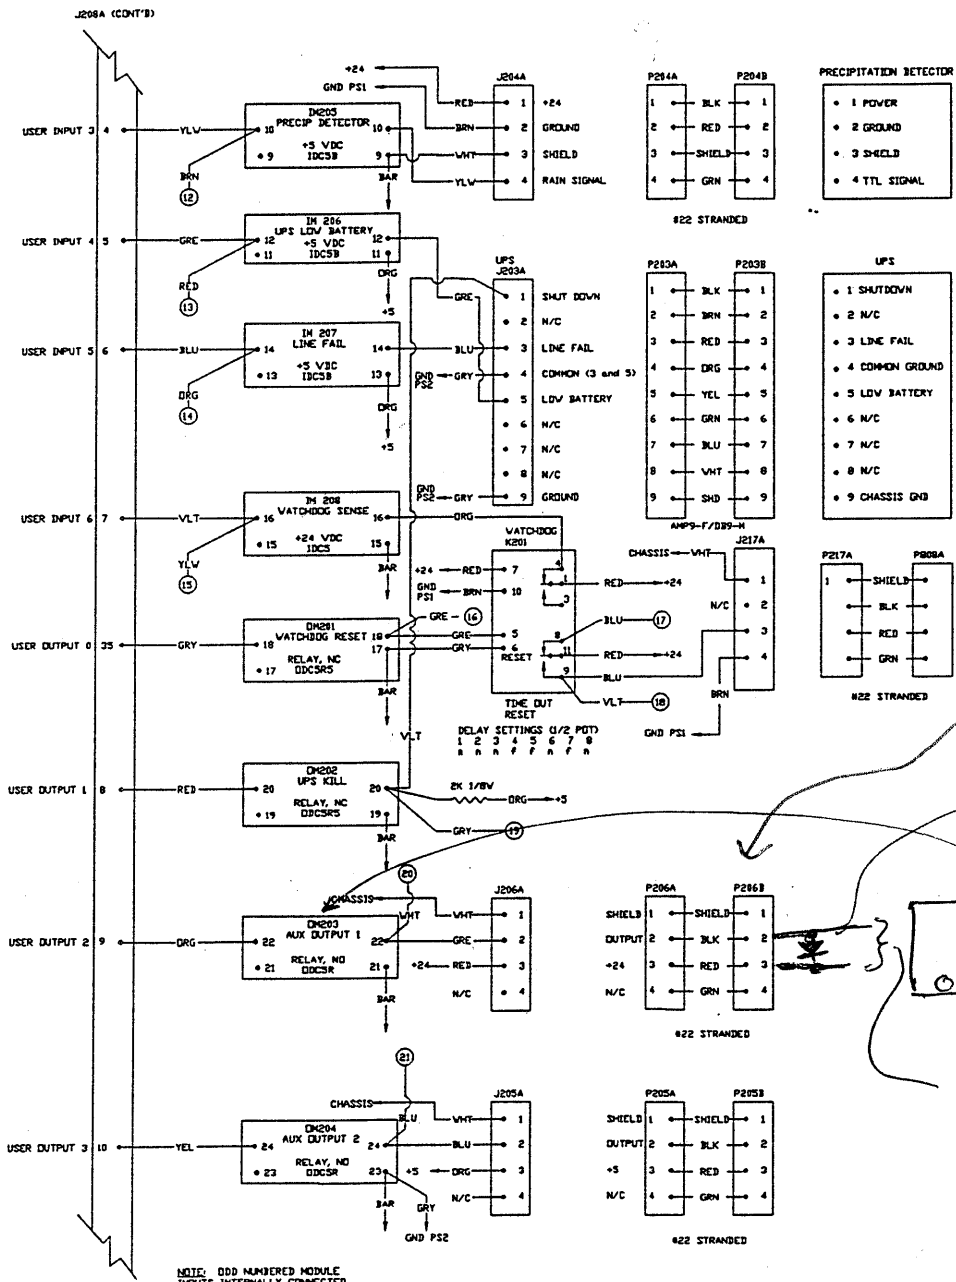


bl 3 commands
bl 3 Aux 1
IN 4003 or similar
which is
plugged into
04
TO SOLENOID COIL





NOTE: ODD NUMBERED MODULE
INPUTS INTERNALLY CONNECTED

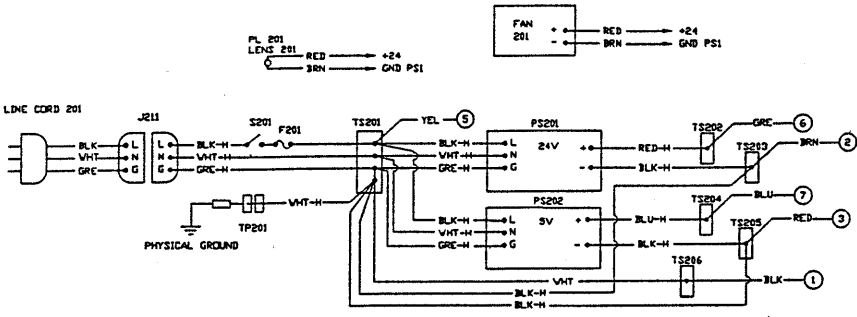

J208A (CONT'D)

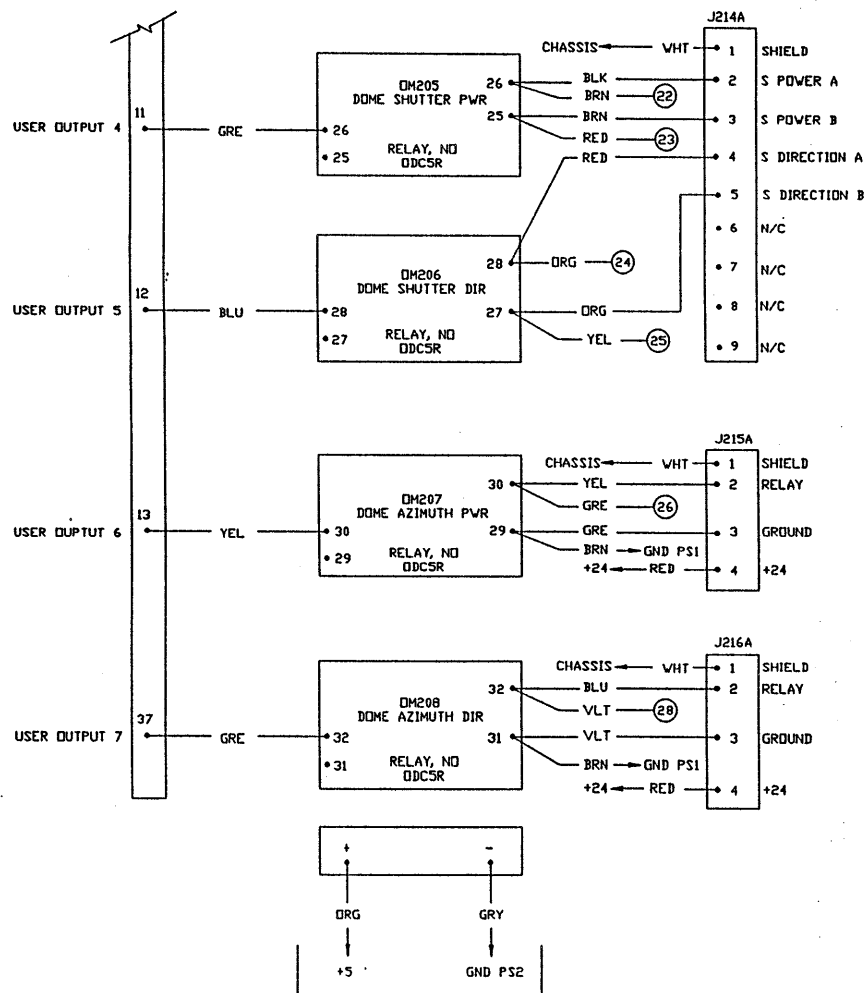


NOTE: ODD NUMBERED INPUTS
INTERNALLY CONNECTED

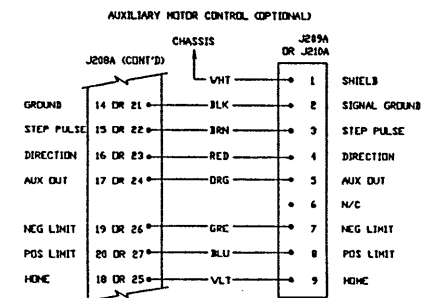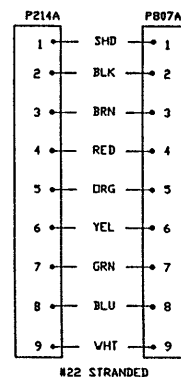


AutoScope Corporation
 p.o. box 2560 mesa, arizona 85214-2560 u.s.a.
 phone 602/997-9902 fax 602/997-9901

REVISION	REVISION DATE	PROJECT NAME	PROJECT NUMBER	REVISION NUMBER
KHV	08.03.94	DCS-200		NONE
DOME AZIMUTH / SHUTTER CONTROL			DCS-34	3.0

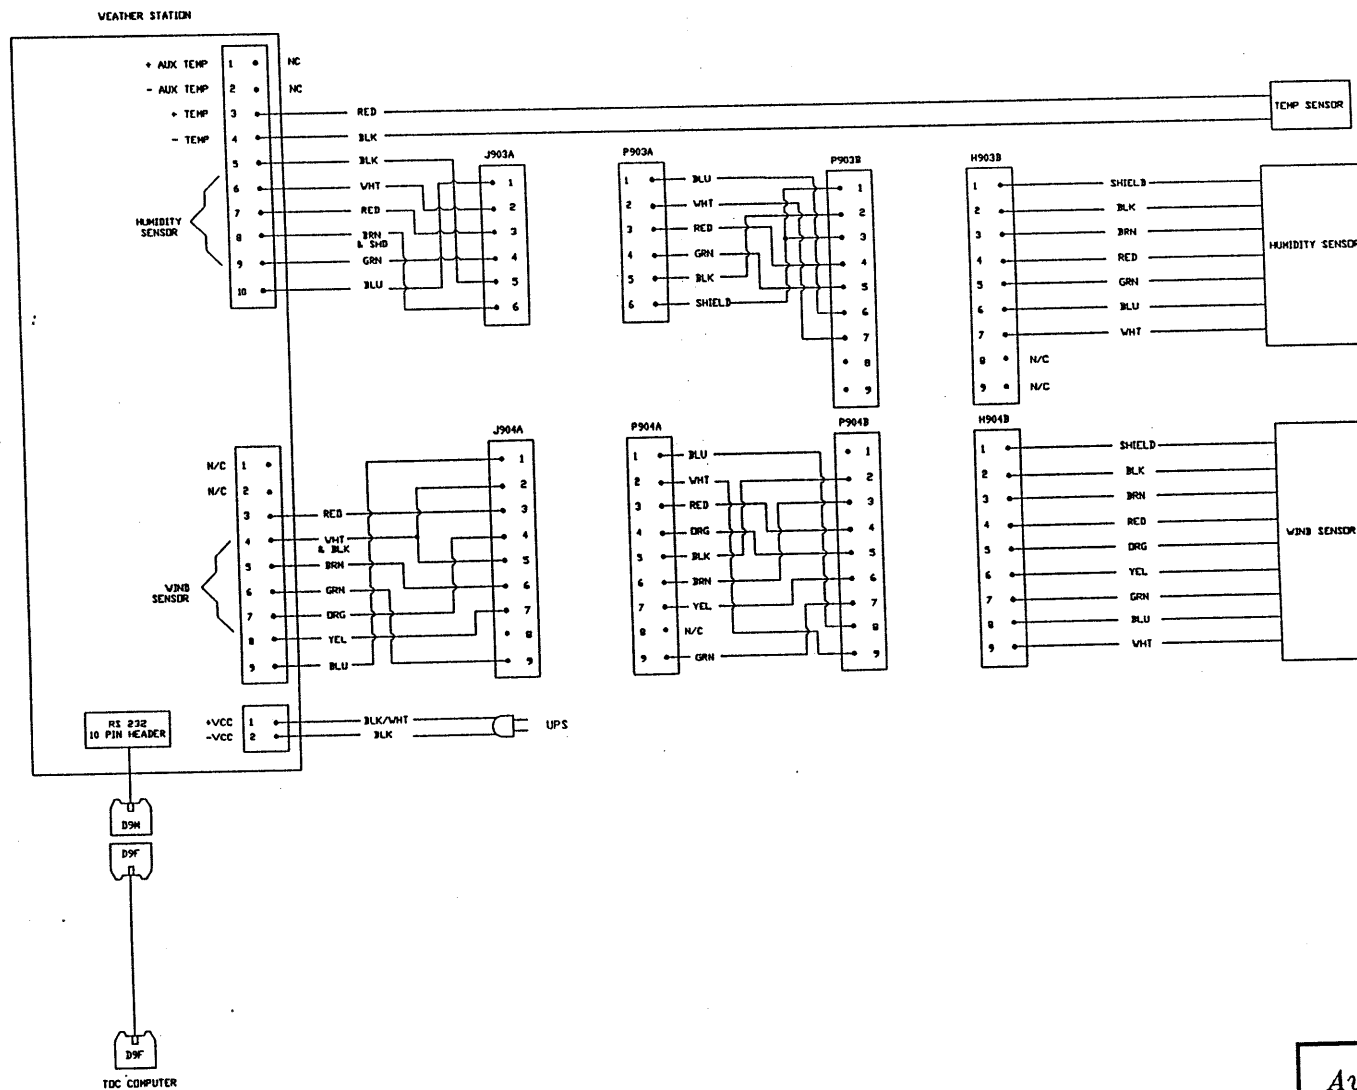

AutoScope Corporation
 p.o. box 2560 mesa, arizona 85214-2560 U.S.A.
 phone 602/497-9802 fax 602/497-9801

REV	REV DATE	REV BY	REV DATE	REV BY	REV DATE
KHV	08.03.94		DCS-200		NONE
WEATHER SENSORS			DCS-55		3.0

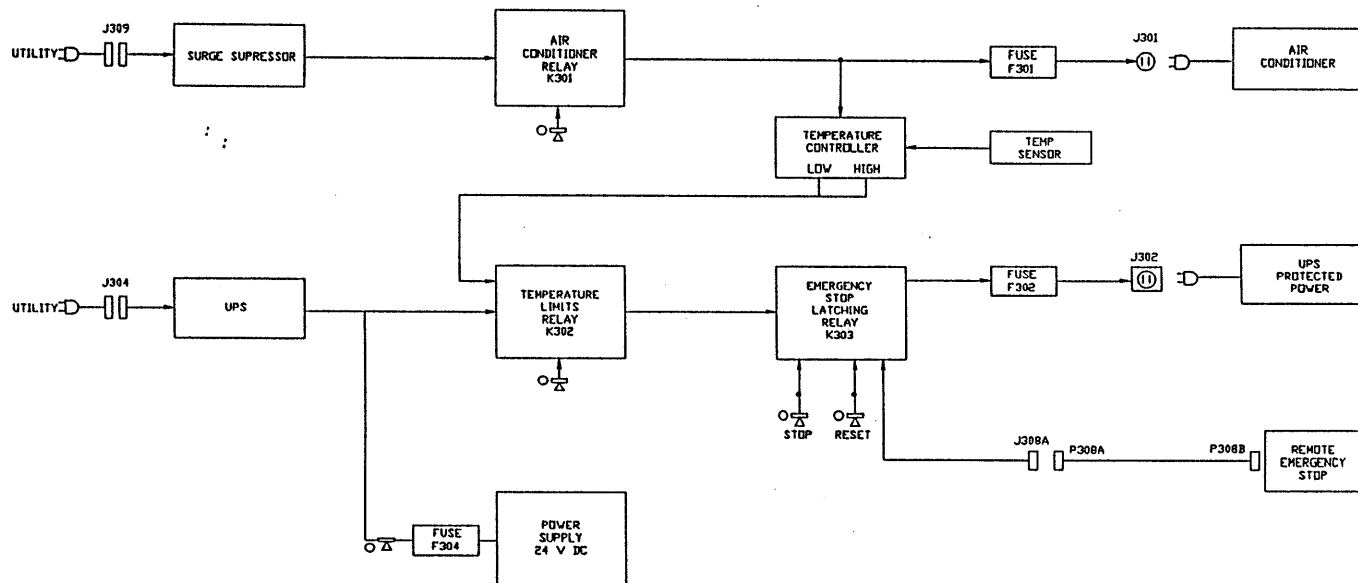

J307A		
1	BLK	1 CHASSIS
2	BRN	2 GROUND PSI
3	RED	3 24 V DC
4	ORG	4 LINE IN
5	YEL	5 NEUTRAL IN
6	GRE	6 GROUND IN
7	BLU	7 AIR BF FUSE
8	VLT	8 AIR AFTER FUSE
9	GRY	9 AIR RELAY COIL
	NC	10 UNUSED
	NC	11 UNUSED
	NC	12 UNUSED
	NC	13 UNUSED
14	ORG	14 SP2 TEMP ON
15	YEL	15 SP2 TEMP OFF
16	GRE	16 SP2 TEMP COM
17	BLU	17 TEMP LIMIT COIL
18	VLT	18 TEMP-LIMIT AC UNUSED
19	GRY	19 UPS AC IN
20	VHT	20 UPS AC BF FUSE
21	BLK	21 UPS AC AFTER FUSE
	NC	22 UNUSED
	NC	23 UNUSED
24	ORG	24 RESET COIL
25	YEL	25 EMERGENCY STOP COIL
	NC	26 UNUSED
	NC	27 UNUSED
	NC	28 UNUSED
	NC	29 UNUSED
	NC	30 UNUSED
	NC	31 UNUSED
	NC	32 UNUSED
	NC	33 UNUSED
	NC	34 UNUSED
	NC	35 UNUSED
	NC	36 UNUSED
	NC	37 UNUSED

AutoScope Corporation
 p.o. box 2560 mesa, arizona 85214-2560 u.s.a.
 phone 602/997-8982 fax 602/997-9491

SECTION	PCB PART NO.	PCB PART NO.	PCB PART NO.
KHV	08.03.94	PCS-100	NONE
POWER SUPPLY	PCS-SI	3.0	

