


Work Instruction - Operations	HITACHI
CONTINGENCY PLAN (ALTERNATE SERVICE PLAN)	Hitachi Rail Honolulu JV

Plan No. 5	This plan handles a single-line blockage from East Kapolei Station to West Oahu Station
Terminus:	East Kapolei UP platform<->Aloha Station UP platform (default)

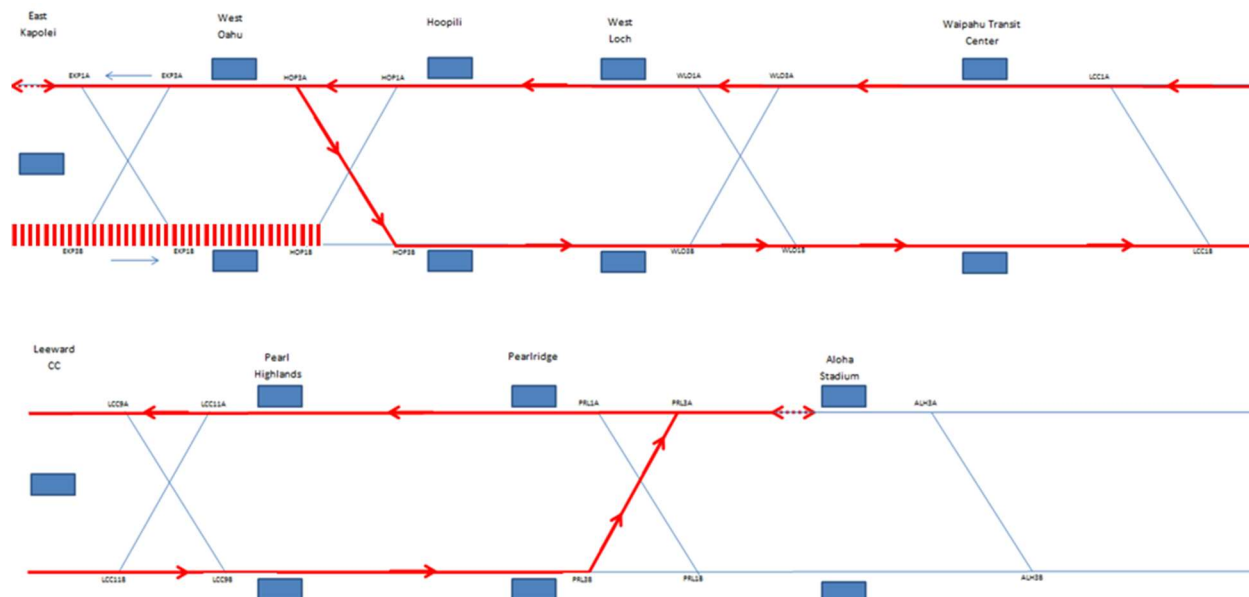

Additional Staff Requirements	
Station Operator(s)	1 to 2 additional staff required at both East Kapolei Station UP platform and West Oahu Station UP platform to assist passengers going eastbound / westbound

Staff Action	
Engineering & Fault Controller	<ul style="list-style-type: none"> Coordinate with maintainer to address the blockage
Maintainer	<ul style="list-style-type: none"> Send maintenance unit to the scene to address the blockage De-energize and isolate the blocked area from the running line
Train Controller	<ul style="list-style-type: none"> Set short turn back operation defined for this plan Set shuttle operation defined for this plan Remove excessive trains if required
OCC Supervisor	<ul style="list-style-type: none"> Request additional workforce for East Kapolei Station and West Oahu Station
Information Controller	<ul style="list-style-type: none"> Inform Station Operators at East Kapolei Station about the use of the UP platform only Inform Station Operators at West Oahu Station about the use of the UP platform only
Station Operator(s) at East Kapolei Station	<ul style="list-style-type: none"> Inform passengers to use the UP platform Assist passenger, monitor passenger flow, and prepare for crowd control
Station Operator(s) at West Oahu Station	<ul style="list-style-type: none"> Inform passengers to use the UP platform Assist passenger, monitor passenger flow, and prepare for crowd control

End of No. 5

Document Code	HNL-09421 Contingency Plan (Alternate Service Plan).01	Effective Date:	
File Name	HNL-09421.00.00-1-Contingency Plan (Alternate Service Plan)	Rev No. 01	Page 7 of 32