



Project Name:

testingAdxf

Client Name:

te

Capacity:

te



No description provided.

## **1. Basket screens**



## **2. Manual Screen**

## Sec01: General Data

Field	Value
Manufacturer	Ietos Factory
Service	Inlet Area
Fluid	Sewage
Operation	Manual
Quantity of Units	1
Country of Origin	Egypt

## Sec02: Design Data


Field	Value
Type	Bar Coarse Screen
Channel Depth	1500
Channel Width	400
Water Level	600
Bar Thickness	12
Bar Width	50
Bar Spacing	25
Inclination Degree	60°
Hand Rack Qty	2

## Sec03: Material Data

Field	Value
Frame	Stainless Steel 316
Bars	Stainless Steel 316
Rake Tube	Stainless Steel 316
Rake Plate	Stainless Steel 316



Bolts & Nuts	A4
--------------	----

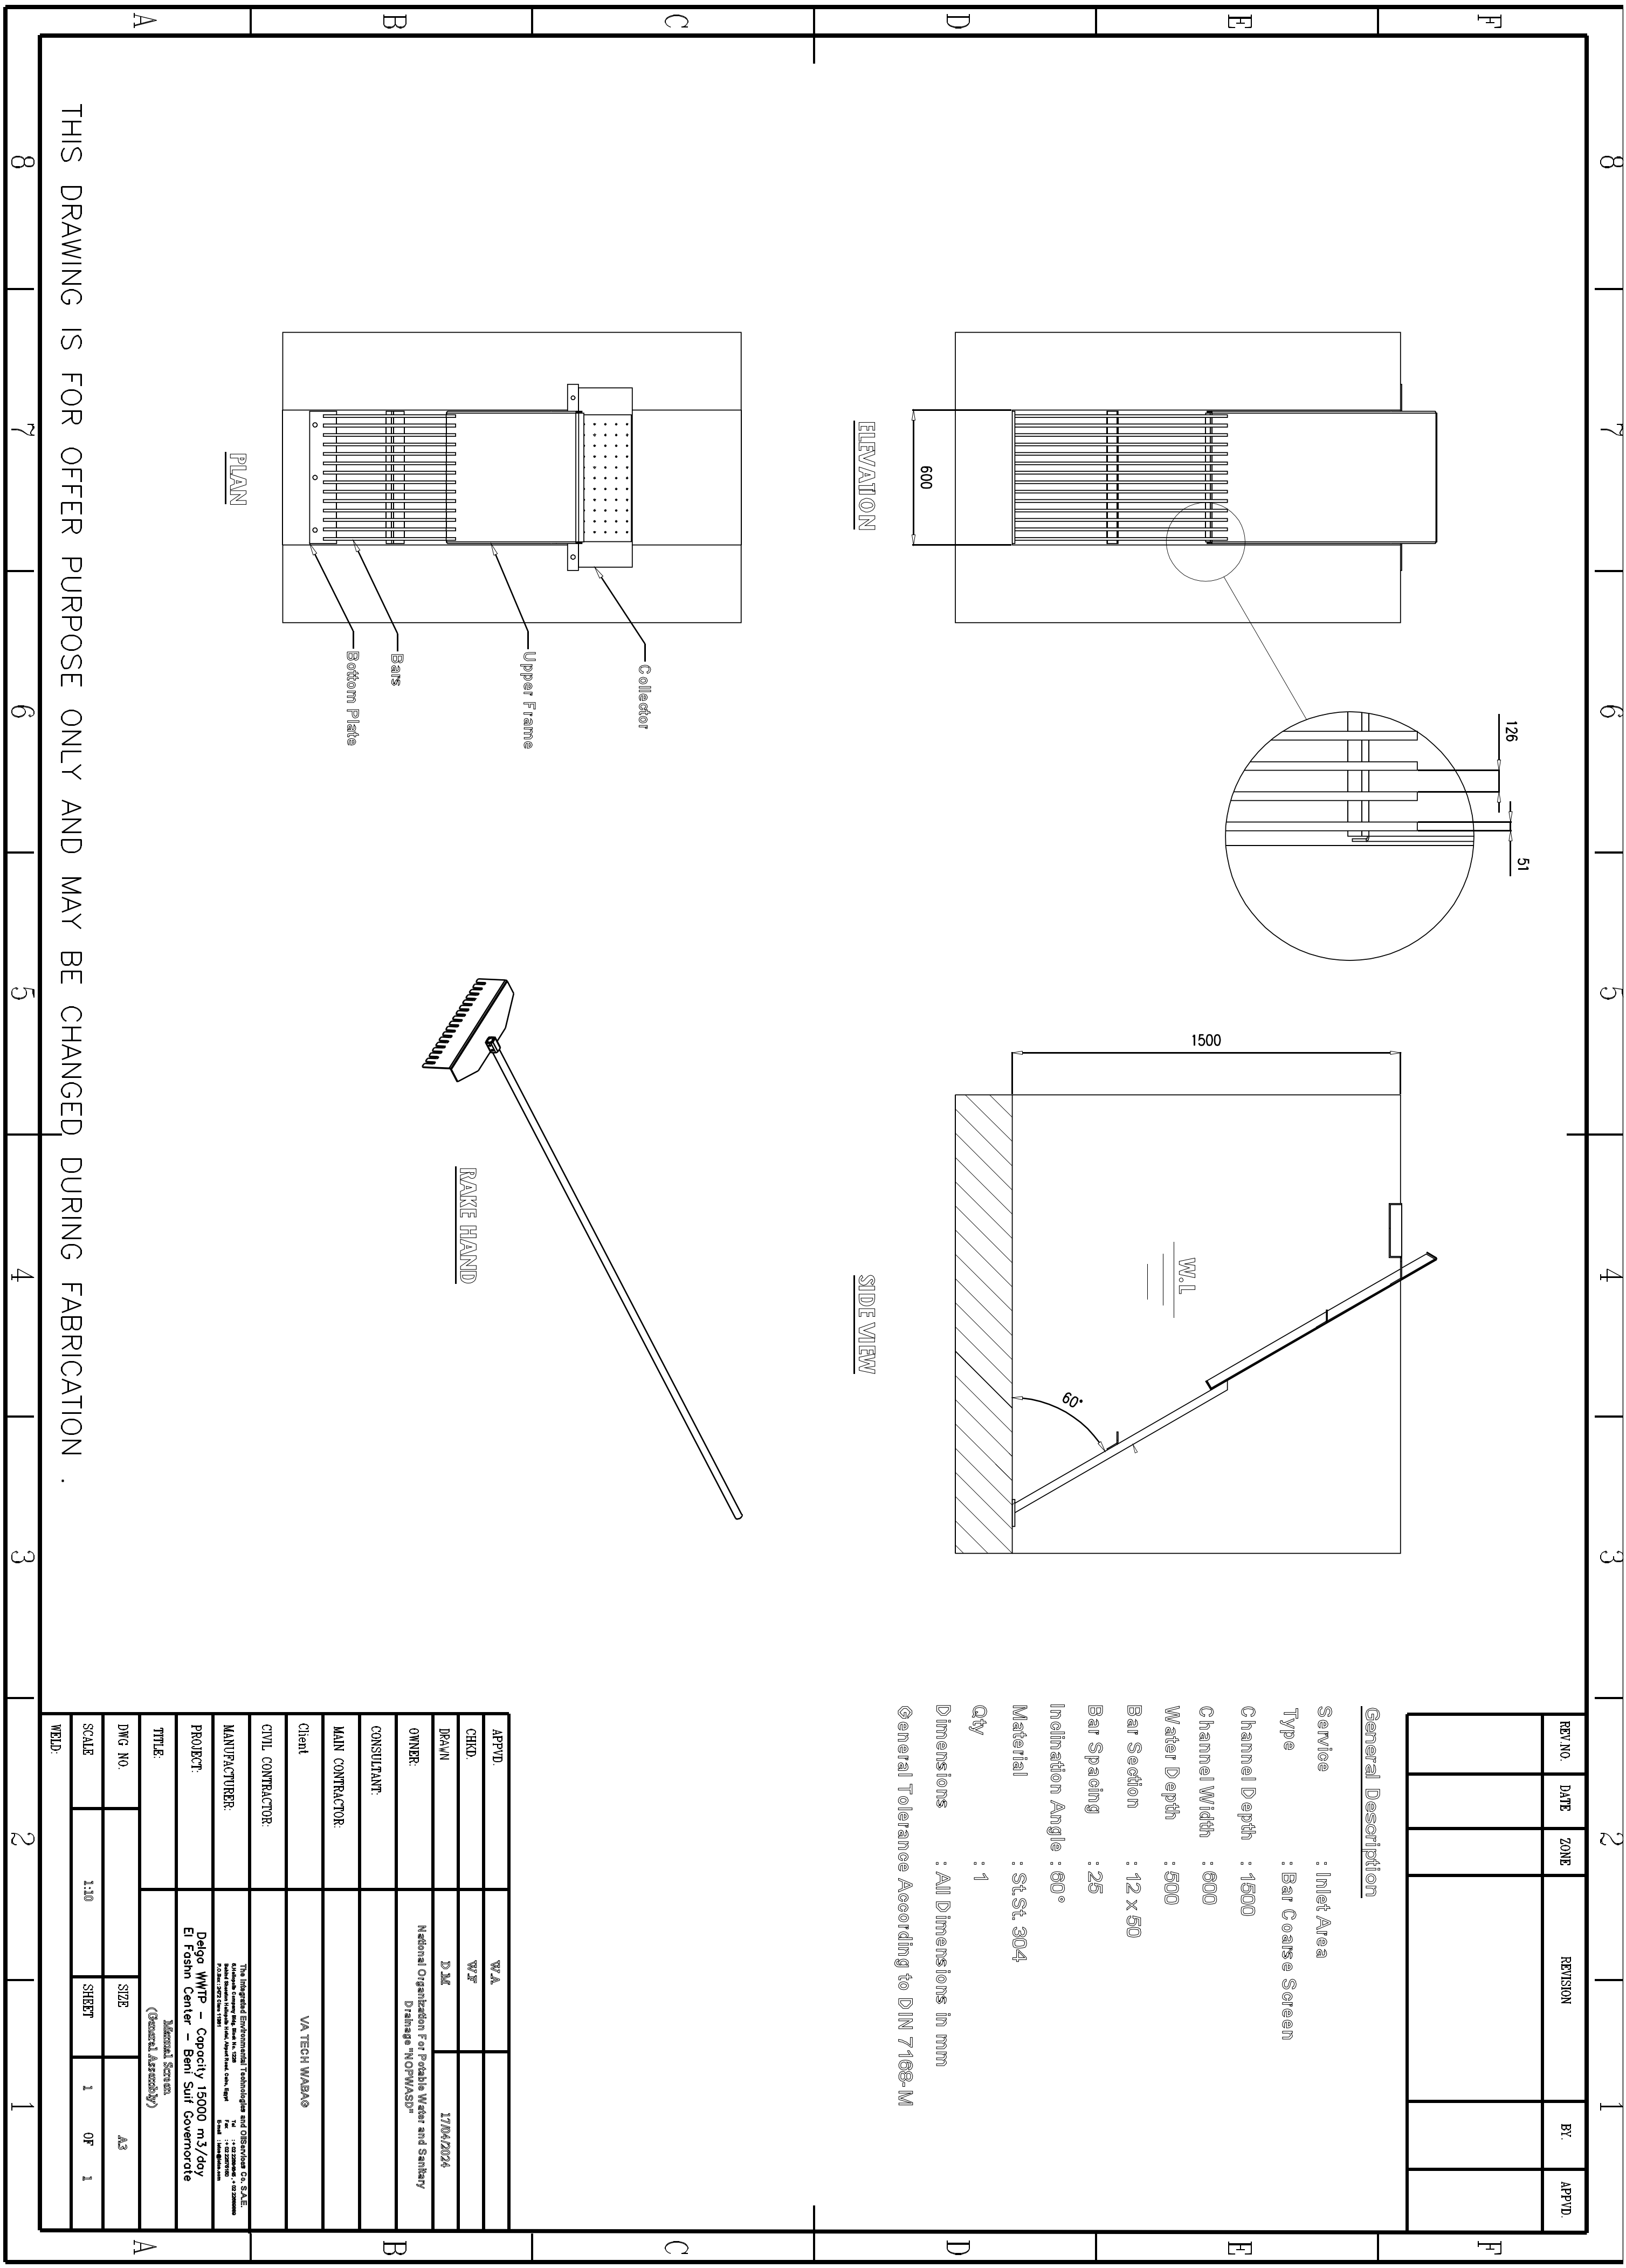

### **3. Belt Conveyor**



## Sec01: General Data

Field	Value
Manufacturer	Ietos Factory
Service	Screening Area
Fluid	Screening Disposals
Operation	Automatic & Manual
Quantity of Units	1
Country of Origin	Egypt

## Sec02: Design Data

Field	Value
Width	600
Length	3200 approx.
Belt Thickness	10
Mounting	Horizontal
Chute	Included

## Sec03: Gearbox Data

Field	Value
Type of drive	Gear Motor
Power	0.25
Power Supply	380/3/50
Driving Unit Service Factor	2
Motor Insulation Protection	IP 66
Isolation / Temp. Class	Class F/B
Gear Motor	Rossi/Bonfiglioli

#### Sec04: Motor Data

Field	Value
Frame	Hot Dip Galvanized Steel
Idlers	Coated Steel Unit
Belt	Triple-Ply Nylon Layer
Driving & Driven Drum Set	Coated Steel Unit
Belt Scraper	Rubber
Bolts & Nuts	A4

#### Sec05: Material Data

Field	Value
1. One set of bearing	Yes
2. Five rollers with accessories	Yes
3. One set of bearing for motor	Yes

REV. NO.	DATE	ZONE	REVISION	BY	APP'D.