



Project Name:

TESTING_A_0001

Client Name:

q

Capacity:

q



q



1. Gritremoval

Sec01: General Data

Field	Value
Manufacturer	Ietos Factory
Service	Grit & Grease Removal Tank
No of Channels per Bridge	One Channel
Fluid	Sewage
Operation	Automatic & Manual
Quantity of Units	1
Country of Origin	Egypt

Sec02: Design Data

Field	Value
Type	Longitudinal Scraper Bridge
Channel Length	750015312
Channel Depth	3190453543
Channel Width	250013512
Water Depth	2000
Bridge Length	2900 approx.
Walkway Width	750
Handrail Height	1000
Side Plate (Safety)	100
Scraper Height	300

Sec03: Walkway, Handrail, Wheel Data

Field	Value
Drive Wheel Quantity	4
Drive Wheel Diameter	Acc. To Design

Drive Wheel Material	Polyurethane Coated Carbon Steel 37
----------------------	-------------------------------------

Sec04: Scraper Data

Field	Value
Power	0.37
Power Supply	380 /3 /50
Driving Unit Service Factor	â‰¥ 2
Motor Insulation Protection	IP66
Isolation / Temp. Class	Class F/B

Sec05: Gearmotor Data

Field	Value
Power	0.18
Power Supply	380 /3 /50
Driving Unit Service Factor	â‰¥ 2
Motor Insulation Protection	IP65
Isolation / Temp. Class	Class F/B

Sec06: Scraper Data

Field	Value
Voltage	380
Phase	3
Frequency	50
Insulation Protection	IP 54
Panel Thickness	2

Sec07: Drive unit

Field	Value
-------	-------

Bridge structure	Hot dip galvanized steel 37
Grating	Hot dip galvanized steel 37
Hand railing	Hot dip galvanized steel 37
End carriage	Hot dip galvanized steel 37
Surface scraper	Stainless Steel 316


Sec08: Control panel Data

Field	Value
1. Two complete bottom scrapers for grit	Yes
2. Two complete scrapers for oil	Yes
3. Four wheels with Rubber tires	Yes
4. Two sets of bearings	Yes

REV. NO.	DATE	ZONE	REVISION	BY	APP'D.

General Description

Service	: Oil & Grease Removal Tank
Channel Width	: 2500 mm
Water depth	: 2000 mm
Type	: longitudinal Bridge
Bridge length	: 2300 Approx. mm
Walkway Width	: 750 mm
Handrail Height	: 1000 mm
Dimension	: All Dimension in mm.

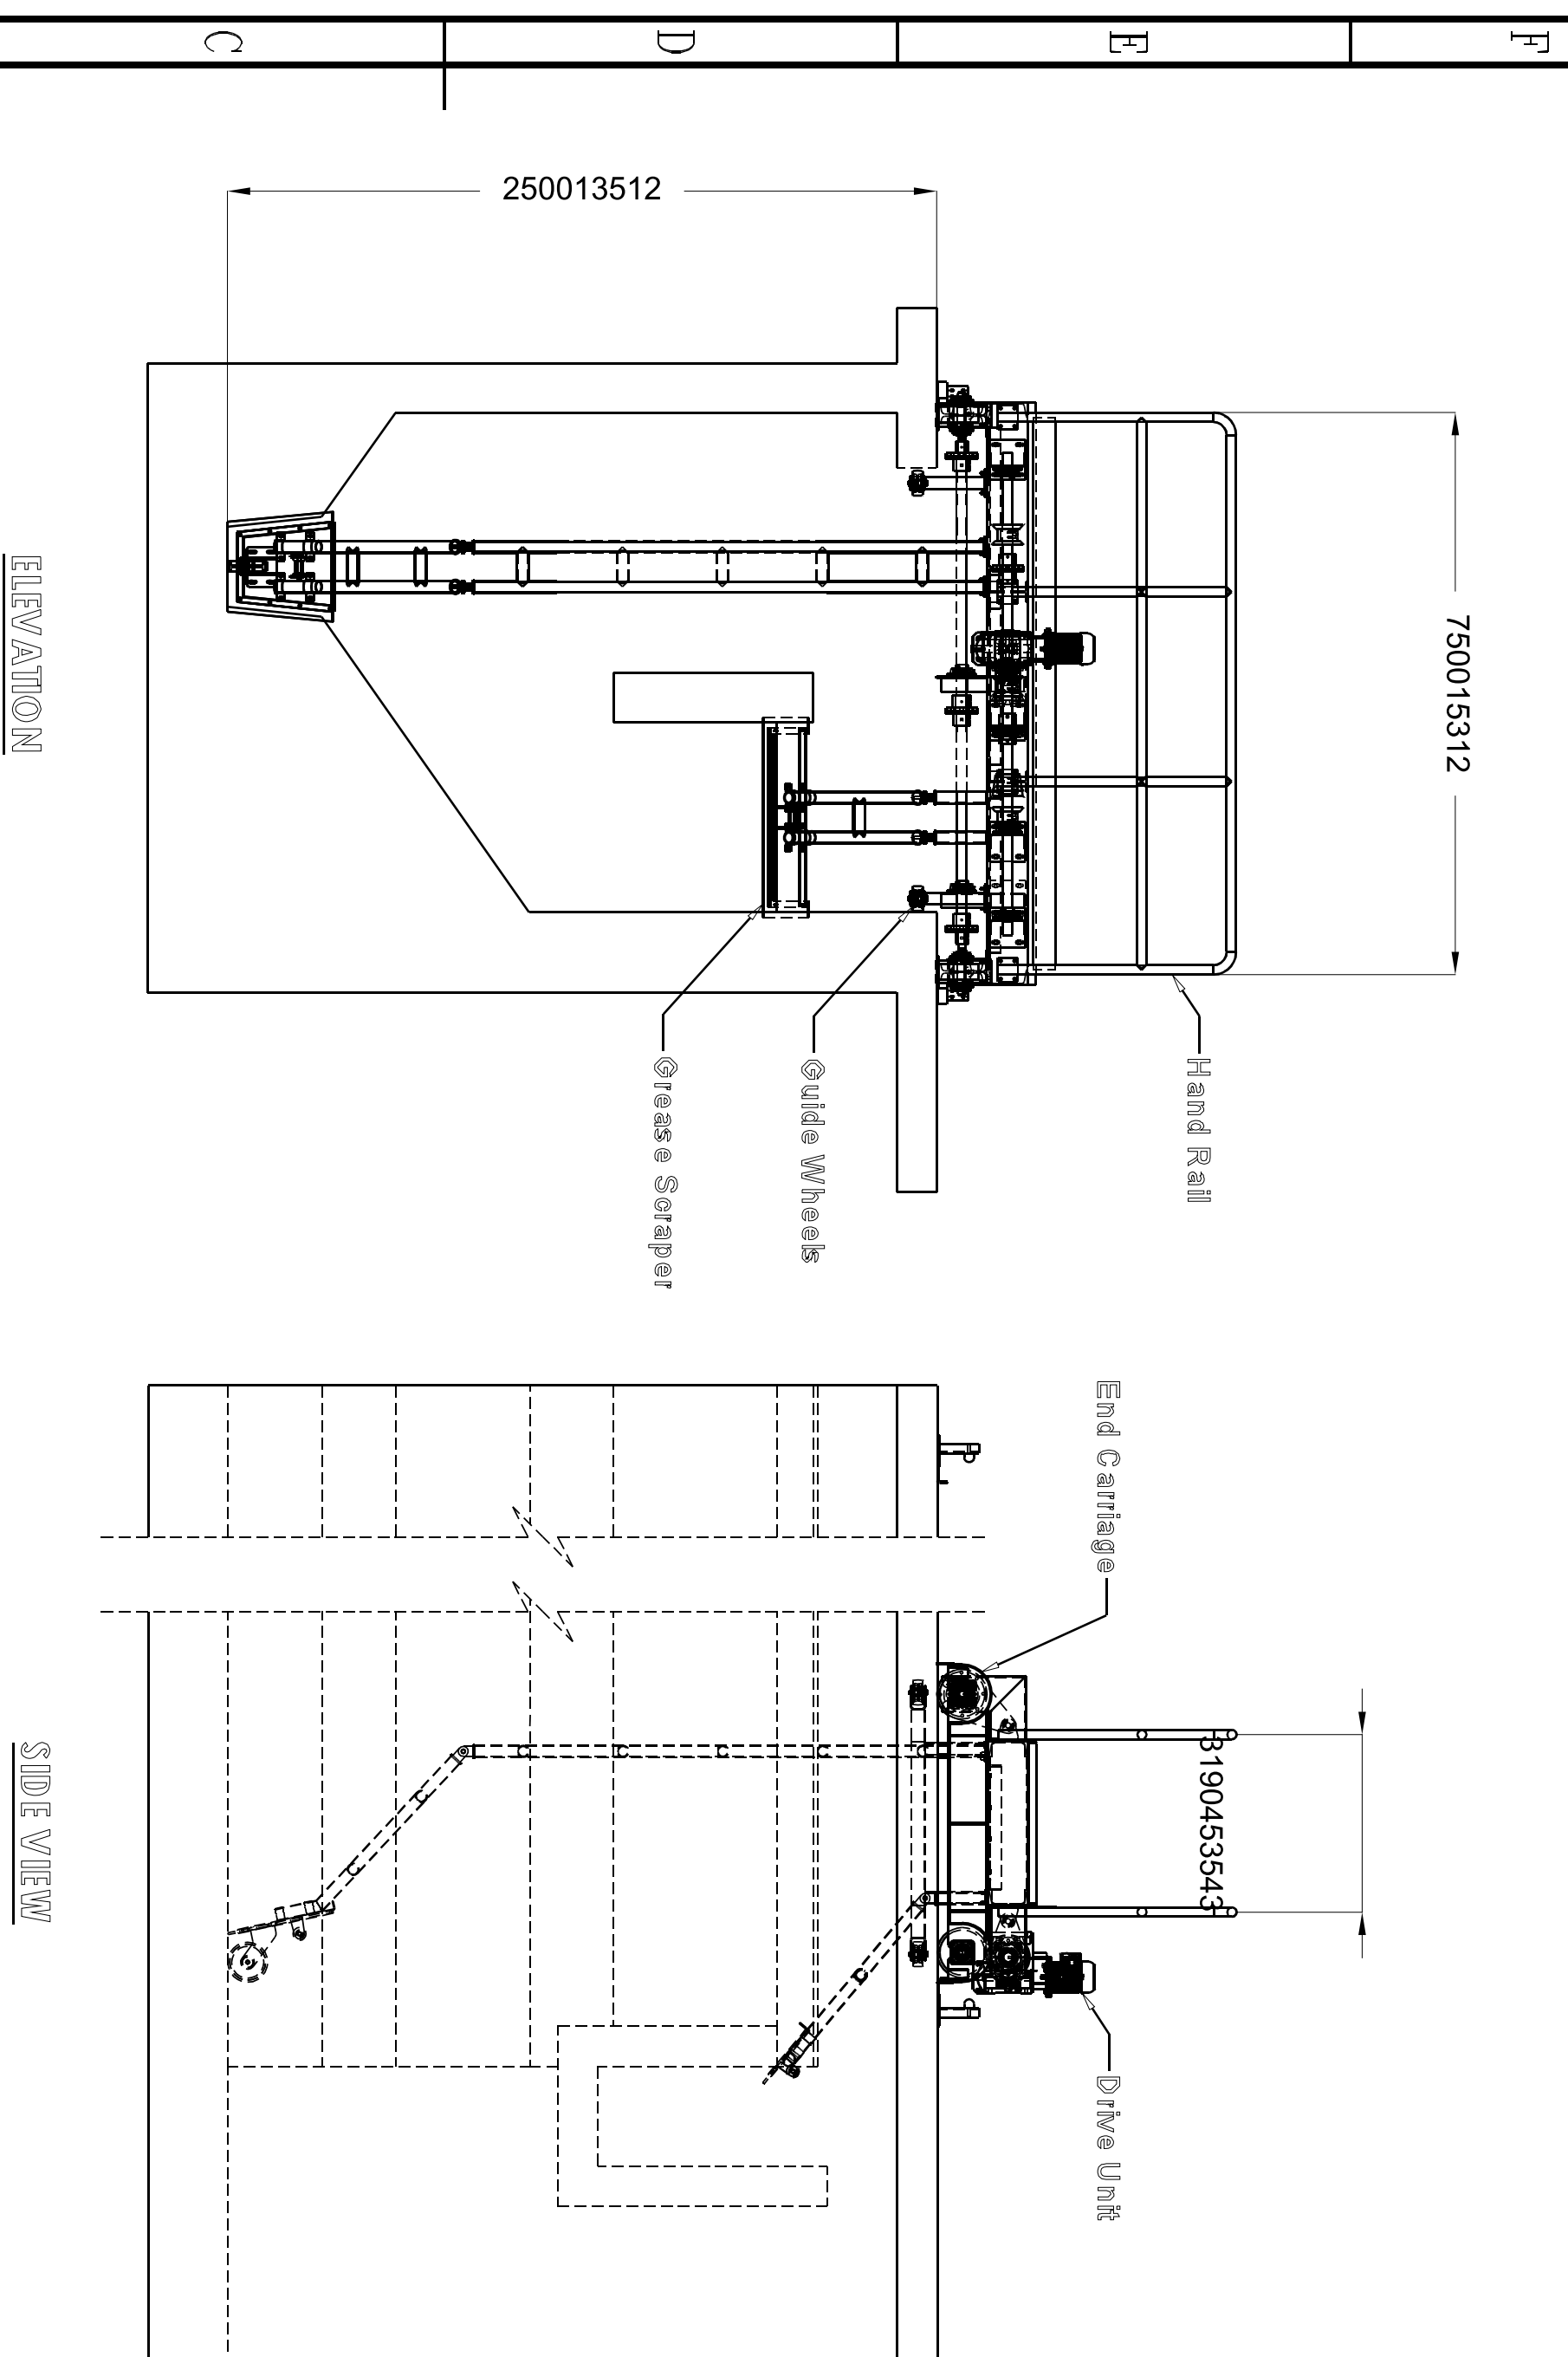

APPRO.	W.A.			
CHD.	W.F.			
DEVAL	D.M.			01/09/2028
OWNER	National Organization For Probable Violence and Security Damage WCMWASIP			
CONSULTANT				
MAIN CONTRACTOR				
Client	VA, TIECH WABAO			
CITY CONTRACTOR				
MAIN CONTRACTOR				
PROJECT	Delta WWP - Capacity 15000 m3/day E' Fashn center - Beni Suif Governorate On - site Testing Strategic Assessment Methods (Chemical Analysis)			
DWG NO.		SIZE	A3	
SCALE	1:50	SHEET	1	OF 1
DED.				

THIS DRAWING IS FOR OFFER PURPOSE ONLY AND MAY BE CHANGED DURING FABRICATION .



2. Container

Sec01: General Data

Field	Value
Manufacturer	Ietos Factory
Service	Screening Area/GRC Area
Fluid	Screenings disposal & Grit
Qty	2
Operation	Manual
Country of Origin	Egypt

Sec02: Design Data

Field	Value
Capacity	2
Thickness	6
Accessories	2 Rear Swivel castors with brakes
Length	100
Width	50
Height	20
Cover	Included

Sec03: Material Data

Field	Value
Container Body	Epoxy Coated Steel
Cover	Epoxy Coated Steel
Wheels	Steel Wheels covered with polyurethane

3. Primary Sedimentation Tank

Sec01:

Field	Value
Manufacturer	Ietos Factory
Service	Final Settling Tank
Fluid	Sewage
Operation	Automatic & Manual
Quantity of Units	1
Country of Origin	Egypt

Sec02:

Field	Value
Type	Rotatory Half Scraper Bridge
Tank Diameter	24123
Side Wall Depth	4320
Water depth	3500
Bridge length	14.5123 approx.
Handrail Height	1000
Walkway Width	750
Side Plate	100
Sludge Scraper Height	¥ 300
Scraper Thickness	¥ 4

Sec03:

Field	Value
Drive Wheel Quantity	2
Drive Wheel Diameter	400
Drive Wheel Material	Cast mild steel covered by polyurethane layer

Sec04:

Field	Value
Weir Type	V-Notch
Weir Length	75.4 Approx.
Weir Height	300
Weir Thickness	4
Weir Adjustable Height	100

Sec05:

Field	Value
Power	1.1
Power Supply	380 /3/50
Driving Unit Service Factor	â‰¥ 2
Motor Insulation Protection	IP66
Isolation / Temp. Class	Class F/B

Sec06:

Field	Value
No. of Rings	14
Origin	Europe


Sec07:

Field	Value
Voltage	380
Phase	3
Frequency	50
Insulation Protection	IP 54

Panel Thickness	2
-----------------	---

Sec08:

Field	Value
Bridge structure	Hot dip galvanized steel.37
Hand rail	Hot dip galvanized steel.37
End carriage	Hot dip galvanized steel.37
Bottom scraper	Stainless Steel 304
Surface scraper	Stainless Steel 304

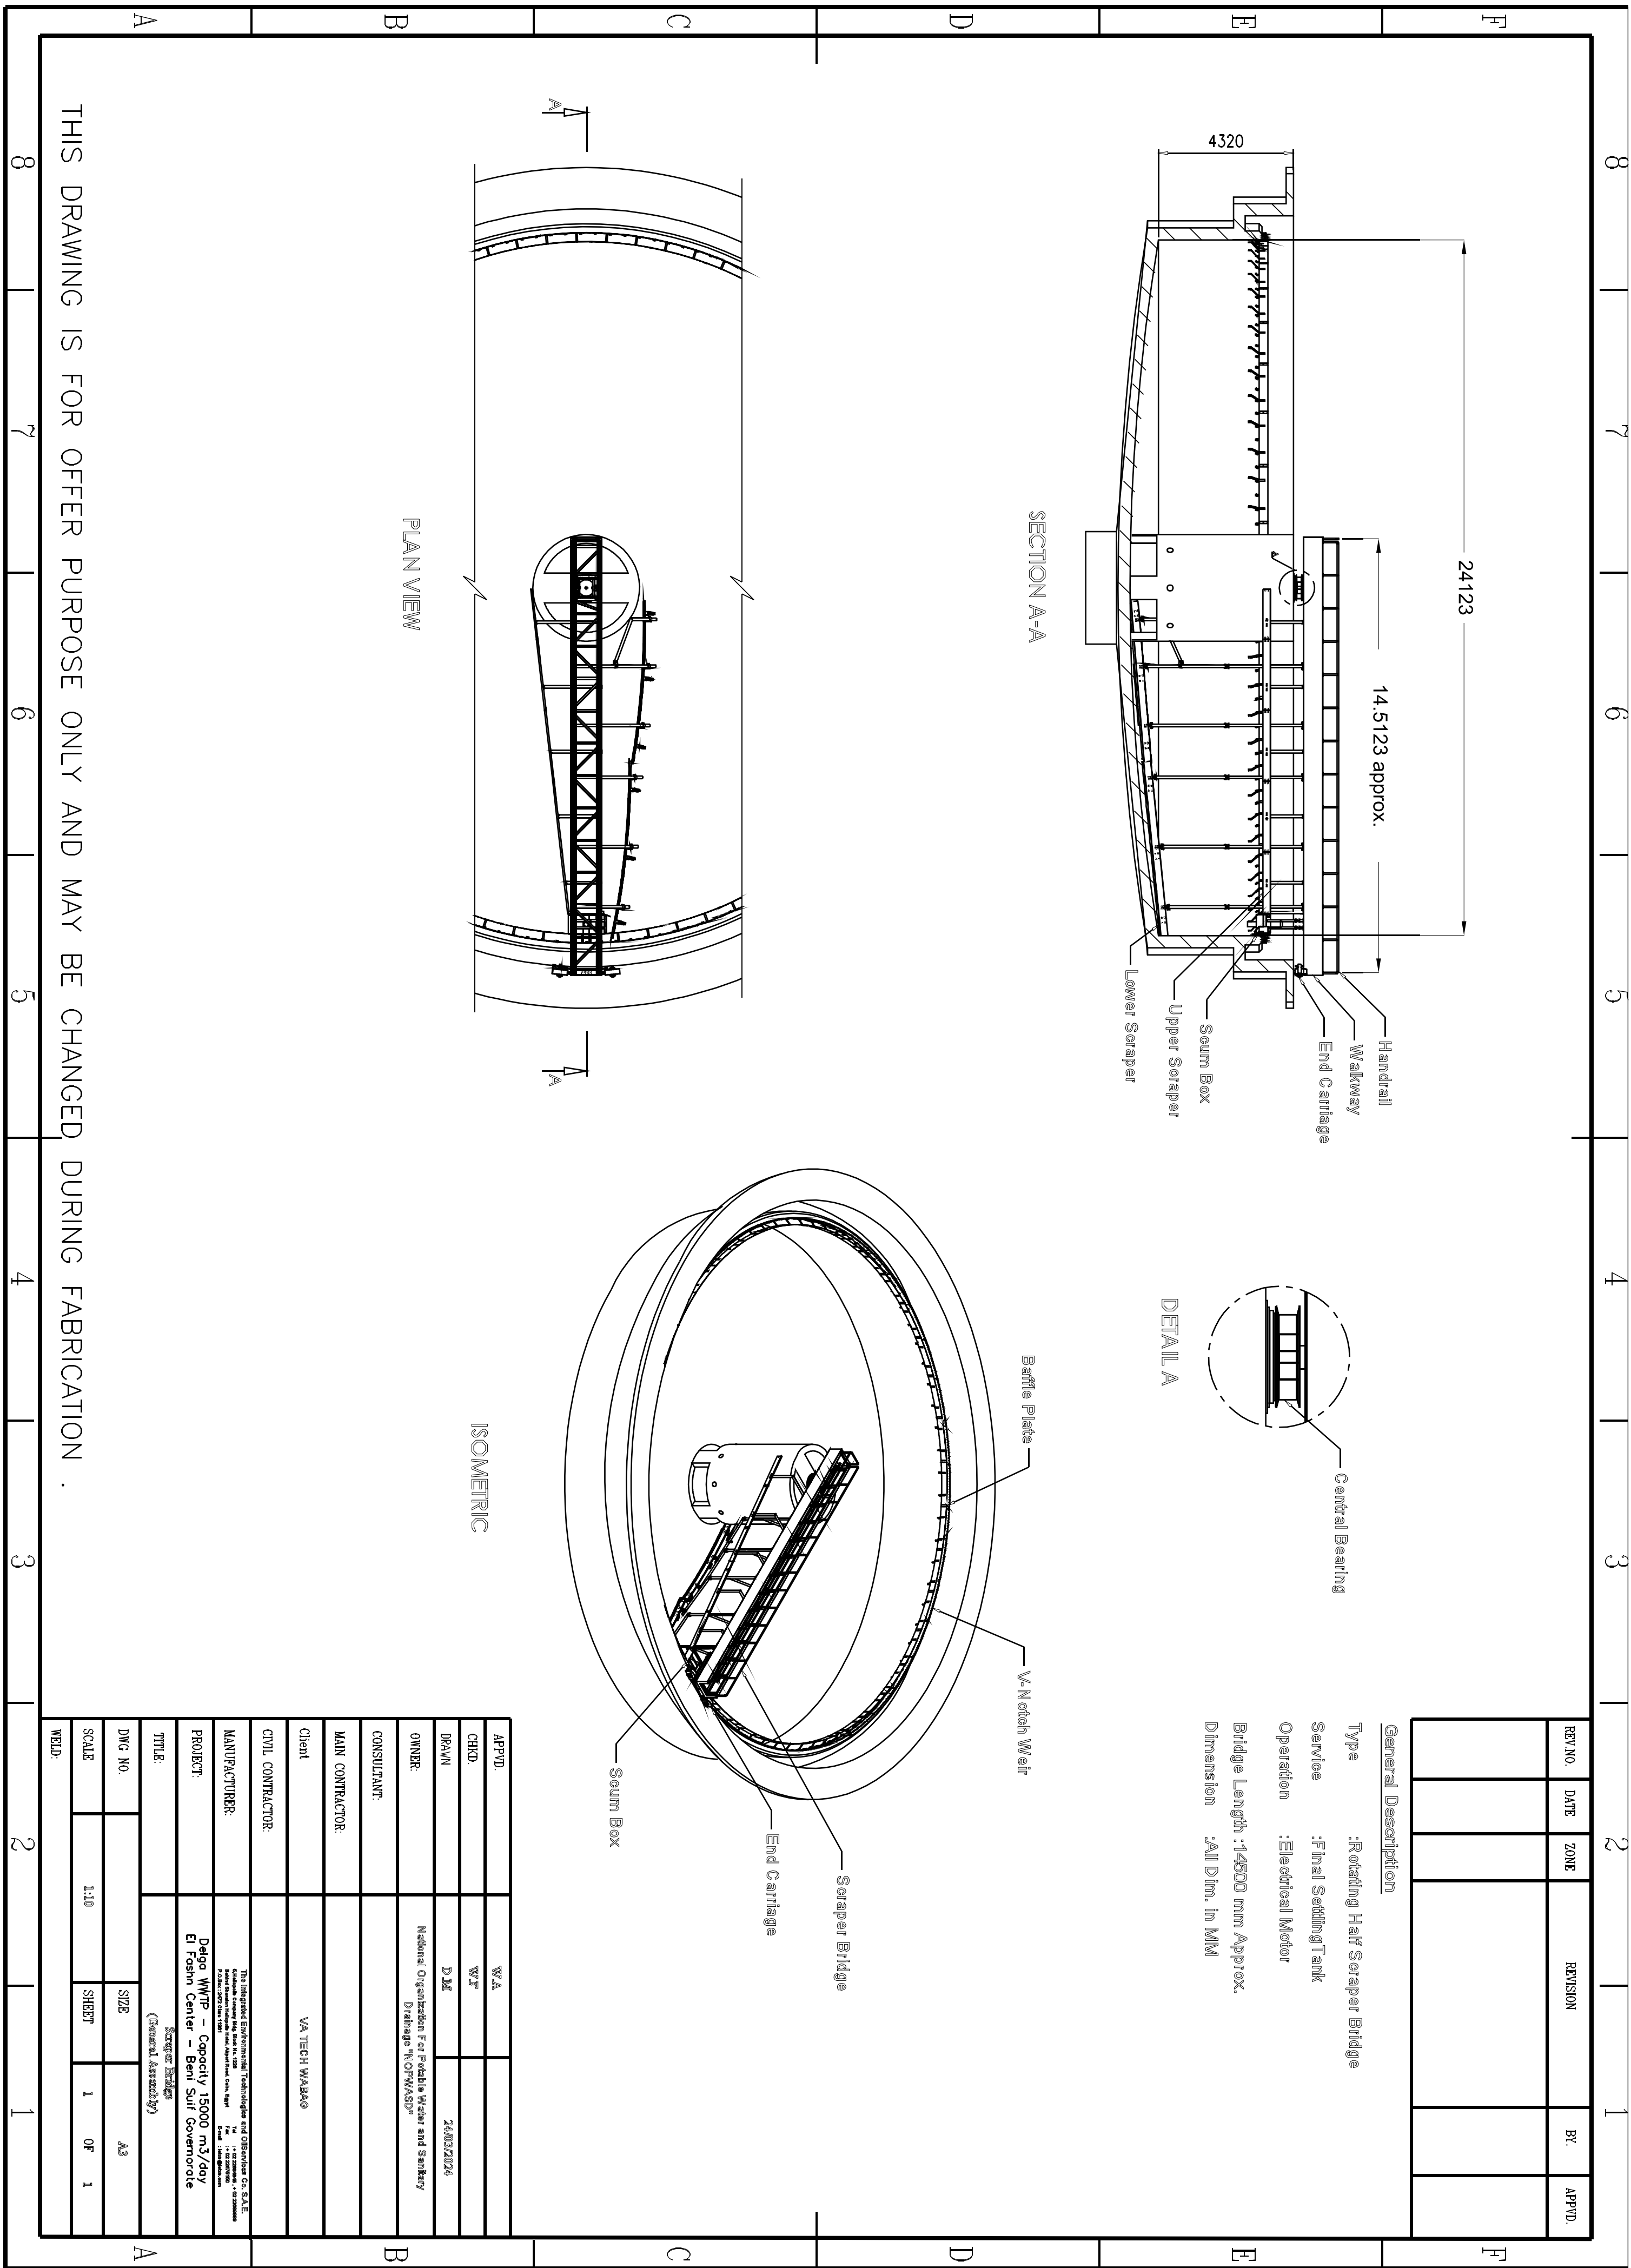

THIS DRAWING IS FOR OFFER PURPOSE ONLY AND MAY BE CHANGED DURING FABRICATION .

4. Belt Conveyor

Sec01: General Data

Field	Value
Manufacturer	Ietos Factory
Service	Screening Area
Fluid	Screening Disposals
Operation	Automatic & Manual
Quantity of Units	1
Country of Origin	Egypt

Sec02: Design Data

Field	Value
Width	213123
Length	123123 approx.
Belt Thickness	10
Mounting	Horizontal
Chute	Included

Sec03: Gearbox Data


Field	Value
Type of drive	Gear Motor
Power	0.25
Power Supply	380/3/50
Driving Unit Service Factor	2
Motor Insulation Protection	IP 66
Isolation / Temp. Class	Class F/B
Gear Motor	Rossi/Bonfiglioli

Sec04: Motor Data


Field	Value
Frame	Hot Dip Galvanized Steel
Idlers	Coated Steel Unit
Belt	Triple-Ply Nylon Layer
Driving & Driven Drum Set	Coated Steel Unit
Belt Scraper	Rubber
Bolts & Nuts	A4

Sec05: Material Data


Field	Value
1. One set of bearing	Yes
2. Five rollers with accessories	Yes
3. One set of bearing for motor	Yes

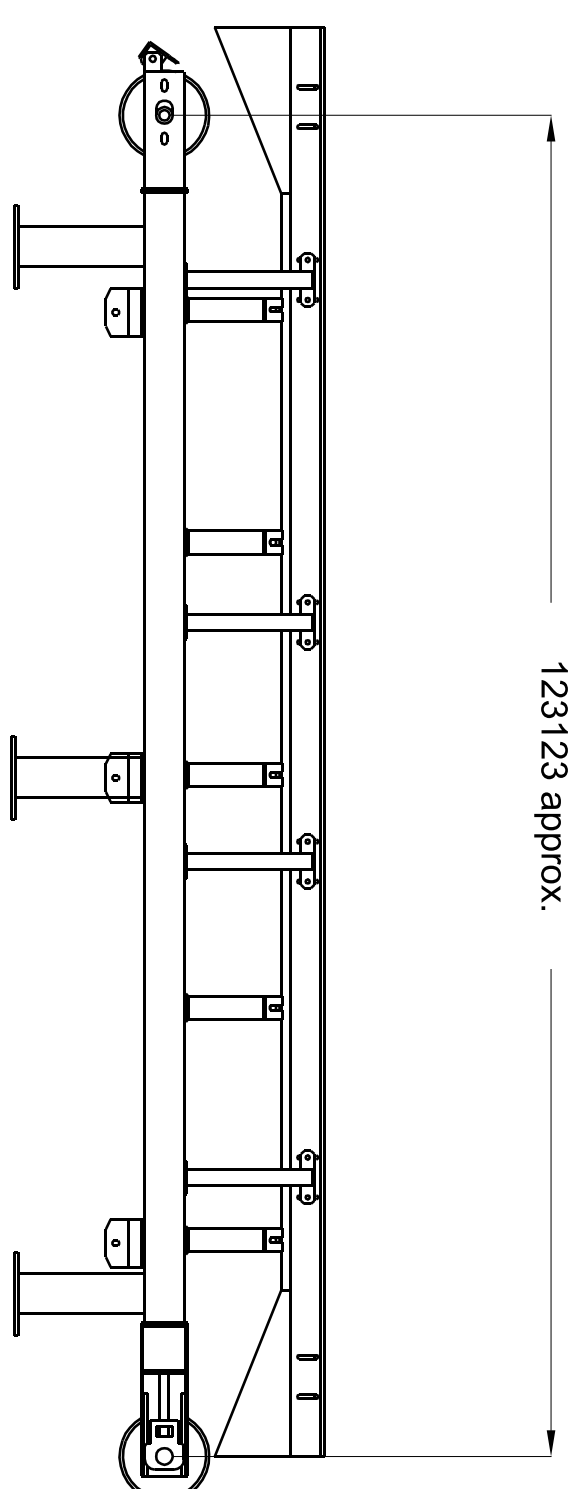


ELEVATION

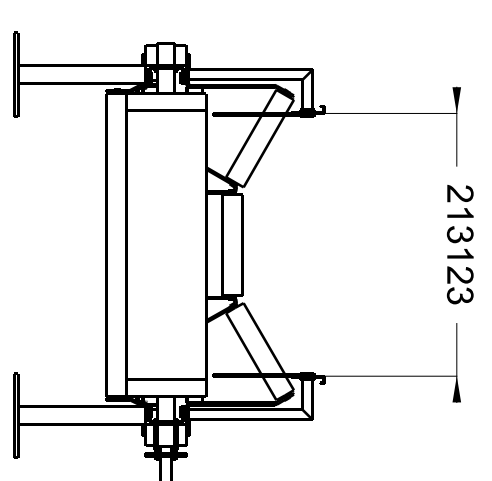


SIDE VIEWS

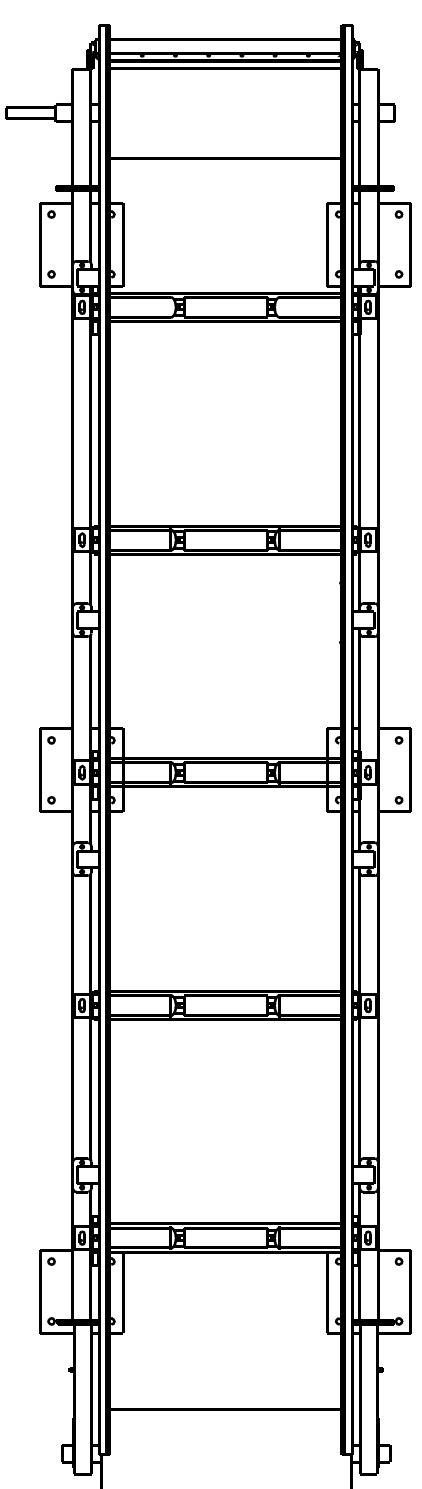


PLAN

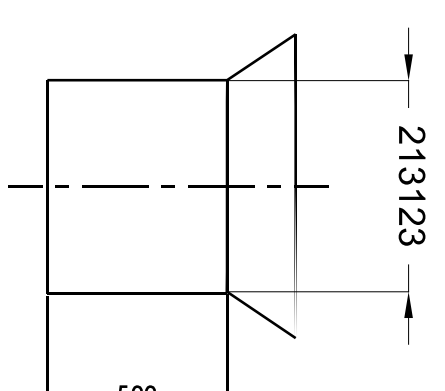

Elevation

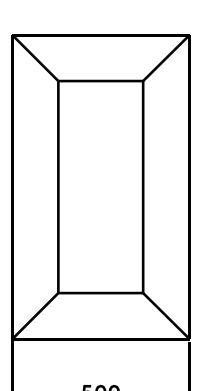

Plan

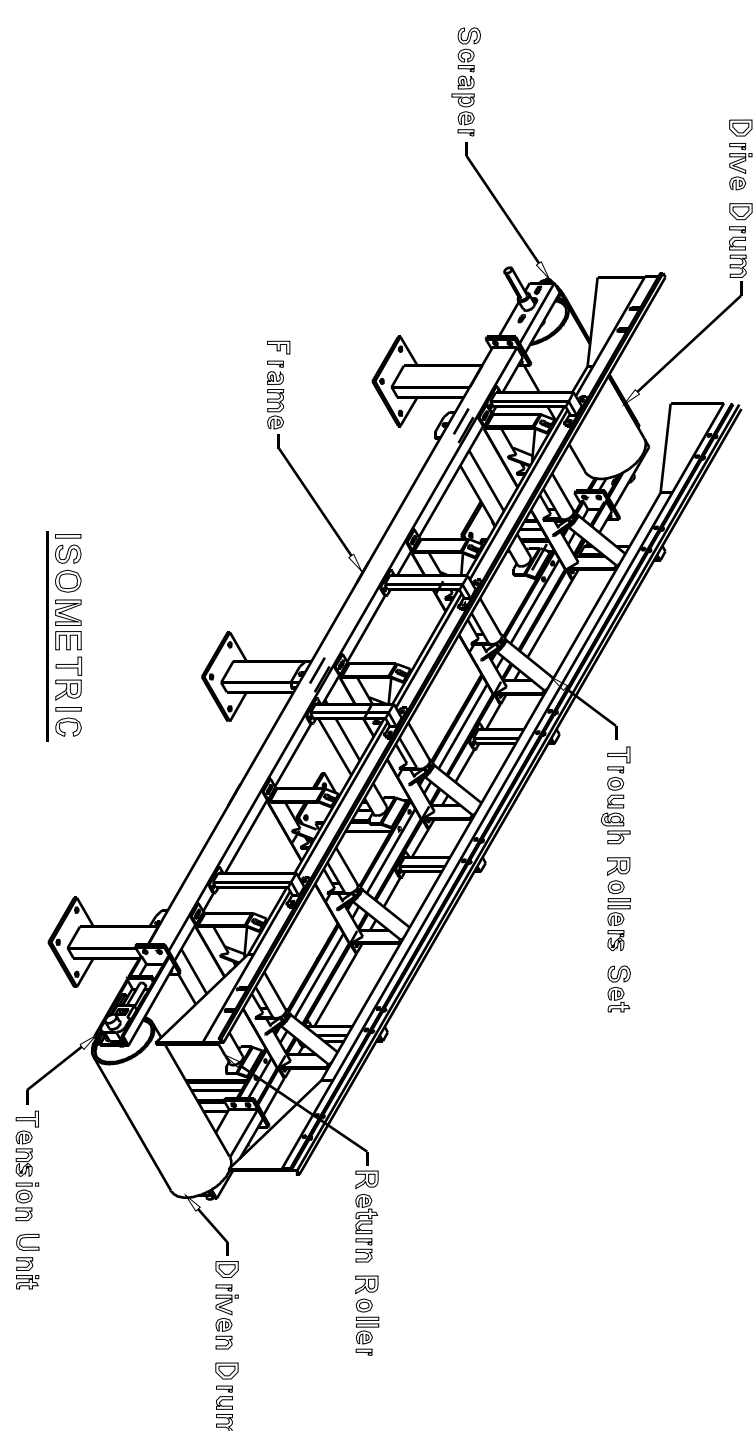

ISOMETRIC

BELT CONVEYOR CHUTE

THIS DRAWING IS FOR OFFER PURPOSE ONLY AND MAY BE CHANGED DURING FABRICATION.



5. Thickener

Sec01:

Field	Value
Manufacturer	Ietos Factory
Service	Sludge Thickener Tank
Fluid	Sewage
Operation	Automatic & Manual
Quantity of Units	1

Sec02:

Field	Value
Type	Fixed Concrete Bridge
Tank Inner Diameter	9500123
Side Wall Depth	3500123
Water Level	3000
Number of Arms	3 arms
Scraper Height	â%¥ 250
Scraper Thickness	â%¥ 4
Cleaning Brushes	Included

Sec03:

Field	Value
Weir Type	V-Notch
Weir Length	29.9 approx.
Weir Height	300
Weir Thickness	4
Rubber Sealing Thickness	â%¥ 4

Sec04:


Field	Value
Power	0.37
Power Supply	380 /3/50
Driving Unit Service Factor	â‰¥ 2
Motor Insulation Protection	IP66
Isolation / Temp. Class	Class F/B

Sec05:

Field	Value
Voltage	380
Phase	3
Frequency	50
Insulation Protection	IP 54
Panel Thickness	2

Sec06:

Field	Value
Bridge structure	Concrete
Rotating shaft	Stainless Steel 304
Picket fence	Stainless Steel 304
Supporting arms	Stainless Steel 304
Weir	Stainless Steel 304

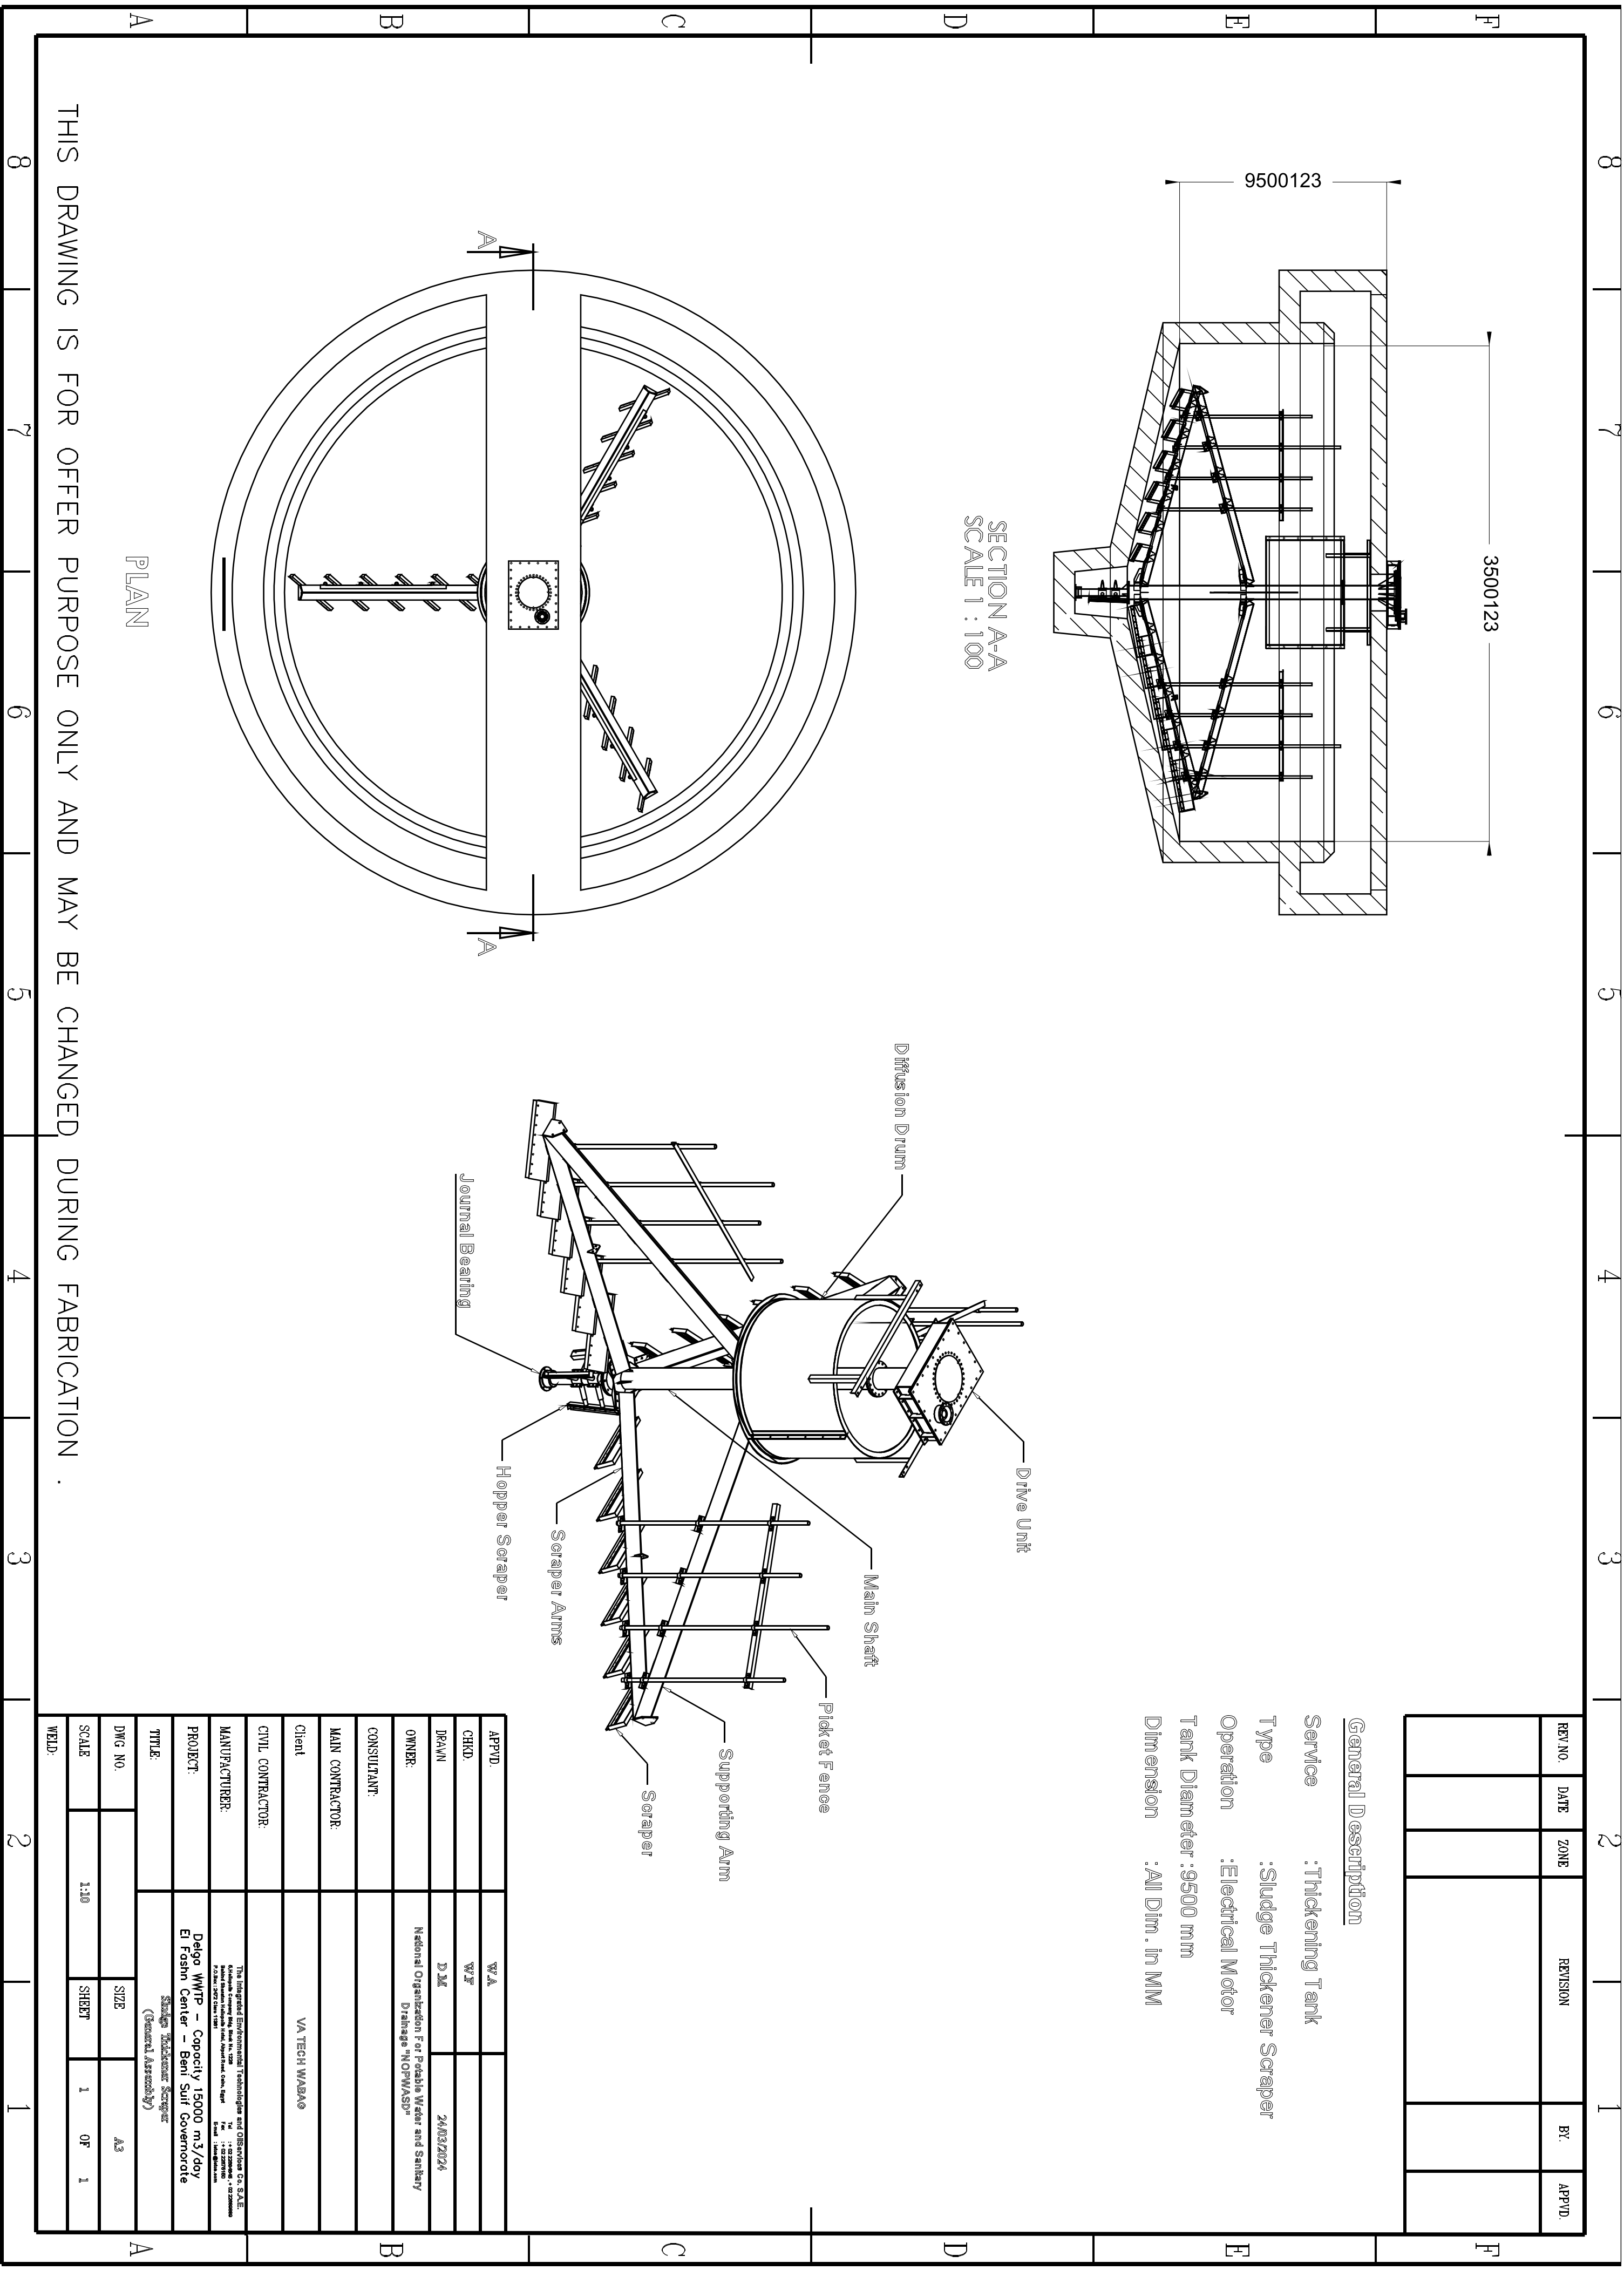

THIS DRAWING IS FOR OFFER PURPOSE ONLY AND MAY BE CHANGED DURING FABRICATION .

87654321

6. Sand Silo

Sec01:

Field	Value
Manufacturer	Ietos Factory
Service	Collecting & removing sand from grit removal tank
Fluid	Sand & water
Operation	Manual
Quantity of Units	2

Sec02:

Field	Value
Capacity	3
Tank Diameter	1750123
Cylindrical Shell Vertical Height	1500
Thickness	6123
Quick Shutoff Gate Valve	Included



Sec03:

Field	Value
Silo Tank	Epoxy Coated Steel
Discharge Hopper	Epoxy Coated Steel
Silo Legs	Epoxy Coated Steel
Hand rail	Epoxy Coated Steel
Ladder	Epoxy Coated Steel

REV. NO.	DATE	ZONE	REVISION	BY	APPROD.



General Description

Service :GRC
Type :Sand Silo
Capacity : 3 m3
Thickness : 6 mm
Operation :Manual
Quantity : 2
Dimension :All Dim. in mm
Tolerance :According to DIN 7168-M

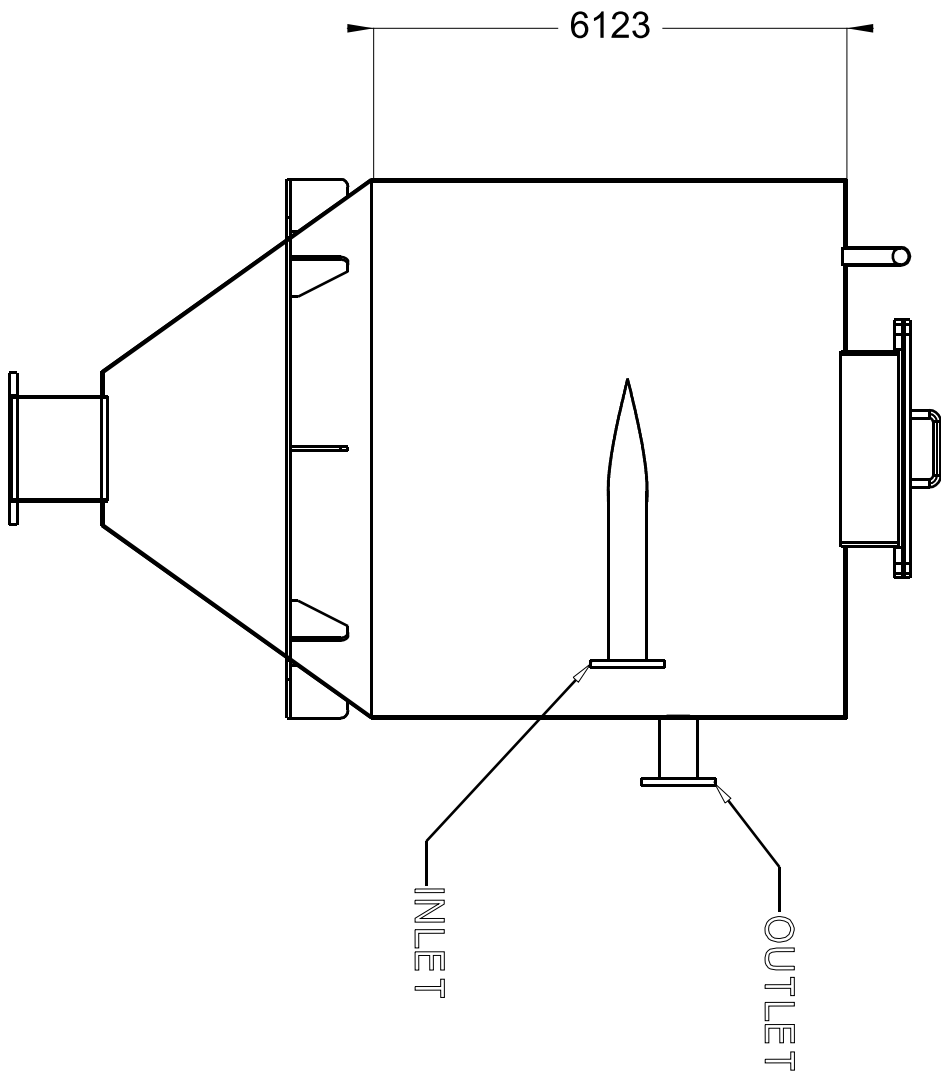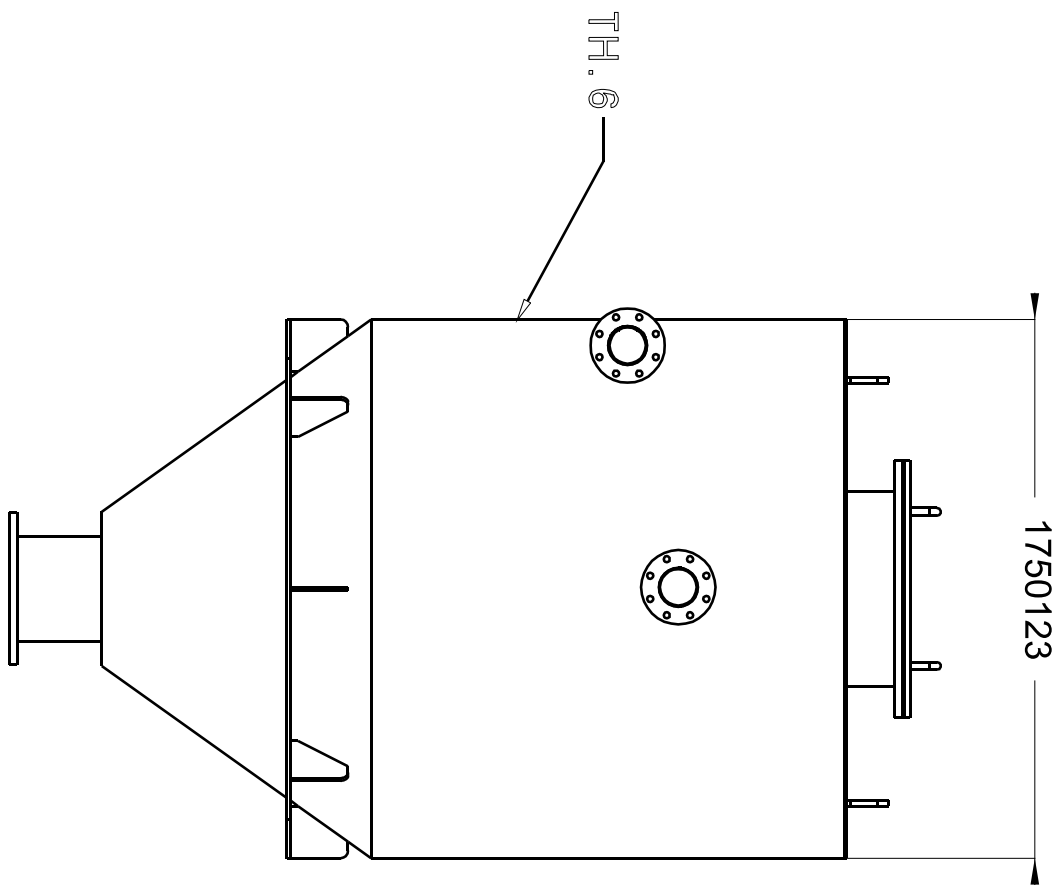

ELEVATION

SIDE VIEW

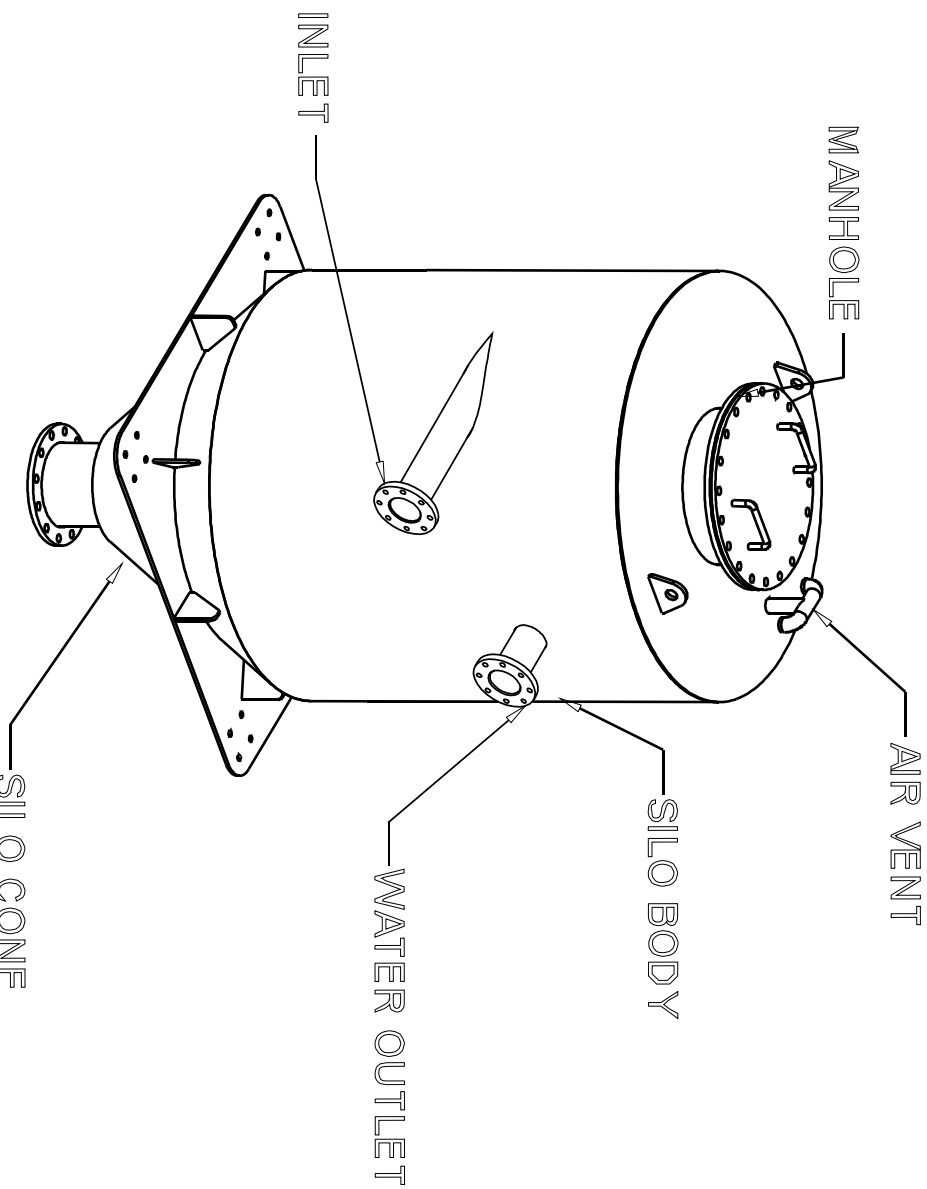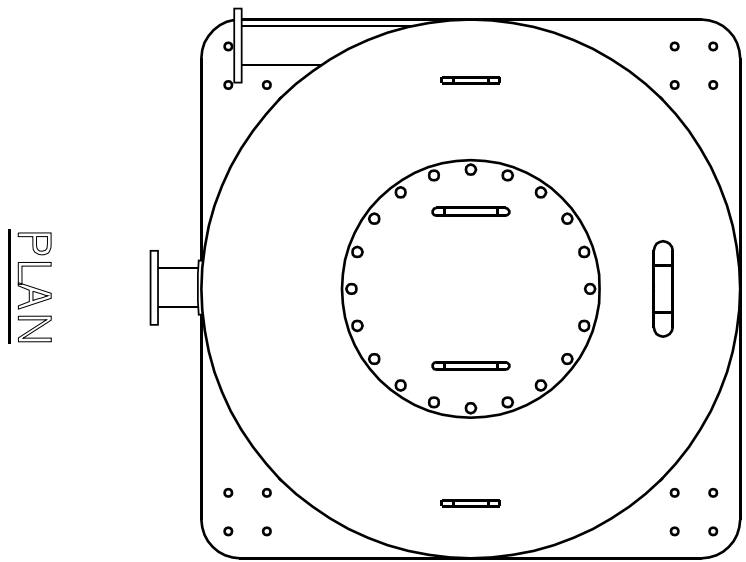

PLAN

ISOMETRIC

THIS DRAWING IS FOR OFFER PURPOSE ONLY AND MAY BE CHANGED DURING FABRICATION .

APPROD.	W.A.		
CHKD.	W.Z		
DRWN.	D.M	17/04/2024	
OWNER.	Medinal Corporation "F-47" Jeddah Water and Sewerage Drainage "NGPWASR"		
CONSULTANT.			
MAIN CONTRACTOR.			
Client.	VA TECH WABAS		
CIVIL CONTRACTOR.			
MANUFACTURER.	The Silo will be fabricated in GRC and will be finished with 12.5 mm sand blasting and then will be painted with 2 coats of 100% epoxy paint 700gms/2500cm ² per coat. The silo will be delivered to the site in 100% assembled condition.		
PRODUCT.	Design WWP - Capacity 15000 m3/day 6' 6"dia. Sand Silo Sand Silo (General Assembly)		
TITLE.		SIZE	A3
DWG NO.			
SCALE	1:50	SHEET	1 OF 1
WELD.			

7. Telescopic Valve

Sec01:

Field	Value
Manufacturer	Ietos Factory
Fluid	Sewage
Service	Final Settling Tank
Operation	Actuated (Modulated)
Qty	1
Country of Origin	Egypt

Sec02:

Field	Value
Valve Diameter	DN 400
Sliding Tube Diameter	DN 350
Adjustable Height	1000

Sec03:

Field	Value
Body	Stainless steel 304
Sliding tube	Stainless steel 304
Stem	Stainless steel 304
Sealing	Rubber
Hand wheel	Cast iron
Bolts	A2



8. Manual Screen

Sec01: General Data

Field	Value
Manufacturer	Ietos Factory
Service	Inlet Area
Fluid	Sewage
Operation	Manual
Quantity of Units	1
Country of Origin	Egypt

Sec02: Design Data


Field	Value
Type	Bar Coarse Screen
Channel Depth	1500123
Channel Width	400123
Water Level	600
Bar Thickness	12123
Bar Width	50
Bar Spacing	25123
Inclination Degree	60123°
Hand Rack Qty	2

Sec03: Material Data

Field	Value
Frame	Stainless Steel 316
Bars	Stainless Steel 316
Rake Tube	Stainless Steel 316
Rake Plate	Stainless Steel 316



Bolts & Nuts	A4
--------------	----

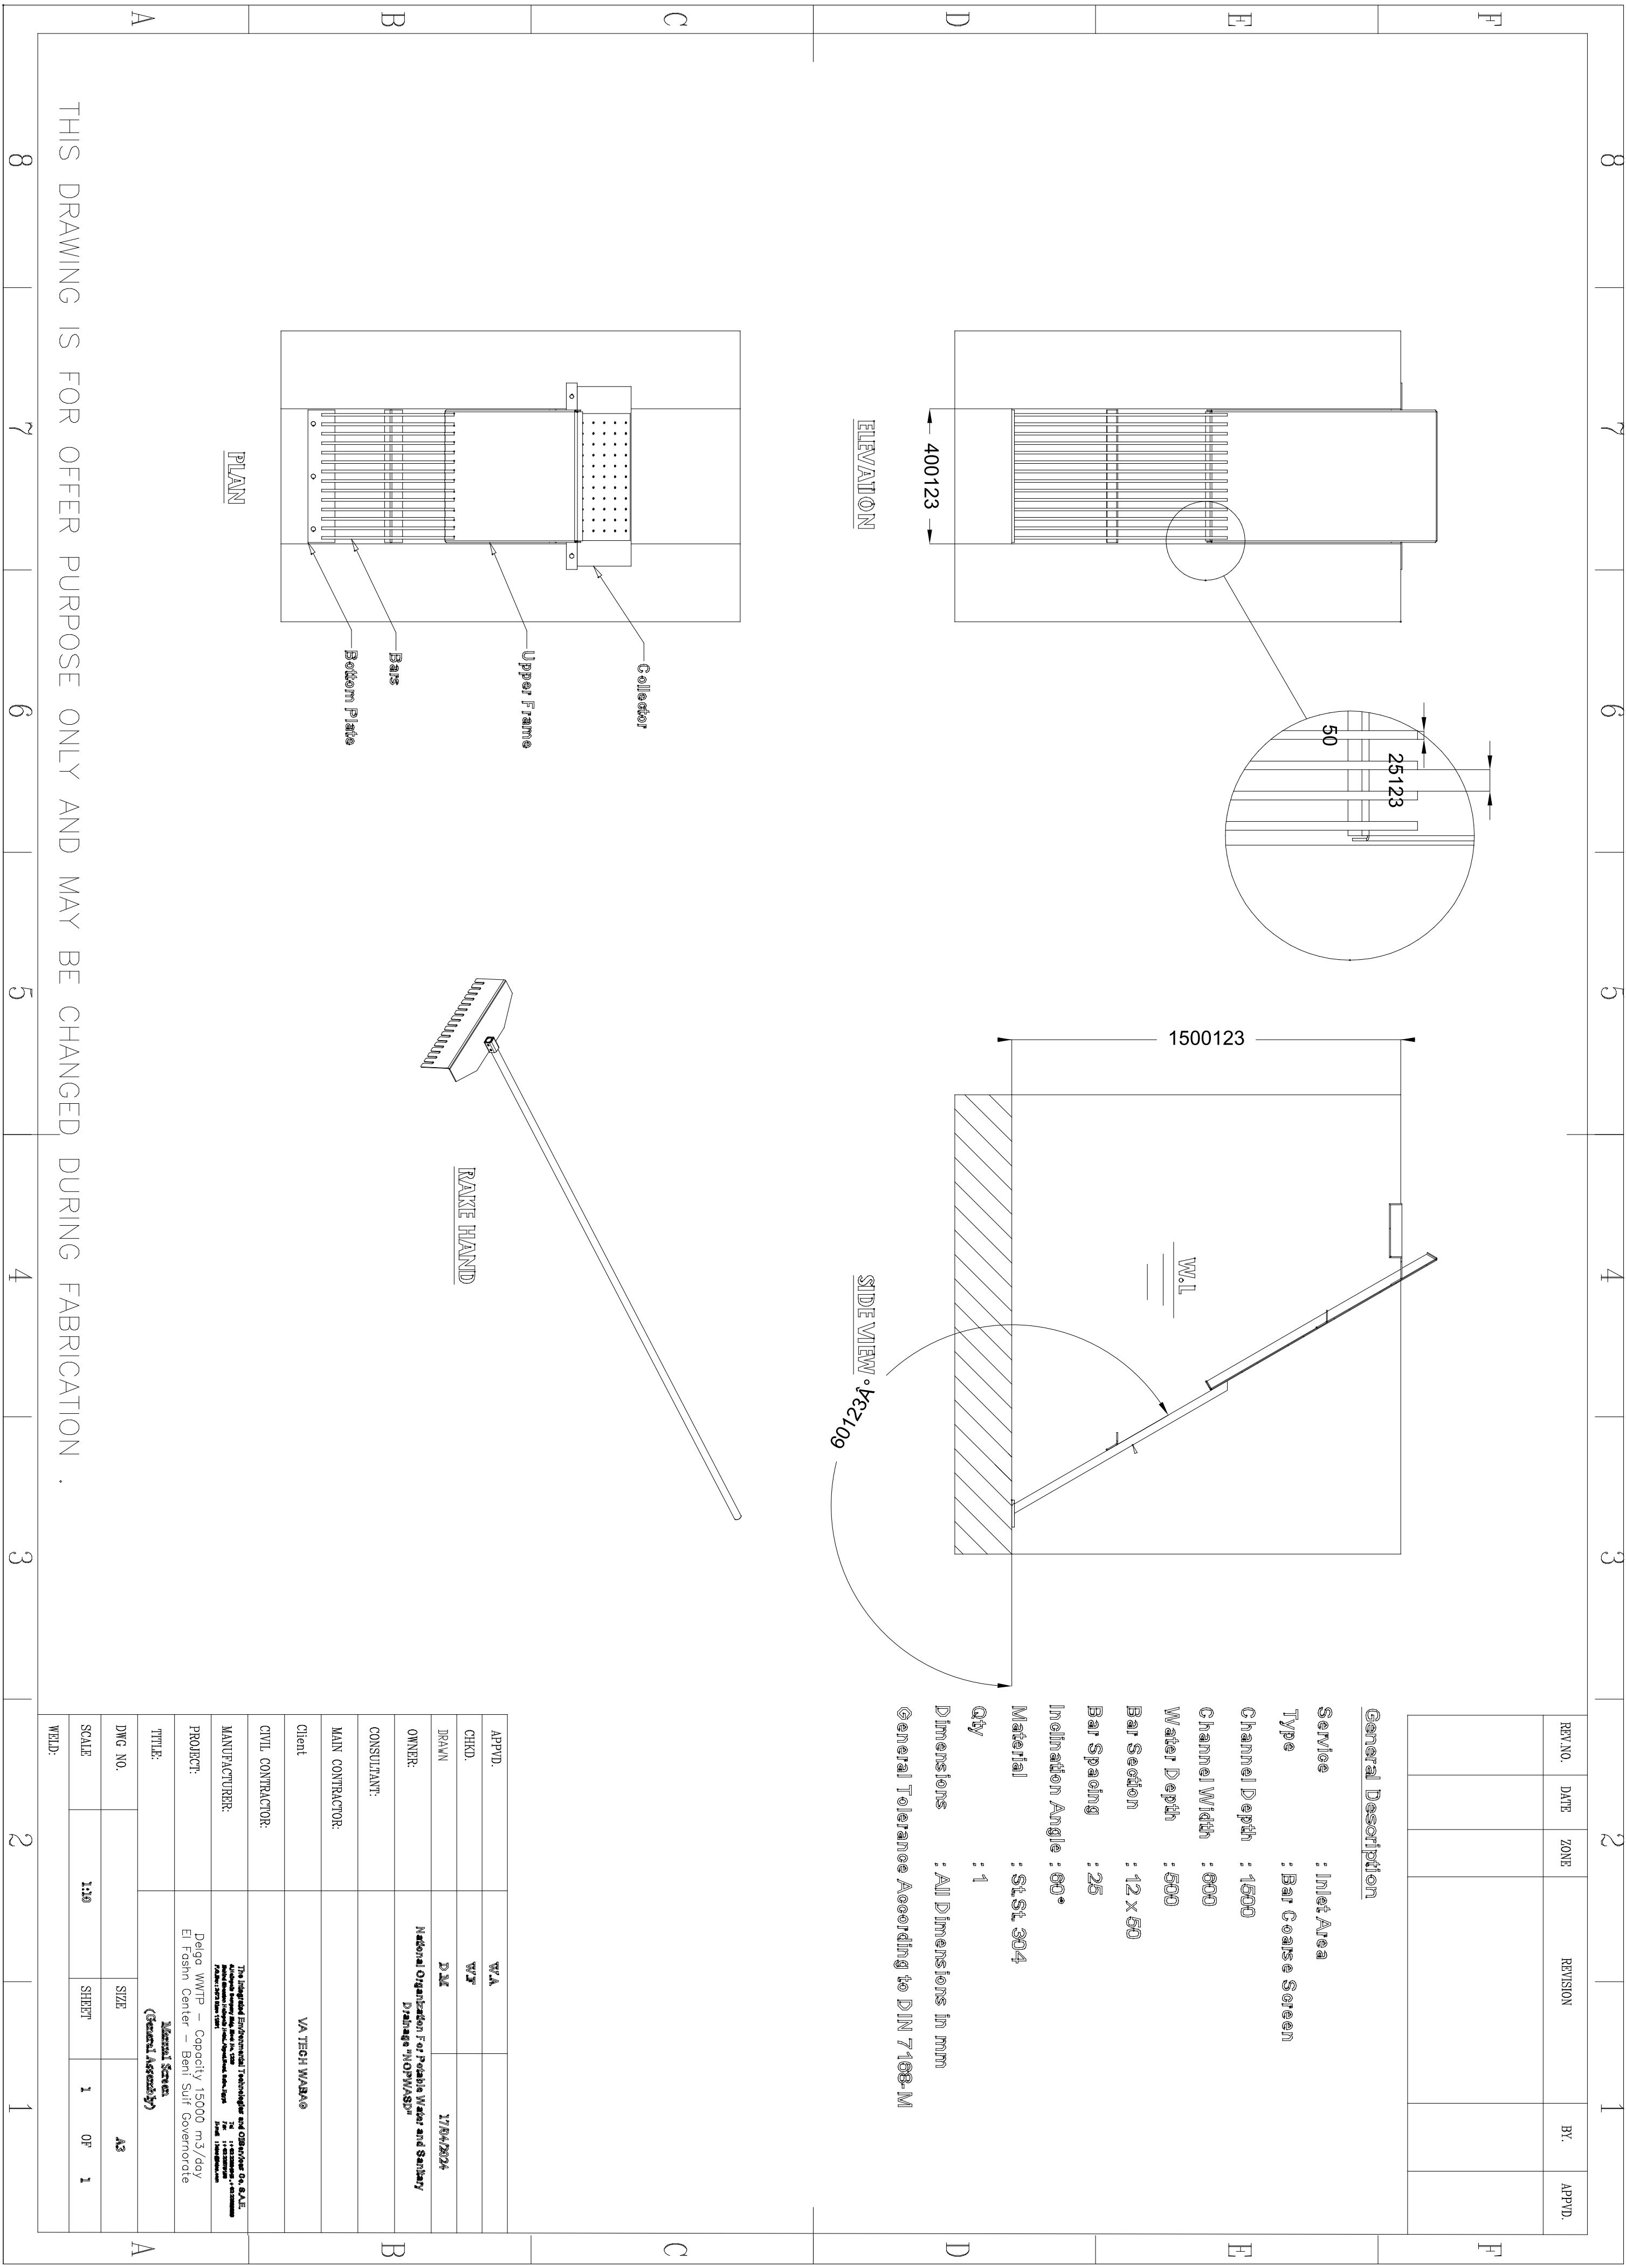

9. Mechanical Screen

Sec01: General Data

Field	Value
Manufacturer	Ietos Factory
Service	Inlet Area
Fluid	Sewage
Operation	Automatic & Manual
Quantity of Units	1
Country of Origin	Egypt

Sec02: Design Data

Field	Value
Type	Mechanical Coarse Screen-Multi rack
Channel Depth	1500123
Channel Width	400123
Water Depth	600123
Bar Thickness	10123
Bar Width	50123
Bar Spacing	25123
Inclination Degree	60123

Sec03: Gearmotor Data

Field	Value
Power	0.37
Power Supply	380/3/50
Driving Unit Service Factor	2
Motor Insulation Protection	IP 65
Isolation / Temp. Class	Class F/B

Sec04: Control panel Data

Field	Value
Voltage	380
Phase	3
Frequency	50
Insulation Protection	IP 65
Panel Thickness	2

Sec05: Material Data

Field	Value
Screen Bars	Stainless Steel 316
Frame	Stainless Steel 316
Rack	Stainless Steel 316
Rack (Teeth)	Artelon
Sprockets	Stainless Steel 316

Sec06: Other Data

Field	Value
One Rack	Yes
Two sets of bearings	Yes

