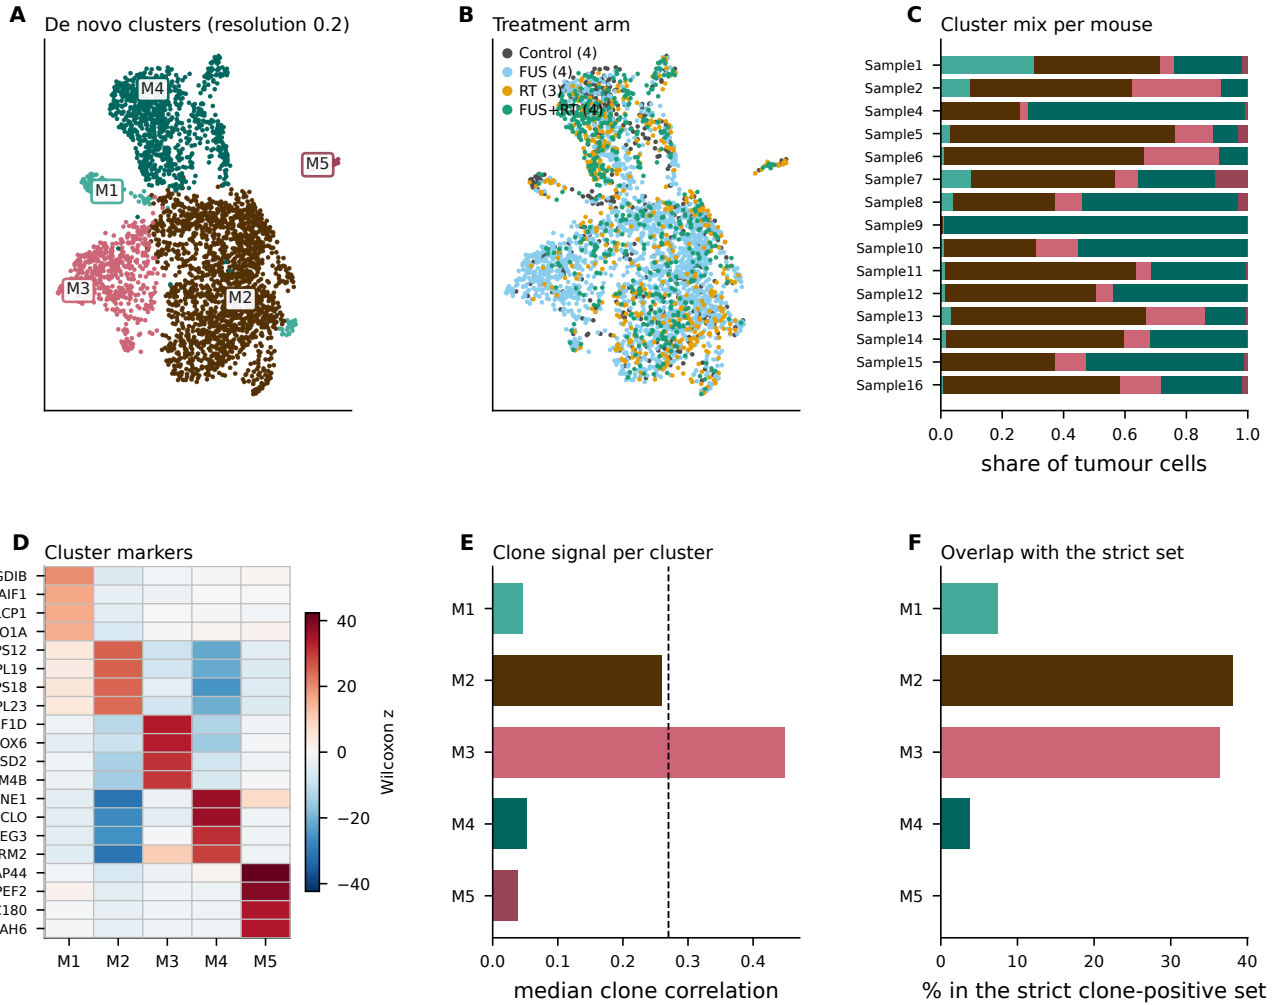

A
De novo clusters (resolution 0.2)
M4
M5
M1
M3
M2
B
Treatment arm
Control (4)
FUS (4)
RT (3)
FUS+RT (4)
C
Cluster mix per mouse
Sample1
Sample2
Sample4
Sample5
Sample6
Sample7
Sample8
Sample9
Sample10
Sample11
Sample12
Sample13
Sample14
Sample15
Sample16
0.0
0.2
0.4
0.6
0.8
1.0
share of tumour cells
D
Cluster markers
ARHGDIB
AIF1
LCP1
CORO1A
RPS12
RPL19
RPS18
RPL23
TAF1D
SOX6
FCHSD2
RBM4B
SYNE1
PCLO
PEG3
SRRM2
CFAP44
SPEF2
CCDC180
DNAH6
M1
M2
M3
M4
M5
40
20
0
−20
−40
Wilcoxon z
E
Clone signal per cluster
M1
M2
M3
M4
M5
0.0
0.1
0.2
0.3
0.4
median clone correlation
F
Overlap with the strict set
M1
M2
M3
M4
M5
0
10
20
30
40
% in the strict clone-positive set