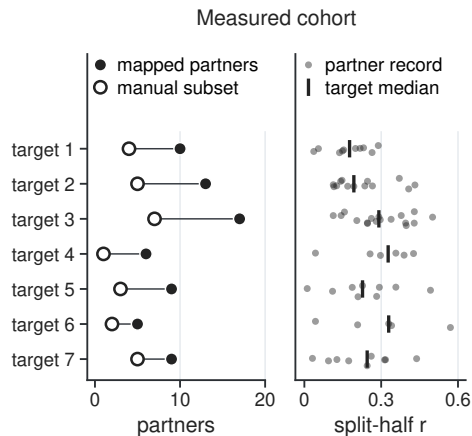
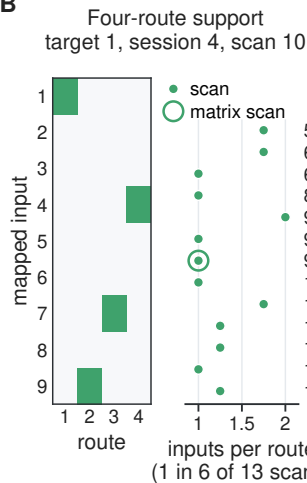
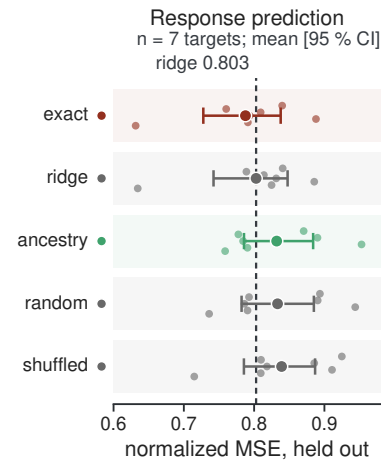
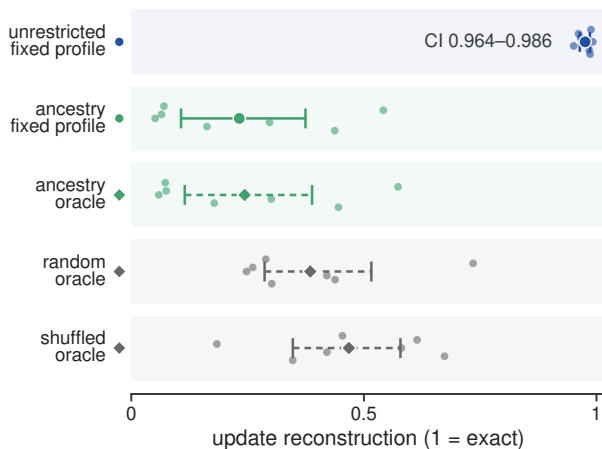


A**B****C****D**

Fixed-profile fidelity: update reconstruction
 $n = 7$ targets; mean [95 % CI]

—●— fixed transfer profile - - - ♦ - - - oracle trialwise amplitudes

**E**

Reliability calibration: simulated – measured
5 of 125 beyond ± 1.96 SE; largest |difference| 0.0069

record: mean and ± 1.96 SE whisker from
1,000 simulated datasets ($n = 123$ of 125)
negative measured r , set to 0 ($n = 2$ of 125;
raw -0.098 and -0.188)
- - - simulated mean = measured

