


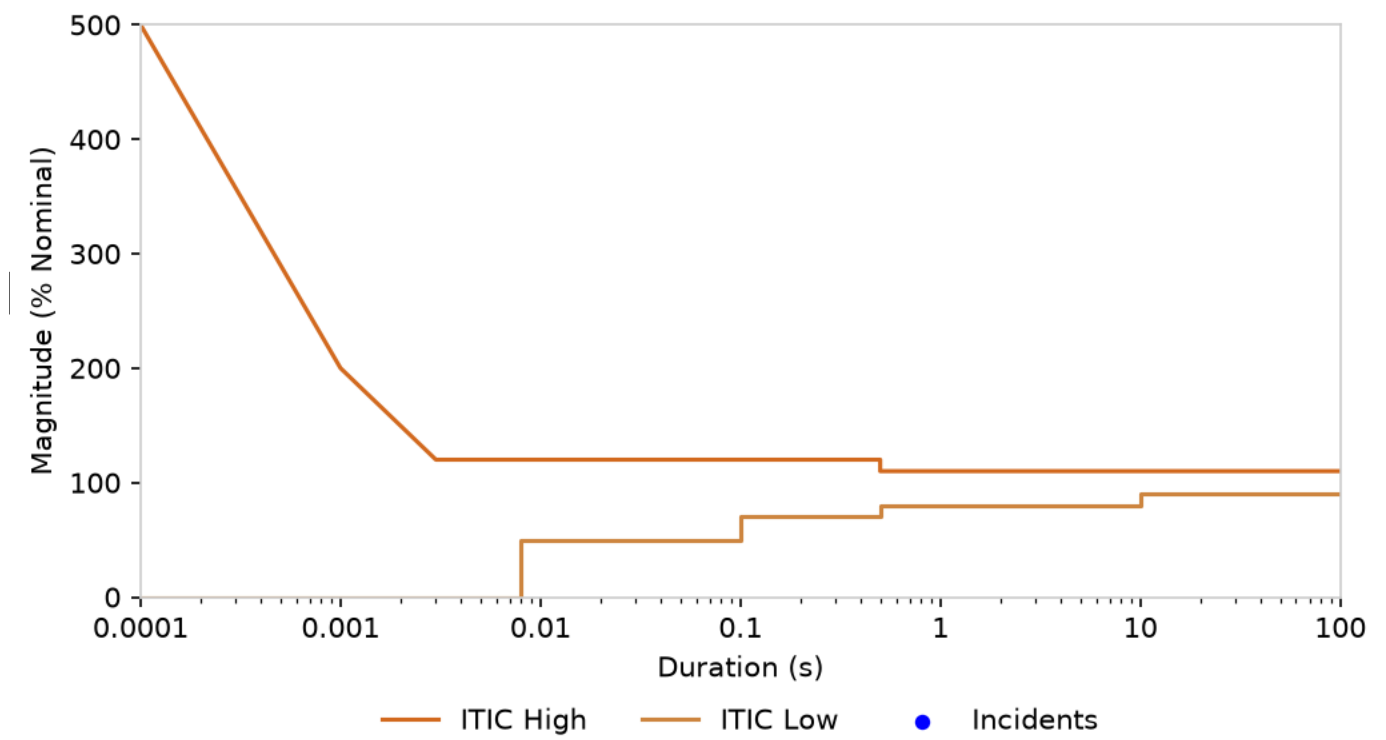

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	06/11/2026 10:59:31 AM	Trafo 5	Sag	V1	3546812.414	87.65