


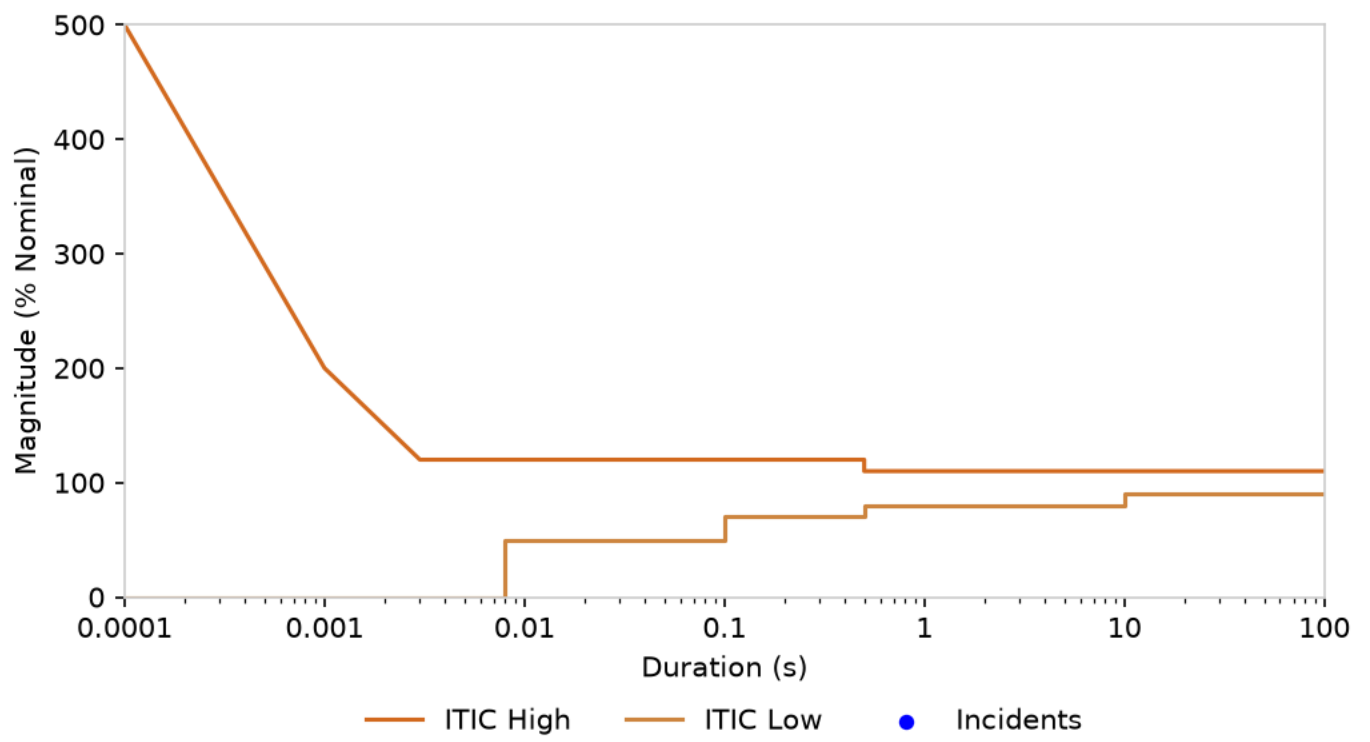

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	07/22/2026 12:36:18 PM	Trafo 5	Sag	V1	1134.002	89.60