


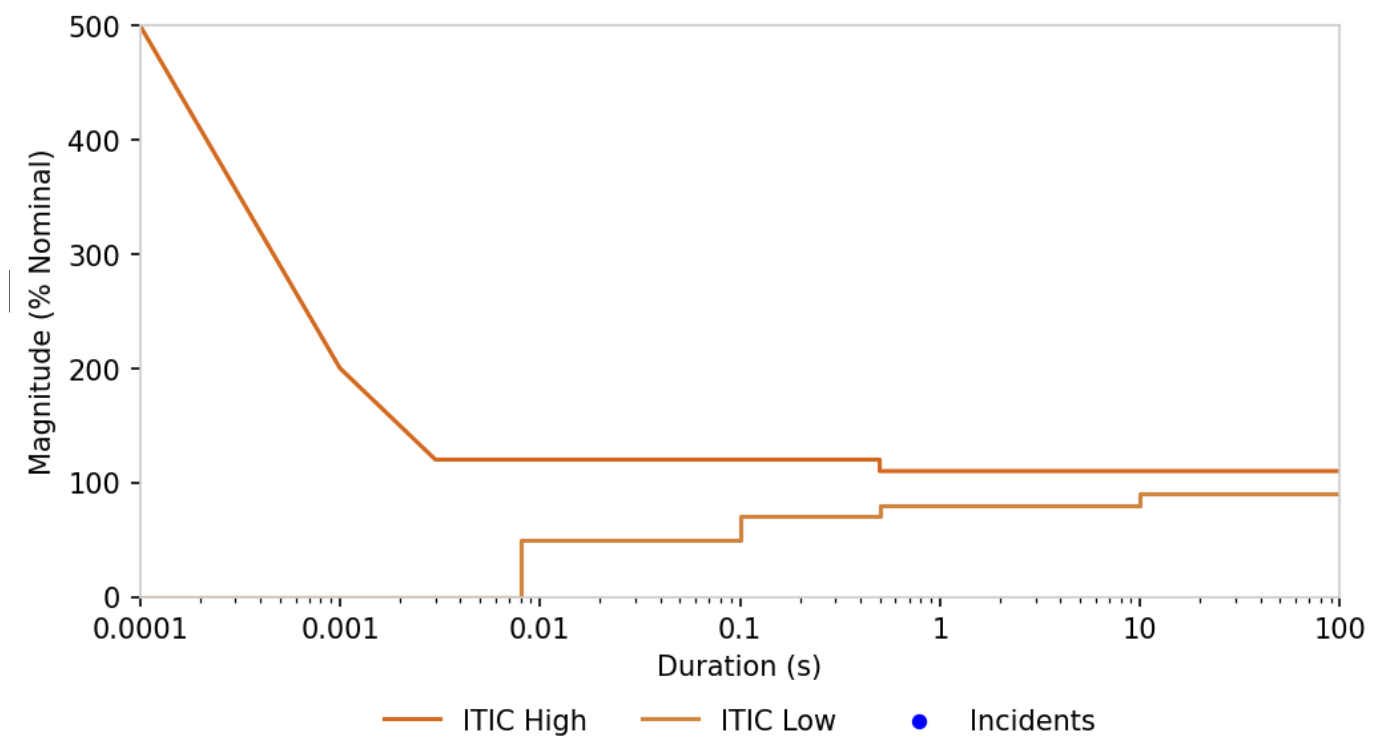

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/28/2026 03:44:53 PM	Trafo 5	Sag	V1	49796.739	88.09