


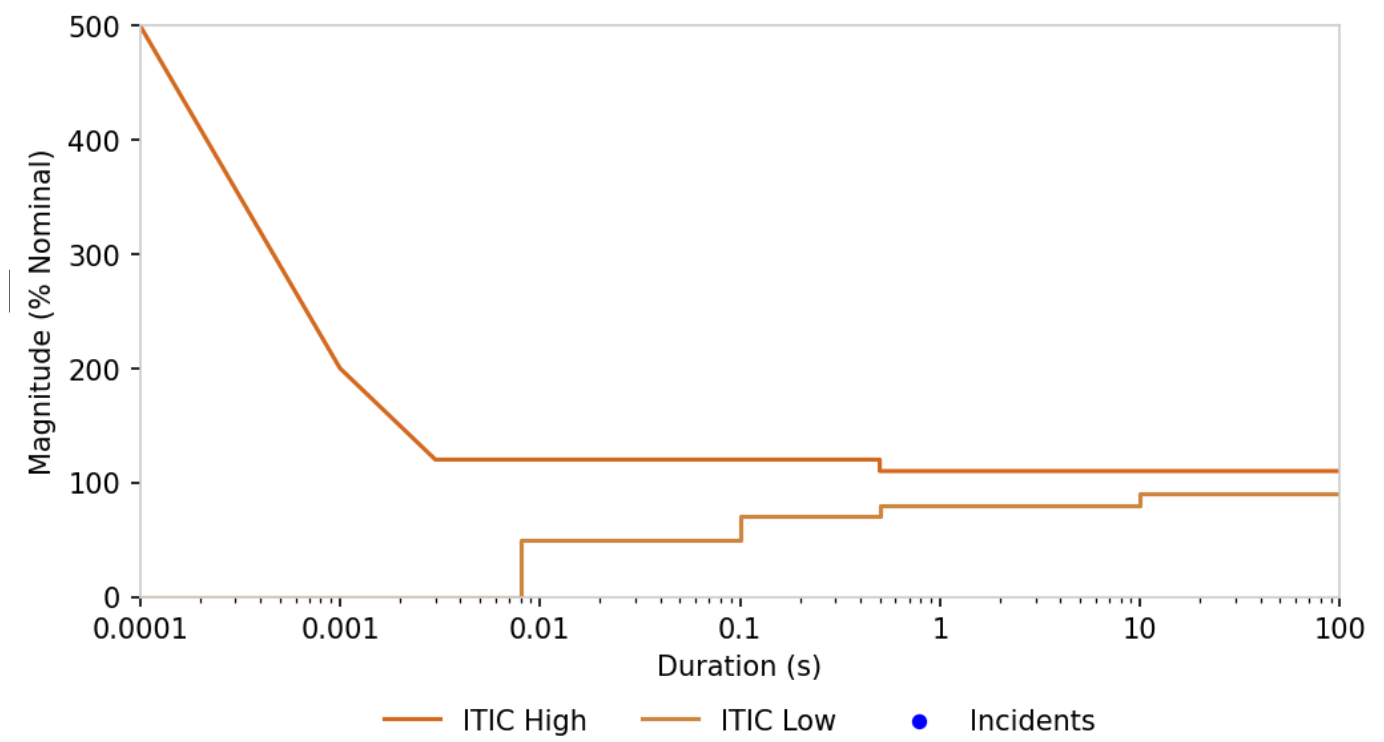

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/29/2026 09:16:36 PM	Trafo 5	Sag	V1	6392.759	87.90