


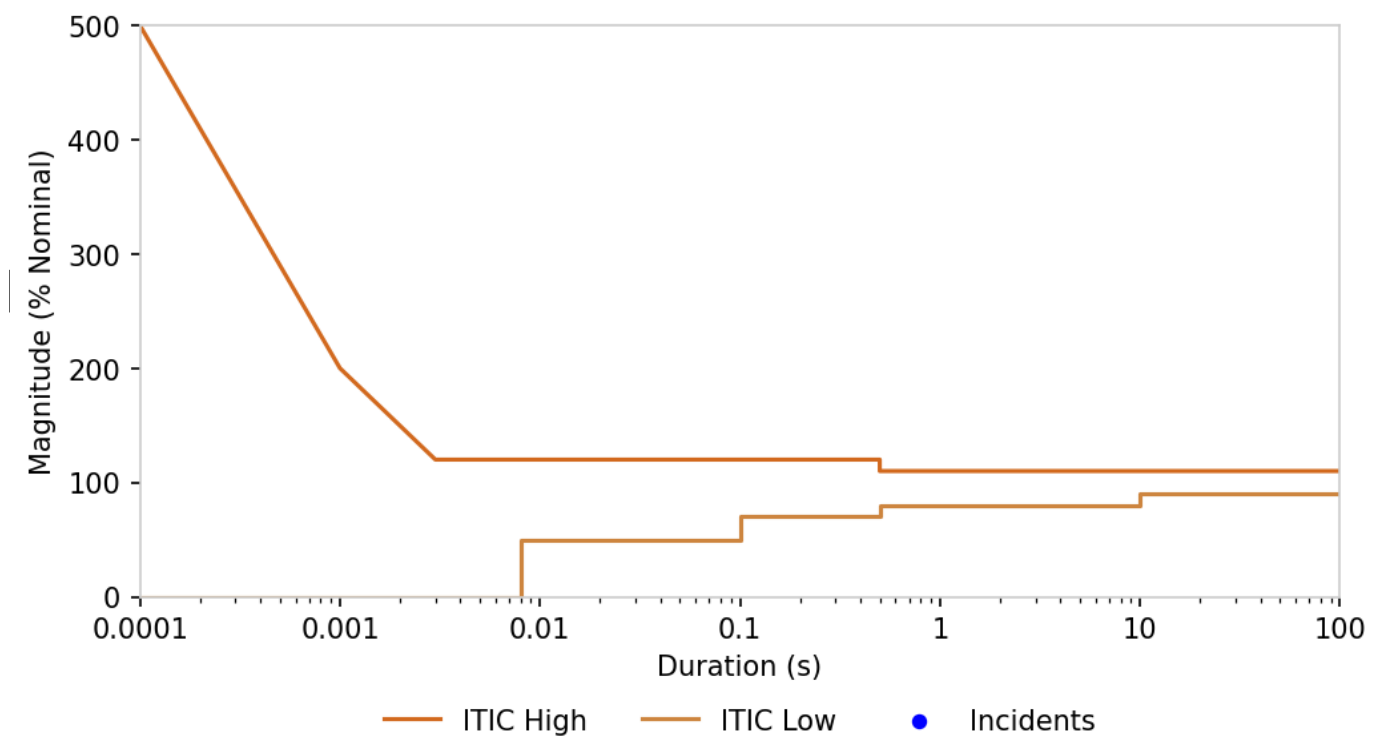

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/29/2026 11:15:17 PM	Trafo 5	Sag	V1	1668.060	88.58