


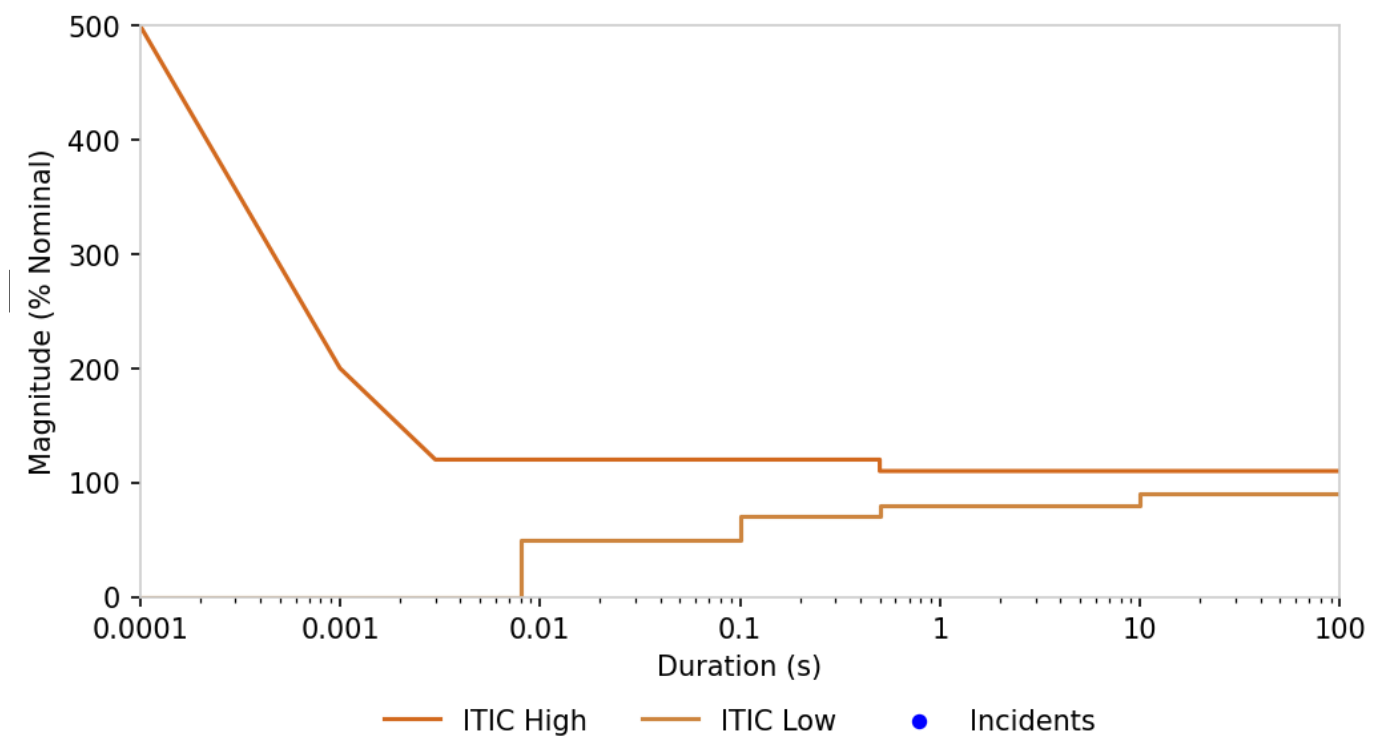

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/29/2026 11:43:44 PM	Trafo 5	Sag	V1	16832.620	88.09