


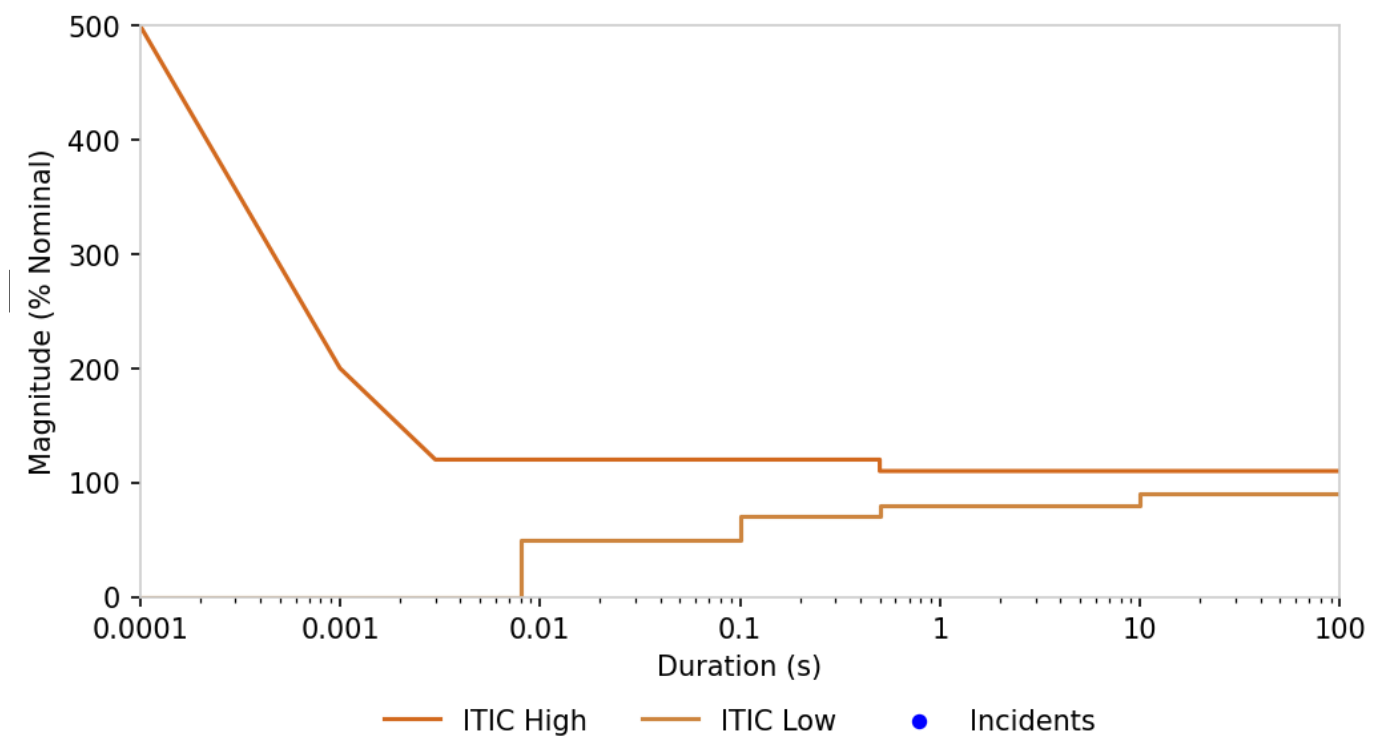

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/30/2026 05:28:08 AM	Trafo 5	Sag	V1	280.655	89.49