


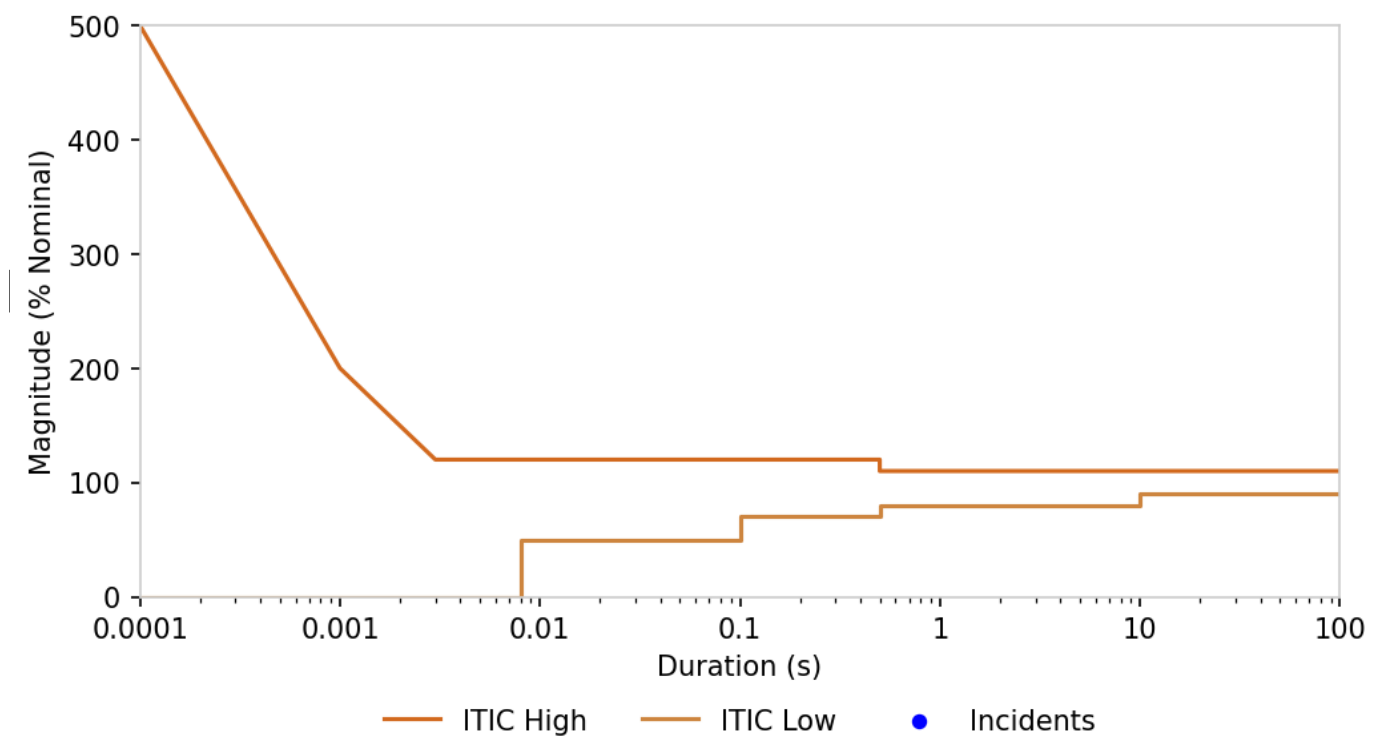

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/30/2026 05:34:44 AM	Trafo 5	Sag	V1	15186.189	88.28