


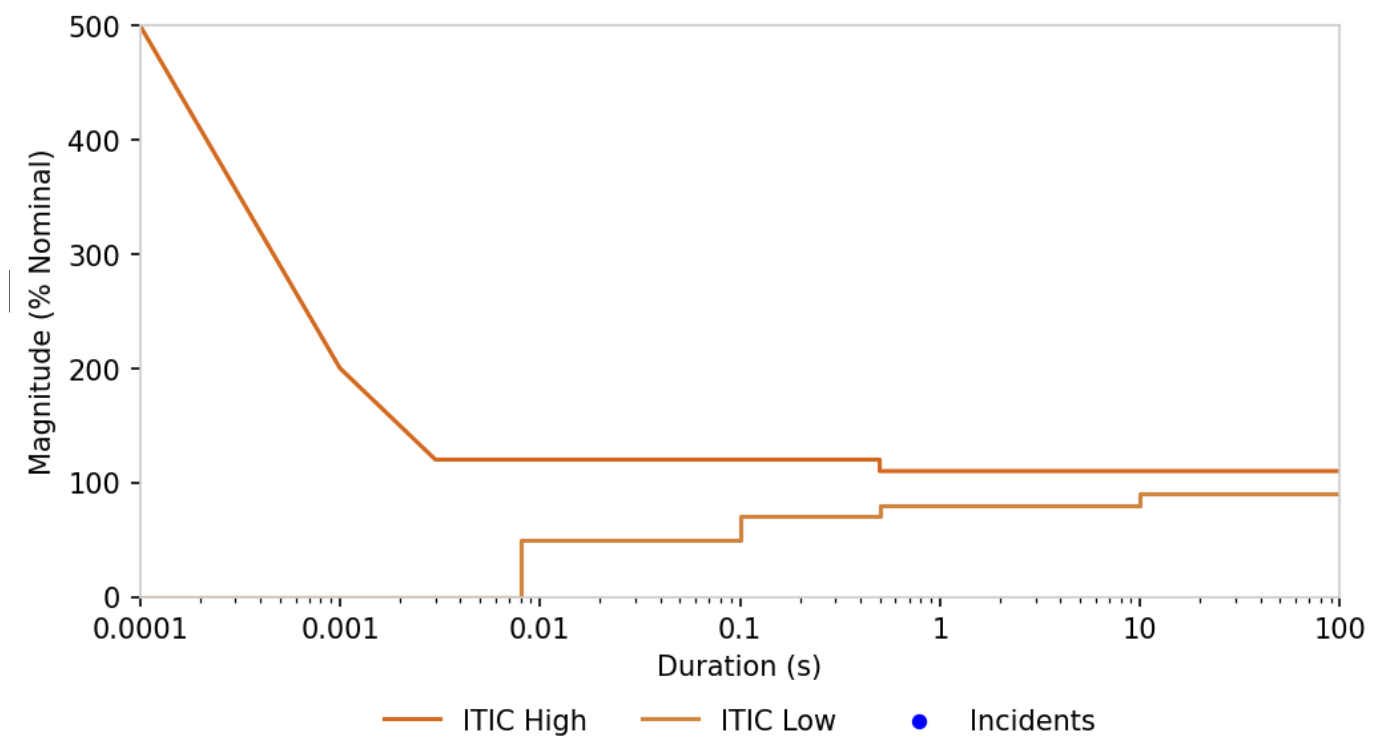

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/30/2026 01:06:20 PM	Trafo 5	Sag	V1	17946.553	88.00