


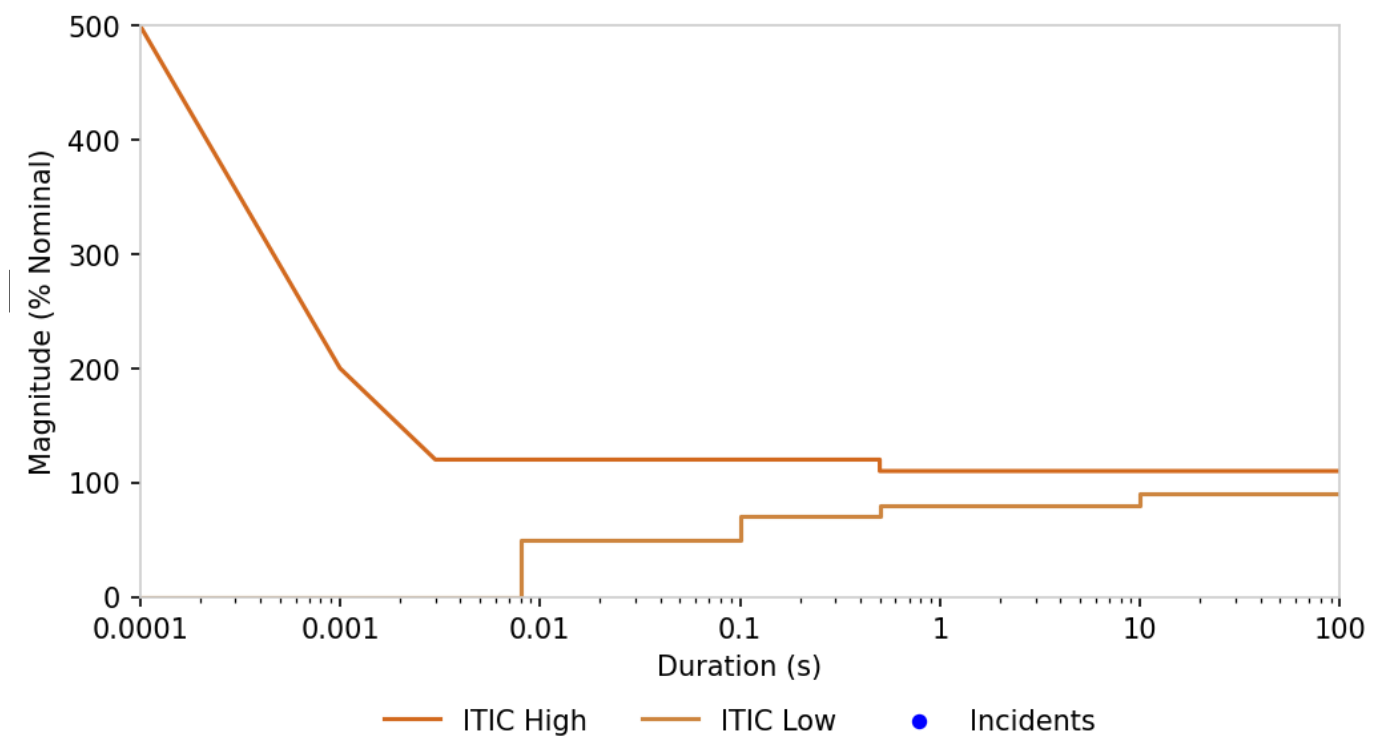

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/30/2026 07:42:57 PM	Trafo 5	Sag	V1	1842.667	88.61