


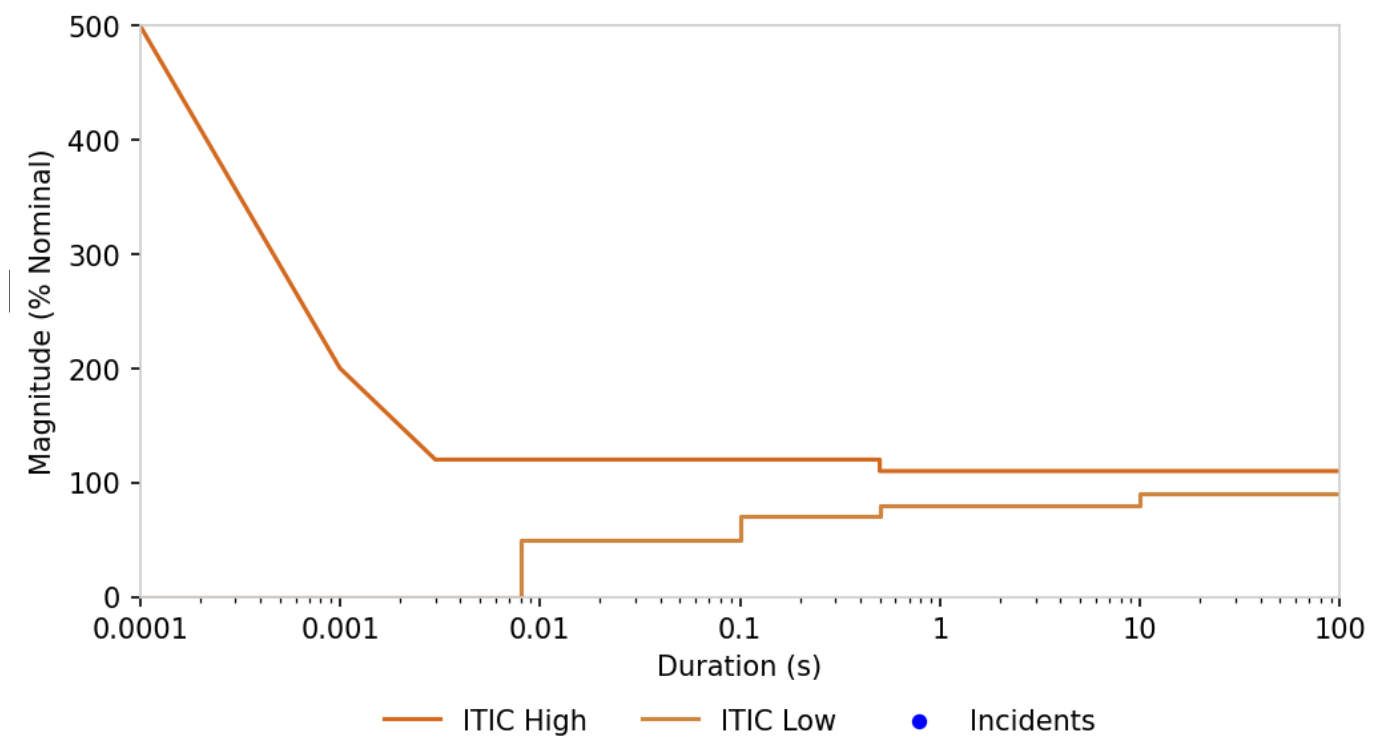

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/30/2026 08:14:09 PM	Trafo 5	Sag	V1	10055.214	88.67