


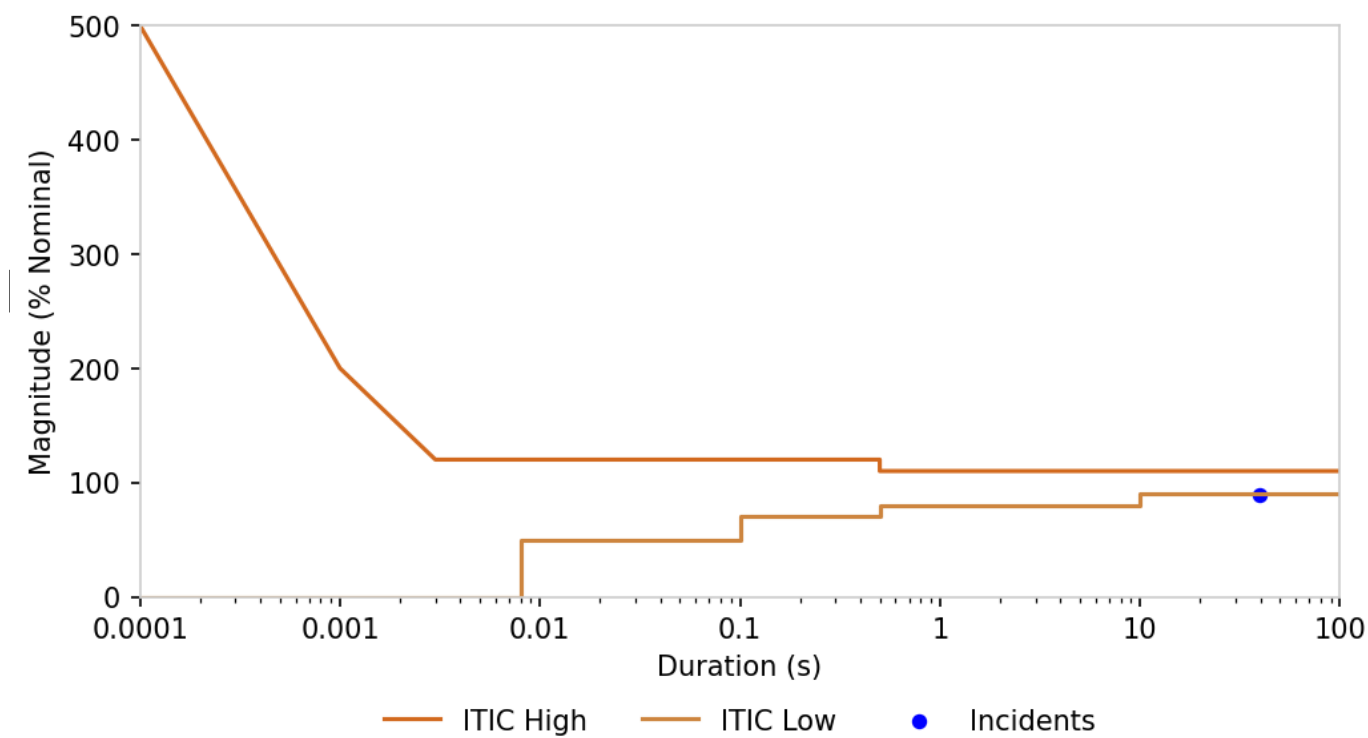

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/31/2026 03:59:57 PM	Trafo 5	Sag	V1	39.356	89.02