


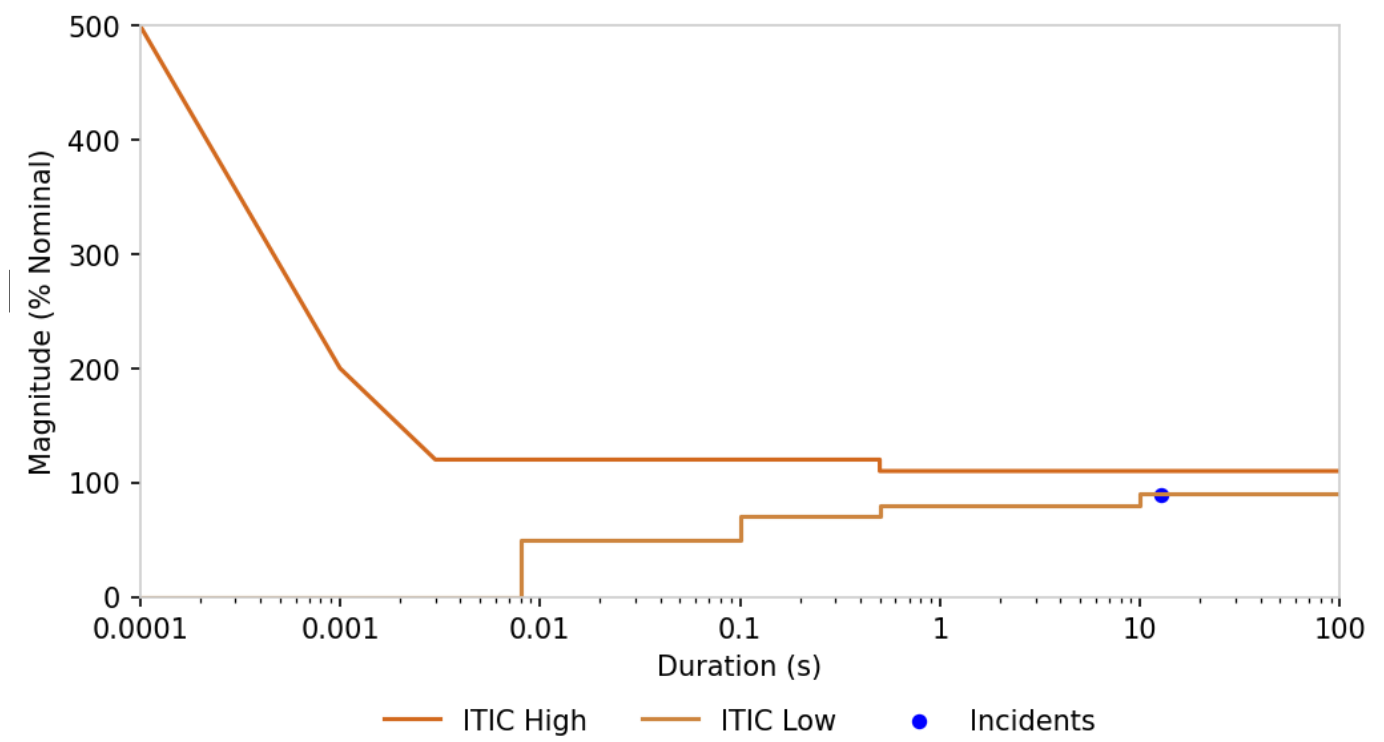

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/31/2026 04:33:51 PM	Trafo 5	Sag	V1	12.762	89.51