


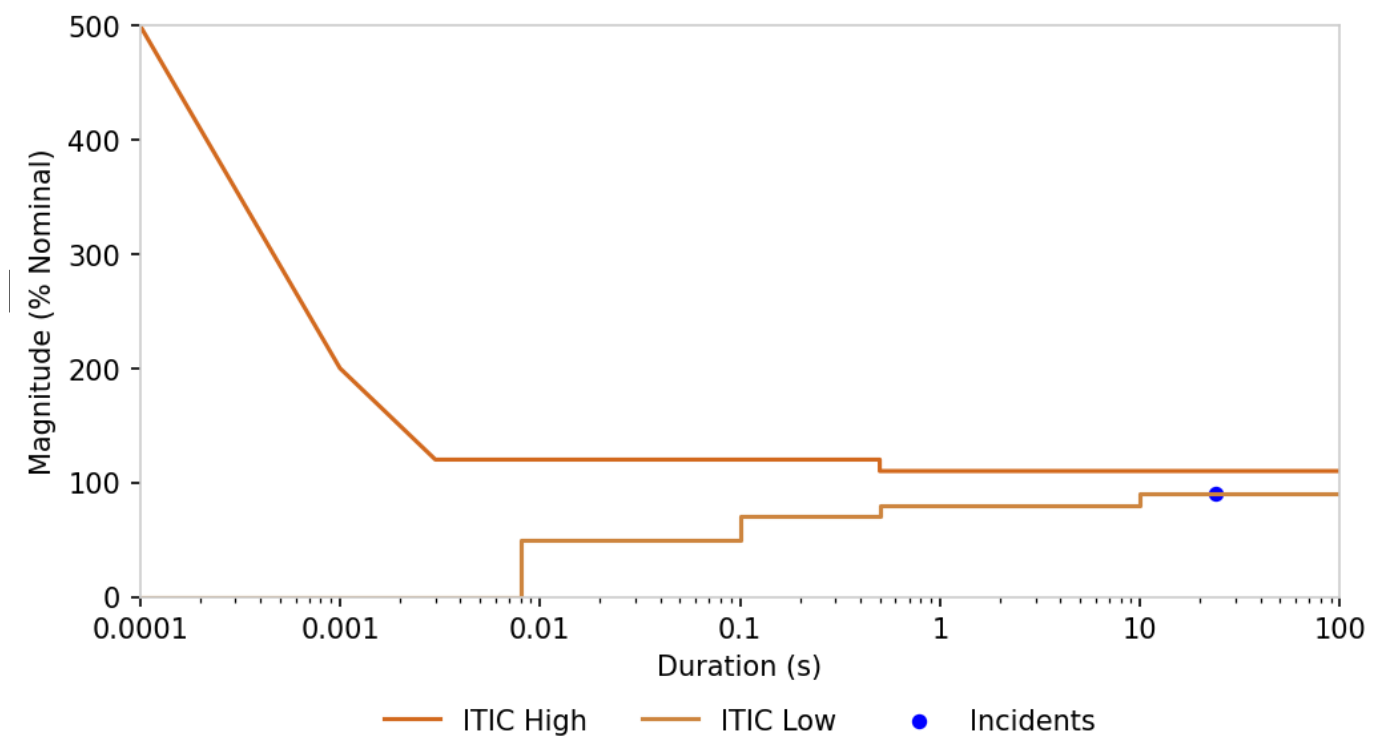

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	05/31/2026 08:34:17 PM	Trafo 5	Sag	V1	23.770	89.69