


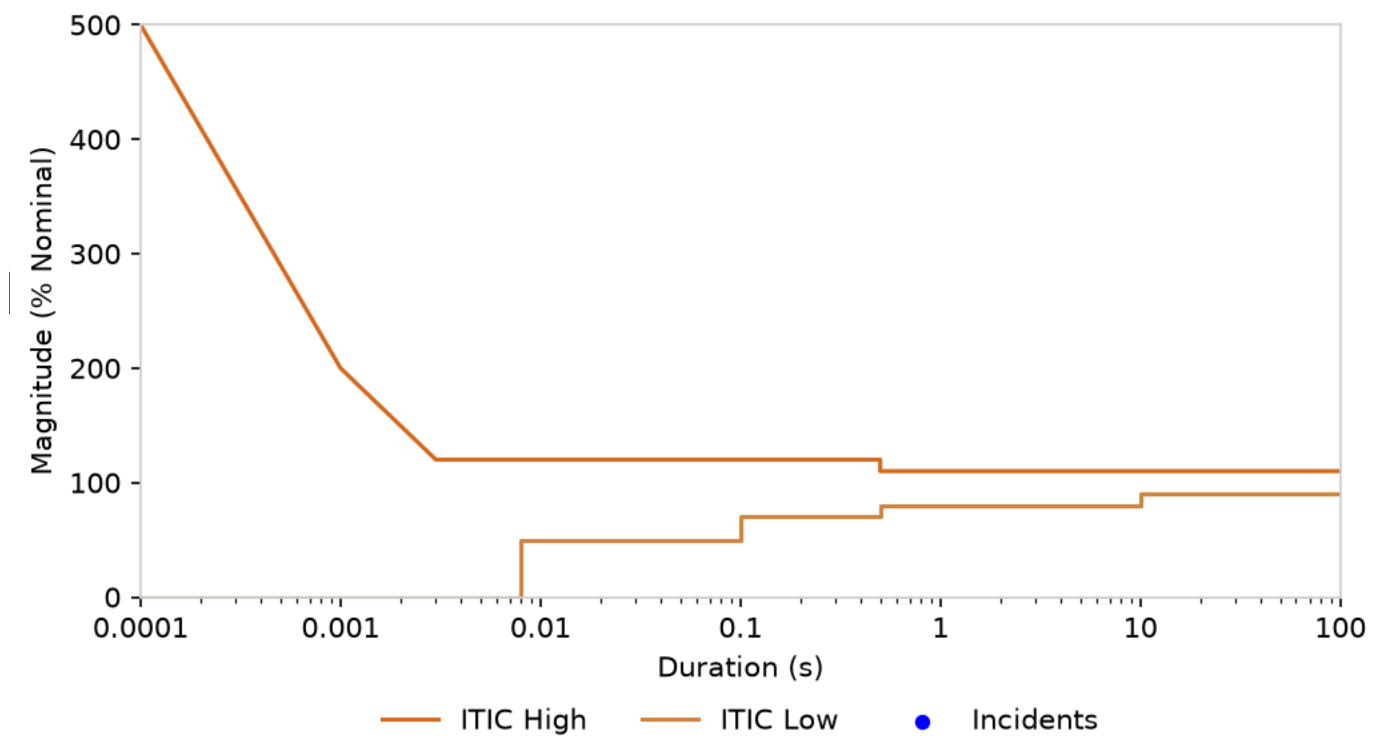

Worst Disturbance per Incident						
ID	Incident Time	Meter	Type	Phase	Duration (s)	Magnitude (%)
1	07/23/2026 12:53:00 PM	Trafo 5	Sag	V1	16641.656	88.20