


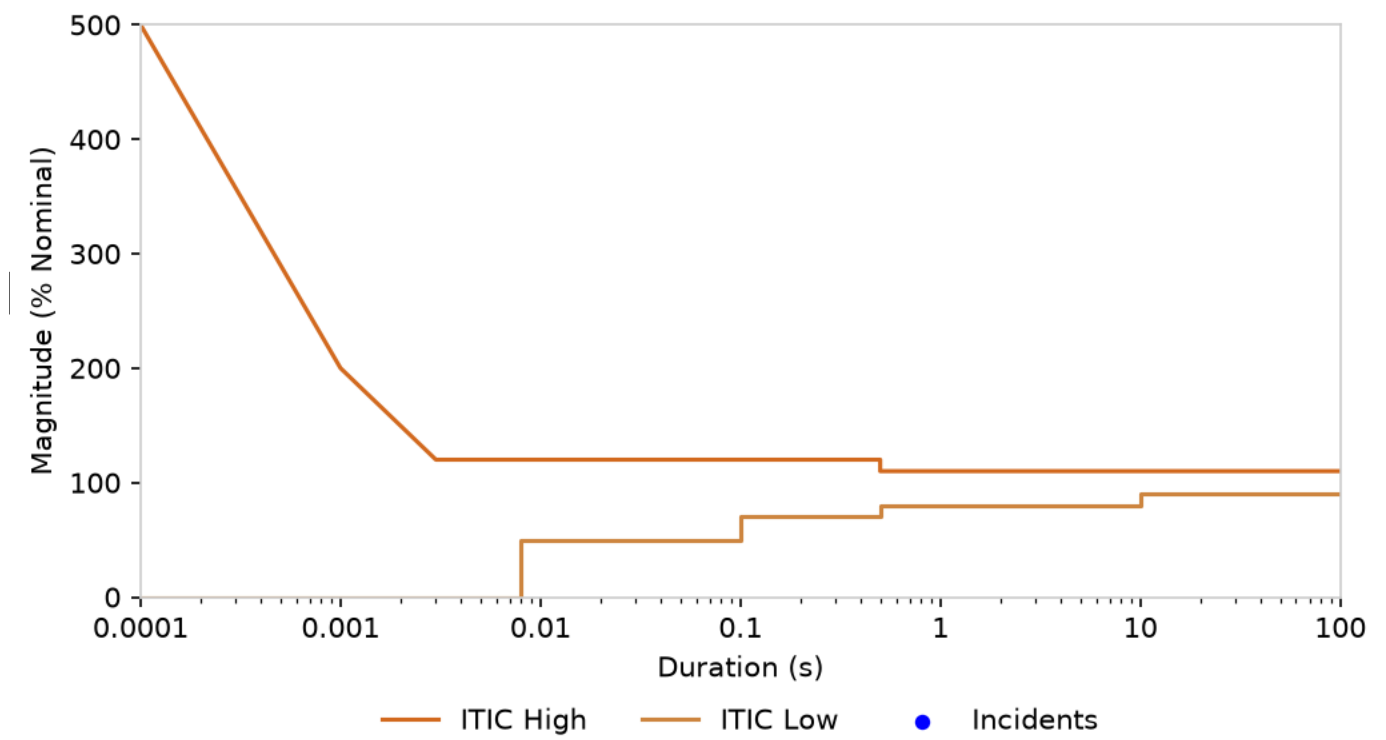

| Worst Disturbance per Incident |                        |         |      |       |              |               |
|--------------------------------|------------------------|---------|------|-------|--------------|---------------|
| ID                             | Incident Time          | Meter   | Type | Phase | Duration (s) | Magnitude (%) |
| 1                              | 07/23/2026 05:36:34 PM | Trafo 5 | Sag  | V1    | 1375.021     | 89.44         |