



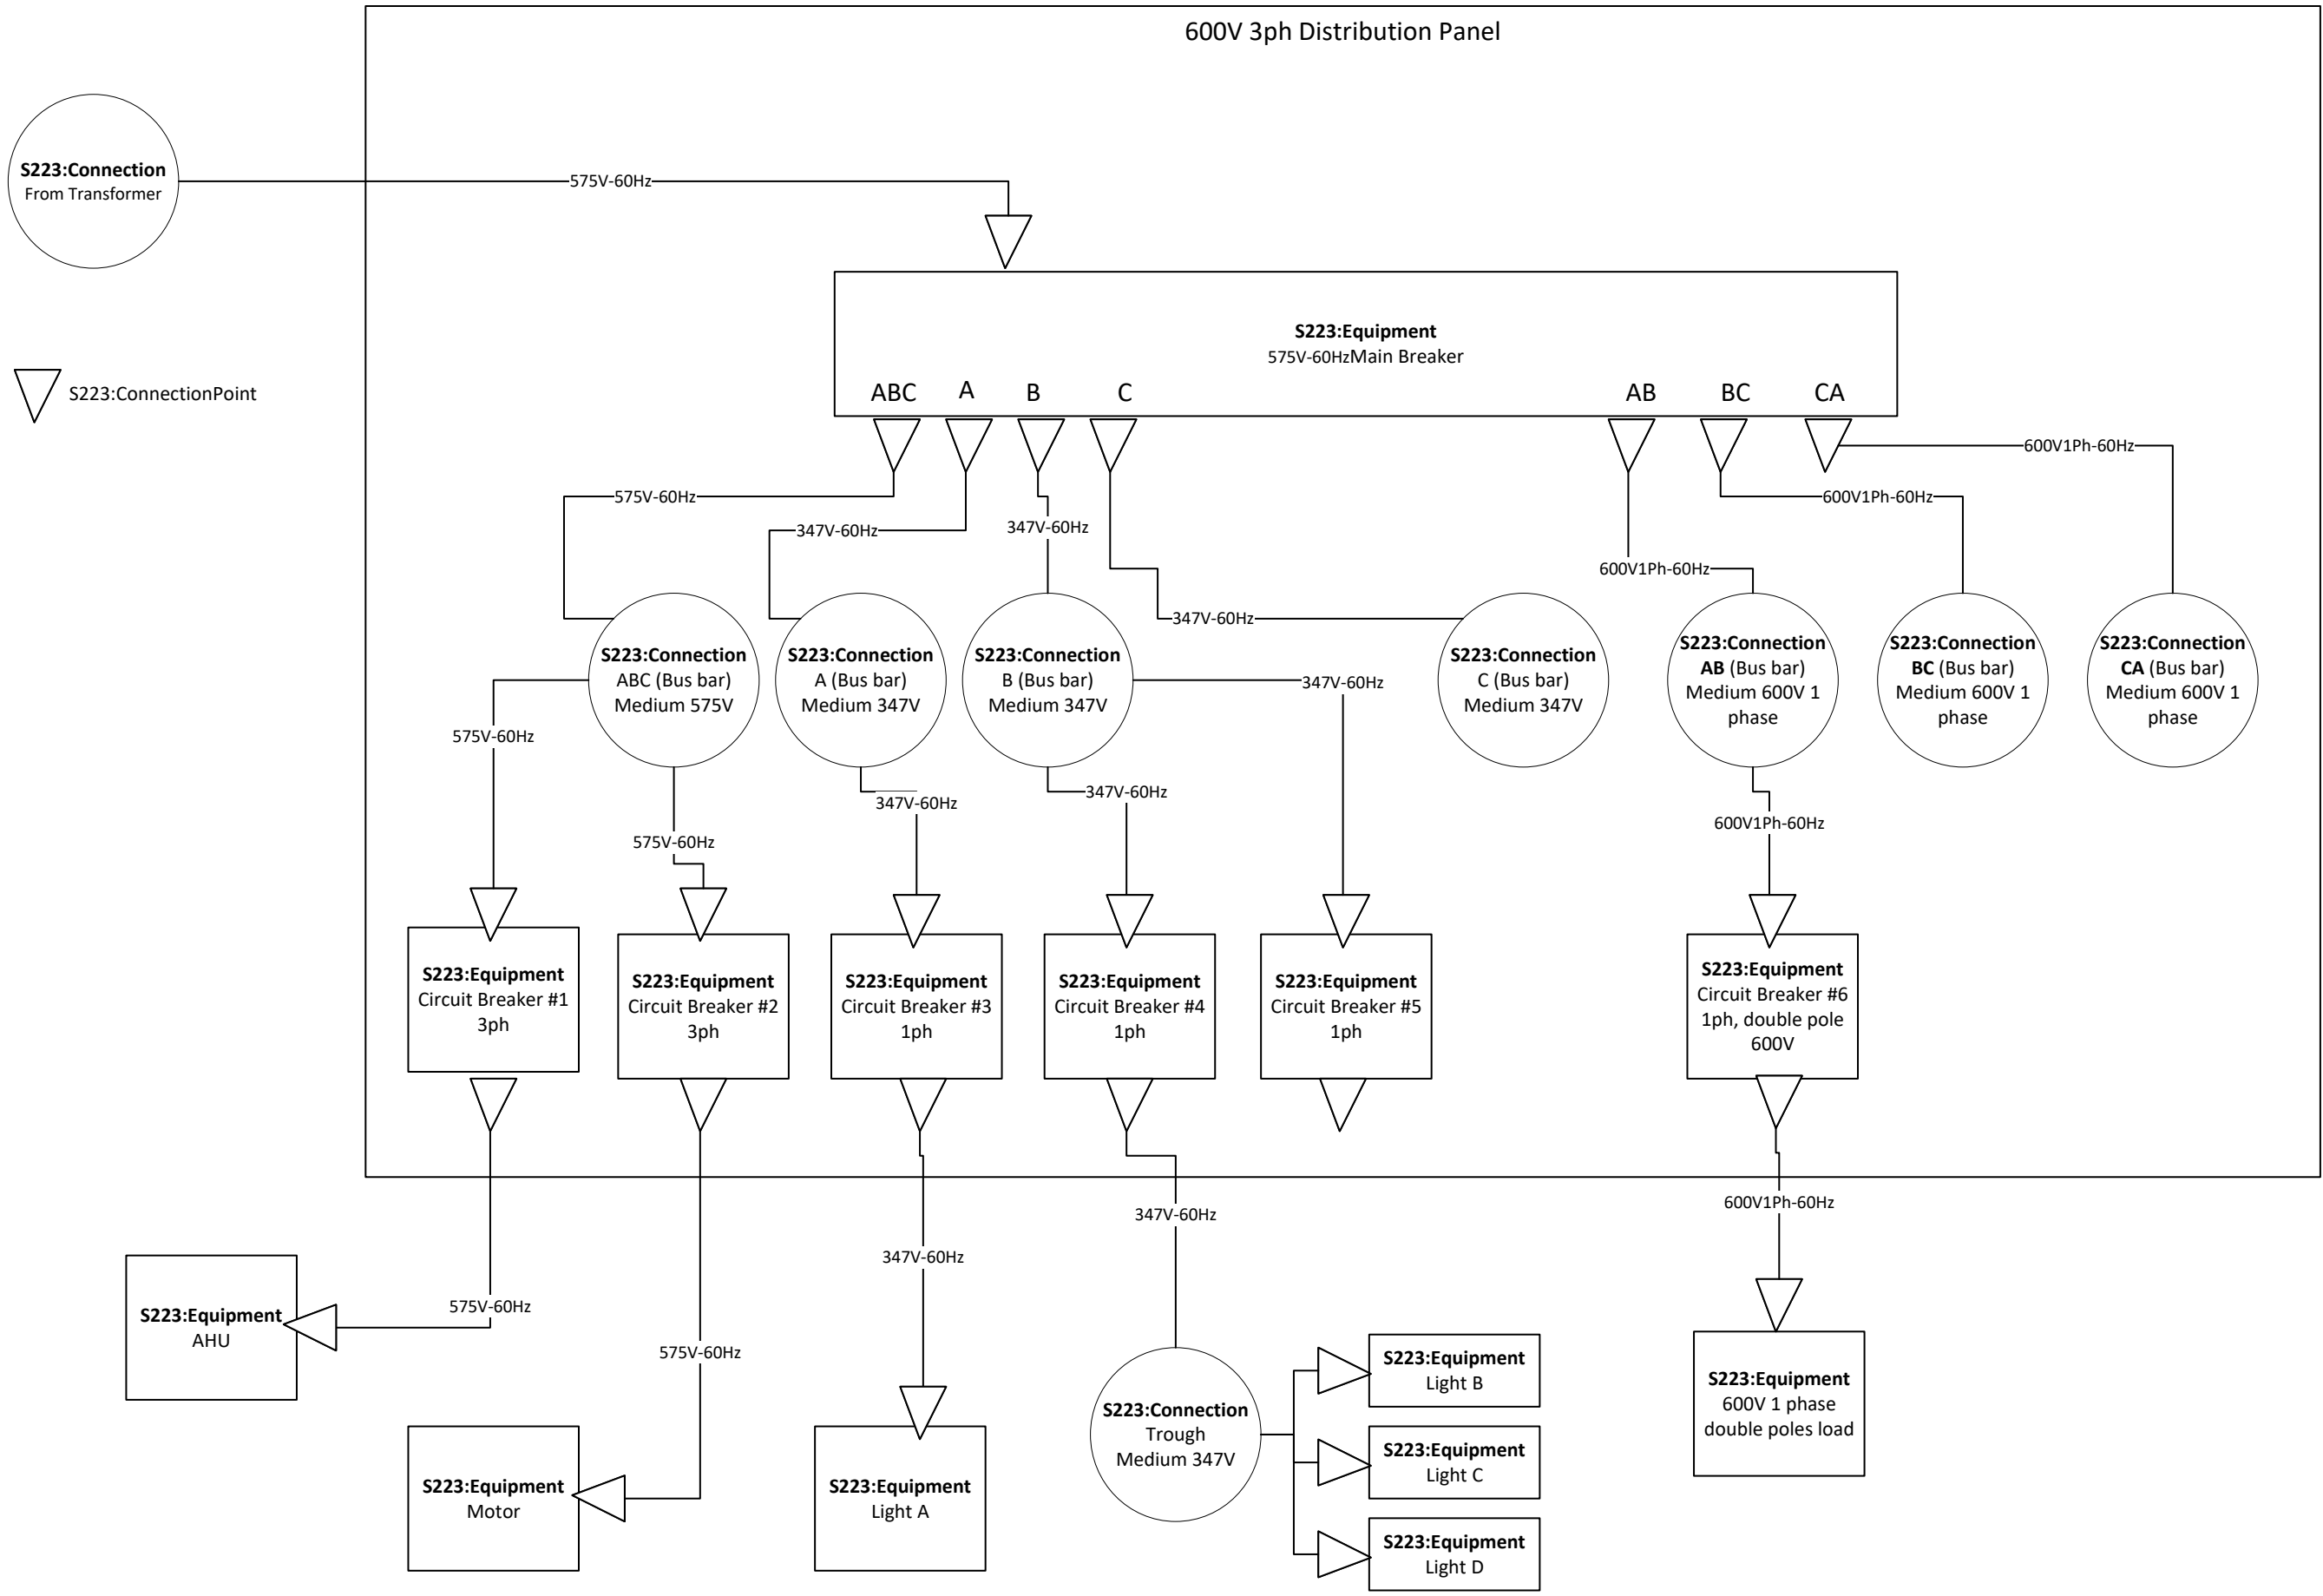
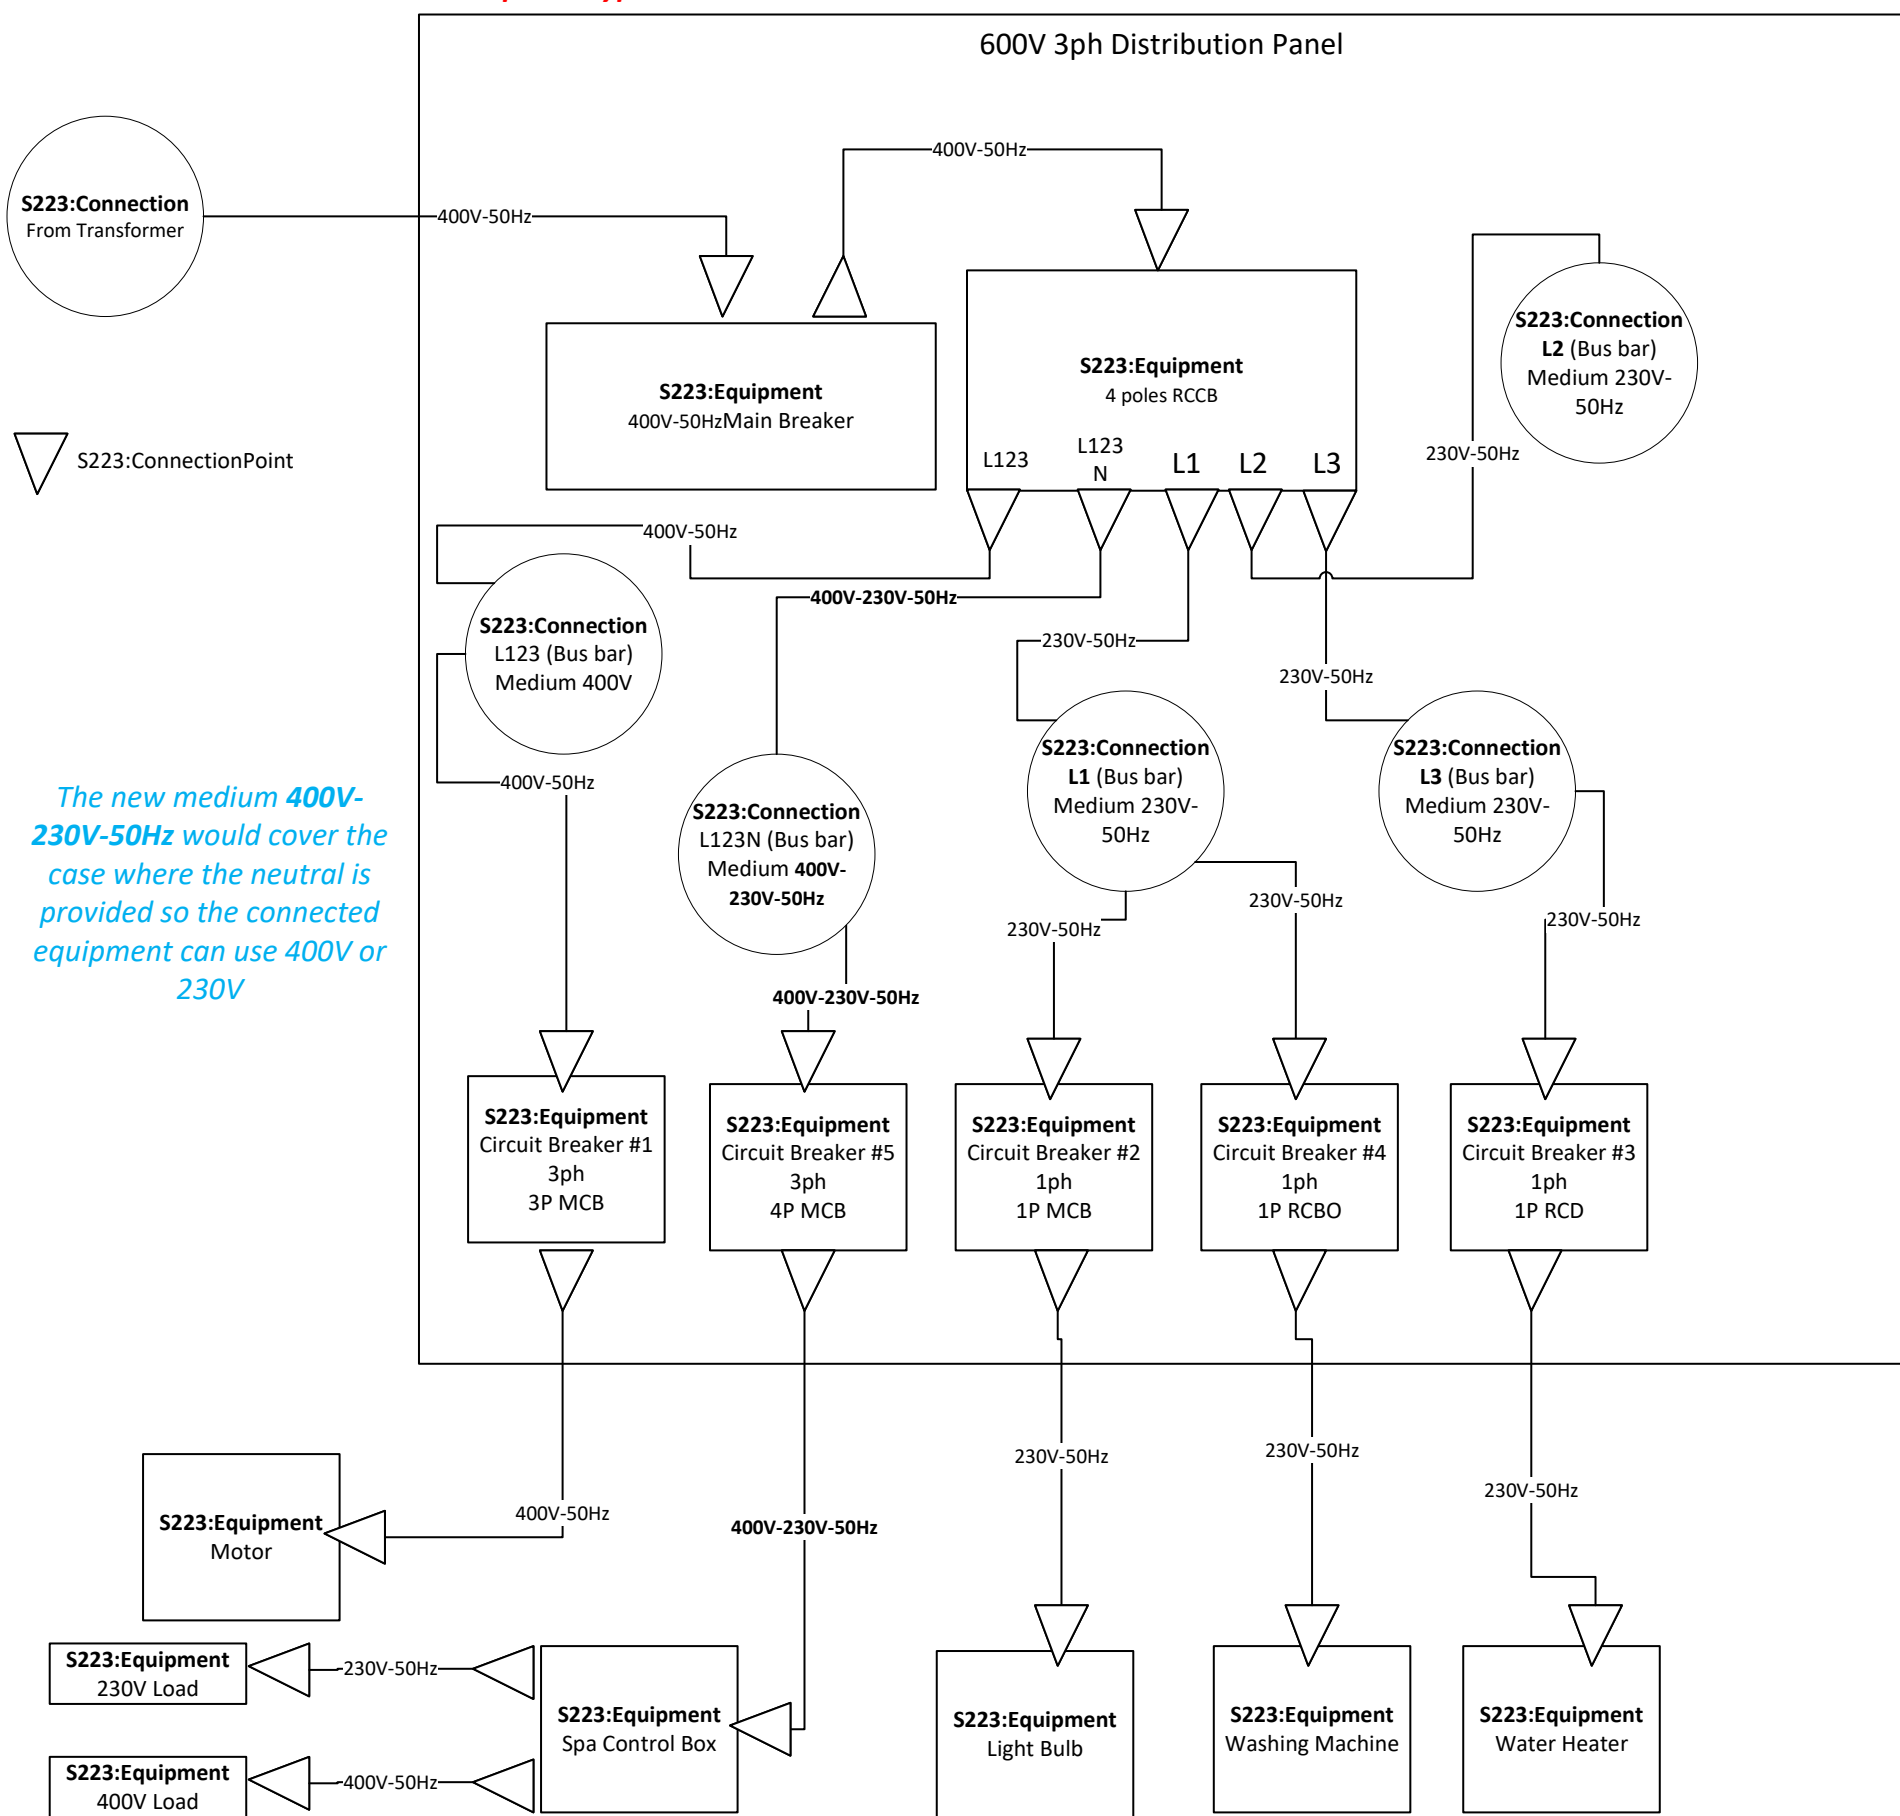


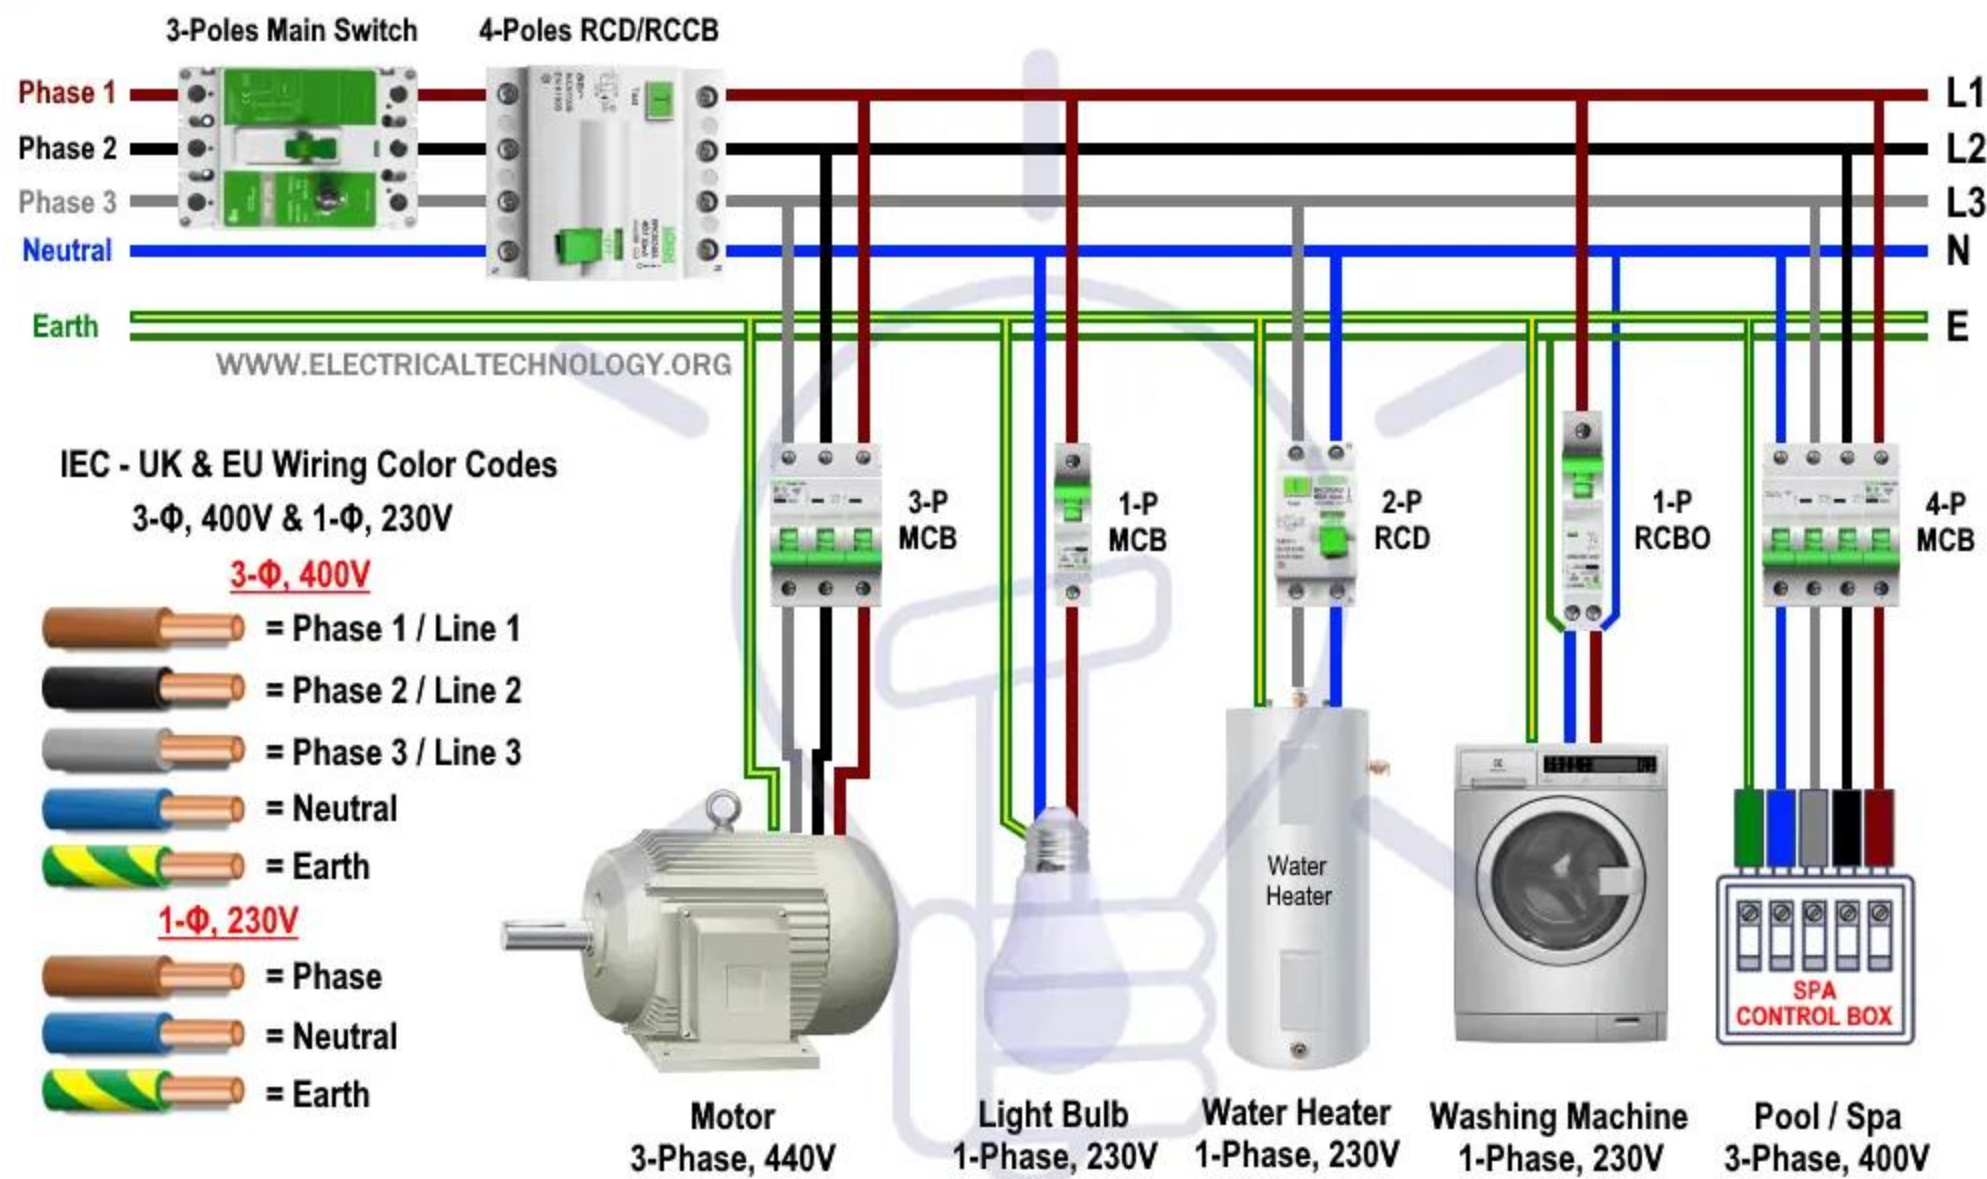

Wiring 400V, 3-Φ & 230V, 1-Φ Load Circuits in Distribution Board

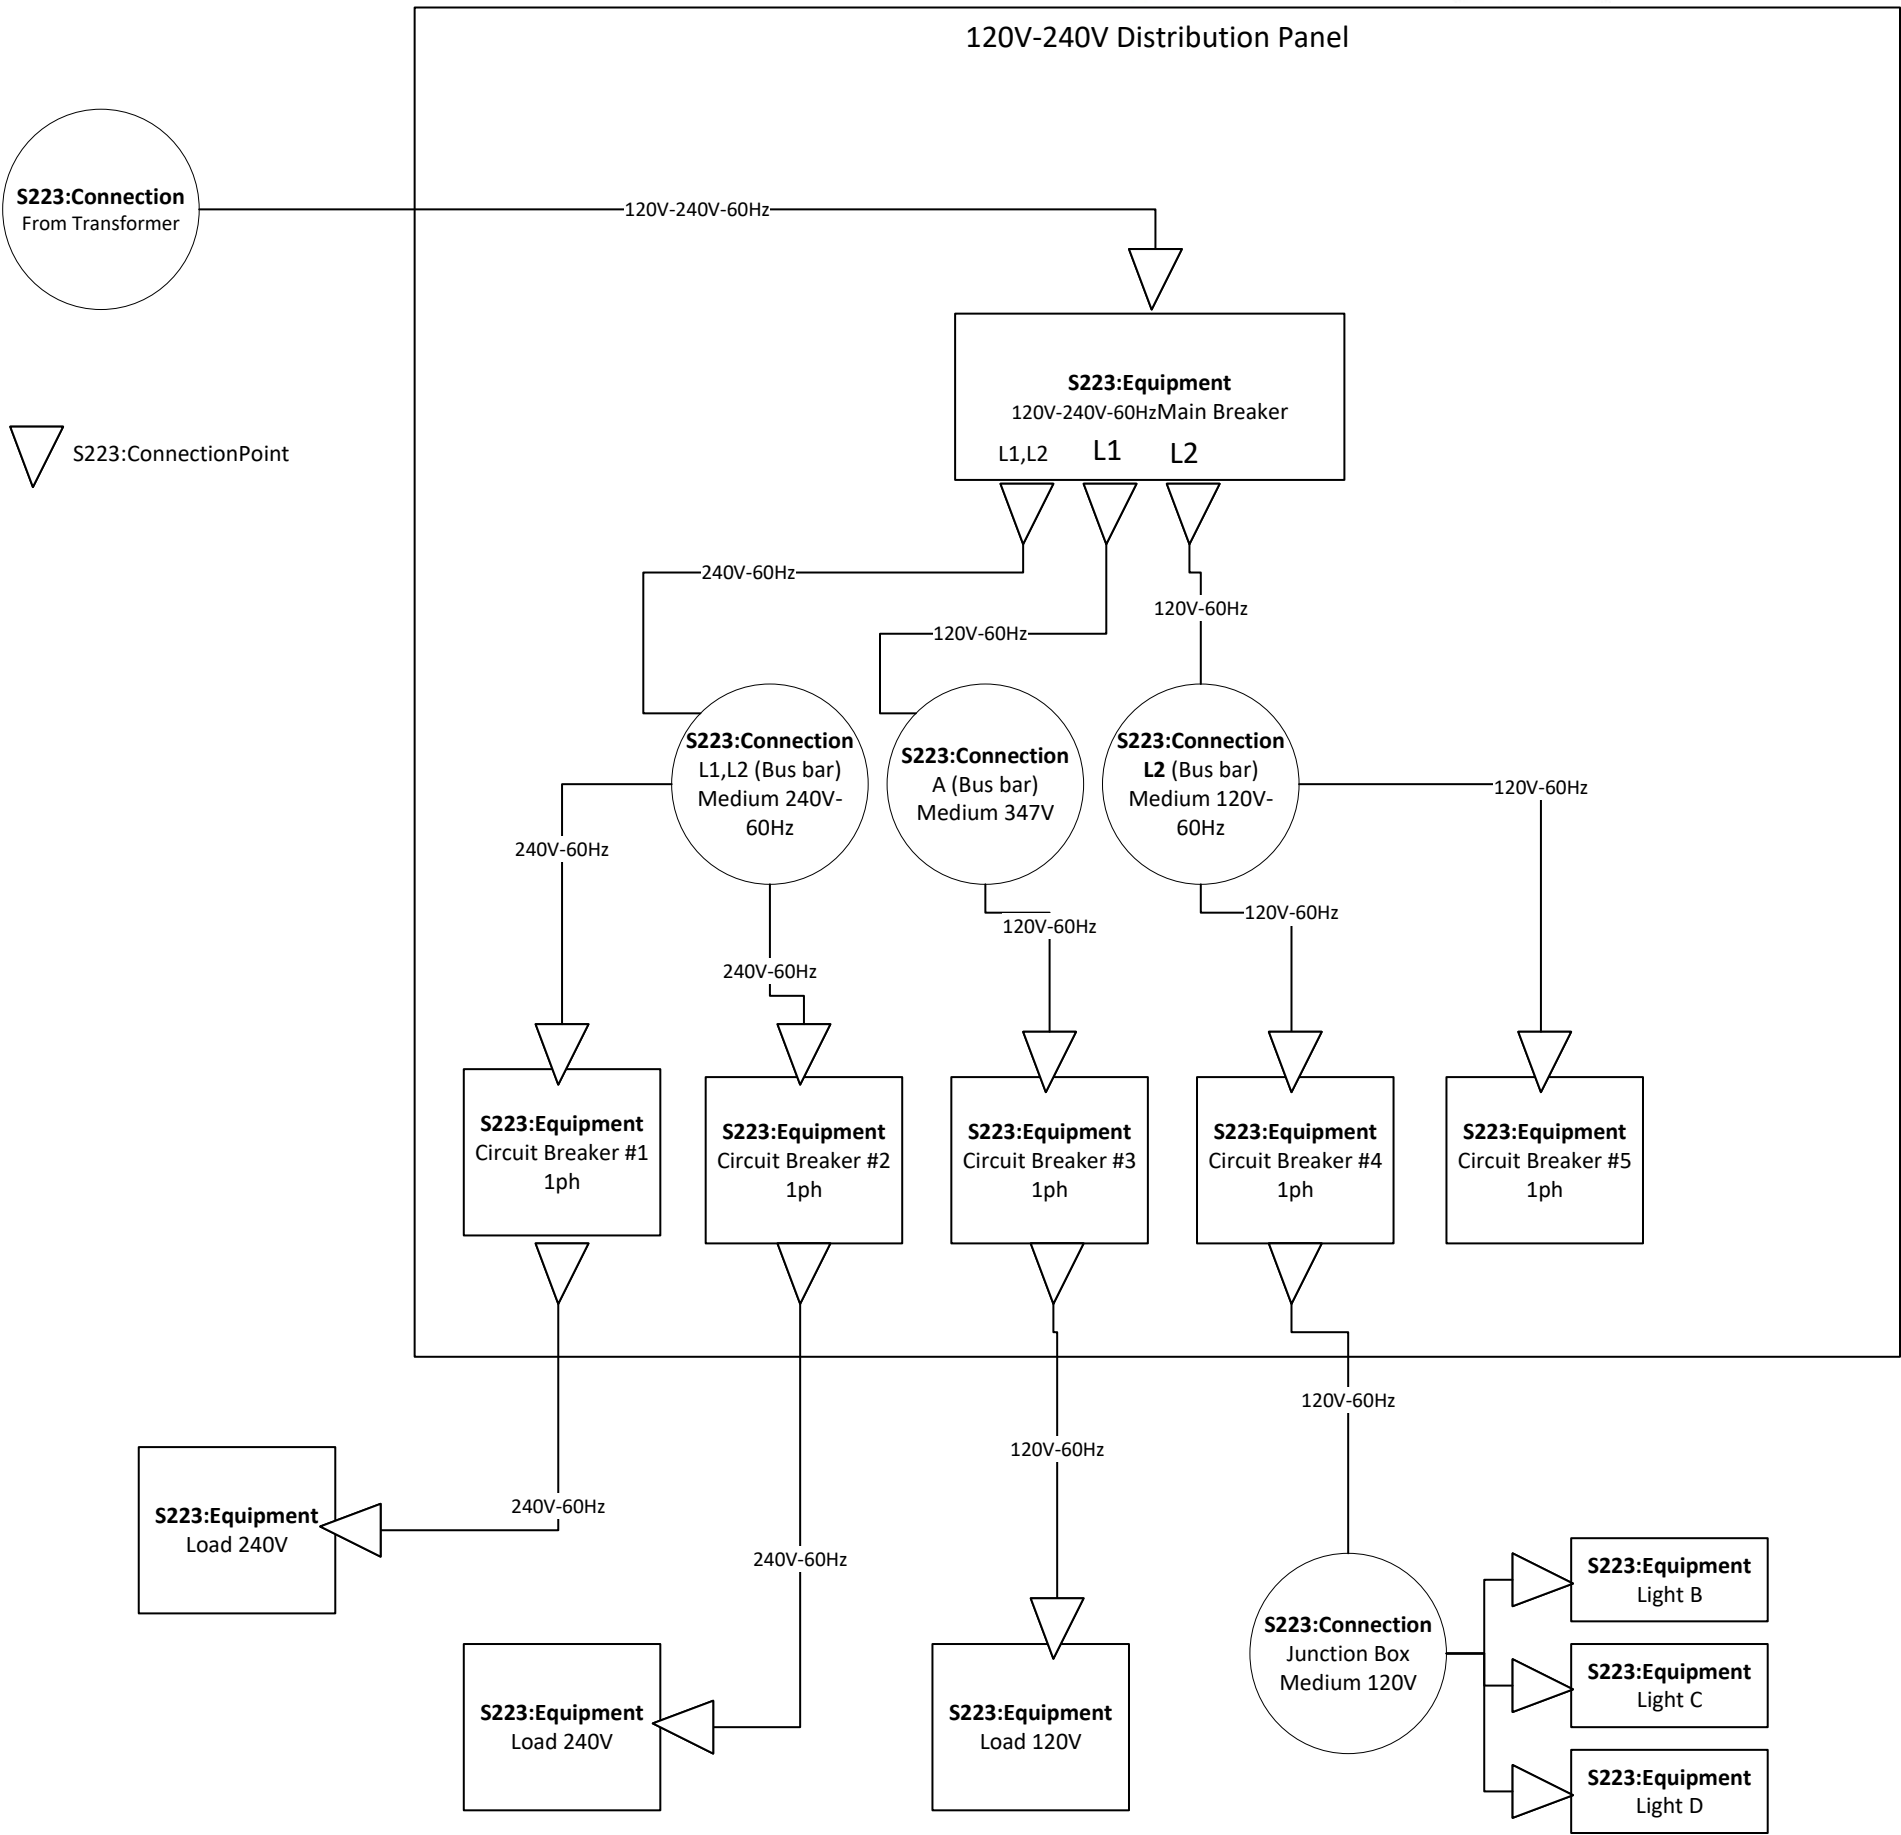

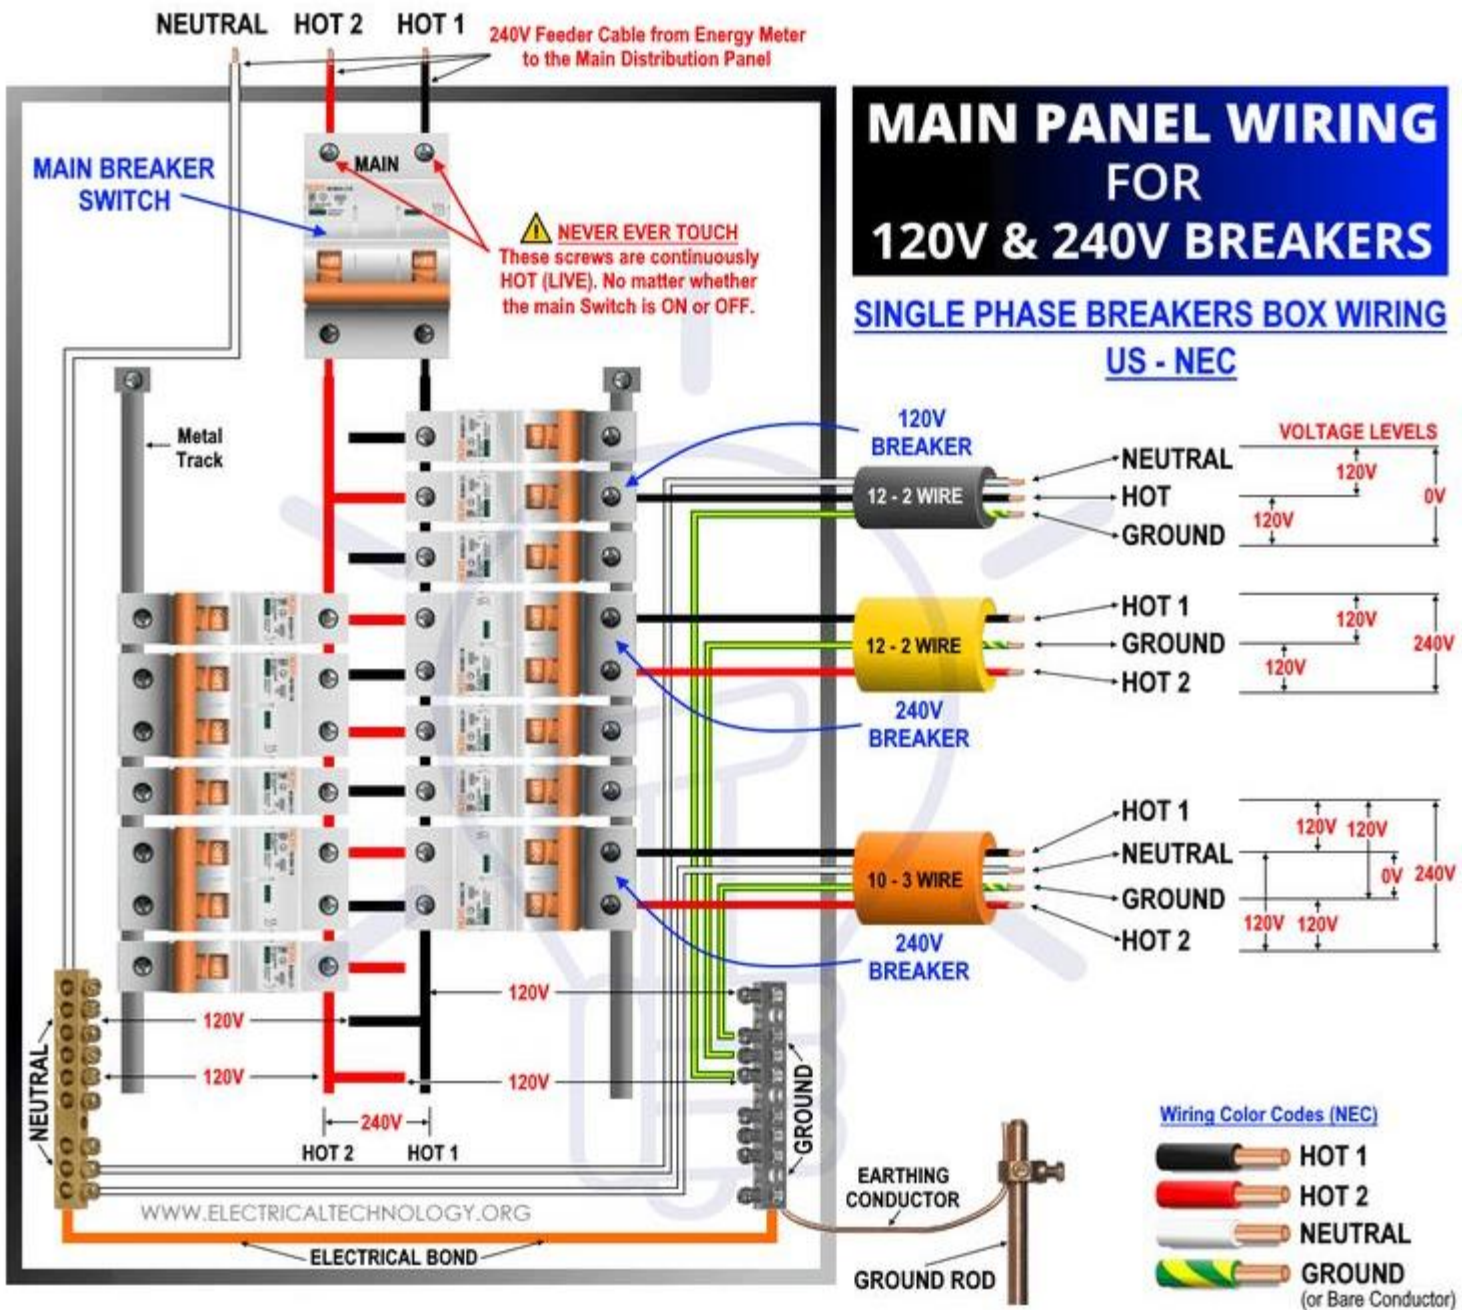

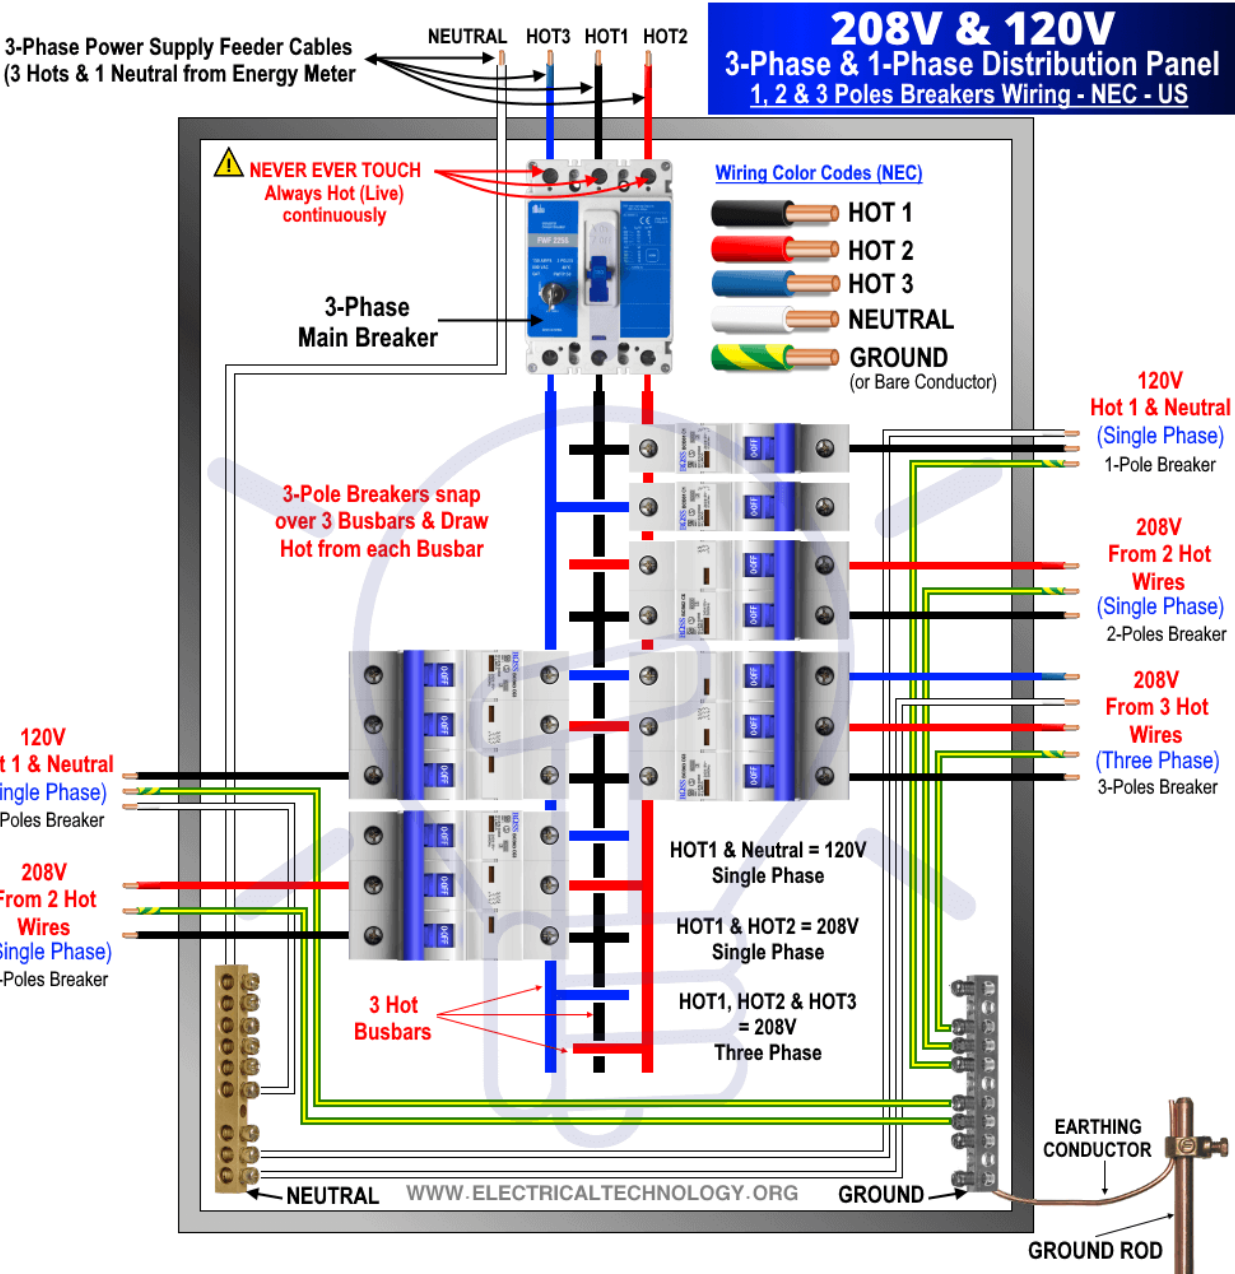

I'm pretty sure that not using all phases on a 3 poles breaker is not legal in Quebec... or at least, not recommended

If I'm wrong, those two special cases would need to be defined as special equipment with inlet and outlet according to their configuration

