


Experiment 2: Voltage Distribution Analysis
(302-Hour Operation)



Experiment 2: Statistical Analysis - 302-Hour Extended MFC Operation

Statistical Performance Metrics

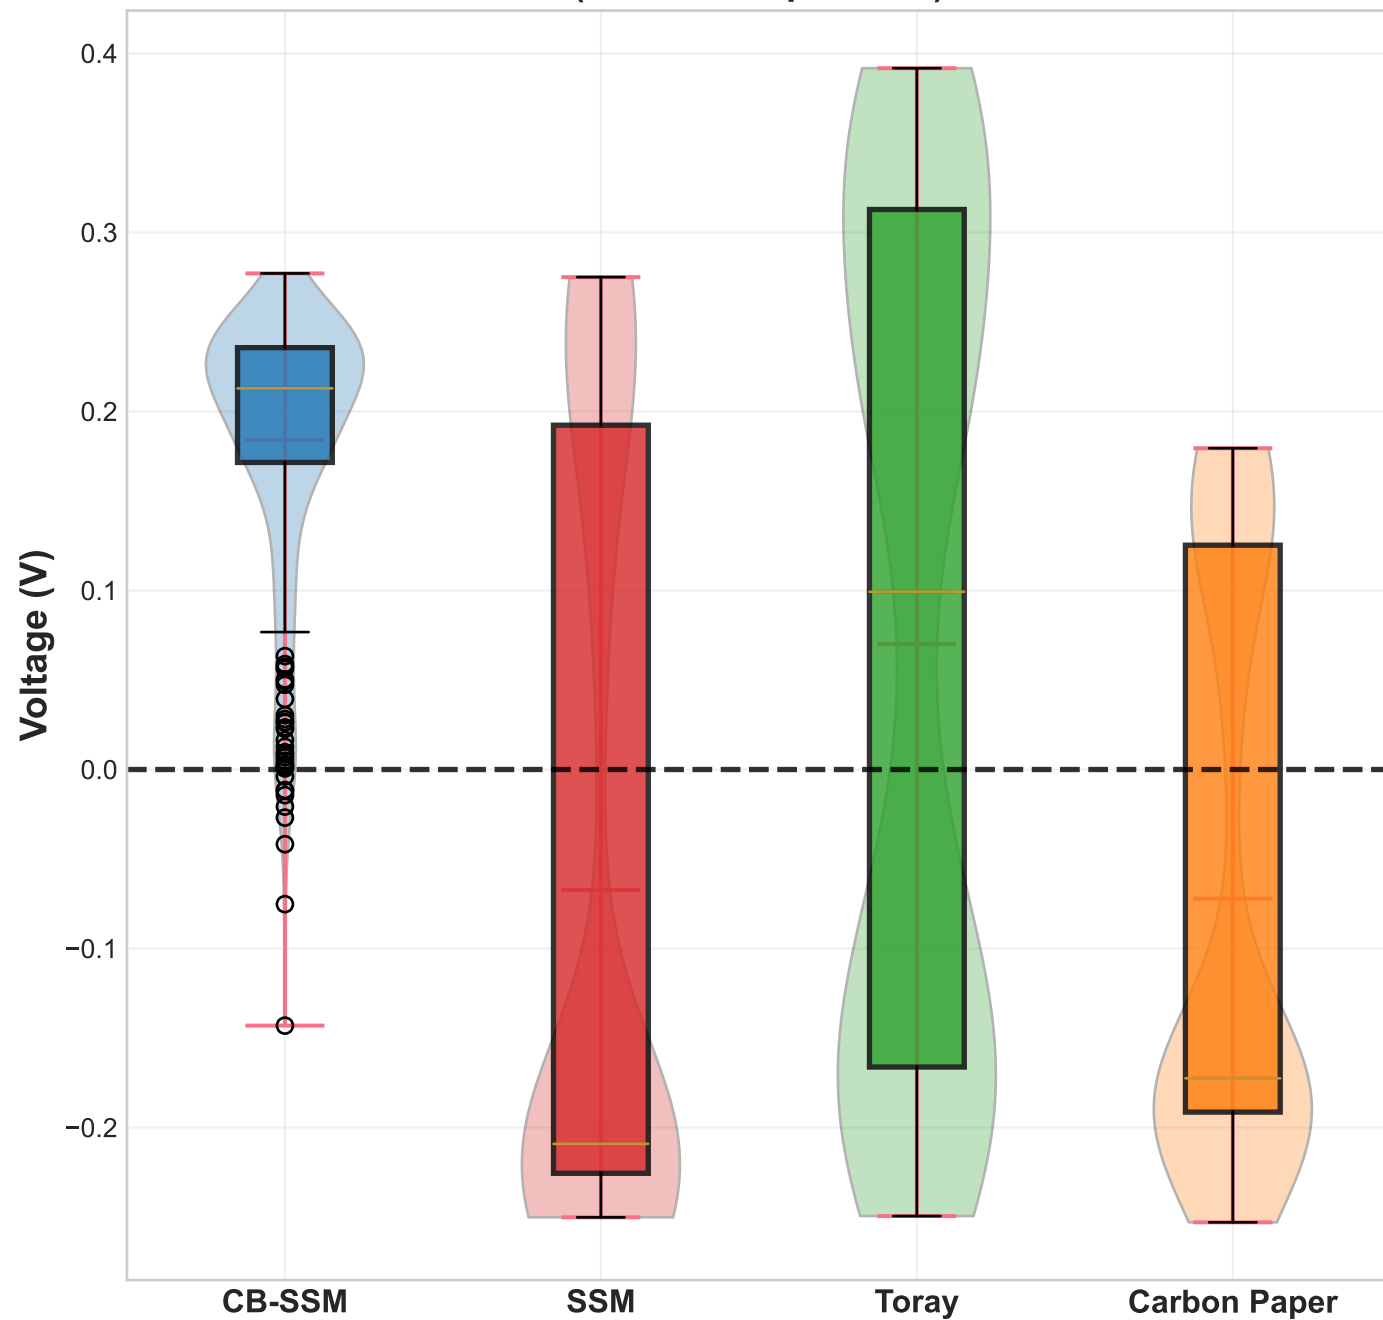