MAJOR PROJECT REPORT

ON

ASSESSMENT OF INDOOR AIR QUALITY IN AN EDUCATIONAL INSTITUTION

{PVPSIT}

Submitted in partial fulfilment of the requirement for the award of the Degree in

BACHELOR OF TECHNOLOGY
IN
CIVIL ENGINEERING

Submitted by

M.HANIL KUMAR (19501A0129)

K.HRUTHIK (19501A0120)

T. MOHAN (19501A0142)

M. SWARNA JATHIN (19501A0128)

Under the Esteemed Guidance of

Dr. Manne Anupama Ammulu

(Assistant Professor)

DEPARTMENT OF CIVIL ENGINEERING

PRASAD V. POTLURI SIDDHARTHA INSTITUTE OF TECHNOLOGY

(AUTONOMOUS)

Affiliated to JNTU Kakinada, Approved by AICTE, New Delhi

Accredited by NBA & NAAC A+, ISO 9001:2015 Certified

Institution KANURU, VIJAYAWADA-520007

2022-2023

PRASAD V. POTLURI SIDDHARTHA INSTITUTE OF TECHNOLOGY
(Autonomous)
DEPARTMENT OF CIVIL ENGINEERING
KANURU, VIJAYAWADA-520007

CERTIFICATE

This is to certify that the major project work entitled "**ASSESSMENT OF INDOOR AIR QUALITY IN AN EDUCATIONAL INSTITUTION"** is a record of bonafide work carried out by **M.HANIL KUMAR (19501A0129), K.HRUTHIK (19501A0120), T. MOHAN (19501A0142), M. SWARNA JATHIN (19501A0128) for** the award of **BACHELOR OF TECHNOLOGY** degree in **CIVIL ENGINEERING** at Prasad V. Potluri Siddhartha Institute of Technology is a record of student's work carried out under our supervision and guidance during academic year 2022-2023.

(Dr. MANNE ANUPAMA AMMULU) **Project Guide**	**(Dr.V.JAGADISH)** **Project Coordinator**	**(Dr. K. RAMESH)** **Head of the Department**

Internal Examiner **External Examiner**

DECLARATION

This is to certify that the Major project Report entitled **"ASSESSMENT OF INDOOR AIR QUALITY AN EDUCATIONAL INSTITUTION"** written and submitted by us is an original work done under the guidance of **Dr. Manne Anupama Ammulu** is submitted in partial fulfilment of the requirements for the award of the Degree of Bachelor of Technology in Civil Engineering. This is a record of bonafide work carried out by us and the results embodied in this Project Report have not been reproduced and copied from any source.

PROJECT ASSOCIATES:

M.HANIL KUMAR	**(19501A0129)**
K.HRUTHIK	**(19501A0120)**
T. MOHAN	**(19501A0142)**
M. SWARNA JATHIN	**(19501A0128)**

ACKNOWLEDGEMENT

The satisfaction and euphoria on the successful completion of any task would be incomplete without the mention of the people who made it possible, whose constant guidance and encouragement crowned our effort with success.

We would like to express our profound appreciation to our Principal **Dr. K. Sivaji Babu**, **Principal, PVP Siddhartha Institute of Technology** for extending his official support for the completion of our Major Project.

We express our thanks to **Dr. K. Ramesh, Head of Civil Engineering Department**, for all the facilities provided to successfully complete our Major project work.

We have immense pleasure to express my gratitude to **Dr. V. Jagadish, Associate Professor,** Project Coordinator of Civil Engineering, PVPSIT for his encouragement and help at many stages in the course of our B. Tech Project

We are deeply indebted to our Project Guide**, Dr. Manne Anupama Ammulu, Assistant Professor and Mr. V. Preetham(Phase-1)** for the motivation, guidance, tutelage, and patience throughout this Major project work. We appreciate her broad range of expertise and attention to detail, as well as the constant encouragement he has given to us over the years.

In our association with all the above persons, we experienced not only their depth of knowledge but also affection towards us. Finally, we take this opportunity to thank one and all of our **Civil Engineering Teaching & Non-Teaching Staff** For their able cooperation both academic and non-academic all throughout our four years. We shall remember all our staff as long as our memory lives.

PROJECT ASSOCIATES:

M.HANIL KUMAR	**(19501A0129)**
K.HRUTHIK	**(19501A0120)**
T. MOHAN	**(19501A0142)**
M. SWARNA JATHIN	**(19501A0128)**

ABSTRACT

Air pollution sources in indoor area are one of the main factors for reducing indoor air quality of locations. In the current research, factors affecting indoor air quality and its symptoms are evaluate as case study in an educational institution in Vijayawada. In order to conduct this descriptive-analytical study, gas pollutants affecting indoor air quality were determined using portable analysis systems. Indoor Air Quality Toolkit was used in order to study the Indoor air quality.

Indoor Air Quality in college campus is of global concern due to their significant effects on pupil health, academic performance, and productivity.

In this project, we will evaluate the indoor air quality in all class rooms, Laboratories and Faculty rooms (staff rooms) of all the departments in our institution. We will prospectively measure indoor air quality using air quality device in different areas of our Institution. In this process, CO2, Temperature and Humidity will be measured.

And we conduct a survey on Indoor Air Quality in Prasad V Potluri Siddhartha Institution to make our analytical-descriptive study more effective.

CONTENTS

S.NO	CONTENT	Page No.
1	INTRODUCTION	01
1.1	GENERAL	01
1.2	IMMEDIATE EFFECTS DUE TO POLLUTION OF IAQ	04
1.3	LONG-TERM EFFECTS DUE TO POLLUTION OF IAQ	04
1.4	HEALTH EFFECTS	05
1.5	POLLUTANT SOURCES	05
1.6	TEMPERATURE	06
1.7	CO2	07
1.8	HUMIDITY	08
2	LITERATURE REVIEW	10
3	METHODOLOGY	16
4	OBJECTIVES	17
5	RESULTS	18
6	DISCUSSION	139
7	SURVEY ON IAQ	142
8	DISCUSSION ON SURVEY ON IAQ	148
9	MEASURES TO IMPROVE IAQ	150
10	CONCLUSION	151
11	GALLERY	156
	REFERENCES	152

LIST OF TABLES

S.NO	Name of the Table	Page No.
1.	PPM Ranges of CO2	08
2.	CO2 values in classrooms of CE	18
3.	CO2 values in staffrooms of CE	18
4.	CO2 values in laboratories of CE	19
5.	Temperature values in classrooms of CE	20
6.	Temperature values in staffrooms of CE	20
7.	Temperature values in laboratories of CE	21
8.	Humidity values in classrooms of CE	21
9.	Humidity values in Laboratories of CE	22
10.	Humidity values in Staff Rooms of CE	22
11.	CO2 values in classrooms of Mech	23
12.	CO2 values in staffrooms of Mech	24
13.	CO2 values in laboratories of Mech	24
14.	Temperature values in classrooms of Mech	25
15.	Temperature values in staffrooms of Mech	26
16.	Temperature values in laboratories of Mech	26
17.	Humidity values in classrooms of Mech	27
18.	Humidity values in Laboratories of Mech	27
19.	Humidity values in Staff Rooms of Mech	28
20.	CO2 values in classrooms of CSE	28
21.	CO2 values in staffrooms of CSE	29
22.	CO2 values in laboratories of CSE	30
23.	Humidity values in classrooms of CSE	30
24.	Humidity values in Laboratories of CSE	31
25.	Humidity values in Staff Rooms of CSE	31
26.	Temperature values in classrooms of CSE	32
27.	Temperature values in staffrooms of CSE	32
28.	Temperature values in laboratories of CSE	33
29.	CO2 values in classrooms of IT	34
30.	CO2 values in staffrooms of IT	34
31.	CO2 values in laboratories of IT	35
32.	Humidity values in classrooms of IT	35
33.	Humidity values in Laboratories of IT	36
34.	Humidity values in Staff Rooms of IT	36
35.	Temperature values in classrooms of IT	37
36.	Temperature values in staffrooms of IT	37
37.	Temperature values in laboratories of IT	38
38.	CO2 values in classrooms of ECE	38
39.	CO2 values in staffrooms of ECE	39
40.	CO2 values in laboratories of ECE	40
41.	Humidity values in classrooms of ECE	40
42.	Humidity values in Laboratories of ECE	41

43.	Humidity values in Staff Rooms of ECE	41
44.	Temperature values in classrooms of ECE	42
45.	Temperature values in staffrooms of ECE	42
46.	Temperature values in laboratories of ECE	43
47.	CO2 values in classrooms of EEE	43
48.	CO2 values in staffrooms of EEE	44
49.	CO2 values in laboratories of EEE	44
50.	Humidity values in classrooms of EEE	45
51.	Humidity values in Staffrooms of EEE	45
52.	Humidity values in laboratories of EEE	46
53.	Temperature values in classrooms of EEE	46
54.	Temperature values in staffrooms of EEE	47
55.	Temperature values in laboratories of EEE	48
56.	CO2 values in classrooms of FE	48
57.	CO2 values in staffrooms of FE	49
58.	CO2 values in laboratories of FE	50
59.	Humidity values in classrooms of FE	50
60.	Humidity values in Staffrooms of FE	51
61.	Humidity values in laboratories of FE	51
62.	Temperature values in classrooms of FE	52
63.	Temperature values in staffrooms of FE	53
64.	Temperature values in laboratories of FE	53
65.	CO2 values in classrooms of MBA	54
66.	CO2 values in staffrooms of MBA	54
67.	Humidity values in classrooms of MBA	55
68.	Humidity values in Staffrooms of MBA	56
69.	Temperature values in classrooms of MBA	56
70.	Temperature values in staffrooms of MBA	57
71.	CO2 values in classrooms of CE	58
72.	CO2 values in staffrooms of CE	58
73.	CO2 values in laboratories of CE	59
74.	Temperature values in classrooms of CE	59
75.	Temperature values in staffrooms of CE	60
76.	Temperature values in laboratories of CE	60
77.	Humidity values in classrooms of CE	61
78.	Humidity values in Laboratories of CE	61
79.	Humidity values in Staff Rooms of CE	62
80.	CO2 values in classrooms of Mech	63
81.	CO2 values in staffrooms of Mech	63
82.	CO2 values in laboratories of Mech	64
83.	Temperature values in classrooms of Mech	64
84.	Temperature values in staffrooms of Mech	65
85.	Temperature values in laboratories of Mech	65
86.	Humidity values in classrooms of Mech	66
87.	Humidity values in Staff Rooms of Mech	66
88.	Humidity values in Laboratories of Mech	67
89.	CO2 values in classrooms of CSE	68
90.	CO2 values in staffrooms of CSE	68

91.	CO2 values in laboratories of CSE	69
92.	Humidity values in classrooms of CSE	69
93.	Humidity values in Laboratories of CSE	70
94.	Humidity values in Staff Rooms of CSE	70
95.	Temperature values in classrooms of CSE	71
96.	Temperature values in staffrooms of CSE	71
97.	Temperature values in laboratories of CSE	72
98.	CO2 values in classrooms of IT	73
99.	CO2 values in staffrooms of IT	73
100.	CO2 values in laboratories of IT	74
101.	Humidity values in classrooms of IT	74
102.	Humidity values in Laboratories of IT	75
103.	Humidity values in Staff Rooms of IT	76
104.	Temperature values in classrooms of IT	76
105.	Temperature values in staffrooms of IT	77
106.	Temperature values in laboratories of IT	77
107.	CO2 values in classrooms of ECE	78
108.	CO2 values in staffrooms of ECE	79
109.	CO2 values in laboratories of ECE	79
110.	Humidity values in classrooms of ECE	80
111.	Humidity values in Laboratories of ECE	80
112.	Humidity values in Staff Rooms of ECE	81
113.	Temperature values in classrooms of ECE	82
114.	Temperature values in staffrooms of ECE	82
115.	Temperature values in laboratories of ECE	83
116.	CO2 values in classrooms of EEE	84
117.	CO2 values in staffrooms of EEE	84
118.	CO2 values in laboratories of EEE	85
119.	Humidity values in classrooms of EEE	85
120.	Humidity values in Staffrooms of EEE	86
121.	Humidity values in laboratories of EEE	86
122.	Temperature values in classrooms of EEE	87
123.	Temperature values in staffrooms of EEE	87
124.	Temperature values in laboratories of EEE	88
125.	CO2 values in classrooms of FE	89
126.	CO2 values in staffrooms of FE	89
127.	CO2 values in laboratories of FE	90
128.	Humidity values in classrooms of FE	91
129.	Humidity values in Staffrooms of FE	91
130.	Humidity values in laboratories of FE	92
131.	Temperature values in classrooms of FE	93
132.	Temperature values in staffrooms of FE	93
133.	Temperature values in laboratories of FE	94
134.	CO2 values in classrooms of MBA	95
135.	CO2 values in staffrooms of MBA	95
136.	Humidity values in classrooms of MBA	96
137.	Humidity values in Staffrooms of MBA	96
138.	Temperature values in classrooms of MBA	96

139.	Temperature values in staffrooms of MBA	96
140.	CO2 values in classrooms of CE	97
141.	CO2 values in staffrooms of CE	97
142.	CO2 values in laboratories of CE	98
143.	Temperature values in classrooms of CE	98
144.	Temperature values in staffrooms of CE	99
145.	Temperature values in laboratories of CE	100
146.	Humidity values in classrooms of CE	100
147.	Humidity values in Laboratories of CE	101
148.	Humidity values in Staff Rooms of CE	101
149.	CO2 values in classrooms of Mech	102
150.	CO2 values in staffrooms of Mech	102
151.	CO2 values in laboratories of Mech	103
152.	Temperature values in classrooms of Mech	103
153.	Temperature values in staffrooms of Mech	104
154.	Temperature values in laboratories of Mech	104
155.	Humidity values in classrooms of Mech	105
156.	Humidity values in Laboratories of Mech	106
157.	Humidity values in Staff Rooms of Mech	106
158.	CO2 values in classrooms of CSE	107
159.	CO2 values in staffrooms of CSE	107
160.	CO2 values in laboratories of CSE	108
161.	Humidity values in classrooms of CSE	109
162.	Humidity values in Laboratories of CSE	109
163.	Humidity values in Staff Rooms of CSE	110
164.	Temperature values in classrooms of CSE	111
165.	Temperature values in staffrooms of CSE	111
166.	Temperature values in laboratories of CSE	112
167.	CO2 values in classrooms of IT	113
168.	CO2 values in staffrooms of IT	113
169.	CO2 values in laboratories of IT	114
170.	Humidity values in classrooms of IT	114
171.	Humidity values in Laboratories of IT	115
172.	Humidity values in Staff Rooms of IT	116
173.	Temperature values in classrooms of IT	116
174.	Temperature values in staffrooms of IT	117
175.	Temperature values in laboratories of IT	117
176.	CO2 values in classrooms of ECE	118
177.	CO2 values in staffrooms of ECE	118
178.	CO2 values in laboratories of ECE	119
179.	Humidity values in classrooms of ECE	120
180.	Humidity values in Laboratories of ECE	120
181.	Humidity values in Staff Rooms of ECE	121
182.	Temperature values in classrooms of ECE	122
183.	Temperature values in staffrooms of ECE	122
184.	Temperature values in laboratories of ECE	123
185.	CO2 values in classrooms of EEE	123
186.	CO2 values in staffrooms of EEE	124

187.	CO2 values in laboratories of EEE	124
188.	Humidity values in classrooms of EEE	125
189.	Humidity values in Staffrooms of EEE	125
190.	Humidity values in laboratories of EEE	126
191.	Temperature values in classrooms of EEE	126
192.	Temperature values in staffrooms of EEE	127
193.	Temperature values in laboratories of EEE	128
194.	CO2 values in classrooms of FE	129
195.	CO2 values in staffrooms of FE	130
196.	CO2 values in laboratories of FE	130
197.	Humidity values in classrooms of FE	131
198.	Humidity values in Staffrooms of FE	132
199.	Humidity values in laboratories of FE	132
200.	Temperature values in classrooms of FE	133
201.	Temperature values in staffrooms of FE	134
202.	Temperature values in laboratories of FE	134
203.	CO2 values in classrooms of MBA	135
204.	CO2 values in staffrooms of MBA	135
205.	Humidity values in classrooms of MBA	136
206.	Humidity values in Staffrooms of MBA	136
207.	Temperature values in classrooms of MBA	137
208.	Temperature values in staffrooms of MBA	137
209.	CO2 in Final Year Class Room of CE Dept	139
210.	Temperature in Final Year Class Room of CE Dept	139
211.	Humidity in Final Year Class Room of CE Dept	140

LIST OF FIGURES

S.NO	Name of the Figures	Page No.
1.	IAQ Measurement Device	09
2.	Campus Layout	15
3.	CO2 values in classrooms of CE	18
4.	CO2 values in staffrooms of CE	19
5.	CO2 values in laboratories of CE	19
6.	Temperature values in classrooms of CE	20
7.	Temperature values in staffrooms of CE	20
8.	Temperature values in laboratories of CE	21
9.	Humidity values in classrooms of CE	21
10.	Humidity values in Laboratories of CE	22
11.	Humidity values in Staff Rooms of CE	23
12.	CO2 values in classrooms of Mech	23
13.	CO2 values in staffrooms of Mech	24
14.	CO2 values in laboratories of Mech	25
15.	Temperature values in classrooms of Mech	25
16.	Temperature values in staffrooms of Mech	26
17.	Temperature values in laboratories of Mech	26
18.	Humidity values in classrooms of Mech	27
19.	Humidity values in Laboratories of Mech	27
20.	Humidity values in Staff Rooms of Mech	28
21.	CO2 values in classrooms of CSE	29
22.	CO2 values in staffrooms of CSE	29
23.	CO2 values in laboratories of CSE	30
24.	Humidity values in classrooms of CSE	30
25.	Humidity values in Laboratories of CSE	31
26.	Humidity values in Staff Rooms of CSE	31
27.	Temperature values in classrooms of CSE	32
28.	Temperature values in staffrooms of CSE	33
29.	Temperature values in laboratories of CSE	33
30.	CO2 values in classrooms of IT	34
31.	CO2 values in staffrooms of IT	34
32.	CO2 values in laboratories of IT	35
33.	Humidity values in classrooms of IT	35
34.	Humidity values in Laboratories of IT	36
35.	Humidity values in Staff Rooms of IT	37
36.	Temperature values in classrooms of IT	37
37.	Temperature values in staffrooms of IT	38
38.	Temperature values in laboratories of IT	38

39.	CO2 values in classrooms of ECE	39
40.	CO2 values in staffrooms of ECE	39
41.	CO2 values in laboratories of ECE	40
42.	Humidity values in classrooms of ECE	40
43.	Humidity values in Laboratories of ECE	41
44.	Humidity values in Staff Rooms of ECE	42
45.	Temperature values in classrooms of ECE	42
46.	Temperature values in staffrooms of ECE	43
47.	Temperature values in laboratories of ECE	43
48.	CO2 values in classrooms of EEE	44
49.	CO2 values in staffrooms of EEE	44
50.	CO2 values in laboratories of EEE	45
51.	Humidity values in classrooms of EEE	45
52.	Humidity values in Staffrooms of EEE	46
53.	Humidity values in laboratories of EEE	46
54.	Temperature values in classrooms of EEE	47
55.	Temperature values in staffrooms of EEE	47
56.	Temperature values in laboratories of EEE	48
57.	CO2 values in classrooms of FE	49
58.	CO2 values in staffrooms of FE	49
59.	CO2 values in laboratories of FE	50
60.	Humidity values in classrooms of FE	51
61.	Humidity values in Staffrooms of FE	51
62.	Humidity values in laboratories of FE	52
63.	Temperature values in classrooms of FE	52
64.	Temperature values in staffrooms of FE	53
65.	Temperature values in laboratories of FE	54
66.	CO2 values in classrooms of MBA	54
67.	CO2 values in staffrooms of MBA	55
68.	Humidity values in classrooms of MBA	55
69.	Humidity values in Staffrooms of MBA	56
70.	Temperature values in classrooms of MBA	56
71.	Temperature values in staffrooms of MBA	57
72.	CO2 values in classrooms of CE	58
73.	CO2 values in staffrooms of CE	58
74.	CO2 values in laboratories of CE	59
75.	Temperature values in classrooms of CE	59
76.	Temperature values in staffrooms of CE	60
77.	Temperature values in laboratories of CE	61
78.	Humidity values in classrooms of CE	61
79.	Humidity values in Laboratories of CE	62

80.	Humidity values in Staff Rooms of CE	62
81.	CO2 values in classrooms of Mech	63
82.	CO2 values in staffrooms of Mech	63
83.	CO2 values in laboratories of Mech	64
84.	Temperature values in classrooms of Mech	65
85.	Temperature values in staffrooms of Mech	65
86.	Temperature values in laboratories of Mech	66
87.	Humidity values in classrooms of Mech	66
88.	Humidity values in Laboratories of Mech	67
89.	Humidity values in Staff Rooms of Mech	67
90.	CO2 values in classrooms of CSE	68
91.	CO2 values in staffrooms of CSE	69
92.	CO2 values in laboratories of CSE	69
93.	Humidity values in classrooms of CSE	70
94.	Humidity values in Laboratories of CSE	70
95.	Humidity values in Staff Rooms of CSE	71
96.	Temperature values in classrooms of CSE	71
97.	Temperature values in staffrooms of CSE	72
98.	Temperature values in laboratories of CSE	72
99.	CO2 values in classrooms of IT	73
100.	CO2 values in staffrooms of IT	73
101.	CO2 values in laboratories of IT	74
102.	Humidity values in classrooms of IT	75
103.	Humidity values in Laboratories of IT	75
104.	Humidity values in Staff Rooms of IT	76
105.	Temperature values in classrooms of IT	76
106.	Temperature values in staffrooms of IT	77
107.	Temperature values in laboratories of IT	78
108.	CO2 values in classrooms of ECE	78
109.	CO2 values in staffrooms of ECE	79
110.	CO2 values in laboratories of ECE	80
111.	Humidity values in classrooms of ECE	80
112.	Humidity values in Laboratories of ECE	81
113.	Humidity values in Staff Rooms of ECE	81
114.	Temperature values in classrooms of ECE	82
115.	Temperature values in staffrooms of ECE	82
116.	Temperature values in laboratories of ECE	83
117.	CO2 values in classrooms of EEE	83
118.	CO2 values in staffrooms of EEE	84
119.	CO2 values in laboratories of EEE	84
120.	Humidity values in classrooms of EEE	85

121.	Humidity values in Staffrooms of EEE	85
122.	Humidity values in laboratories of EEE	86
123.	Temperature values in classrooms of EEE	87
124.	Temperature values in staffrooms of EEE	87
125.	Temperature values in laboratories of EEE	88
126.	CO2 values in classrooms of FE	89
127.	CO2 values in staffrooms of FE	90
128.	CO2 values in laboratories of FE	90
129.	Humidity values in classrooms of FE	91
130.	Humidity values in Staffrooms of FE	92
131.	Humidity values in laboratories of FE	92
132.	Temperature values in classrooms of FE	93
133.	Temperature values in staffrooms of FE	94
134.	Temperature values in laboratories of FE	94
135.	CO2 values in classrooms of MBA	95
136.	CO2 values in staffrooms of MBA	95
137.	Humidity values in classrooms of MBA	96
138.	Humidity values in Staffrooms of MBA	96
139.	Temperature values in classrooms of MBA	96
140.	Temperature values in staffrooms of MBA	97
141.	CO2 values in classrooms of CE	97
142.	CO2 values in staffrooms of CE	97
143.	CO2 values in laboratories of CE	98
144.	Temperature values in classrooms of CE	99
145.	Temperature values in staffrooms of CE	99
146.	Temperature values in laboratories of CE	100
147.	Humidity values in classrooms of CE	100
148.	Humidity values in Laboratories of CE	101
149.	Humidity values in Staff Rooms of CE	101
150.	CO2 values in classrooms of Mech	102
151.	CO2 values in staffrooms of Mech	102
152.	CO2 values in laboratories of Mech	103
153.	Temperature values in classrooms of Mech	103
154.	Temperature values in staffrooms of Mech	104
155.	Temperature values in laboratories of Mech	105
156.	Humidity values in classrooms of Mech	105
157.	Humidity values in Laboratories of Mech	106
158.	Humidity values in Staff Rooms of Mech	106
159.	CO2 values in classrooms of CSE	107
160.	CO2 values in staffrooms of CSE	108
161.	CO2 values in laboratories of CSE	108

162.	Humidity values in classrooms of CSE	109
163.	Humidity values in Laboratories of CSE	110
164.	Humidity values in Staff Rooms of CSE	110
165.	Temperature values in classrooms of CSE	111
166.	Temperature values in staffrooms of CSE	112
167.	Temperature values in laboratories of CSE	112
168.	CO2 values in classrooms of IT	113
169.	CO2 values in staffrooms of IT	114
170.	CO2 values in laboratories of IT	114
171.	Humidity values in classrooms of IT	115
172.	Humidity values in Laboratories of IT	115
173.	Humidity values in Staff Rooms of IT	116
174.	Temperature values in classrooms of IT	116
175.	Temperature values in staffrooms of IT	117
176.	Temperature values in laboratories of IT	118
177.	CO2 values in classrooms of ECE	118
178.	CO2 values in staffrooms of ECE	119
179.	CO2 values in laboratories of ECE	119
180.	Humidity values in classrooms of ECE	120
181.	Humidity values in Laboratories of ECE	121
182.	Humidity values in Staff Rooms of ECE	121
183.	Temperature values in classrooms of ECE	122
184.	Temperature values in staffrooms of ECE	122
185.	Temperature values in laboratories of ECE	123
186.	CO2 values in classrooms of EEE	123
187.	CO2 values in staffrooms of EEE	124
188.	CO2 values in laboratories of EEE	125
189.	Humidity values in classrooms of EEE	125
190.	Humidity values in Staffrooms of EEE	126
191.	Humidity values in laboratories of EEE	126
192.	Temperature values in classrooms of EEE	127
193.	Temperature values in staffrooms of EEE	127
194.	Temperature values in laboratories of EEE	128
195.	CO2 values in classrooms of FE	129
196.	CO2 values in staffrooms of FE	129
197.	CO2 values in laboratories of FE	130
198.	Humidity values in classrooms of FE	131
199.	Humidity values in Staffrooms of FE	131
200.	Humidity values in laboratories of FE	132
201.	Temperature values in classrooms of FE	133
202.	Temperature values in staffrooms of FE	133

203.	Temperature values in laboratories of FE	134
204.	CO2 values in classrooms of MBA	135
205.	CO2 values in staffrooms of MBA	136
206.	Humidity values in classrooms of MBA	136
207.	Humidity values in Staffrooms of MBA	137
208.	Temperature values in classrooms of MBA	137
209.	Temperature values in staffrooms of MBA	138
210.	CO2 in Final Year Class Room of CE Dept	139
211.	Temperature in Final Year Class Room of CE Dept	139
212.	Humidity in Final Year Class Room of CE Dept	140

1. INTRODUCTION

1.1. GENERAL:

Air pollution is the contamination of air due to the presence of substances in the atmosphere that are harmful to the health of humans and other living beings, or cause damageto the climate or to materials. There are many different types of air pollutants, such as gases(including ammonia, carbon monoxide, sulphur dioxide, nitrous oxides, methane, carbon dioxide and chlorofluorocarbons), particulates (both organic and inorganic), and biological molecules. Air pollution can cause diseases, allergies, and even death to humans; it can also cause harm to other living organisms such as animals and food crops, and may damage the natural environment (for example, climate change, ozone depletion or habitat degradation) or built environment (for example, acid rain). Air pollution can be caused by both human activitiesand natural phenomena.

It is well accepted that indoor environments air pollutants have adverse health effects on humans (Marchetti et al., 2019; Pacitto et al., 2020), ambient pollution constitutes globallyan important causative agent of premature death and disease (Kalimeri et al., 2019). Poor indoorair exposures are one stressor that might adversely affect human early life development. Students are considered as more susceptible and vulnerable to air pollution (Arcega-Cabrera etal., 2018; Ferguson and Solo-Gabriele, 2016; Iglesias-Gonzalez ´ et al., 2020) since they havehigher breathing rates (Landrigan et al., 2018) and organ systems are developing rapidly (Hoeket al., 2012). Many time-dependent and synchronized processes that are programmed during early development could increase the risk of childhood disease if perturbed (Braun, 2017).

Students spend most of their daytime in classrooms to perform academic activities (Pacitto et al., 2020). Therefore, classroom indoor air quality (IAQ) is essential to early-life exposures that could increase the risk of disease across the lifespan. Studies on children have reported that increased classroom carbon dioxide (CO2) concentration decreased school attendance (Gaihre et al., 2014) in a short period, while persistent exposure to PM10, NO2 andSO2 may disturb children's lungs development in later life (Gauderman et al., 2007). More important, air pollution may play a major role in the central nervous system during sensitive periods (such as childhood) and consequently affect behavior and school performance (Alemany et al., 2018; Berman et al., 2018; Grineski et al., 2020). Good IAQ in classrooms isimportant to provide a productive, safe, and comfortable environment for students.

Air pollution is currently recognized as the single biggest environmental threat to human health. People spend 90% of their time in indoor environments, therefore maintaining adequate indoor air quality is essential to minimize negative health impacts. Institutions are nodifferent, as Students and Faculty members spend long hours in the facilities subject to their inherent air quality.

Indoor air quality (IAQ) is a complex and dynamic issue that is affected by different factors:

- Outdoor air Quality
- Indoor activities
- Indoor occupant density
- Ventilation practices
- Indoor intrinsic emissions (e.g., equipment/furniture/coatings).

The effect of the indoor environment on people's lives, the performance of work and the public's health is of more concern than the outdoor environment because people spend about 70% to 90% of their time in rooms. It is well accepted that indoor environments air pollutants have adverse health effects on humans. Statistics through studies show that people spend most of their time in an indoor environment, with 87% of the time inside a closed building and 6% in a closed vehicle.

As a result, people can be at risk with prolonged exposure to indoor air quality (IAQ). Besides, factors such as inadequate ventilation, growth of microorganisms on walls, in carpets,or the components of heating, ventilation and air-conditioning systems cause poor indoor air quality and might even threaten human health. This was the motivation behind the number of studies that have been conducted on the indoor environment quality (IEQ) in Institutions.

The primary purpose of an institution is to provide children with the optimal environment for their learning and development. Institutions have always been a second homefor the students, and they spend most of their time indoors while at school (almost 12% of theirtime inside classrooms). Schools are among the critical social infrastructures in society and areoften the focus for children's social activity. Classrooms are more congested than other workplaces, with an occupancy density of approximately four times that of office buildings.

Good indoor air quality (IAQ) in classrooms is essential because it may affect the health, performance, alertness, ability to concentrate, and comfort of pupils and teachers.

Classrooms have typically been justified as an important built environment type by reference to the adverse effects of unfavorable indoor conditions on pupils' health, comfort, and academic performance. Children are sensitive to various environmental exposures during this developmental stage of their life, which can have long-term negative consequences such as respiratory disease and low cognitive function. In addition, the risk of cross-contamination in classrooms is usually higher than in other indoor environments and poses logistical challenges and/or risks of transmission.

Indoor and outdoor air quality are the most significant factors affecting the quality of our life in general. We breathe 10 m3 of air every day and spend 80–95% of our lives indoors.Indoor air pollution can lead to health problems, odours, discomforts and irritation, diseases, cancer, and even increased human mortality. Also, some air pollutants affect the construction materials and the structure of the building itself. It was reported that long-term exposure to airpollution, including PM2.5 and O3, is estimated to cause more than 8.8 million deaths per year.At the same time, NO2 exposure results in 4 million new cases of pediatric asthma per year. SO2 is associated with damage to respiratory symptoms and premature death.

SO2 and NO2 are classified as primary pollutants, whereas O3 is a secondary pollutantin the troposphere due to the photochemical reactions between NOx and VOCs. High atmospheric SO2 concentrations are primarily due to Sulphur-containing fuels such as coal fordomestic heating purposes in urban areas. PM2.5 is emitted from anthropogenic sources such as the combustion of fossil fuels, manufacturing, domestic heating, and exhausts of automobiles(e.g., elemental carbon). Air contains many microorganisms, which act as a transmission or dispersal medium. Biological agents may be released into the air as single unattached microbialcells (viruses, bacteria, fungi), as clumps consisting of several microorganisms, or intact cells or cell fragments may be attached to other suspended particles. Biological agents are agents ormicro fragments from plant or animal matter or microorganisms. Like outdoor pollutant sources, indoor sources can be biological and chemical. Indoor pollution originates from biological agents such as bacteria, fungi, viruses, molds, pollen, animal hair, dander, and excrement, while chemical sources contain cleaners, solvents, fuels, adhesives, various combustion by-products, and emissions from furnishings and floor and wall coverings.

1.2. Immediate Effects due to pollution of IAQ:

Some health effects may show up shortly after a single exposure or repeated exposuresto a pollutant. These include irritation of the eyes, nose, and throat, headaches, dizziness, and fatigue. Such immediate effects are usually short-term and treatable. Sometimes the treatmentis simply eliminating the person's exposure to the source of the pollution, if it can be identified.Soon after exposure to some indoor air pollutants, symptoms of some diseases such as asthmamay show up, be aggravated, or worsened.

The likelihood of immediate reactions to indoor air pollutants depends on several factors including age and preexisting medical conditions. In some cases, whether a person reacts to a pollutant depends on individual sensitivity, which varies tremendously from person to person. Some people can become sensitized to biological or chemical pollutants after repeated or high-lvl exposures.

Certain immediate effects are similar to those from colds or other viral diseases, so it is often difficult to determine if the symptoms are a result of exposure to indoor air pollution. For this reason, it is important to pay attention to the time and place symptoms occur. If the symptoms fade or go away when a person is away from the area, for example, an effort should be made to identify indoor air sources that may be possible causes. Some effects may be made worse byan inadequate supply of outdoor air coming indoors or from the heating, cooling or humidity conditions prevalent indoors.

1.3. Long-Term effects due to pollution of IAQ:

Other health effects may show up either years after exposure has occurred or only afterlong or repeated periods of exposure. These effects, which include some respiratory diseases, heart disease and cancer, can be severely debilitating or fatal. It is prudent to try to improve theindoor air quality in your home even if symptoms are not noticeable.

While pollutants commonly found in indoor air can cause many harmful effects, there is considerable uncertainty about what concentrations or periods of exposure are necessary to produce specific health problems. People also react very differently to exposure to indoor air pollutants. Further research is needed to better understand which health effects occur after exposure to the average pollutant concentrations found in homes and which occurs from the higher concentrations that occur for short periods of time.

1.4. Health Effects:

- Difficulty in Concentrating o Illness, Allergies and Stress oCold oIrritation of Eyes, Nose and Throat o Headaches o Rashes, Muscle pain and Fatigue oAsthma
- Respiratory diseases, heart diseases andCancer oNasal congestion

1.5. Pollutant Sources:

There are many sources of indoor air pollution. These can include:

- Fuel-burning combustion appliances
- Tobacco products
- Building materials and furnishings as diverse as:
- Deteriorated asbestos-containing insulation
- Newly installed flooring, upholstery, or carpet
- Cabinetry or furniture made of certain pressed wood products
- Products for household cleaning and maintenance, personal care, or hobbies
- Central heating and cooling systems and humidification devices
- Excess moisture
- Outdoor sources such as:
- Radon
- Pesticides
- Outdoor air pollution.

The relative importance of any single source depends on how much of a given pollutant it emitsand how hazardous those emissions are. In some cases, factors such as how old the source is and whether it is properly maintained are significant. For example, an improperly adjusted gas stove can emit significantly more carbon monoxide than one that is properly adjusted.

Some sources, such as building materials, furnishings and products like air fresheners, can release pollutants more or less continuously. Other sources, related to activities like smoking, cleaning, redecorating or doing hobbies release pollutants intermittently. Unvented or malfunctioning appliances or improperly used products can release higher and sometimes dangerous levels of pollutants indoors. Pollutant concentrations can remain in the air for long periods after some activities.

1.6. Temperature:

Colloquially, "room temperature" is a range of air temperatures that most people preferfor indoor settings. It feels comfortable to a person when they are wearing typical indoor clothing. Human comfort can extend beyond this range depending on humidity, air circulationand other factors. Food or beverages may be served at room temperature, meaning neither heated nor cooled. In certain fields, like science and engineering, and within a particular context, room temperature can mean different agreed-upon ranges. In contrast, ambient temperature is the actual temperature, as measured by a thermometer, of the air (or other medium and surroundings) in any place. The ambient temperature (e.g., an unheatedroom in winter) may be very different from an ideal room temperature.

Comfort temperatures:

The American Heritage Dictionary of the English Language identifies room temperature as around 20–22 °C(68–72 °F), while the Oxford English Dictionary states that it is "conventionally taken as about 20 °C (68 °F)". The ideal room temperature may vary by place and culture; studies from Nigeria show a comfortable temperature range of 26–28 °C (79–82 °F), comfortably cool 24–26 °C (75–79 °F) and comfortably warm 28–30 °C (82– 86°F).

Owing to variations in humidity and (likely) clothing, recommendations for summer and winter may vary; a suggested typical range for summer is 23–25.5 °C (73–78 °F), with that forwinter being 20–23.5 °C (68–74 °F). Some studies have suggested that thermal comfort preferences of men and women may differ significantly, with women on average preferring higher ambient temperatures.

In the recent past it was common for house temperatures to be kept below the comfort level; a1978 UK study found average indoor home temperatures to be 15.8 °C (60.4 °F) while Japan in 1980 had median home temperatures of 13 °C (55 °F) to 15 °C (59 °F).

1.7.CO_2:

Carbon dioxide (chemical formula CO_2) is a chemical compound made up of moleculesthat each have one carbon atom covalently double bonded to two oxygen atoms. It is found in the gas state at room temperature. In the air, carbon dioxide is transparent to visible light but absorbs infrared radiation, acting as a greenhouse gas. It is a trace gas in Earth's atmosphere at417 ppm (about 0.04%) by volume, having risen from preindustrial levels of 280 ppm. Burningfossil fuels is the primary cause of these increased CO_2 concentrations and also the primary cause of global warming and climate change. Carbon dioxide is soluble in water and is found in groundwater, lakes, ice caps, and seawater. When carbon dioxide dissolves in water it formscarbonic acid (H_2CO_3), which causes ocean acidification as atmospheric CO_2 levels increase.

As the source of available carbon in the carbon cycle, atmospheric carbon dioxide is the primarycarbon source for life on Earth. Its concentration in Earth's pre-industrial atmosphere since latein the Precambrian has been regulated by organisms and geological phenomena. Plants, algae and cyanobacteria use energy from sunlight to synthesize carbohydrates from carbon dioxide and water in a process called photosynthesis, which produces oxygen as a waste product.[13] In turn, oxygen is consumed and CO_2 is released as waste by all aerobic organisms when they metabolize organic compounds to produce energy by respiration. CO_2 is released from organic materials when they decay or combust, such as in forest fires. Since plants requireCO_2 for photosynthesis, and humans and animals depend on plants for food, CO_2 is necessary for the survival of life on earth.

Carbon dioxide is 53% more dense than dry air, but is long lived and thoroughly mixes in the atmosphere. About half of excess CO_2 emissions to the atmosphere are absorbed by land and ocean carbon sinks. These sinks can become saturated and are volatile, as decay and wildfiresresult in the CO_2 being released back into the atmosphere. CO_2 is eventually sequestered (storedfor the long term) in rocks and organic deposits like coal, petroleum and natural gas.

Sequestered CO_2 is released into the atmosphere through burning fossil fuels or naturally by volcanoes, hot springs, geysers, and when carbonate rocks dissolve in water or react with acids.

CO2 Level(ppm)	Problem faced
250-400	Normal background concentration in outdoor ambient air
400-1,000	Concentrations typical of occupied indoor spaces with good air exchange
1,000-2,000	Complaints of drowsiness and poor air
2,000-5,000	Headaches, sleepiness and stagnant, stale, stuffy air. Poor concentration, loss of attention, increased heart rate and slight nausea may also be present
>5,000	Workplace exposure limit (as 8-hour TWA) in most jurisdictions
>40,000	Exposure may lead to serious oxygen deprivation resulting in permanentbrain damage, coma, even death

Table :1 ppm ranges of CO2

1.7. Humidity:

Humidity is the concentration of water vapor present in the air. Water vapor, the gaseous state of water, is generally invisible to the human eye.[2] Humidity indicates the likelihood for precipitation, dew, or fog to be present. Humidity depends on the temperature and pressure of the system of interest. The same amount of water vapor results in higher relative humidity in cool air than warm air. A related parameter is the dew point. The amount of water vapor neededto achieve saturation increases as the temperature increases. As the temperature of a parcel of air decreases it will eventually reach the saturation point without adding or losing water mass.The amount of water vapor contained within a parcel of air can vary significantly. For example,a parcel of air near saturation may contain 28 g of water per cubic metre of air at 30 °C (86 °F),but only 8 gm of water per cubic metre of air at 8 °C (46 °F).

Three primary measurements of humidity are widely employed: absolute, relative, andspecific. Absolute humidity is expressed as either mass of water vapor per volume of moist air(in grams per cubic metre) or as mass of water vapor per mass of dry air (usually in grams perkilogram). Relative humidity, often expressed as a percentage, indicates a present state of absolute humidity relative to a maximum humidity given the same temperature. Specific humidity is the ratio of water vapor mass to total moist air parcel mass.

Humidity plays an important role for surface life. For animal life dependent onperspiration (sweating) to regulate internal body temperature, high humidity impairs heat exchange efficiency by reducing the rate of moisture evaporation from skin surfaces. This effectcan be calculated using a heat index table, also known as a humidex.

The notion of air "holding" water vapor or being "saturated" by it is often mentioned in connection with the concept of relative humidity. This, however, is misleading the amount of water vapor that enters (or can enter) a given space at a given temperature is almost independent of the amount of air (nitrogen,oxygen, etc.) that is present. Indeed, a vacuum has approximately the same equilibrium capacityto hold water vapor as the same volume filled with air; both are given by the equilibrium vaporpressure of water at the given temperature.[5][6] There is a very small difference described under"Enhancement factor" below, which can be neglected in many calculations unless greataccuracy is required.

Fig: IAQ Measurement Device

2.LITERATURE REVIEW

1.Indoor air quality in educational institutions in Beijing: Field tests, problems and recommendations

Authors: Chaorui Cai, Zhiwei Sun and Louise .

This study investigated indoor CO2 and PM2.5 real-time concentrations together with air temperature, humidity and air-cleaning effectiveness of 33 classrooms in 21 educational institution in Beijing, China by natural ventilation with air cleaners (NV system) compared to mechanical ventilation with fresh air ventilators (MV system).

2. Indoor air quality and health in Institutional building: A critical review for developing the roadmap for the future school environment

Authors: Sasan Sadrizadeh, Runming Yao, Feng Yuan and Hazim Awbi

In this article, they analyzed indoor air quality and health in schools, with the primary focus on ventilation, thermal comfort, productivity, and exposure risk. This study conducts a comprehensive review to summarizes the existing knowledge to highlight the latest research and solutions and proposes a roadmap for the future school environment.

3.Overheating and indoor air quality in primary schools in the UK

Authors: Sara Mohamed, Lucelia Rodrigues, Siddig Omer and John Calautit

In this work, the authors conducted field studies to assess the indoor air quality and overheating levels in eight recently built classrooms in two new low-carbon primary schools during heating and non-heating seasons. Monitored variables included globe temperatures, air temperatures, surface temperatures, carbon dioxide (CO2), and particles matter with a diameter of less than 2.5 mm (PM2.5), airstream velocity and relative humidity.

4. Indoor air quality in the primary school of China—results from CIEHS 2018 study

Authors: Yuan-duo Zhu, Xu Li, Lin Fan, Li Li, Jiao Wang, Wen-jing Yang, Lin Wang, Xiaoyuan Yao, and Xian-liang Wang .

Their results suggest that indoor air pollution in classrooms was a severe problem in Chinese

primary schools. It is necessary to strengthen ventilation in the classroom to improve indoor air quality. What's more, a healthy learning environment should be created for primary school students. The ratios of indoor to outdoor (I/O) of PM2.5 were calculated in each classroom to 11 identify whether the indoor environment the pollutants comes from outdoors.

5. Quantifying indoor air quality determinants in urban and rural nursery and primary schools.

Authors: P.T.B.S. Branco , M.C.M. Alvim-Ferraz , F.G. Martins and S.I.V. Sousa.

This study mainly 16 aimed to quantify determinants of selected IAP, in nursery and primary schools from both 17 urban and rural sites, accounting for seasonal variations. In 101 indoor microenvironments 18 (classrooms, bedrooms and canteens) from 25 nursery and primary schools, CO2, CO, HCOH, 19 NO2, O3, total volatile organic compounds, PM1, PM2.5, PM10, total suspended particles

6. Assessment of indoor and outdoor air quality in primary schools of Cyprus during the COVID–19 pandemic measures in May–July 2021.

Authors: Corina Konstantinou, Andria Constantinou and Eleni G. Kleovoulou

The study took place during May–July 2021 when a schoolspecific COVID-19 protocol was in place. Questionnaire-based characteristics of schools/classrooms were collected along with 24/48-h long IAQ monitoring of air temperature, relative humidity (RH), particulate matter (PM), carbon dioxide (CO2) and volatile organic compounds (VOCs), using low-cost sensors. Mixed effect models assessed the IAQ determinants during school hours. Indoor PM, temperature, RH and VOCs increased with progressing school periods in the day, while indoor CO2 decreased.

7. Investigation of indoor and outdoor air quality in a university campus during COVID-19 lock down period

Authors: Mansoor Ahmad Bhat, Fatma Nur Eraslan, Alaa Awad and Semra Malkoc

This study intends to give a glimpse to quantify the impact of a pandemic on air quality in different indoor environments in a university campus in Eskis¸ehir, Turkey and calls for followup studies. Indoor concentrations were evaluated together with outdoor concentrations. In general,

it can be said that the calculated I/O ratios for SO2, NO2, O3, bacteria, and fungi were less than 1 in most indoor environments.

8. A comprehensive analysis of the intervention of a fresh air ventilation system on indoor air quality in classrooms

Authors: Yu-HaoChen, Yen-PeiTu and Shih-YiSung 12

This study investigated CO2 and PM2.5 concentrations in 86 classrooms installed with air conditioners in elementary and middle schools in southern Taiwan, each additionally installed with a fresh air ventilation system equipped with an E11-class filter.

9. Adequate indoor air quality in nursing homes: An unmet medical need

Authors: Manasa Reddy , Mohammad Heidarinejad , Brent Stephens, Israel Rubinstein

They propose that IAQ should be regularly monitored in nursing homes to proactively identify and address vulnerabilities in these facilities and that resources should be provided for remedial interventions to improve IAQ in nursing homes, including but not limited to source control, improving ventilation and filtration, and deploying air cleaners where appropriate.

10. Control and management of hospital indoor air quality

Authors: Michael Leung, Alan H.S. Chan

The complex hospital environment requires special attention to ensure healthful indoor air quality (IAQ) to protect patients and healthcare workers against hospital-acquired (nosocomial) infections and occupational diseases. The aim here is to recommend effective guidelines for the control and management of hospital IAQ.

11. Evaluation and comparison of the indoor air quality in different areas of the hospital

Authors: Hyun-Joo Lee, PhD , Kang Hyun Lee, MD , Dong-Kyu Kim, MD, PhD

They prospectively measured indoor air quality using air quality sensors in different areas of a hospital from February 1, 2019 to January 31, 2020. Carbon dioxide (CO2), total volatile organic compounds (VOCs).

12. Indoor air quality indicators and toxicity potential at the hospitals' environment in Dhaka, Bangladesh

Authors: Shahid Uz Zaman & Mahbuba Yesmin2& Md. Riad Sarkar Pavel & Farah Jeba & Abdus Salam They examined IAQ indicators (PM1.0, PM2.5, PM10, NO2, CO2, and TVOC) at sixteen locations of three hospitals with an emphasis on seasonal variations, indoor/ outdoor correlation, and concomitant toxicity potential (TP) of human exposure between October 2019 and January 2020. For the measurement of trace gases (NO2, CO2, and TVOC), Aeroqual 500 series (New Zealand) sampler was used; particulate matter (PM1.0, PM2.5, and PM10) concentrations and relative humidity (RH) were measured using the IGERESS air quality monitoring device (WP6930S, China). The total average concentration of IAQ indicators were 104.1 ± 67.6 (PM1.0), 137.4 ± 89.2 (PM2.5), and 159.0 ± 103.3 (PM10) μgm−3 ; 0.11 ± 0.02 (NO2), 1047.1 ± 234.2 (CO2), and 176.5 ± 117.7 (TVOC) ppm.

13. Microbiological indoor air quality of hospital buildings with different ventilation systems, cleaning frequencies and occupancy levels

Authors: AhmadHassan MuhammadZeeshan

This study aimed to investigate and compare the microbial load, composition and prevalence of fungal and bacterial species at hospital sites facilitated with different ventilation systems and having different disinfection frequencies and occupancy levels. For this purpose, sixteen sampling sites were selected in two public hospital buildings including outpatient departments (OPDs), surgical wards, operation theaters (OTs), emergency departments, waiting room, burn unit, intensive care unit, nursing unit and medical laboratory.

14. Indoor air quality levels in a University Hospital in the Eastern Province of Saudi Arabia

Authors: Mahmoud F. El-Sharkawy, Mohamed E. H. Noweir

The general objective for this study was to assess IAQ inside a large University hospital at AlKhobar City in the Eastern Province of Saudi Arabia. Materials and Methods: Diff erent locations representing areas where most activities and tasks are performed were selected as

sampling points for air pollutants in the selected hospital. In addition, several factors were studied to determine those that were most likely to aff ect the IAQ levels. The temperature and relative percent humidity of diff erent air pollutants were measured simultaneously at each location.

15. Review Indoor Air Quality in Healthcare Units 14

Authors: Ana Fonseca, Isabel Abreu , Maria Joao Guerreiro and Nelson Barros

This study aims to identify the recent trends of research on the topic through a systematic literature review following the preferred reporting items for systematic reviews and metaanalyses (PRISMA) methodology. A total of 171 articles published in the period 2015– 2020 were selected and analyzed. Results show that there is a worldwide growing research interest in this subject, dispersed in a wide variety of scientific journals.

16. Seasonal variation of air quality in hospitals with indoor–outdoor correlations

Authors: Chamseddine A , Alameddine I , Hatzopoulou , and El-Fadel

We examined the distribution of and variation in the indoor and outdoor pollutant concentrations in 12 working areas across three hospitals, with an emphasis on capturing seasonal variations. We assessed correlations between measured indoor and outdoor levels to quantify the importance of indoor sources on air quality relative to outdoor sources. Our results indicated that while indoor and outdoor CO levels were below air quality standards/guidelines, measured PM2.5 and PM10 concentrations at several locations exceeded the standards 2- to 3.5-fold.

Sampling Location:

Prasad V Potluri Siddhartha Institute of Technology, Kanuru, Vijayawada, Andhra Pradesh, India

Fig1: Campus Layout

3. Methodology

1. Identifying the process
2. Data collection
3. Graph Plotting
4. Analysis
5. Comparison
6. Survey on IAQ
7. Measures to improve IAQ

4.OBJECTIVES

1. TO Assess the Indoor Air Quality in an Educational Institution (PVPSIT).
2. To collect the Indoor Air Quality parameters such as CO2, Temperature and Humidityduring the Rainy, Winter and Summer seasons.
3. To analyze and evaluate the Indoor Air Quality parameters in three seasons.
4. To compare the values of Indoor Air Quality parameters of classrooms, staffrooms and laboratories of each department individually in three seasons.
5. To conduct a survey on Indoor Air Quality.
6. To suggest the measures to improve the poor Indoor Air Quality based on the analysis.

5.RESULTS

Phase 1- Rainy Season

CIVIL ENGINEERING

Table2: CO2 in Class Rooms of Civil Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (155)	507	525	518	540	530	520	450	393
THIRD YEAR (154)	527	590	741	612	522	555	509	446
FINAL YEAR (143)	1623	1596	1459	1390	1325	1293	1235	1193

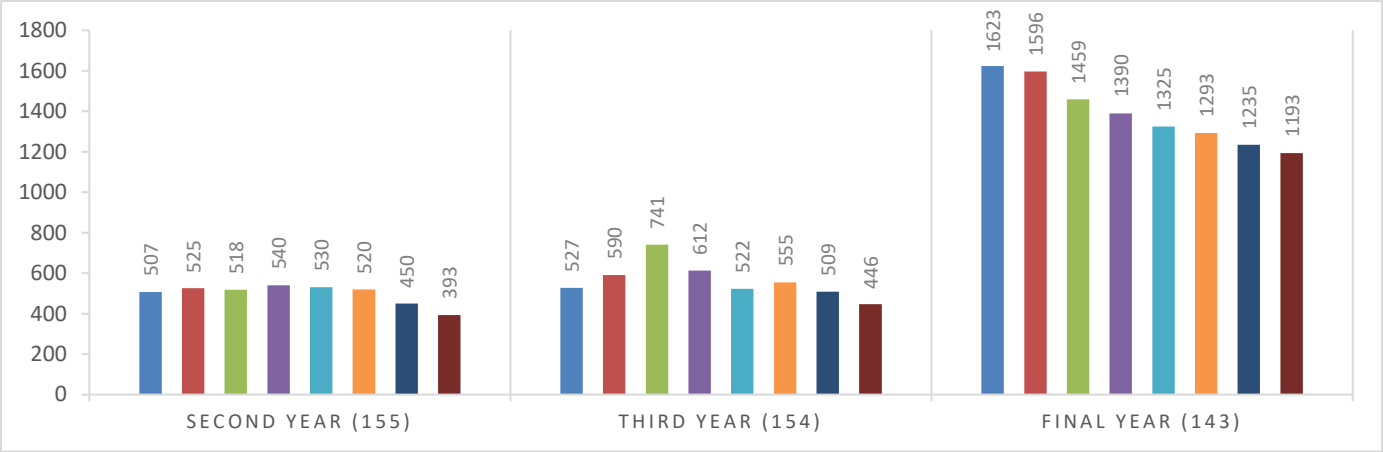

Fig2: CO2 in Class Rooms of Civil Dept

Table3: CO2 in Staff Rooms of Civil Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CIVIL HOD ROOM (158)	430	425	416	436	459	425	430	393
CIVIL OFFICE ROOM (157)	413	420	423	450	551	532	448	420
STAFF ROOM -1 (153(A))	486	470	458	485	515	556	535	512
STAFF ROOM -2 (153(B))	448	420	432	400	420	433	415	334
STAFF ROOM -3 (145)	438	420	486	510	529	513	490	450
TUTORIAL ROOM (152)	600	651	623	610	635	612	600	550
EXAM CELL (144)	610	590	556	450	553	543	520	515
CIVIL LIBRARY (151)	595	620	580	655	610	585	553	503

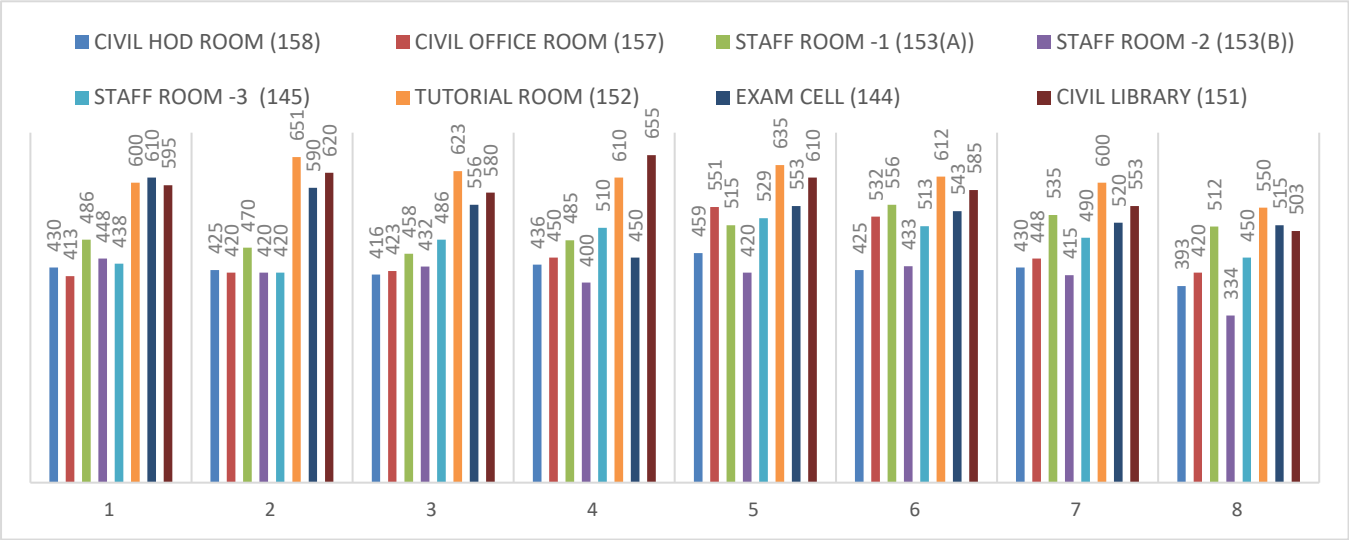

Fig3: CO2 in Staff Rooms of Civil Dept

Table4: CO2 in Laboratories of Civil Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CONCRTE TECHNOLOGY LAB (156)	600	559	518	540	530	404	437	393
TRANSPORTATION ENGINEERING LAB (153)	443	527	558	592	615	690	710	692
GEOTECHNICAL LAB (146)	430	423	415	450	465	480	473	446
COMPUTER AIDED DESIGN LAB (249)	555	569	580	588	496	501	470	438
FLUID MECHANICS LAB (119)	700	658	605	583	509	416	669	768
ENVIRONMENTAL ENGINEERING LAB - 1	595	580	593	600	664	695	540	515
ENVIRONMENTAL ENGINEERING LAB ROOM -2	583	595	540	623	650	692	716	700

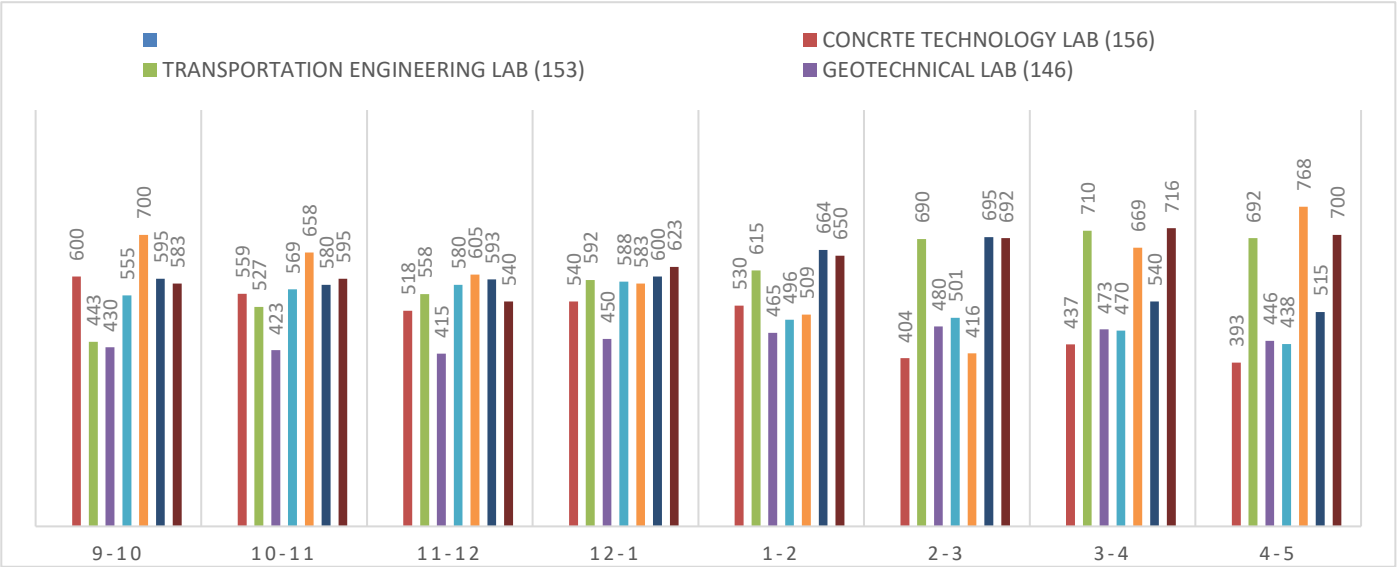

Fig4: CO2 in Laboratories of Civil Dept

Table5: Temperature in Class Rooms of Civil Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (155)	30.4	30.8	30.5	30.8	30.8	30.9	31.3	31.2
THIRD YEAR (154)	30.5	30.7	30.7	30.9	30.6	30.8	31.0	31.2
FINAL YEAR (143)	30.9	31.0	31.2	30.7	30.5	30.3	30.8	31.0

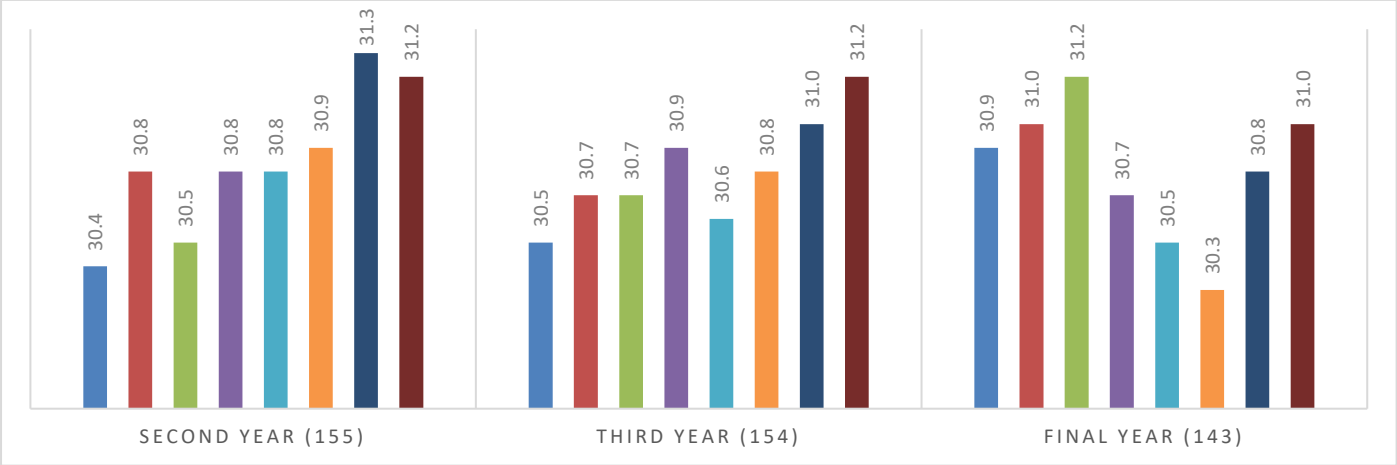

Fig5: Temperature in Class Rooms of Civil Dept

Table6: Temperature in Staff Rooms of Civil Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CIVIL HOD ROOM (158)	30.6	30.8	31	31.2	31.6	31.8	31.5	31.3
CIVIL OFFICE ROOM (157)	30.1	30.3	30.9	31.1	30.7	30.9	30.8	30.6
STAFF ROOM -1 (153(A))	30.6	30.9	30.7	30.7	30.6	30.6	30.4	30.5
STAFF ROOM -2 (153(B))	31.1	31.2	30.8	30.7	30.7	30.7	30.8	30.9
STAFF ROOM -3 (145)	30.8	30.9	30.7	30.6	30.8	30.3	31.2	31.0
TUTORIAL ROOM (152)	30.6	30.7	30.5	30.7	30.5	30.5	30.4	30.2
EXAM CELL (144)	30.6	30.7	31.4	31.2	30.6	30.2	30.9	30.8
CIVIL LIBRARY (151)	31.2	31.0	31.2	30.6	31.2	31.1	31.0	31.0

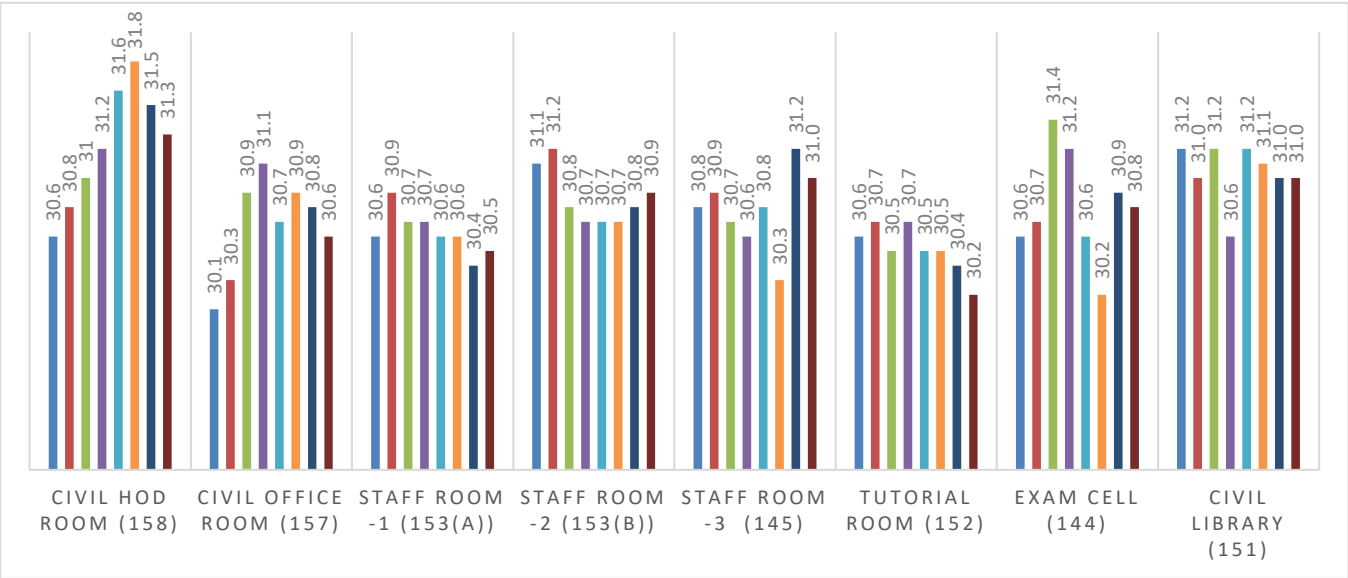

Fig6: Temperature in Staff Rooms of Civil Dept

Table7: Temperature in Laboratories of Civil Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CONCRTE TECHNOLOGY LAB (156)	31.1	31.1	30.3	31.1	31.2	31.3	30.9	30.7
TRANSPORTATION ENGINEERING LAB (153)	30.7	30.8	30.9	30.5	30.7	30.6	30.1	30.2
GEOTECHNICAL LAB (146)	30.8	30.9	30.4	30.5	30.9	30.4	30.7	30.4
COMPUTER AIDED DESIGN LAB (249)	31.2	31.4	32.1	32.0	31.1	30.9	31.0	31.0
FLUID MECHANICS LAB (119)	31.3	31.1	32.2	32.1	31.6	31.0	31.1	31.2
ENVIRONMENTAL ENGINEERING LAB - 1	31.2	31.3	31.4	31.1	30.9	31.3	30.9	30.7
ENVIRONMENTAL ENGINEERING LAB ROOM - 2	31.2	31.3	31.4	31.1	30.9	31.3	30.9	30.7

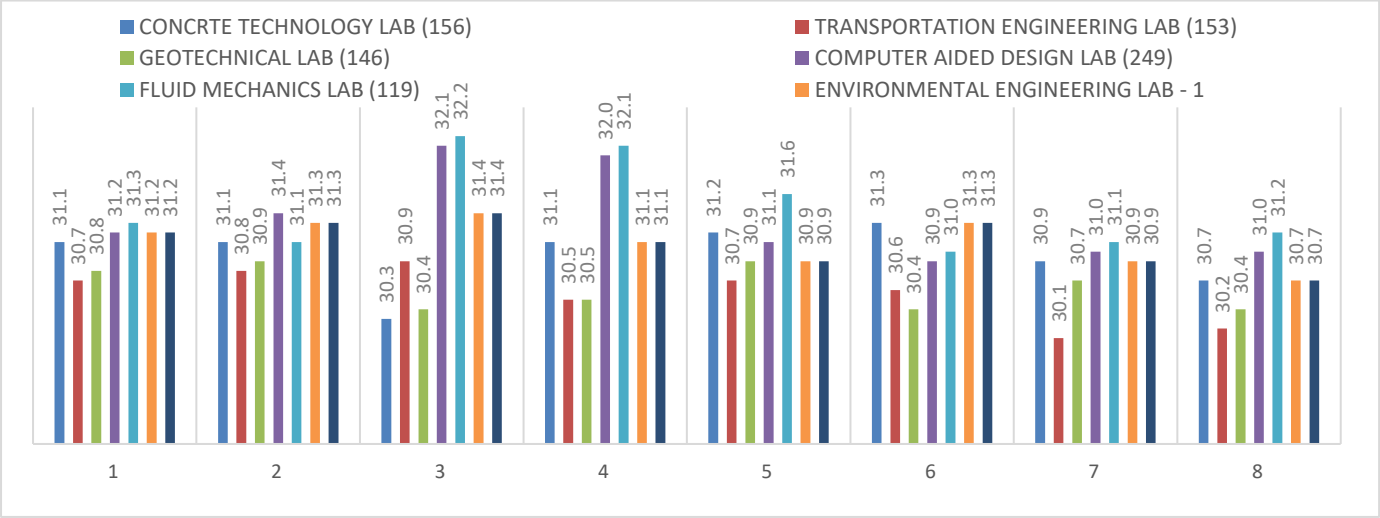

Fig7: Temperature in Laboratories of Civil Dept

Table8: Humidity in Class Rooms of Civil Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (155)	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
THIRD YEAR (154)	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
FINAL YEAR (143)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7

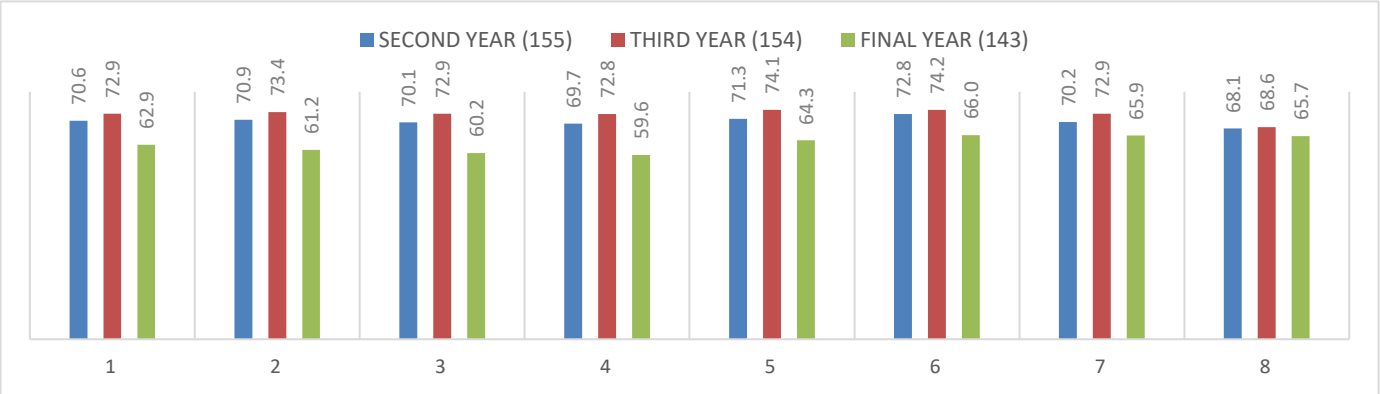

Fig8: Humidity in Class Rooms of Civil Dept

Table9: Humidity in Laboratories of Civil Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CONCRTE TECHNOLOGY LAB (156)	69.3	68.1	68.9	68.7	69.1	69.2	70.3	71.[illegible]
TRANSPORTATION ENGINEERING LAB (153)	71.3	71	72.8	73.1	75.6	76.3	73.8	74.[illegible]
GEOTECHNICAL LAB (146)	71.1	71.5	73.8	74.2	74.3	74.5	74.2	74.[illegible]
COMPUTER AIDED DESIGN LAB (249)	69.6	70.2	71.3	71.1	68.9	68.9	69.1	71.[illegible]
FLUID MECHANICS LAB (119)	71.1	71.3	71.9	71.8	71.5	71.1	71.9	72.[illegible]
ENVIRONMENTAL ENGINEERING LAB - 1	71.2	72.1	72.6	72.9	73.2	73.4	72.1	71.[illegible]
ENVIRONMENTAL ENGINEERING LAB ROOM - 2	71.2	72.1	72.6	72.9	73.2	74.1	72.1	71.[illegible]

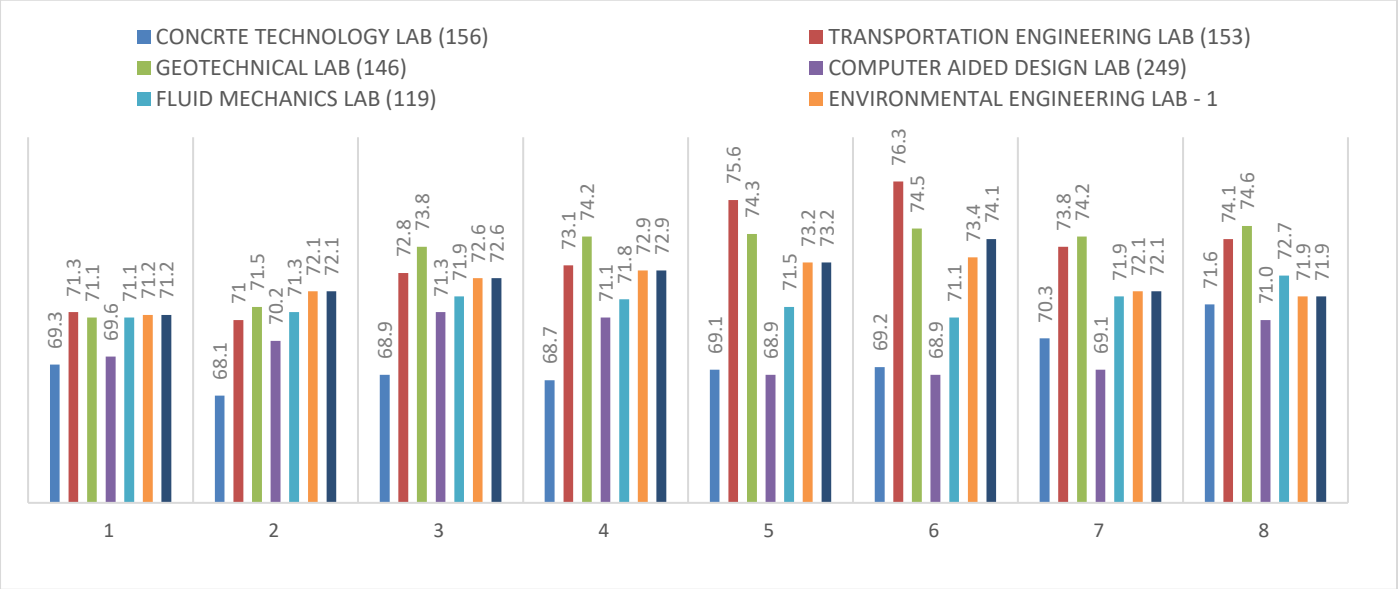

Fig9: Humidity in Laboratories of Civil Dept

Table10: Humidity in Staff Rooms of Civil Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CIVIL HOD ROOM (158)	70.9	70.9	70.5	68.4	68.1	67.3	67.9	68.2
CIVIL OFFICE ROOM (157)	70.2	70.5	68.9	68.1	71.9	73.9	68.9	67.8
STAFF ROOM -1 (153(A))	71.3	71.5	71.1	71.3	75.9	77.6	77.5	77.3
STAFF ROOM -2 (153(B))	72.1	72.3	71.4	71.9	75.9	76.7	74.3	71.7
STAFF ROOM -3 (145)	71.9	71.4	69.9	69.3	71.9	72.8	70.9	68.4
TUTORIAL ROOM (152)	71.6	71.4	71.2	71.1	73.6	75.5	74.9	72.1
EXAM CELL (144)	71.6	71.9	70.9	69.6	72.1	72.6	70.9	70.9
CIVIL LIBRARY (151)	70.3	70.1	69.2	69.3	69.3	69.9	70.1	69.9

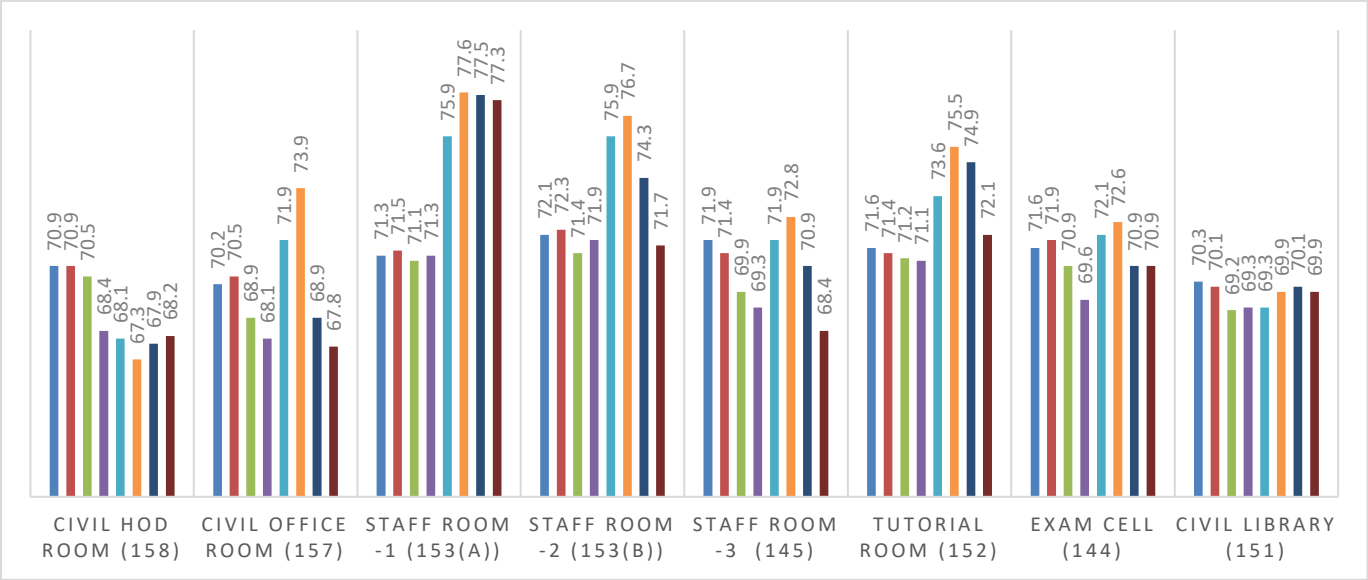

Fig10: Humidity in Staff Rooms of Civil Dept

MECHANICAL ENGINEERING

Table11: CO2 in Class Rooms of Mech Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (123) SECTION -1	400	421	444	465	495	520	450	397
SECOND YEAR (123(A)) SECTION -2	527	590	612	592	588	584	585	590
THIRD YEAR (107) SECTION -1	420	425	435	440	505	515	505	500
THIRD YEAR (108) SECTION -2	502	497	483	465	425	401	385	373
FINAL YEAR (134) SECTION -1	400	430	545	575	561	535	540	515
FINAL YEAR (134(A)) SECTION -2	439	452	478	475	490	488	480	415

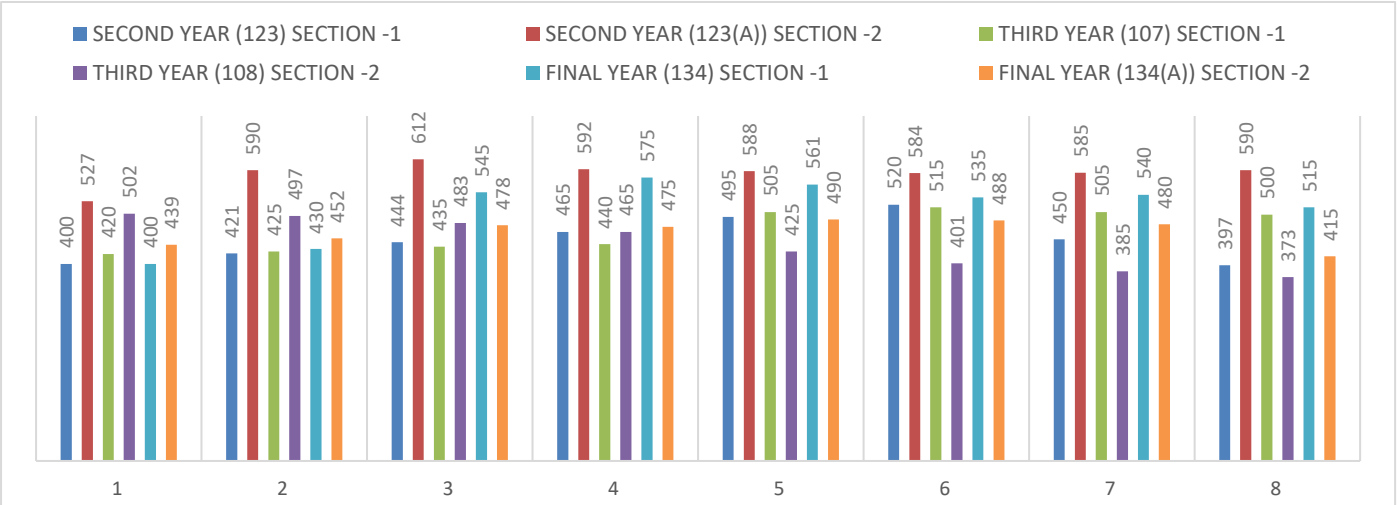

Fig11: CO2 in Class Rooms of Mech Dept

Table12: CO2 in Staff Rooms of Mech Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MECHANICAL HOD ROOM (125)	430	441	459	476	500	515	509	500
MECHANICAL OFFICE ROOM (126)	375	384	399	410	426	443	435	420
STAFF ROOM -1 (333)	512	560	590	610	635	590	575	560
STAFF ROOM -2 (334)	424	440	465	480	470	430	418	419

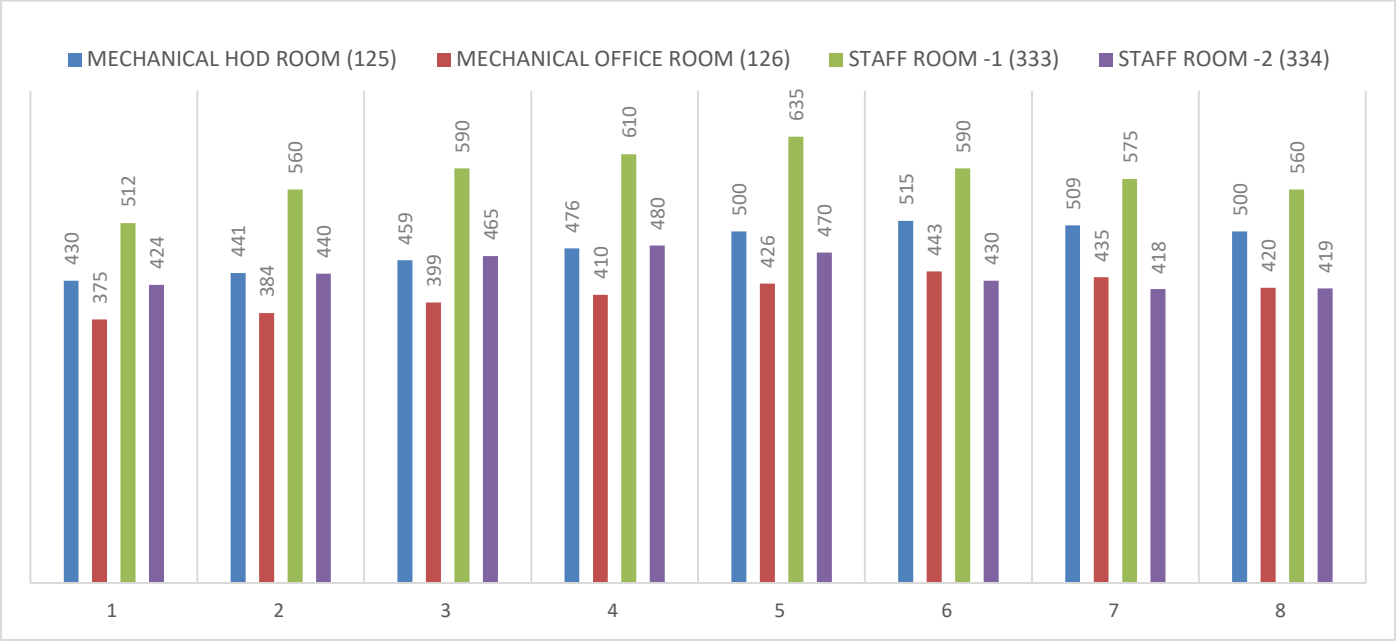

Fig12: CO2 in Staff Rooms of Mech Dept

Table13: CO2 in Laboratories of Mech Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
BASIC WORKSHOP (122(B))	600	559	518	540	530	404	410	419
MATERIAL TESTING LAB (117)	443	527	612	692	712	698	612	585
HEAT TRANSFER LAB (109)	430	423	415	450	465	480	473	420
INSTRUMENTATION AND METOROLGY LAB (328)	555	569	580	588	496	501	470	436
FLUID MECHANICS LAB (119)	700	658	605	583	509	416	490	532
CAM LAB (321)	595	580	593	600	664	610	540	510
CAD LAB (348)	583	595	540	623	690	712	756	590
MACHINE TOOLS LAB -1 (124)	527	590	741	612	522	555	509	490
MACHINE TOOLS LAB -2 (122)	430	425	416	500	459	425	430	400

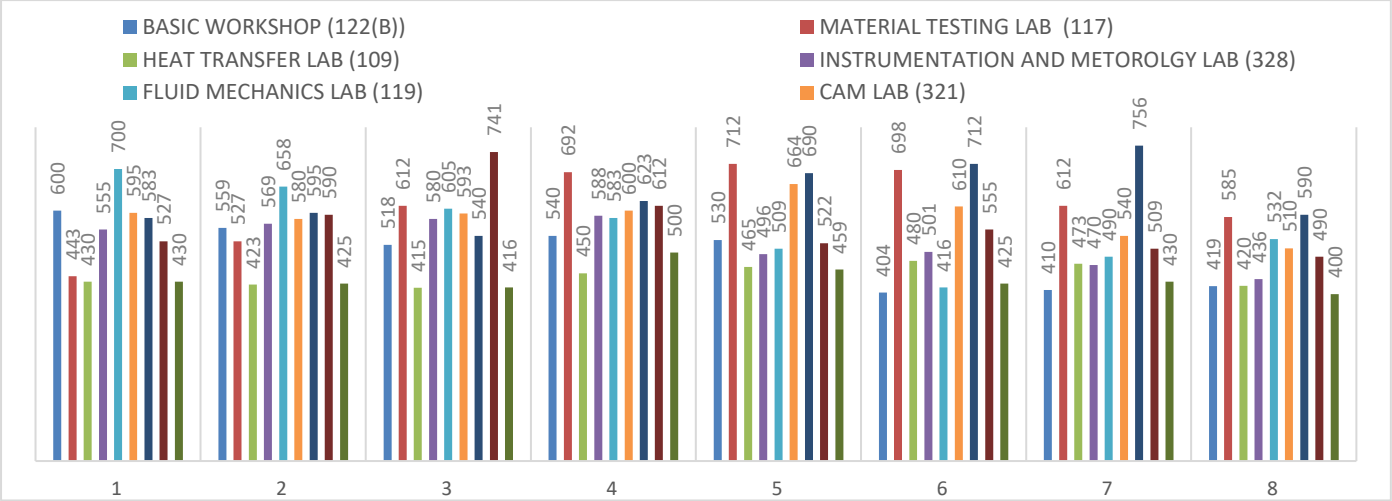

Fig13: CO2 in Laboratories of Mech Dept

Table14: Temperature in Class Rooms of Mech Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (123) SECTION -1	31.1	31.2	30.8	30.7	30.7	30.7	30.8	30.9
SECOND YEAR (123(A)) SECTION -2	31.2	30.6	31.2	31.2	31.4	31.8	31.5	31.3
THIRD YEAR (107) SECTION -1	30.9	30.9	31.8	31.6	31.8	31.8	31.1	31.2
THIRD YEAR (108) SECTION -2	30.6	30.7	30.5	30.7	30.5	30.5	30.4	30.9
FINAL YEAR (134) SECTION -1	31.0	30.1	31.8	31.8	31.5	31.2	31.0	31.0
FINAL YEAR (134(A)) SECTION -2	30.1	30.1	31.8	31.2	31.2	31.9	31.7	31.8

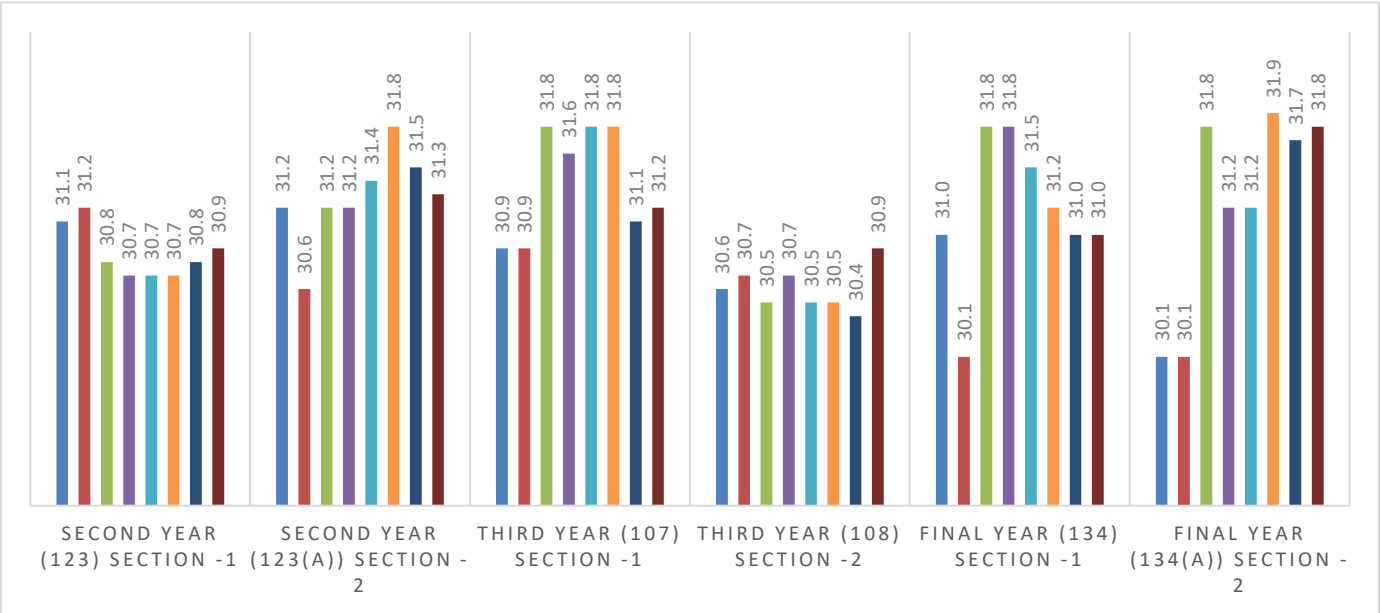

Fig14: Temperature in Class Rooms of Mech Dept

Table15: Temperature in Staff Rooms of Mech Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MECHANICAL HOD ROOM (125)	30.4	30.5	31.2	31.1	31.1	30.9	31.0	31.1
MECHANICAL OFFICE ROOM (126)	30.1	30.3	31.7	31.6	31.8	31.2	30.3	30.3
STAFF ROOM -1 (333)	32.1	32	31.9	31.9	31.8	31.7	31.6	31.5
STAFF ROOM -2 (334)	31.6	31.8	31.8	31.9	31.7	31.6	31.7	31.8

Fig15: Temperature in Staff Rooms of Mech Dept

Table16: CO2 in Laboratories of Mech Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
BASIC WORKSHOP (122(B))	30.6	30.8	31	31.2	31.6	31.8	31.5	31.3
MATERIAL TESTING LAB (117)	30.1	30.3	30.9	31.1	30.7	30.9	30.8	30.6
HEAT TRANSFER LAB (109)	31.1	31.1	30.3	31.1	31.2	31.3	30.9	30.7
INSTRUMENTATION AND METOROLGY LAB (328)	30.6	30.7	31.4	31.2	30.6	30.2	30.9	30.8
FLUID MECHANICS LAB (119)	31.2	31.0	31.2	30.6	31.2	31.1	31.0	31.0
CAM LAB (321)	30.4	30.8	30.5	30.8	30.8	30.9	31.3	31.2
CAD LAB (348)	30.5	30.7	30.7	30.9	30.6	30.8	31.0	31.2
MACHINE TOOLS LAB -1 (124)	31.2	31.4	32.1	32.0	31.1	30.9	31.0	31.0
MACHINE TOOLS LAB -2 (122)	31.1	31.1	30.3	31.1	31.2	31.3	30.9	30.7

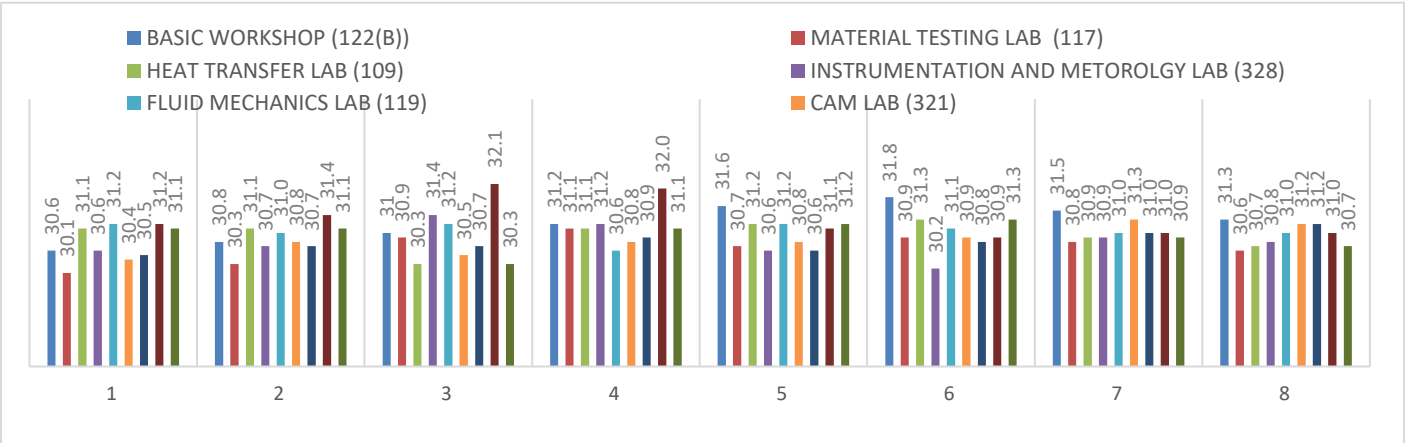

Fig16: CO2 in Laboratories of Mech Dept

Table17: Humidity in Class Rooms of Mech Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (123) SECTION -1	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
SECOND YEAR (123(A)) SECTION -2	71.8	71.3	70.5	69.8	69.4	69.5	69.1	69.3
THIRD YEAR (107) SECTION -1	68.6	68.1	69.4	69.3	67.9	67.3	67.3	66.6
THIRD YEAR (108) SECTION -2	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
FINAL YEAR (134) SECTION -1	69.9	68.9	67.9	67.3	69.2	69.2	69.9	69.4
FINAL YEAR (134(A)) SECTION -2	70.1	69.9	68.9	68.1	68.5	68.2	70.6	70.3

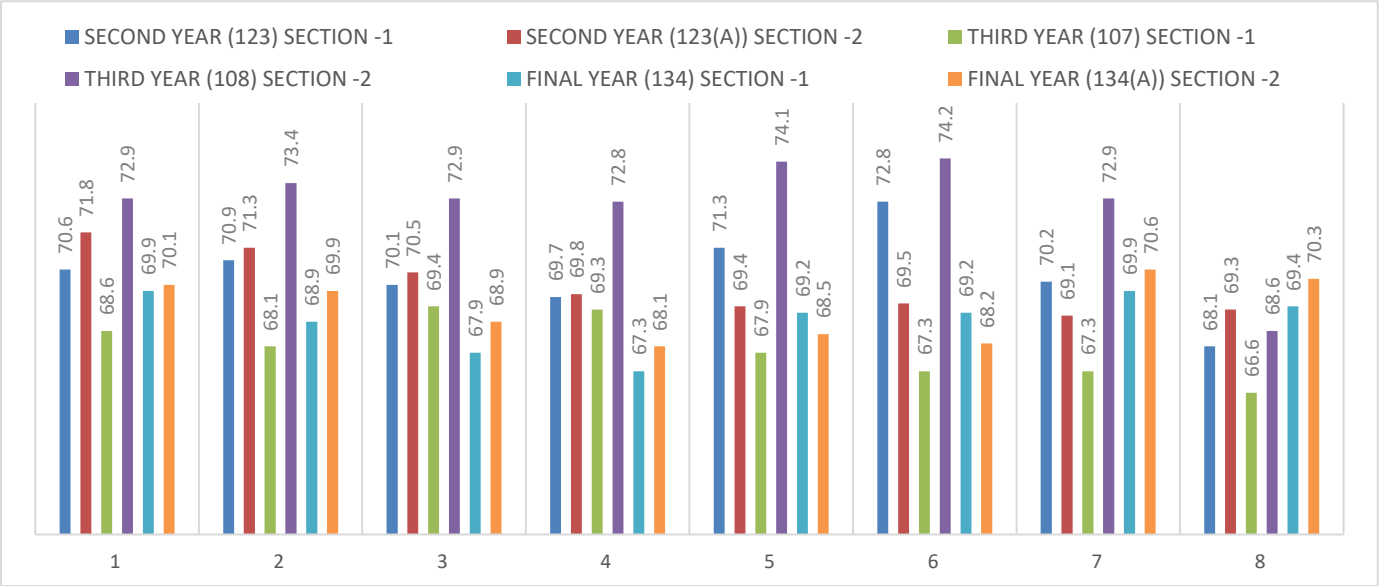

Fig17: Humidity in Class Rooms of Mech Dept

Table18: Humidity in Staff Rooms of Mech Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MECHANICAL HOD ROOM (125)	71.3	72.3	69.9	69.3	72.5	72.4	71.9	71.2
MECHANICAL OFFICE ROOM (126)	71.6	71.3	68.9	68.2	70.2	70.2	71.2	71.2
STAFF ROOM -1 (333)	66.9	67.5	67.9	67.3	66.9	66.1	65.3	65.8
STAFF ROOM -2 (334)	67.2	67.2	66.9	66.3	67.2	67.8	66.7	66.3

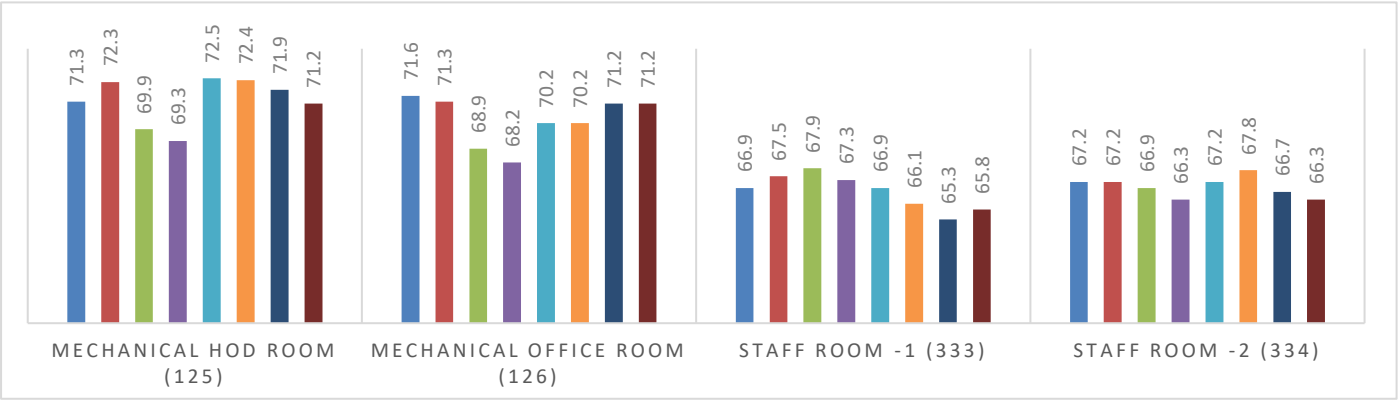

Fig18: Humidity in Staff Rooms of Mech Dept

Table19: Humidity in Laboratories of Mech Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
BASIC WORKSHOP (122(B))	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
MATERIAL TESTING LAB (117)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
HEAT TRANSFER LAB (109)	71.1	71.5	73.8	74.2	74.3	74.5	74.2	74.6
INSTRUMENTATION AND METOROLGY LAB (328)	70.2	70.5	68.9	71.9	75.9	76.7	74.3	71.7
FLUID MECHANICS LAB (119)	71.3	71.5	71.1	69.3	71.9	72.8	70.9	68.4
CAM LAB (321)	72.1	72.3	71.4	71.1	73.6	75.5	74.9	72.1
CAD LAB (348)	71.9	71.4	69.9	69.6	72.1	72.6	70.9	70.9
MACHINE TOOLS LAB -1 (124)	71.8	72.1	69.8	69.3	69.3	69.9	70.1	69.9
MACHINE TOOLS LAB -2 (122)	71.1	71.5	73.8	74.2	74.3	74.5	74.2	74.6

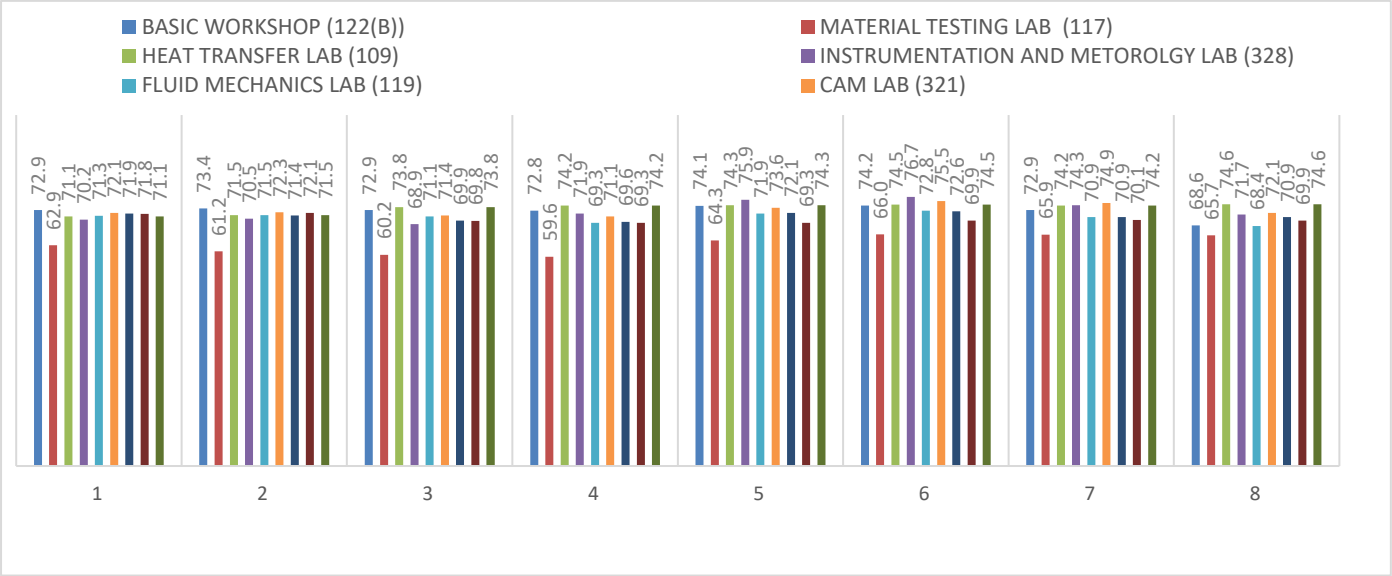

Fig19: Humidity in Laboratories of Mech Dept

COMPUTER SCIENCE AND ENGINEERING

Table20: CO2 in Class Rooms of CSE Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (209) SECTION -1	400	421	444	465	495	520	450	397
SECOND YEAR (210) SECTION -2	527	631	612	592	588	584	585	590
THIRD YEAR (SS) SECTION -1	420	425	435	440	505	515	505	500
THIRD YEAR (108) SECTION -2	502	497	483	465	425	401	385	373
FINAL YEAR (134) SECTION -1	400	430	545	575	561	535	540	515
FINAL YEAR (134(A)) SECTION -2	439	452	478	475	490	488	480	415

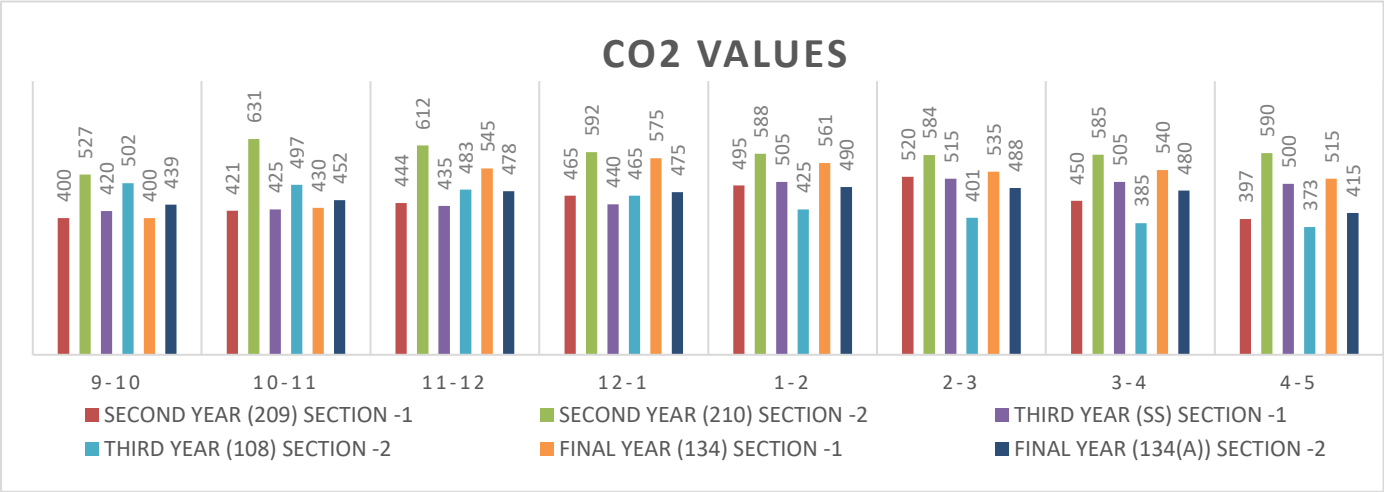

Fig20: CO2 in Class Rooms of CSE Dept

Table21: CO2 in Staff Rooms of CSE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(204)	671	650	607	750	779	520	500	490
STAFF ROOM -1 (205)	629	610	708	650	524	530	536	490
STAFF ROOM -2 (207)	598	650	556	540	535	520	515	500
CSE OFFICE (212)	672	550	570	544	530	622	590	515
CSE HOD (213)	528	550	509	520	510	490	465	445
STAFF ROOM -3 (220)	632	520	516	521	515	520	501	496
STAFF ROOM-4 (221)	509	477	450	435	545	525	519	501
STAFF ROOM -5 (222)	490	450	590	457	462	475	495	450
STAFF ROOM -6 (223)	475	490	528	583	549	547	533	510
PHOENIX DEV CENTRE (226)	690	656	613	594	610	552	519	510
STAFF ROOM -7 (219)	530	515	501	570	595	563	545	530
LIBRARY	520	568	590	545	556	620	527	516

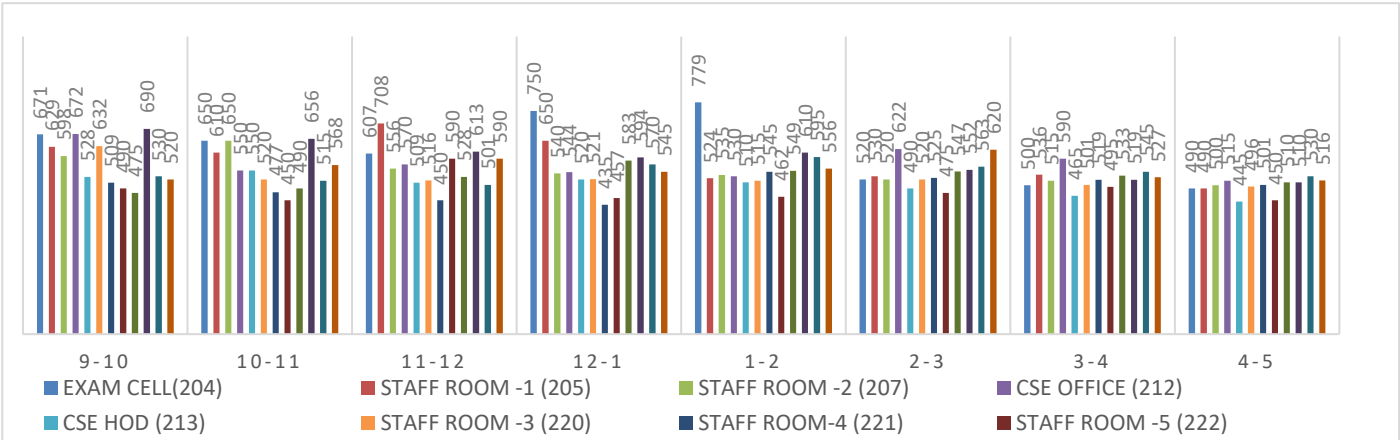

Fig21: CO2 in Staff Rooms of CSE Dept

Table22: CO2 in Laboratories of CSE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
AI & ML LAB(208)	1176	1123	1115	1100	1026	1010	923	883
INVENTION & INNOVATION CELL(211)	629	610	690	725	784	856	950	923
APPLICATION DEVELOPMENT LAB(216)	1281	1269	1356	1390	1435	1379	1290	1235
RESEARCH& DEVELOPMENT LAB(218)	532	513	561	630	715	759	856	812
SERVER ROOM (218(A))	528	550	509	520	556	590	585	542
PROGRAMMING LAB(224)	1727	1710	1656	1638	1526	1456	1389	1286
SKILL TRAINING LAB(323)	2170	2165	2189	2577	2493	2221	1668	1523

Fig22: CO2 in Laboratories of CSE Dept

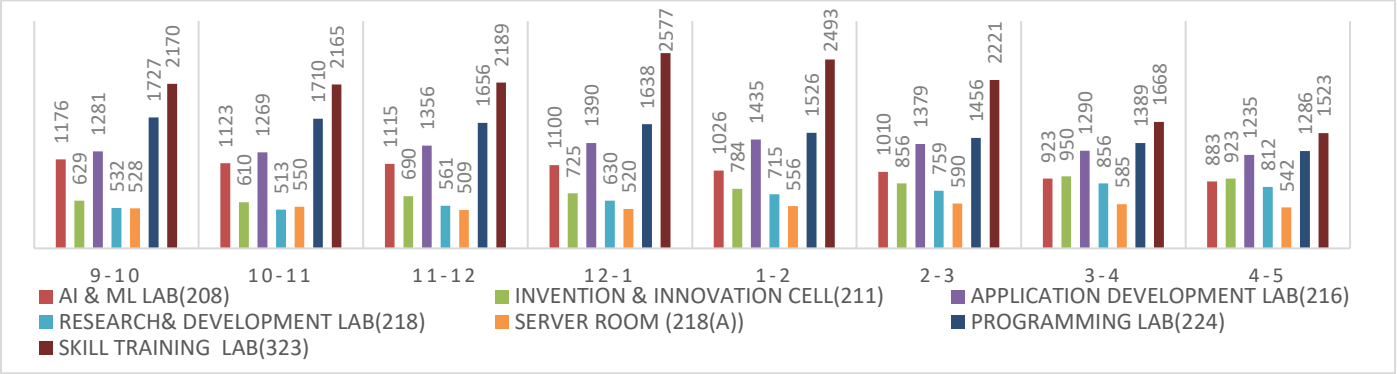

Table23: Humidity in Class Rooms of CSE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (209) SECTION -1	72.5	72.6	72.5	72.6	73.6	73.2	72.6	72.5
SECOND YEAR (210) SECTION -2	72.9	72.8	72.7	75.8	75.3	76.5	76.2	76.3
THIRD YEAR (SS) SECTION -1	72.9	72.8	71.3	70.2	73.4	73.5	72.6	72.2
THIRD YEAR (108) SECTION -2	75.9	75.6	75.8	76.1	76.5	75.6	75.2	75.2
FINAL YEAR (134) SECTION -1	72.3	72.9	73.6	73.4	72.5	72.9	72.4	72.5
FINAL YEAR (134(A)) SECTION -2	73.6	73.9	75.9	73.5	75.5	73.5	73.2	72.1

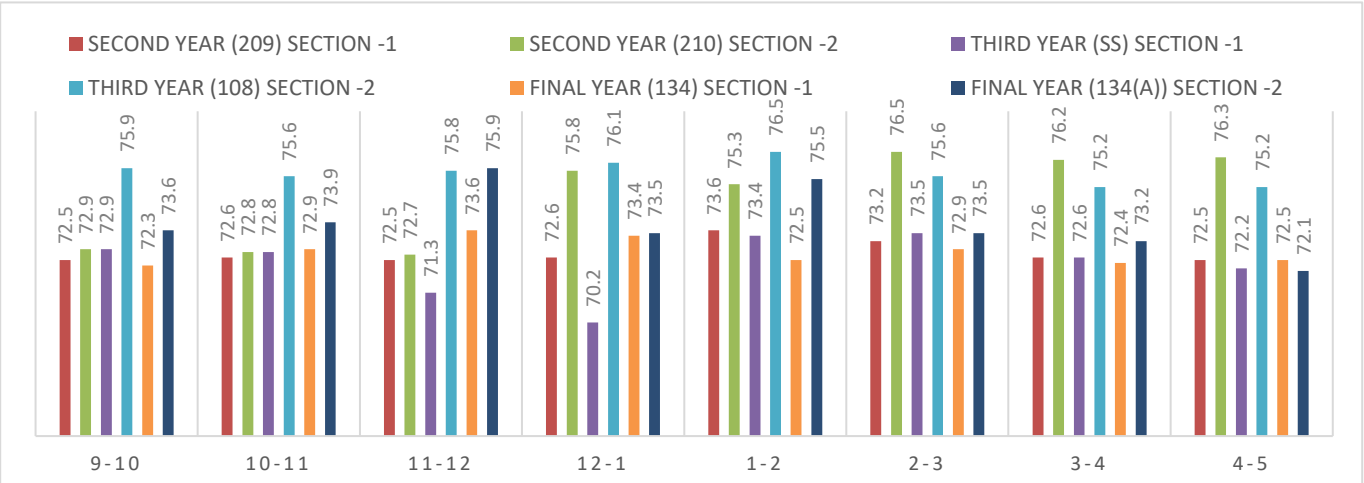

Fig23: Humidity in Class Rooms of CSE Dept

Table24: Humidity in Staff Rooms of CSE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(204)	76.0	74.1	74.2	75.3	75.2	73.6	72.3	72.2
STAFF ROOM -1 (205)	76.1	75.3	74.7	74.2	73.4	73.2	74.2	73.6
STAFF ROOM -2 (207)	72.3	72.4	72.4	74.9	74.3	74.6	74.9	72.6
CSE OFFICE (212)	73.6	73.1	73.5	73.5	73.1	73.3	73.1	73.1
CSE HOD (213)	73.2	73.2	73.4	73.5	72.5	72.6	73.5	72.2
STAFF ROOM -3 (220)	73.2	73.6	73.5	74.9	73.5	73.8	71.3	71.2
STAFF ROOM-4 (221)	74.3	74.5	75.2	75.1	73.6	73.2	72.6	72.1
STAFF ROOM -5 (222)	73.1	73.5	74.7	74.9	73.8	73.5	72.4	72.1
STAFF ROOM -6 (223)	74.1	74.7	74.4	73.3	73.2	73.5	73.3	71.6
PHOENIX DEV CENTRE (226)	70.6	71.3	72.5	72.6	73.5	71.5	71.2	71.1
STAFF ROOM -7 (219)	71.1	71.6	75.4	75.1	71.6	71.2	70.7	70.2
LIBRARY	73.3	74.5	74.7	74.9	74.2	72.3	72.1	72.1

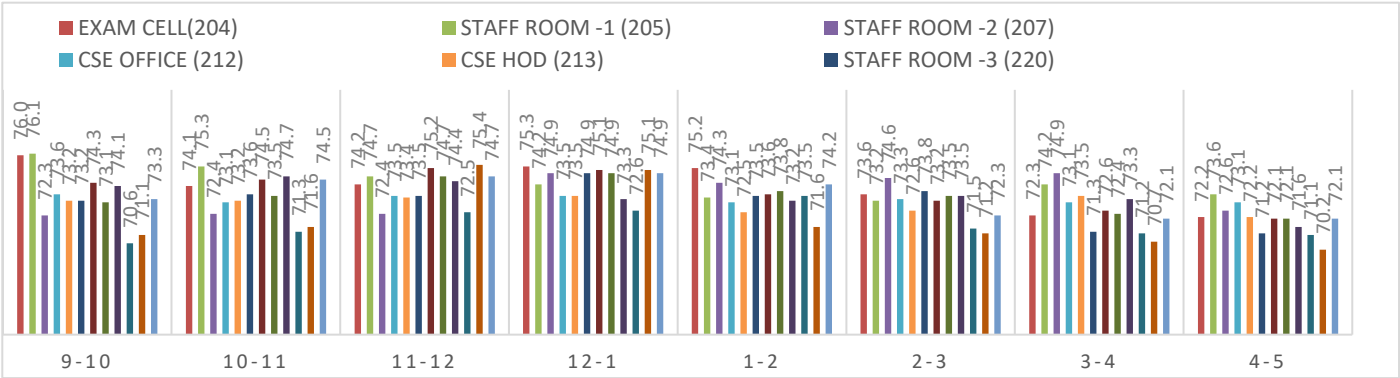

Fig24: Humidity in Staff Rooms of CSE Dept

Table25: Humidity in Laboratories of CSE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
AI & ML LAB(208)	58.9	58.9	64.2	62.3	65.1	65.3	63.5	63.1
INVENTION & INNOVATION CELL(211)	76.1	76.7	64.8	64.9	72.3	72.6	74.1	73.6
APPLICATION DEVELOPMENT LAB(216)	67.1	60.3	60.9	62.6	62.8	64.5	64.3	62.3
RESEARCH& DEVELOPMENT LAB(218)	68.5	68.2	73.3	73.6	55.2	55.3	62.3	62.1
SERVER ROOM (218(A))	62.2	63.3	63.8	52.7	52.3	52.4	57.4	57.2
PROGRAMMING LAB(224)	60.9	60.2	56.6	56.3	63.9	63.4	71.2	71.3
SKILL TRAINING LAB(323)	53.8	51.6	54.7	54.9	65.8	65.3	62.5	61.3

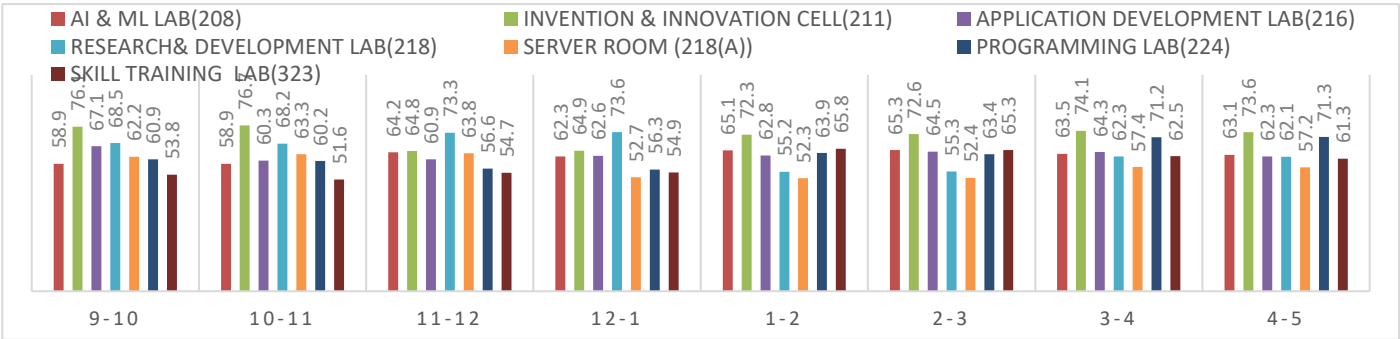

Fig25: Humidity in Laboratories of CSE Dept

Table26: Temperature in Class Rooms of CSE Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (209) SECTION -1	30.1	30.3	30.2	30.6	30.2	30.2	31.2	31.2
SECOND YEAR (210) SECTION -2	31.2	31.6	31.5	31.6	30.2	30.5	30.6	30.1
THIRD YEAR (SS) SECTION -1	31.3	31.6	30.2	30.6	31.6	30.6	31.2	30.2
THIRD YEAR (108) SECTION -2	31.2	31.6	31.5	30.2	30.5	30.6	31.1	30.7
FINAL YEAR (134) SECTION -1	31.2	31.6	31.9	31.4	31.6	30.5	30.1	30.2
FINAL YEAR (134(A)) SECTION -2	31.2	31.1	30.5	30.6	30.1	30.2	30.6	31.1

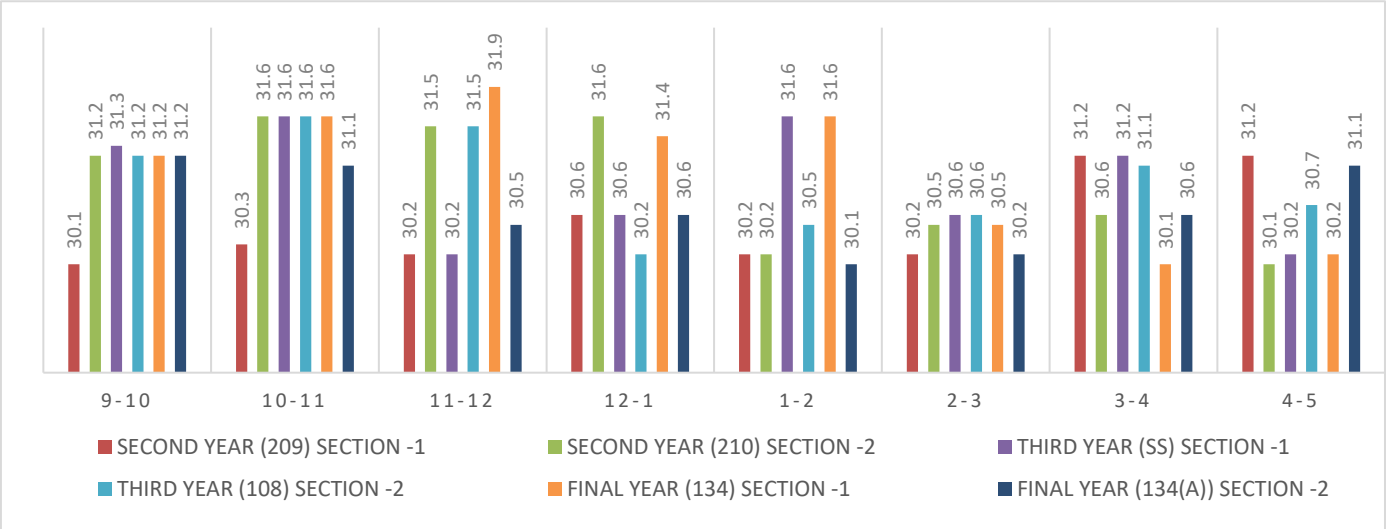

Fig26: Temperature in Class Rooms of CSE Dept

Table27: Temperature in Staff Rooms of CSE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(204)	30.1	30.2	30.6	30.5	30.1	31.2	31.1	30.9
STAFF ROOM -1 (205)	31.3	31.6	31.5	31.2	31.6	31.4	31.9	30.1
STAFF ROOM -2 (207)	30.5	30.6	30.2	31.2	31.6	31.5	31	31.9
CSE OFFICE (212)	30.8	31	30.5	30.2	31.4	31.2	31.5	31.5
CSE HOD (213)	31.2	31.6	31.4	30.5	30.9	30.4	31.5	31.6
STAFF ROOM -3 (220)	31	31.6	31.5	31.3	31.6	31.5	31.5	31.2
STAFF ROOM-4 (221)	30.2	31.2	30.2	31.5	31.6	30.3	30.8	31.9
STAFF ROOM -5 (222)	30.1	32.1	30.2	30.6	31.2	31.3	30.5	30.6
STAFF ROOM -6 (223)	31.5	31.6	31.9	31.5	31	31.4	31.5	30.2
PHOENIX DEV CENTRE (226)	30.2	30.6	30.5	30.4	30.6	30.4	30.5	30.6
STAFF ROOM -7 (219)	30.6	30.5	30.5	31.6	31.5	31.8	31.7	31.6
LIBRARY	30.2	30.5	30.4	30.6	30.5	31.2	31.4	30.7

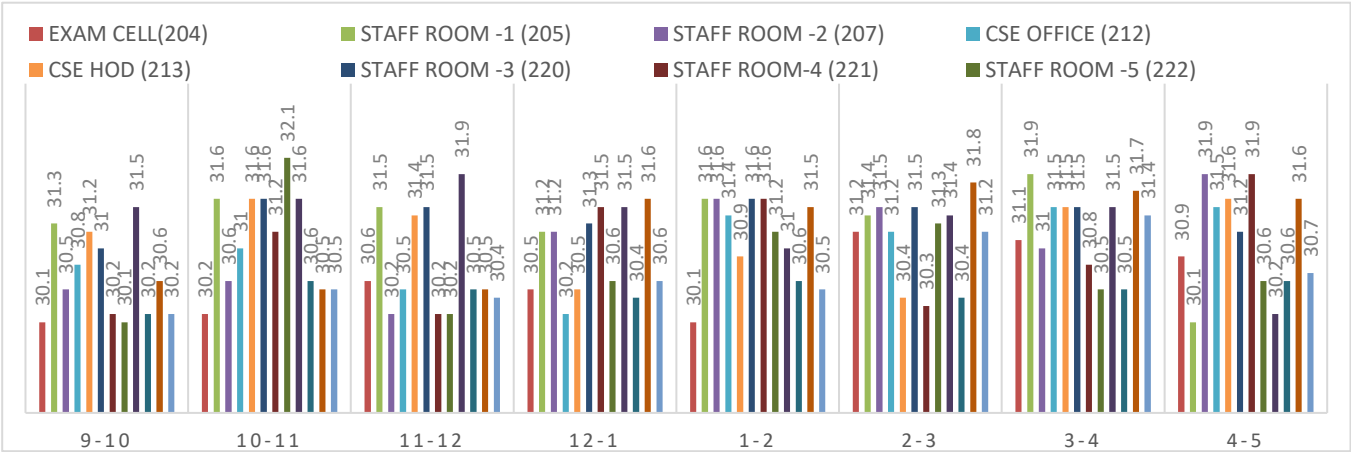

Fig27: Temperature in Staff Rooms of CSE Dept

Table28: Temperature in Laboratories of CSE Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
AI & ML LAB(208)	30.2	30.6	30.4	30.9	31	31.6	31.2	31.2
INVENTION & INNOVATION CELL(211)	30.6	30.2	30.4	30.4	30.5	30.6	31.6	31.2
APPLICATION DEVELOPMENT LAB(216)	30.2	31.2	31.8	31.5	31.9	31.6	31.2	30.2
RESEARCH& DEVELOPMENT LAB(218)	30.2	30.6	30.1	30.2	31.5	31	31.6	31.4
SERVER ROOM (218(A))	30.2	31.6	30.5	30.6	31	31.5	31.2	31.2
PROGRAMMING LAB(224)	31.2	30.6	30.6	31.6	30.5	30.2	30.5	30.2
SKILL TRAINING LAB(323)	31	31.8	31.9	31.2	31.2	32.6	32.4	31.2

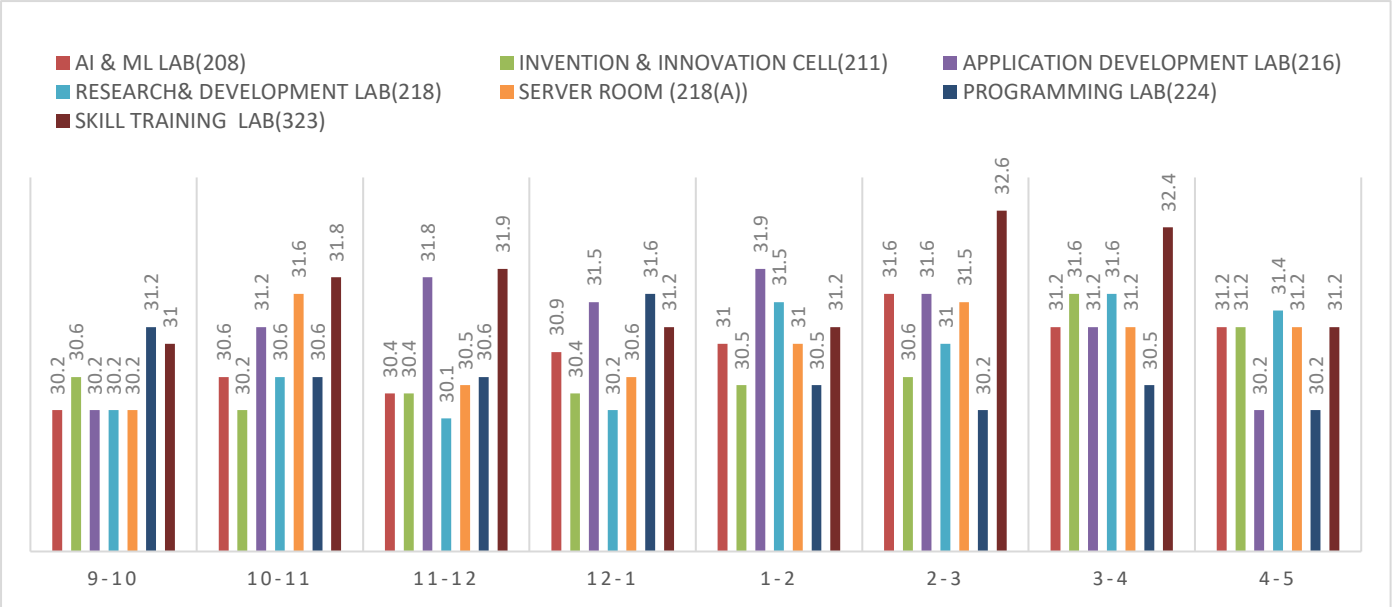

Fig28: Temperature in Laboratories of CSE Dept

INFORMATION TECHNOLOGY

Table29: CO2 in Class Rooms of IT Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (309) SECTION -1	486	465	454	451	457	440	453	410
SECOND YEAR (310) SECTION -2	532	510	459	435	454	462	490	423
THIRD YEAR (329) SECTION -1	569	523	579	582	600	653	513	450
THIRD YEAR (329(A)) SECTION -2	528	546	540	590	582	406	435	401
FINAL YEAR (301) SECTION -1	593	526	501	659	635	612	632	529
FINAL YEAR (303) SECTION -2	584	590	604	635	576	534	576	467

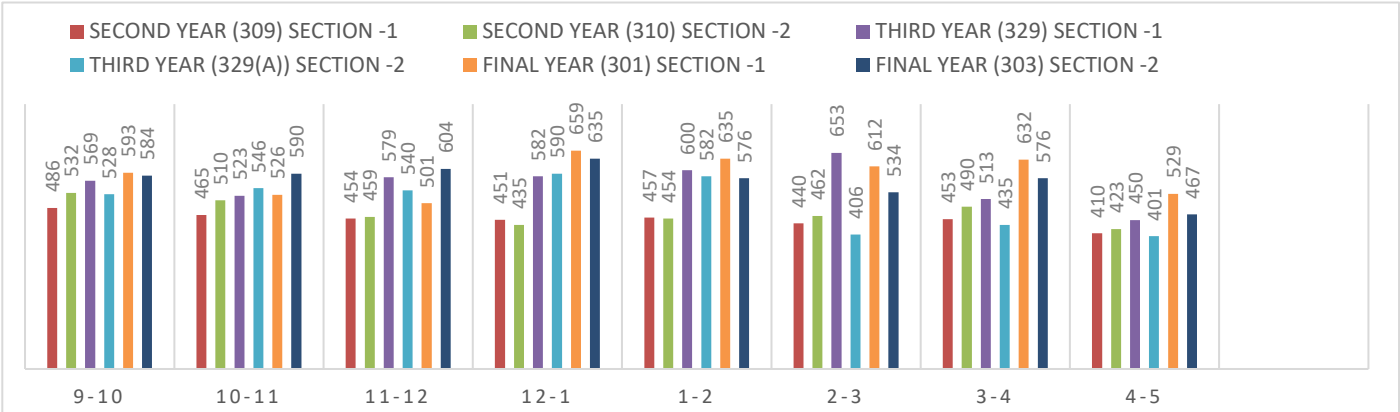

Fig29: CO2 in Class Rooms of IT Dept

Table30: CO2 in Staff Rooms of IT Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
STAFF ROOM-1(304)	458	482	425	496	436	437	431	425
STAFF ROOM -2 (305)	475	457	476	425	498	522	546	453
STAFF ROOM -3 (306)	425	488	458	470	468	482	421	410
IT OFFICE (312)	451	465	485	421	498	437	458	515
IT HOD (313)	584	546	539	521	512	536	524	510
LIBRARY(315)	443	443	415	516	586	410	462	450
EXAM CELL (320)	540	586	541	509	540	536	526	542
STAFF ROOM -4 (322)	518	520	536	589	546	513	500	490
STAFF ROOM -5(319)	660	623	590	556	651	623	613	590

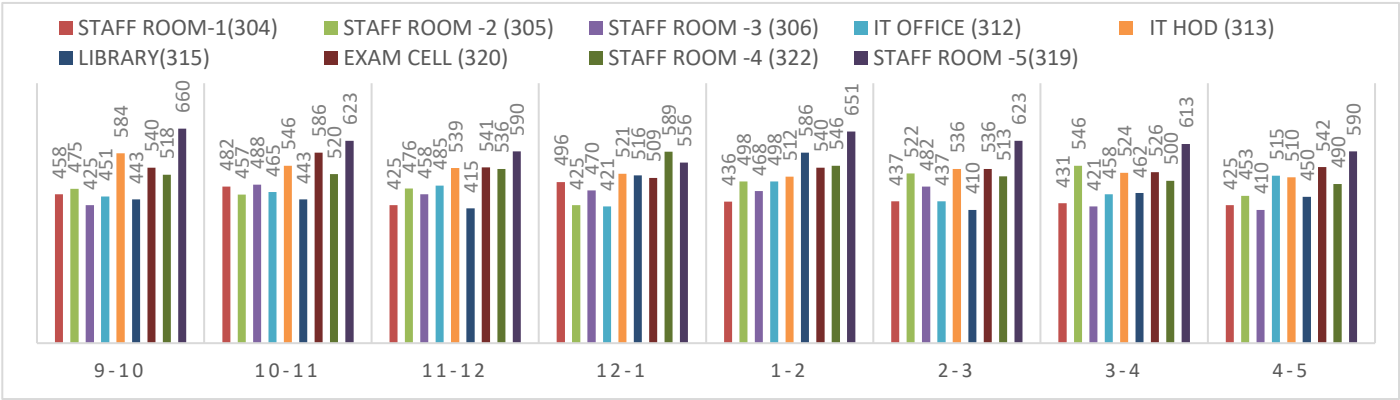

Fig30: CO2 in Staff Rooms of IT Dept

Table31: CO2 in Laboratories of IT Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
PROGRAMMING LANGUAGE &PROJECT LAB(308)	1231	1235	1233	1015	1056	1000	983	96
INSTALLATION LAB(311)	900	865	843	759	689	758	723	67
IDE LAB (316)	1436	1464	1459	1356	1258	1165	1098	107
APSSDC (318)	469	598	682	689	643	546	523	47
INCUBATION CENTRE (326)	477	688	565	560	548	542	519	49

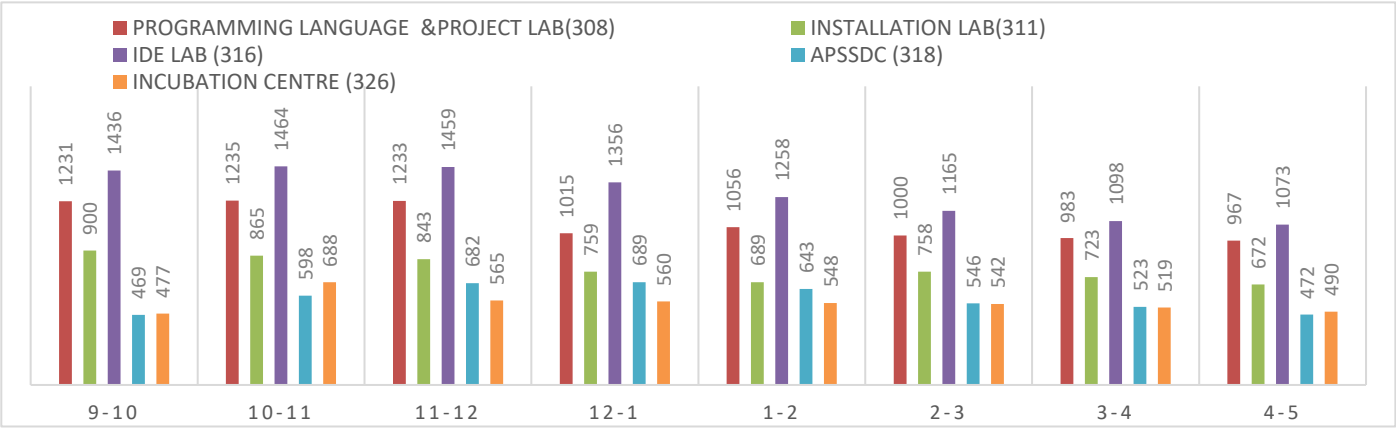

Fig31: CO2 in Laboratories of IT Dept

Table32: Humidity in Class Rooms of IT Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (309) SECTION -1	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
SECOND YEAR (310) SECTION -2	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
THIRD YEAR (329) SECTION -1	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
THIRD YEAR (329(A)) SECTION -2	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
FINAL YEAR (301) SECTION -1	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
FINAL YEAR (303) SECTION -2	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7

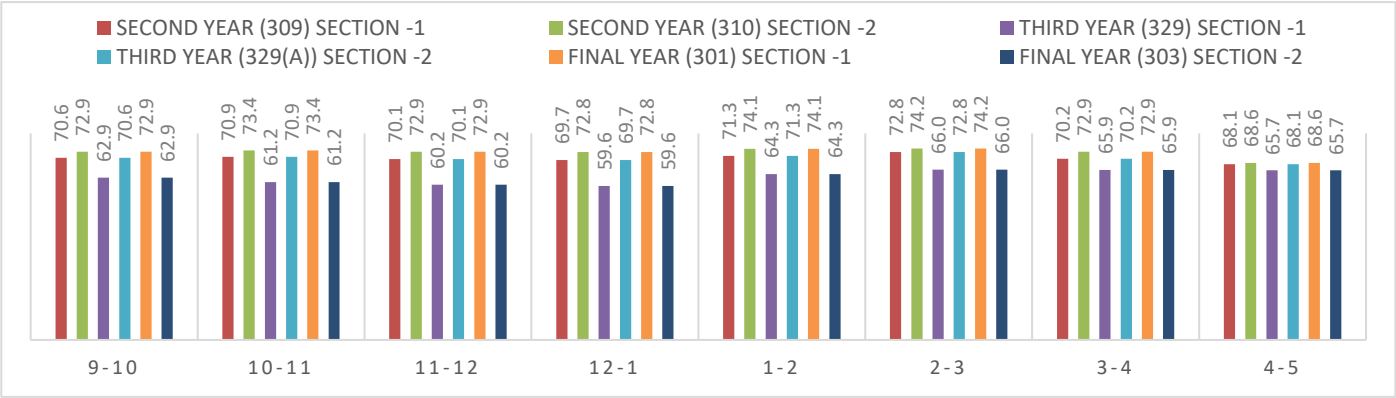

Fig32: Humidity in Class Rooms of IT Dept

Table33: Humidity in Staff Rooms of IT Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
STAFF ROOM-1(304)	72.5	72.6	72.5	72.6	73.6	73.2	72.6	72.5
STAFF ROOM -2 (305)	72.9	72.8	72.7	75.8	75.3	76.5	76.2	76.3
STAFF ROOM -3 (306)	72.9	72.8	71.3	70.2	73.4	73.5	72.6	72.2
IT OFFICE (312)	75.9	75.6	75.8	76.1	76.5	75.6	75.2	75.2
IT HOD (313)	72.3	72.9	73.6	73.4	72.5	72.9	72.4	72.5
LIBRARY(315)	73.6	73.9	75.9	73.5	75.5	73.5	73.2	72.1
EXAM CELL (320)	72.5	72.6	72.5	72.6	73.6	73.2	72.6	72.5
STAFF ROOM -4 (322)	72.9	72.8	72.7	75.8	75.3	76.5	76.2	76.3
STAFF ROOM -5(319)	72.9	72.8	71.3	70.2	73.4	73.5	72.6	72.2

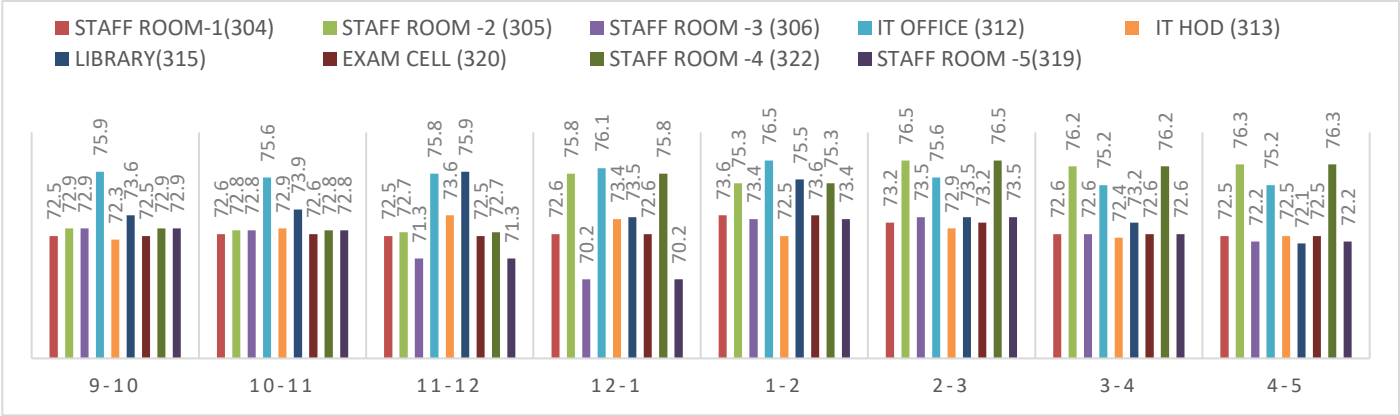

Fig33: Humidity in Staff Rooms of IT Dept

Table34: Humidity in Laboratories of IT Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
PROGRAMMING LANGUAGE &PROJECT LAB(308)	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
INSTALLATION LAB(311)	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
IDE LAB (316)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
APSSDC (318)	67.1	60.3	60.9	62.6	62.8	64.5	64.3	62.3
INCUBATION CENTRE (326)	68.5	68.2	73.3	73.6	55.2	55.3	62.3	62.1

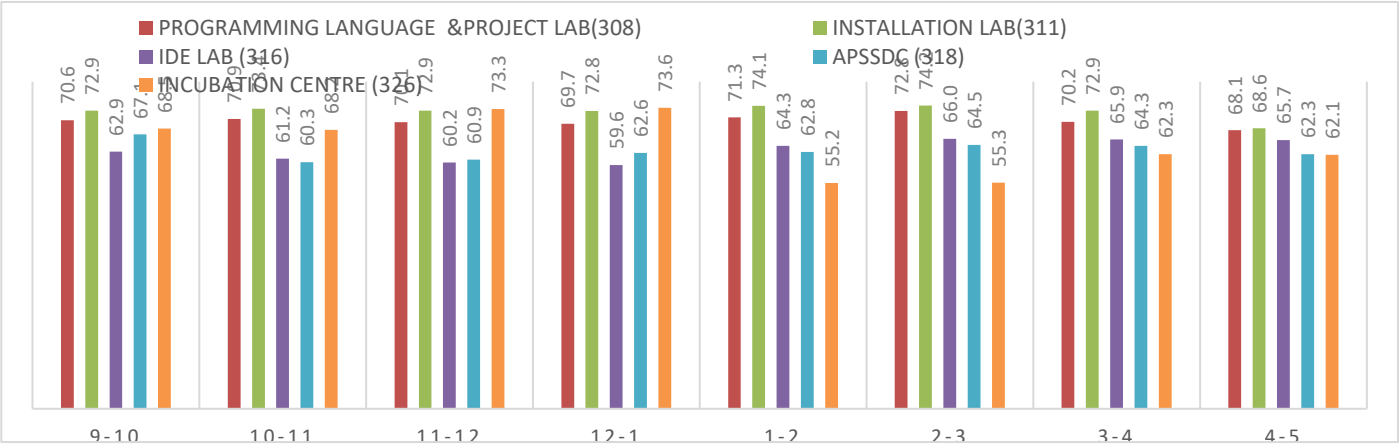

Fig34: Humidity in Laboratories of IT Dept

Table35: Temperature in Class Rooms of IT Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (309) SECTION -1	31.1	31.2	30.8	30.7	30.7	30.7	30.8	30.9
SECOND YEAR (310) SECTION -2	31.2	30.6	31.2	31.2	31.4	31.8	31.5	31.3
THIRD YEAR (329) SECTION -1	30.9	30.9	31.8	31.6	31.8	31.8	31.1	31.2
THIRD YEAR (329(A)) SECTION -2	30.6	30.7	30.5	30.7	30.5	30.5	30.4	30.9
FINAL YEAR (301) SECTION -1	31.0	30.1	31.8	31.8	31.5	31.2	31.0	31.0
FINAL YEAR (303) SECTION -2	30.1	30.1	31.8	31.2	31.2	31.9	31.7	31.8

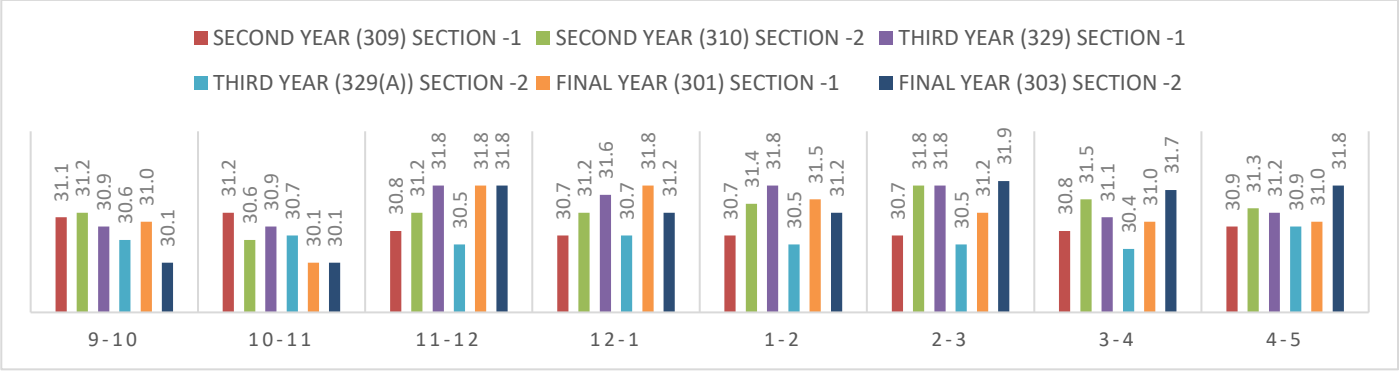

Fig35: Temperature in Class Rooms of IT Dept

Table36: Temperature in Staff Rooms of IT Dept

TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
STAFF ROOM-1(304)	30.6	30.8	31	31.2	31.6	31.8	31.5	31.3
STAFF ROOM -2 (305)	30.1	30.3	30.9	31.1	30.7	30.9	30.8	30.6
STAFF ROOM -3 (306)	30.6	30.9	30.7	30.7	30.6	30.6	30.4	30.5
IT OFFICE (312)	31.1	31.2	30.8	30.7	30.7	30.7	30.8	30.9
IT HOD (313)	30.8	30.9	30.7	30.6	30.8	30.3	31.2	31.0
LIBRARY(315)	30.6	30.7	30.5	30.7	30.5	30.5	30.4	30.2
EXAM CELL (320)	30.6	30.7	31.4	31.2	30.6	30.2	30.9	30.8
STAFF ROOM -4 (322)	31.2	31.0	31.2	30.6	31.2	31.1	31.0	31.0
STAFF ROOM -5(319)	31.1	30.2	31.5	31.8	31.6	31.5	31.7	31.6

Fig36: Temperature in Staff Rooms of IT Dept

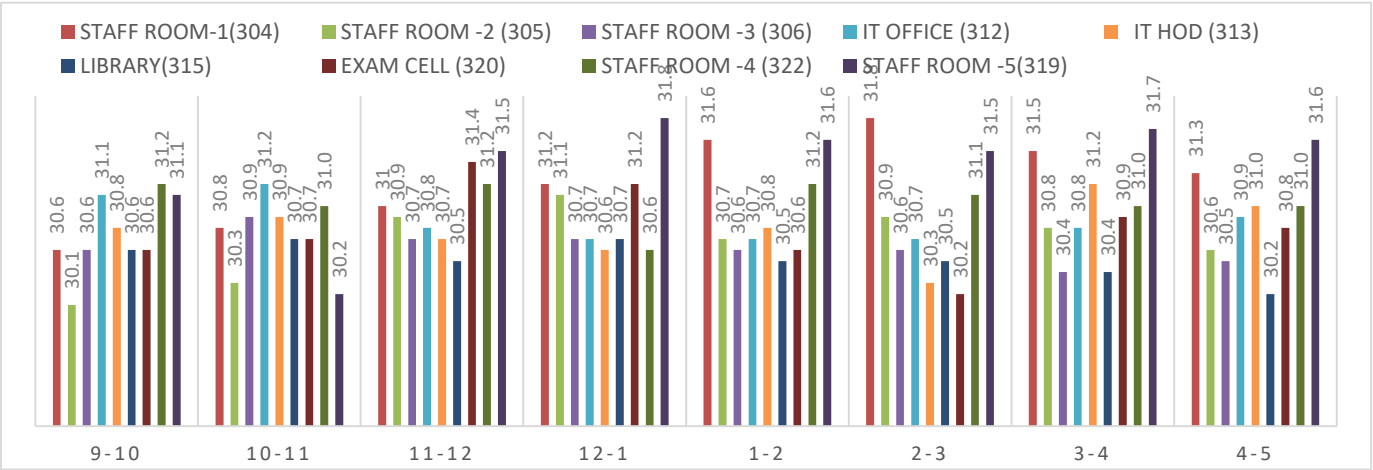

Table37: Temperature in Laboratories of IT Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
PROGRAMMING LANGUAGE &PROJECT LAB(308)	31.1	31.1	30.3	31.1	31.2	31.3	30.9	30.7
INSTALLATION LAB(311)	30.6	30.7	31.4	31.2	30.6	30.2	30.9	30.8
IDE LAB (316)	31.2	31.0	31.2	30.6	31.2	31.1	31.0	31.0
APSSDC (318)	30.4	30.8	30.5	30.8	30.8	30.9	31.3	31.2
INCUBATION CENTRE (326)	30.5	30.7	30.7	30.9	30.6	30.8	31.0	31.2

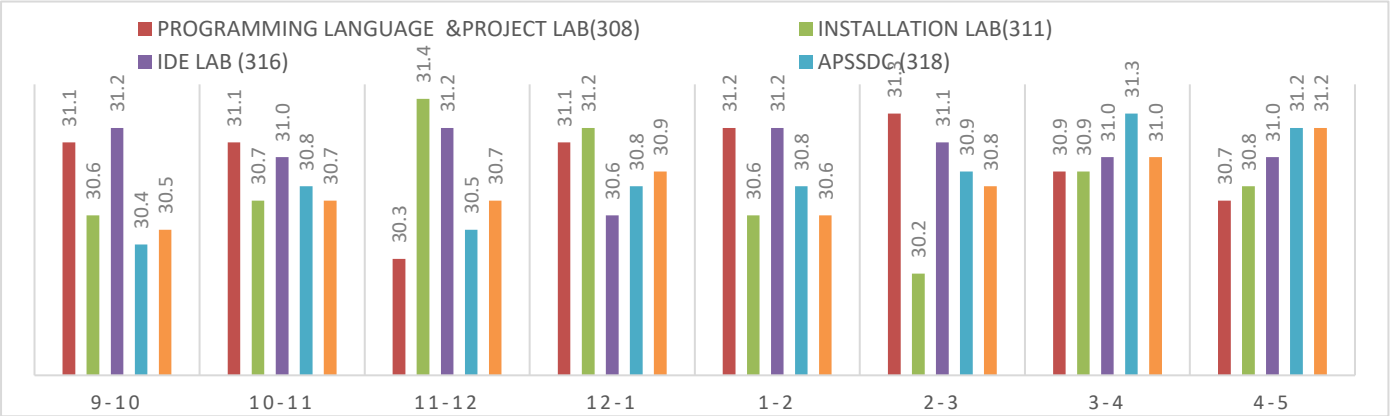

Fig37: Temperature in Laboratories of IT Dept

ELECTRONICS AND COMMUNICATION ENGINEERING

Table38: CO2 in Class Rooms of ECE Dept

TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (365) SECTION -1	527	465	454	451	564	425	453	421
SECOND YEAR (366) SECTION -2	532	510	519	550	495	412	456	415
THIRD YEAR (353(A)) SECTION -1	498	520	515	565	598	610	549	555

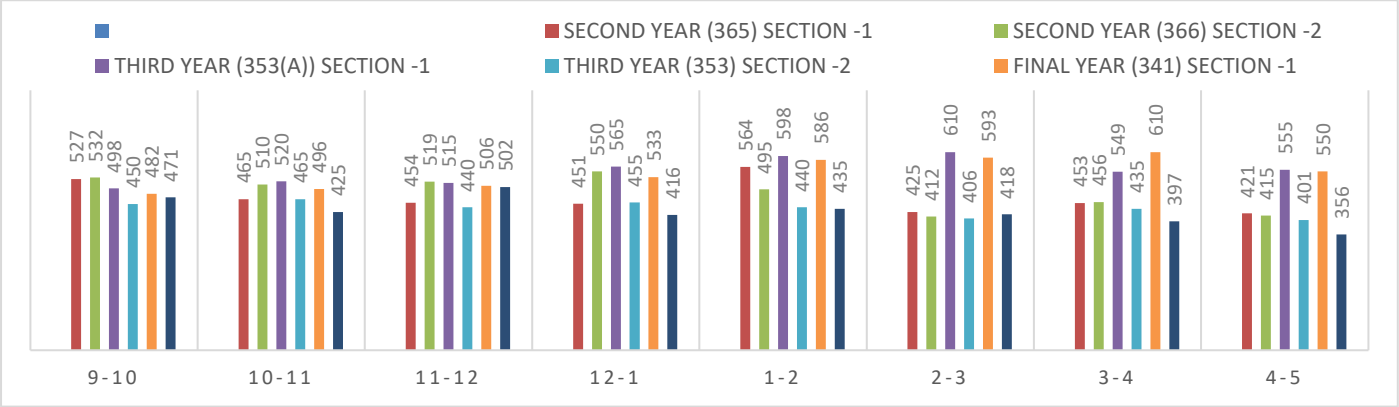

Fig38: CO2 in Class Rooms of ECE Dept

Table39: CO2 in Staff Rooms of ECE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(370)	584	546	539	521	512	536	524	510
ECE OFFICE (368)	443	443	415	516	586	410	462	450
LIBRARY(361)	540	586	541	509	540	536	526	542
STAFF ROOM -1 (358)	518	520	536	589	546	513	500	490
STAFF ROOM -2(340)	392	456	539	521	586	598	562	510
STAFF ROOM -3(254)	401	405	415	516	435	410	462	450
STAFF ROOM -4 (256)	484	492	500	509	540	516	586	546
E-CLASS ROOM (244(A))	561	592	653	689	712	751	786	765
STAFF ROOM -5(363)	492	588	471	481	440	411	430	480
ECE HOD (369)	457	421	446	438	471	480	585	480
STAFF ROOM -6 (362)	450	440	501	496	504	490	483	453

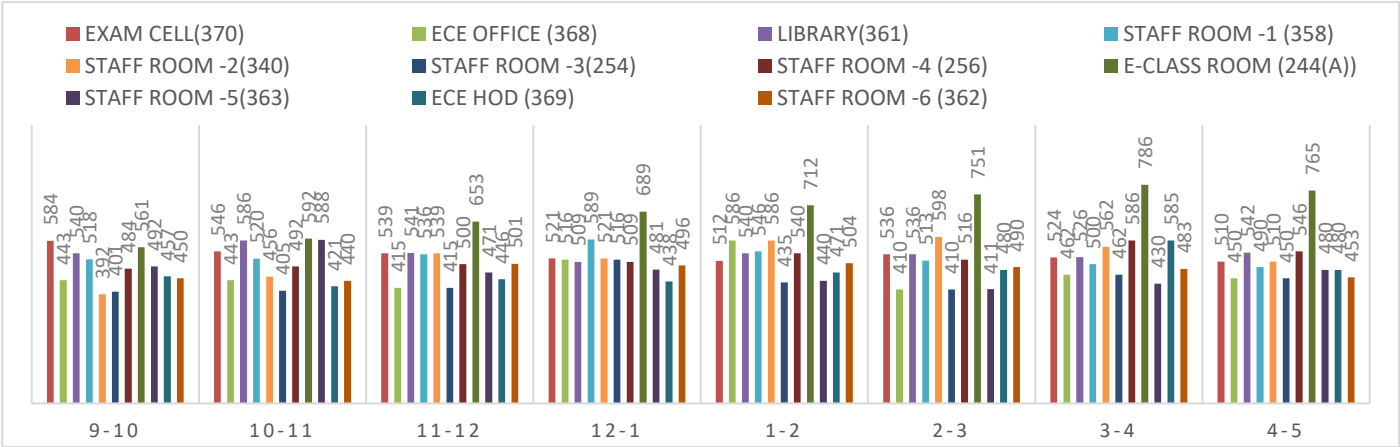

Fig39: CO2 in Staff Rooms of ECE Dept

Table40: CO2 in Laboratories of ECE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE R&D LAB(367)	900	865	843	759	689	758	723	672
VLSI LAB(364)	907	958	926	579	594	568	511	510
EMBEDED SYSTEM LAB (357)	477	688	565	560	548	542	519	490
RESEARCH DEVELOPMENT CELL(344)	414	564	491	456	427	491	470	421
ANALOG & DIGITAL LAB (253)	540	586	541	509	540	536	526	542
JC BOSE HALL (255)	700	658	605	583	652	745	895	821
COMMUNICATION SYSTEM LAB (261)	595	580	593	600	664	695	540	515
MICROWAVE LAB (264)	583	595	540	623	915	849	756	525

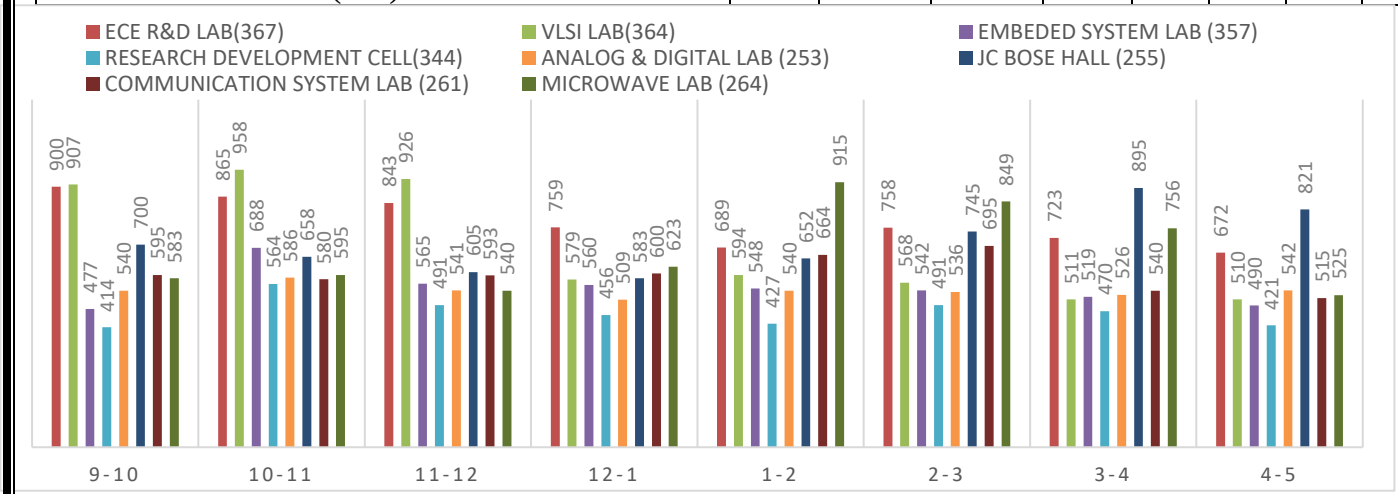

Fig40: CO2 in Laboratories of ECE Dept

Table41: Humidity in Class Rooms of ECE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (365) SECTION -1	71.3	70.0	70.3	70.3	71.3	71.6	71.6	69.1
SECOND YEAR (366) SECTION -2	69.9	68.8	70.1	70.1	70.6	66.8	66.9	66.8
THIRD YEAR (353(A)) SECTION -1	70.4	71.2	71.6	70.3	70.9	71	71.6	71.9
THIRD YEAR (353) SECTION -2	64.9	64.3	64.5	69.3	64.5	67.5	67.4	66.4
FINAL YEAR (341) SECTION -1	70.3	70.9	70.6	71.2	71.9	71.5	71.4	72.1
FINAL YEAR (341(A)) SECTION -2	70.1	66.1	66.9	64.2	65.3	65.5	67.8	67.2

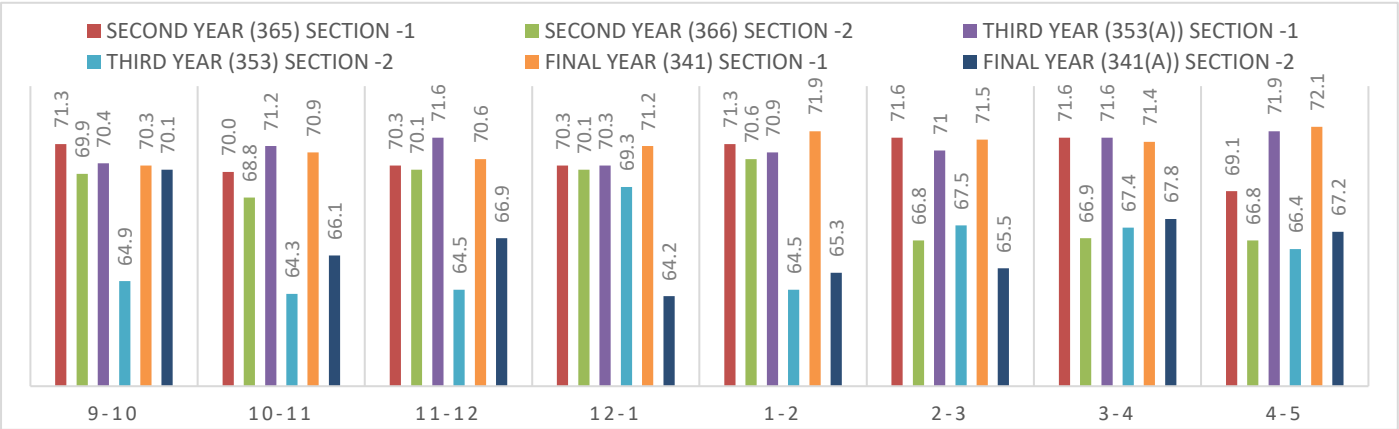

Fig41: Humidity in Class Rooms of ECE Dept

Table42: Humidity in Staff Rooms of ECE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(370)	58.9	58.9	64.2	62.3	65.1	65.3	63.5	63.1
ECE OFFICE (368)	76.1	76.7	64.8	64.9	72.3	72.6	74.1	73.6
LIBRARY(361)	67.1	60.3	60.9	62.6	62.8	64.5	64.3	62.3
STAFF ROOM -1 (358)	68.5	68.2	73.3	73.6	55.2	55.3	62.3	62.1
STAFF ROOM -2(340)	62.2	63.3	63.8	52.7	52.3	52.4	57.4	57.2
STAFF ROOM -3(254)	60.9	60.2	56.6	56.3	63.9	63.4	71.2	71.3
STAFF ROOM -4 (256)	53.8	51.6	54.7	54.9	65.8	65.3	62.5	61.3
E-CLASS ROOM (244(A))	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
STAFF ROOM -5(363)	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
ECE HOD (369)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
STAFF ROOM -6 (362)	67.4	67.3	68.2	66.5	66.2	68.2	68.2	68.3

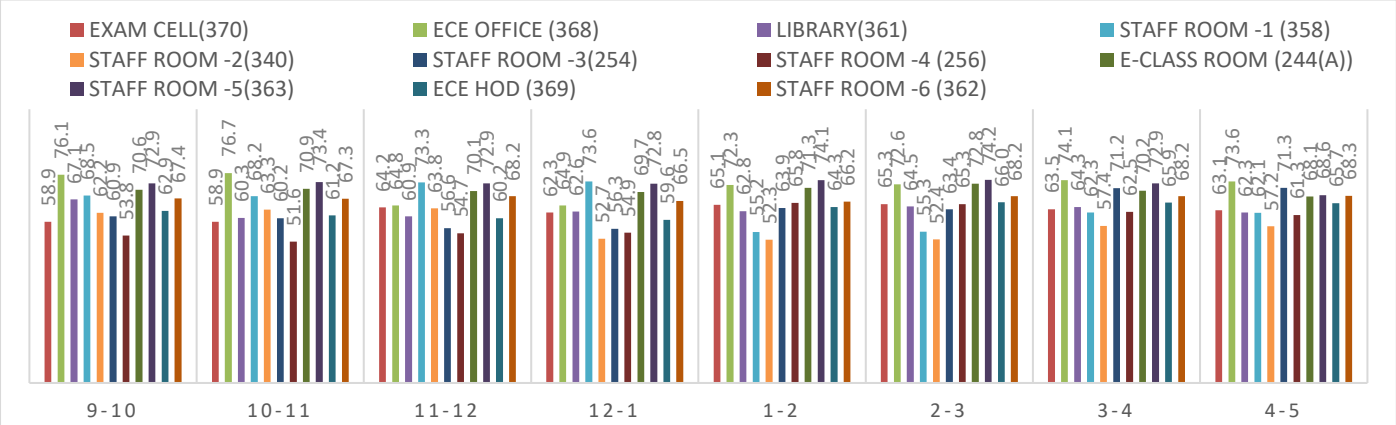

Fig42: Humidity in Staff Rooms of ECE Dept

Table43: Humidity in Laboratories of ECE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE R&D LAB(367)	70.1	71.3	71.6	71.9	70.4	70.1	71.2	71.1
VLSI LAB(364)	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
EMBEDED SYSTEM LAB (357)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
RESEARCH DEVELOPMENT CELL(344)	71.1	71.5	73.8	74.2	74.3	74.5	74.2	74.6
ANALOG & DIGITAL LAB (253)	70.2	70.5	68.9	71.9	75.9	76.7	74.3	71.7
JC BOSE HALL (255)	71.3	71.5	71.1	69.3	71.9	72.8	70.9	68.4
COMMUNICATION SYSTEM LAB (261)	72.1	72.3	71.4	71.1	73.6	75.5	74.9	72.1
MICROWAVE LAB (264)	71.9	71.4	69.9	69.6	72.1	72.6	70.9	70.9

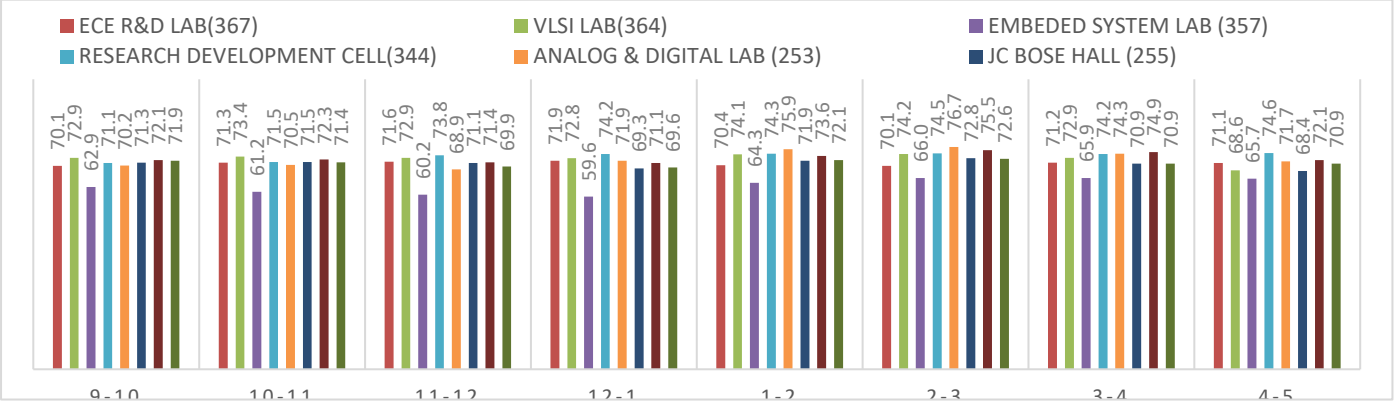

Fig43: Humidity in Laboratories of ECE Dept

Table44: Temperature in Class Rooms of ECE Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (365) SECTION -1	30.2	30.6	30.4	30.9	31	31.6	31.2	31.2
SECOND YEAR (366) SECTION -2	30.6	30.2	30.4	30.4	30.5	30.6	31.6	31.2
THIRD YEAR (353(A)) SECTION -1	31.2	31.6	31.8	31.7	30.9	30.6	31.3	31
THIRD YEAR (353) SECTION -2	30.4	30.5	30.6	31.6	31.2	30.1	31.2	31.5
FINAL YEAR (341) SECTION -1	32.1	32.6	31.2	31.2	30.9	30.9	31.1	31
FINAL YEAR (341(A)) SECTION -2	31.2	31.2	30.2	30.6	31.2	30.5	30.9	30.4

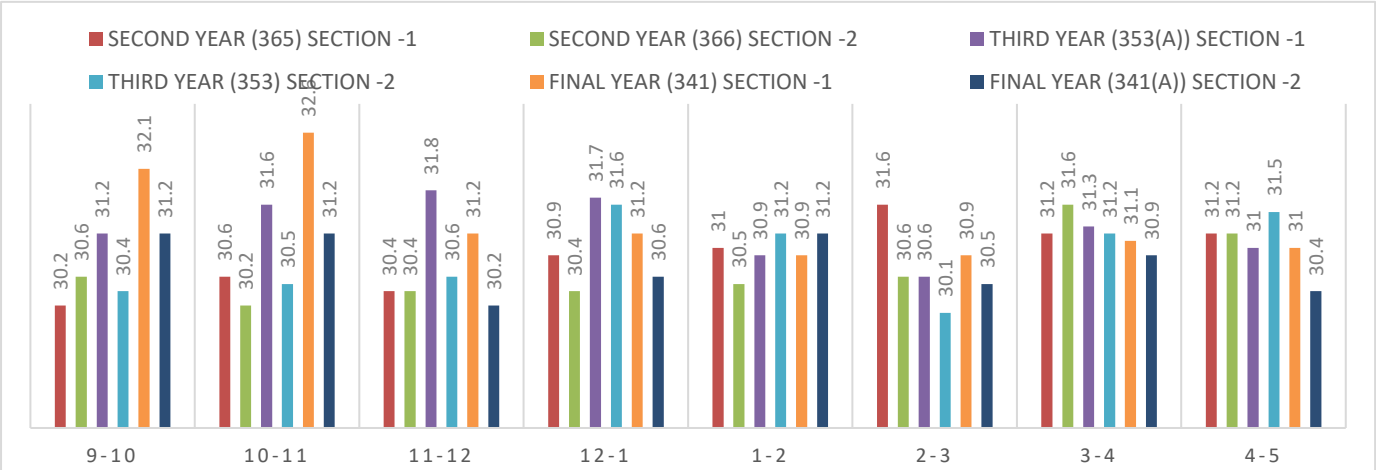

Fig44: Temperature in Class Rooms of ECE Dept

Table45: Temperature in Staff Rooms of ECE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(370)	31.2	31.6	31.5	31.8	31.4	30.1	30.7	30.9
ECE OFFICE (368)	30.2	31.5	30.6	31.2	31.6	31.4	31.2	30.6
LIBRARY(361)	30.2	30.5	31.2	30.6	30.2	30.1	30.7	32.6
STAFF ROOM -1 (358)	30.2	30.6	30.4	30.9	31	31.6	31.2	31.2
STAFF ROOM -2(340)	30.6	30.2	30.4	30.4	30.5	30.6	31.6	31.2
STAFF ROOM -3(254)	30.2	31.2	31.8	31.5	31.9	31.6	31.2	30.2
STAFF ROOM -4 (256)	30.2	30.6	30.1	30.2	31.5	31	31.6	31.4
E-CLASS ROOM (244(A))	30.2	31.6	30.5	30.6	31	31.5	31.2	31.2
STAFF ROOM -5(363)	31.2	30.6	30.6	31.6	30.5	30.2	30.5	30.2
ECE HOD (369)	31.2	31.5	31.7	31	30.2	31.2	31.4	31.8
STAFF ROOM -6 (362)	30.2	31.5	31.5	31.6	31.5	31.9	31.7	31.8

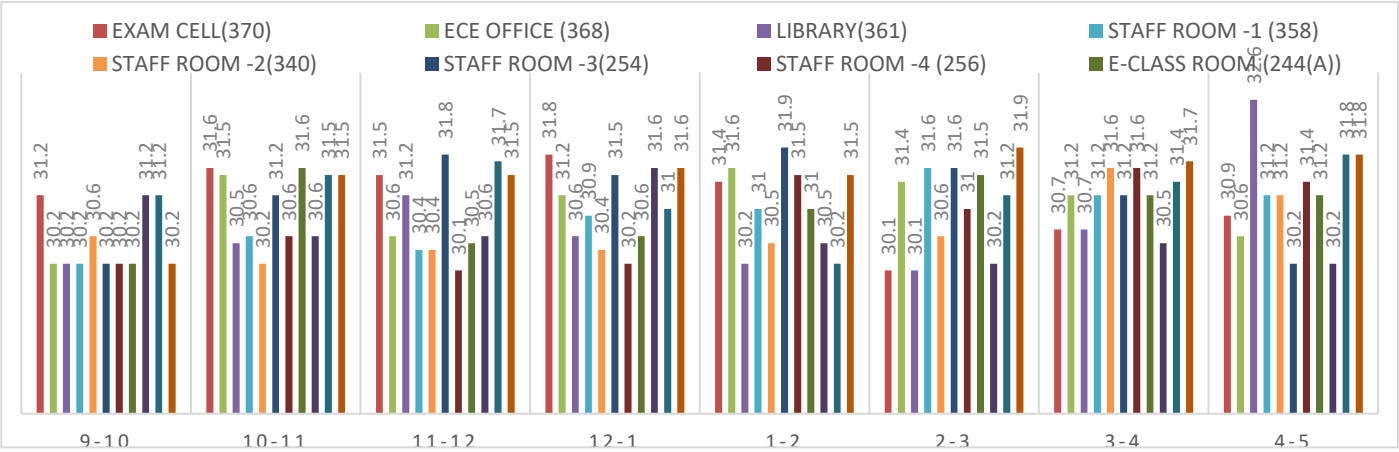

Fig45: Temperature in Staff Rooms of ECE Dept

Table46: Temperature in Laboratories of ECE Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE R&D LAB(367)	31.1	31.1	30.3	31.1	31.2	31.3	30.9	30.7
VLSI LAB(364)	30.7	30.8	30.9	30.5	30.7	30.6	30.1	30.2
EMBEDED SYSTEM LAB (357)	30.8	30.9	30.4	30.5	30.9	30.4	30.7	30.4
RESEARCH DEVELOPMENT CELL(344)	31.2	31.4	32.1	32.0	31.1	30.9	31.0	31.0
ANALOG & DIGITAL LAB (253)	31.3	31.1	32.2	32.1	31.6	31.0	31.1	31.2
JC BOSE HALL (255)	31.2	31.3	31.4	31.1	30.9	31.3	30.9	30.7
COMMUNICATION SYSTEM LAB (261)	31.2	31.3	31.4	31.1	30.9	31.3	30.9	30.7
MICROWAVE LAB (264)	30.2	30.2	31.2	31.6	31.9	31.9	31.2	31.2

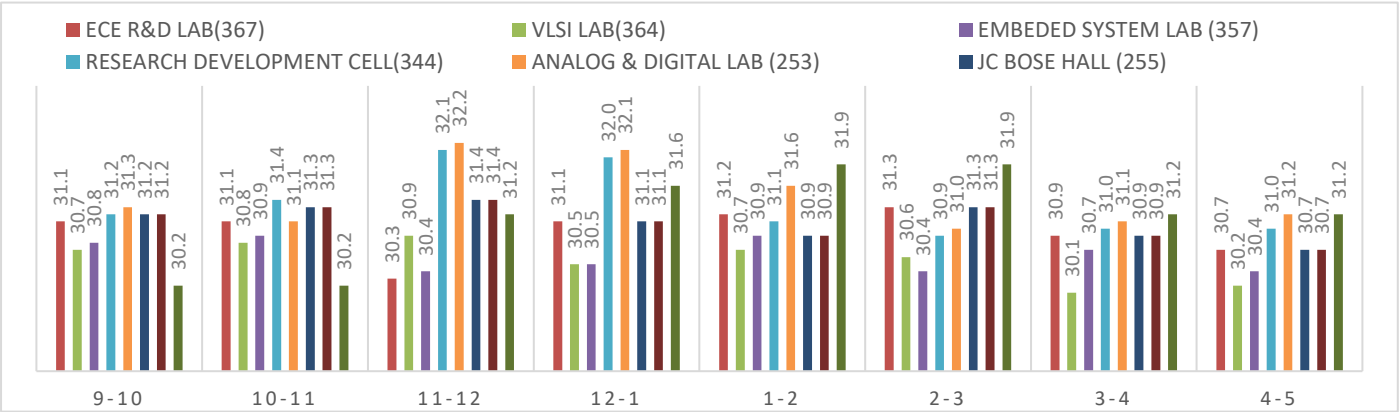

Fig46: Temperature in Laboratories of ECE Dept

ELECTRICAL AND ELECTRONICS ENGINEERING

Table47: CO2 in Class Rooms of EEE Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (242) SECTION -1	397	405	420	443	469	490	515	522
SECOND YEAR (242(A)) SECTION -2	592	565	518	529	552	530	505	489
THIRD YEAR (262) SECTION -1	425	488	458	470	468	482	421	393
THIRD YEAR (263) SECTION -2	430	450	440	413	440	449	445	438
FINAL YEAR (252) SECTION -1	463	479	498	489	480	593	515	493
FINAL YEAR (269) SECTION -2	471	519	502	438	435	490	445	408

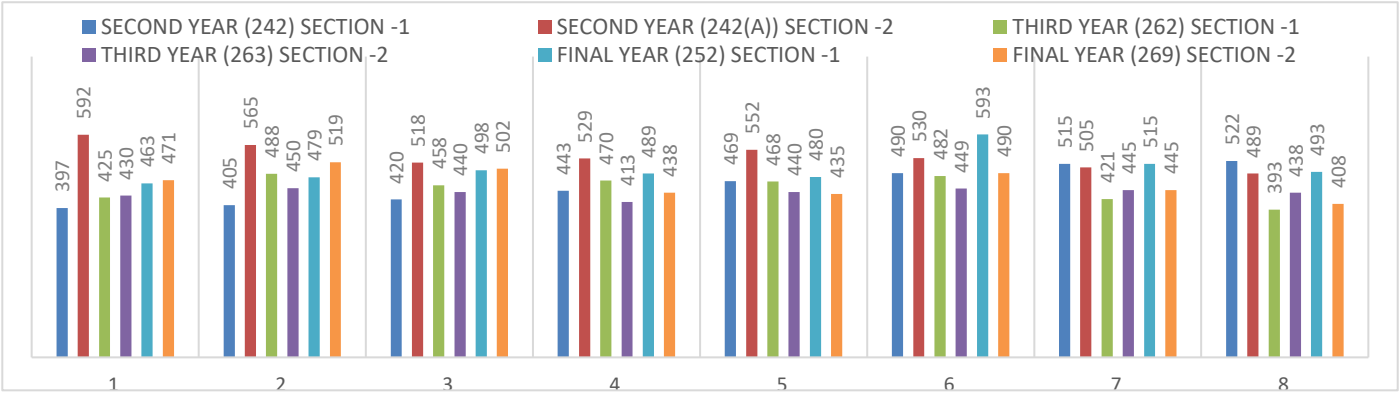

Fig47: CO2 in Class Rooms of EEE Dept

Table48: CO2 in Laboratories of EEE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
NETWORKS LAB (140)	397	446	458	470	468	482	421	415
ELECTROMECHANICS LAB (139)	415	449	465	475	495	503	505	500
ELECTRICAL MEASUREMENTS LAB (133)	425	524	515	505	521	513	426	367
SIMULATION OF ELECTRICAL SYSTEMS LAB (247)	430	450	490	546	569	592	610	600
CONTROL SYSTEMS LAB (243)	400	409	414	418	435	450	500	483
CONTROL SYSTEMS LAB ROOM (243(A))	400	415	418	418	435	450	445	447
POWER ELECTRONICS LAB (241)	469	510	594	623	643	590	523	426

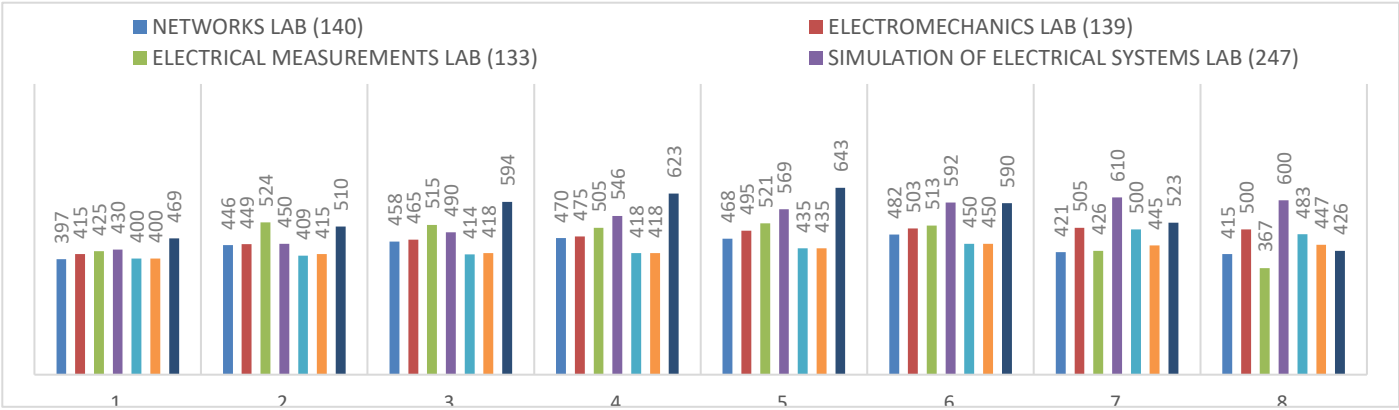

Fig48: CO2 in Laboratories of EEE Dept

Table49: CO2 in Staff Rooms of EEE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE OFFICE (132)	443	471	480	493	509	520	505	498
LIBRARY(245)	540	594	541	467	485	493	526	570
STAFF ROOM -1 (268)	438	459	447	423	440	449	409	393
STAFF ROOM -2(260)	392	430	439	445	475	490	465	450
STAFF ROOM -3(259)	401	419	476	493	485	480	523	500
STAFF ROOM -4 (244)	449	460	469	477	480	482	459	449
STAFF ROOM -5(239)	393	402	409	420	415	410	419	418
ECE HOD (131)	515	577	585	590	590	591	585	573
STAFF ROOM -6 (251)	502	523	481	450	504	490	483	489

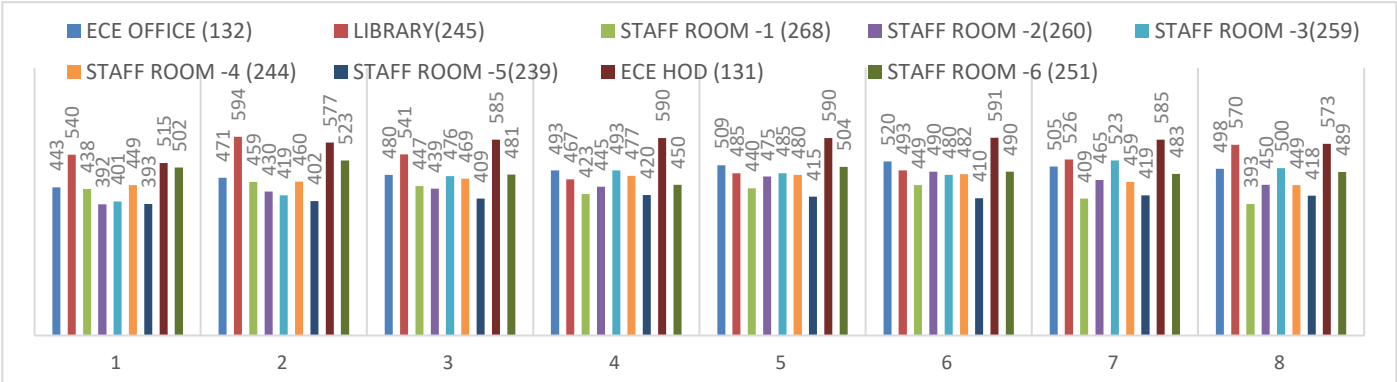

Fig49: CO2 in Staff Rooms of EEE Dept

Table50: Temperature in Class Rooms of EEE Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (242) SECTION -1	31.5	31.7	31.5	31.4	32	31.9	31.8	31.7
SECOND YEAR (242(A)) SECTION -2	31.6	31.7	31.5	31.7	31.5	31.4	31.5	31.6
THIRD YEAR (262) SECTION -1	31.1	31.2	31.1	31.6	31.5	31.9	31.7	31.2
THIRD YEAR (263) SECTION -2	31.1	31.3	31.4	31.5	31	31.2	31.5	31.8
FINAL YEAR (252) SECTION -1	31.5	31.9	31.5	31.4	31.7	31.9	32.1	32.3
FINAL YEAR (269) SECTION -2	31.1	31.2	31.4	31.5	31.1	31.2	31.5	31.8

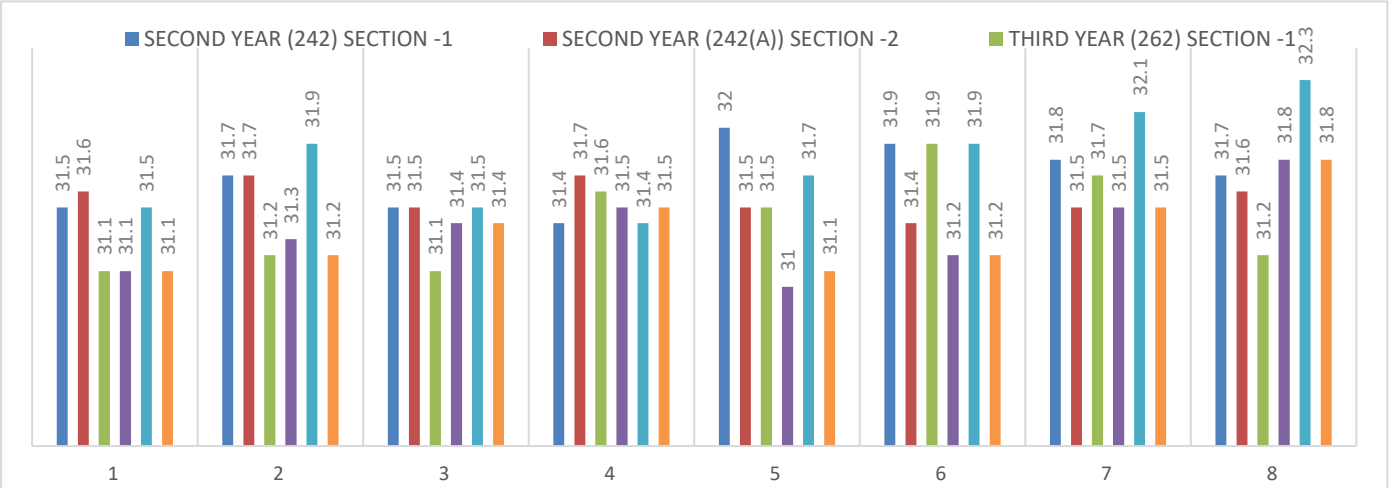

Fig50: Temperature in Class Rooms of EEE Dept

Table51: Temperature in Laboratories of EEE Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
NETWORKS LAB (140)	30.9	30.6	30.8	30.9	30.6	30.7	30.2	30.1
ELECTROMECHANICS LAB (139)	30.1	30.1	31.6	31.8	31.7	31.6	31.5	31.3
ELECTRICAL MEASUREMENTS LAB (133)	31.6	31.7	31.5	31.7	31.5	31.2	30.9	30.1
SIMULATION OF ELECTRICAL SYSTEMS LAB (247)	31	31.2	31.6	31.6	31.7	31.8	31.9	32
CONTROL SYSTEMS LAB (243)	31.1	31.2	31.1	31.6	31.8	31.7	31.9	31.7
CONTROL SYSTEMS LAB ROOM (243(A))	31.9	31.7	31.1	31.2	31.6	31.5	31.8	31.8
POWER ELECTRONICS LAB (241)	31.1	31.2	31.1	31.3	31.5	31.9	31.7	31.8

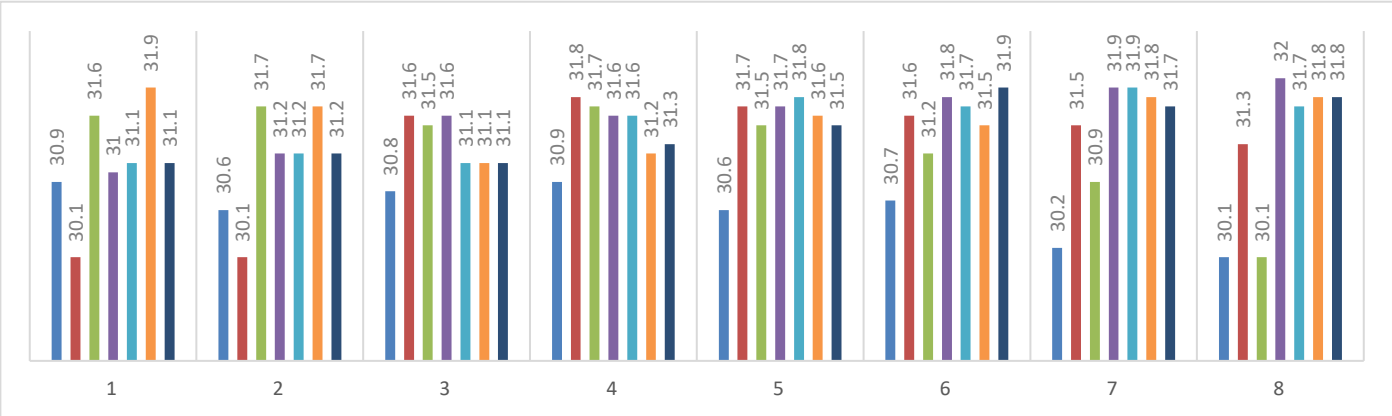

Fig51: Temperature in Laboratories of EEE Dept

Table52: Temperature in Staff Rooms of EEE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE OFFICE (132)	30.6	30.2	31.1	31	31.4	31.3	31.7	31.8
LIBRARY(245)	31.3	31.6	31.5	31.7	31.2	31.5	31.7	31.9
STAFF ROOM -1 (268)	31.1	31.1	31.3	31.5	31.2	31.6	31.2	31.2
STAFF ROOM -2(260)	31	31.2	31.3	31.5	31.7	31.9	31.5	31.6
STAFF ROOM -3(259)	31	31.1	31.3	31.2	31	31	32.3	32.8
STAFF ROOM -4 (244)	31.4	31.7	31.5	31.7	32	32.1	31.9	31.9
STAFF ROOM -5(239)	31.6	31.8	31.6	31.7	31.9	31.7	31.5	31.7
ECE HOD (131)	30.9	30.3	31.2	31.2	31	31.2	31.1	31.3
STAFF ROOM -6 (251)	31.5	31.8	31.4	31.4	31.6	31.5	31.4	31.2

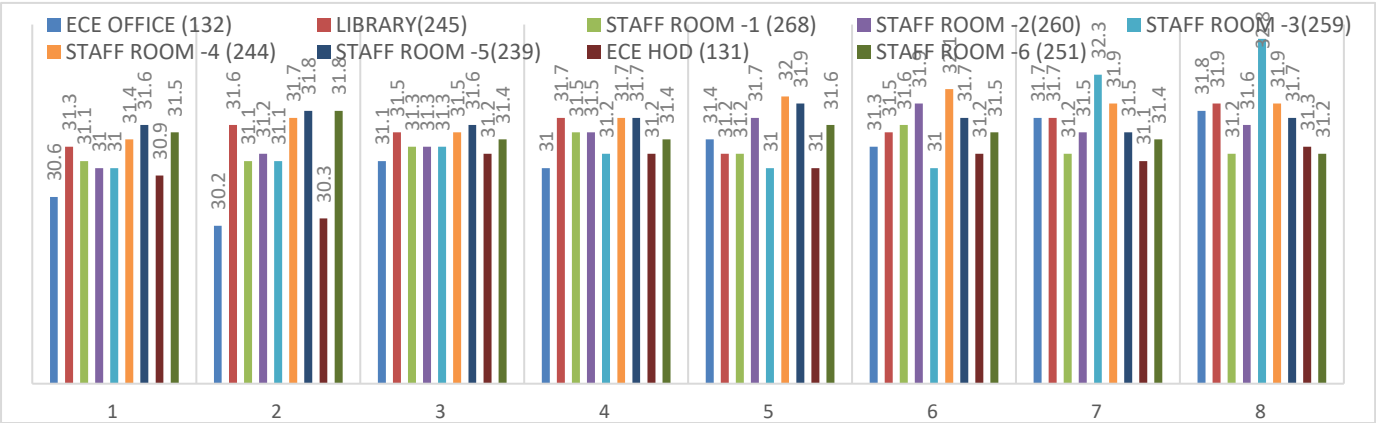

Fig52: Temperature in Staff Rooms of EEE Dept

Table53 : Humidity in Class Rooms of EEE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (242) SECTION -1	64.9	64.3	64.5	69.3	64.5	67.5	67.4	66.4
SECOND YEAR (242(A)) SECTION -2	69.9	68.8	70.1	70.1	70.6	66.8	66.9	66.8
THIRD YEAR (262) SECTION -1	67.1	60.3	60.9	62.6	62.8	64.5	64.3	62.3
THIRD YEAR (263) SECTION -2	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
FINAL YEAR (252) SECTION -1	67.4	67.3	68.2	66.5	66.2	68.2	68.2	68.3
FINAL YEAR (269) SECTION -2	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7

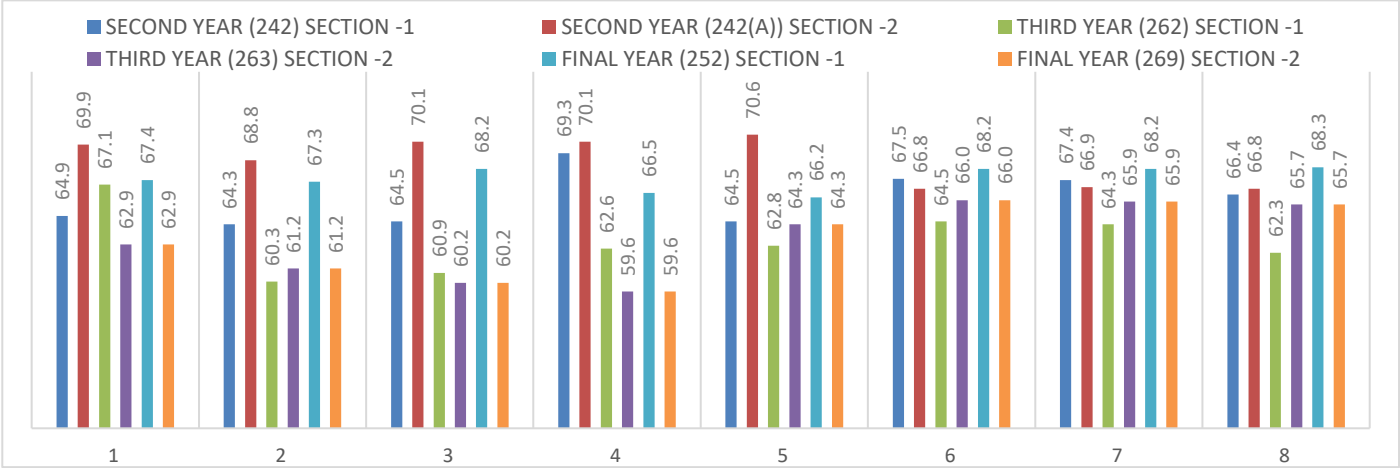

Fig53: Humidity in Class Rooms of EEE Dept

Table54: Humidity in Laboratories of EEE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
NETWORKS LAB (140)	71.6	71.8	70.6	70.9	70.1	69.7	71.3	71.9
ELECTROMECHANICS LAB (139)	64.9	69.6	64.5	67.3	67.3	68.2	69.1	69.3
ELECTRICAL MEASUREMENTS LAB (133)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
SIMULATION OF ELECTRICAL SYSTEMS LAB (247)	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
CONTROL SYSTEMS LAB (243)	71.3	70.0	70.3	70.3	71.3	71.6	71.6	69.1
CONTROL SYSTEMS LAB ROOM (243(A))	76.1	76.7	64.8	64.9	72.3	72.6	74.1	73.6
POWER ELECTRONICS LAB (241)	70.2	70.5	68.9	71.9	75.9	76.7	74.3	71.7

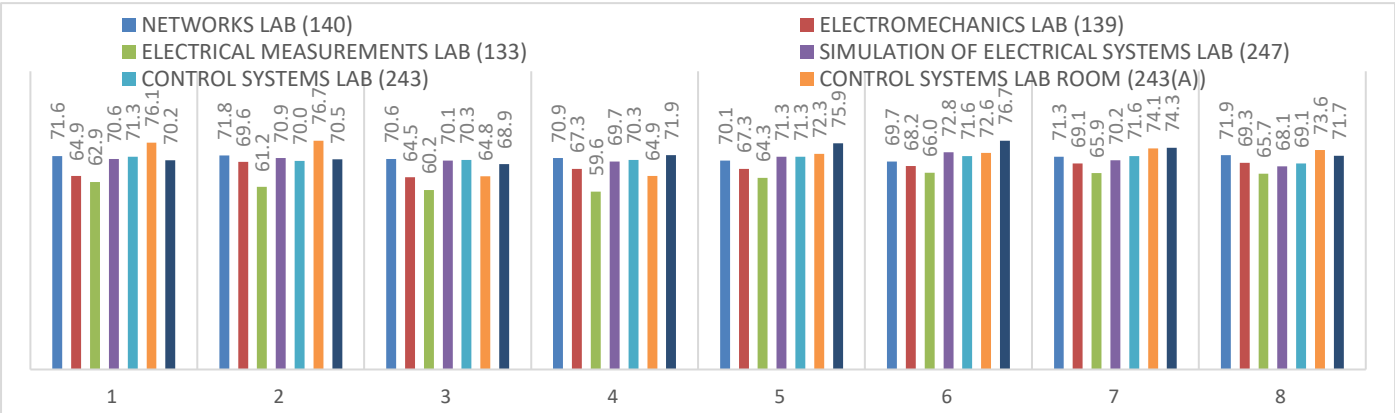

Fig54: Humidity in Laboratories of EEE Dept

Table55: Humidity in Staff Rooms of EEE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EEE OFFICE (132)	67.1	60.3	60.9	62.6	62.8	64.5	64.3	62.3
LIBRARY(245)	68.5	68.2	73.3	73.6	55.2	55.3	62.3	62.1
STAFF ROOM -1 (268)	62.2	63.3	63.8	52.7	52.3	52.4	57.4	57.2
STAFF ROOM -2(260)	60.9	60.2	56.6	56.3	63.9	63.4	71.2	71.3
STAFF ROOM -3(259)	66.9	67.5	67.9	67.3	66.9	66.1	65.3	65.8
STAFF ROOM -4 (244)	67.2	67.2	66.9	66.3	67.2	67.8	66.7	66.3
STAFF ROOM -5(239)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
EEE HOD (131)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
STAFF ROOM -6 (251)	70.2	70.5	68.9	71.9	75.9	76.7	74.3	71.7

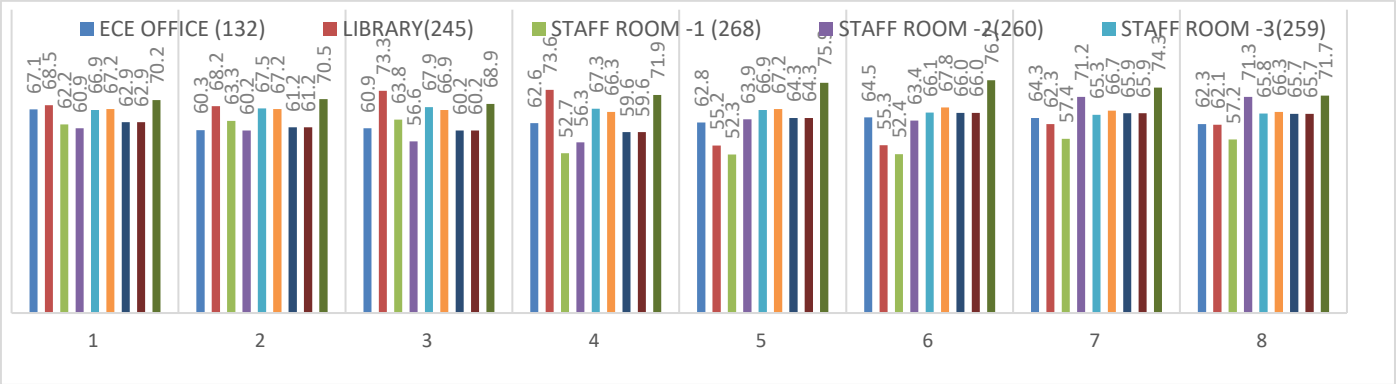

Fig55: Humidity in Staff Rooms of EEE Dept

FRESHMAN ENGINEERING

Table56: CO2 in Class Rooms of FED Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
IT FIRST YEAR (426) SECTION - 1	440	449	455	457	467	450	449	422
IT FIRST YEAR (427) SECTION - 2	475	489	510	580	540	535	523	520
CIVIL FIRST YEAR (422) SECTION -1	483	486	480	471	466	460	449	408
COMPUTER SCIENCE AND DATA SCIENCES (420)	569	598	614	589	582	540	503	482
COMPUTER SCIENCE AND MACHINE LEARNING (419)	1001	909	844	730	655	542	540	530
CSE FIRST YEAR (417) SECTION - 3	537	533	610	677	710	783	719	666
CSE FIRST YEAR (411) SECTION - 2	471	483	502	601	668	566	515	471
CSE FIRST YEAR (410) SECTION - 1	441	490	468	448	436	431	428	408
MECH FIRST YEAR (408)	478	491	540	567	590	566	453	404
EEE FIRST YEAR (407)	433	480	513	529	561	540	529	508
ECE FIRST YEAR (436) SECTION - 1	490	513	525	513	522	505	500	491
ECE FIRST YEAR (437) SECTION - 2	446	466	480	492	461	453	449	420

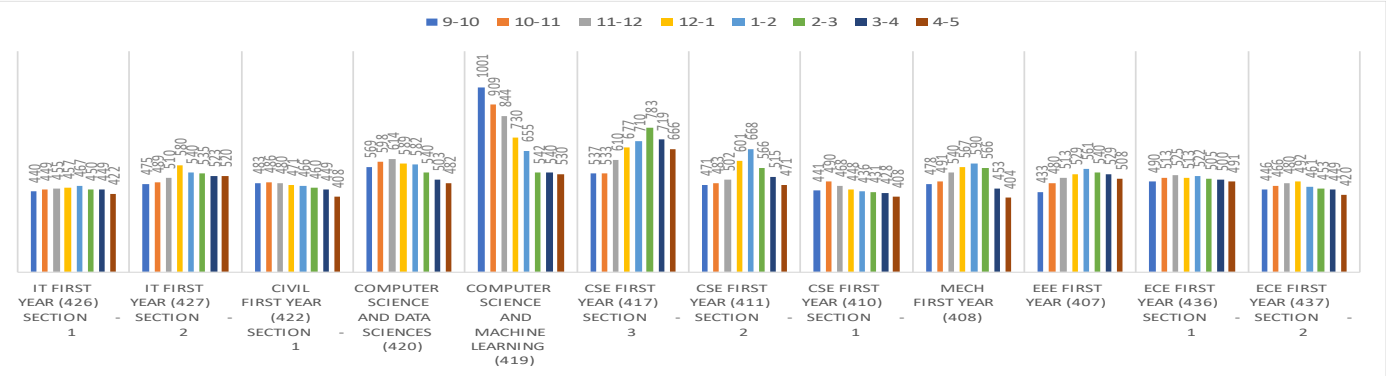

Fig56: CO2 in Class Rooms of FED Dept

Table57: CO2 in Staff Rooms of FED Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
FED OFFICE (418)	514	536	549	556	566	577	549	515
FED HOD ROOM (418(A))	600	648	633	621	619	577	569	540
STAFF ROOM - 1 (416)	425	445	476	500	509	486	465	423
EXAM CELL (413)	409	414	436	444	467	435	421	409
STAFF ROOM - 2 (409)	425	435	436	471	422	420	410	400
STAFF ROOM - 3 (433)	434	443	449	470	480	439	420	401
STAFF ROOM - 4 (434)	450	460	430	470	477	480	439	430
STAFF ROOM - 5 (439)	405	419	427	449	475	480	449	415
STAFF ROOM - 6 (446)	425	462	480	499	510	487	475	455
STAFF ROOM - 7 (415)	505	524	529	550	519	498	477	449
STAFFROOM - 8 (428(A))	411	421	428	433	435	440	429	420

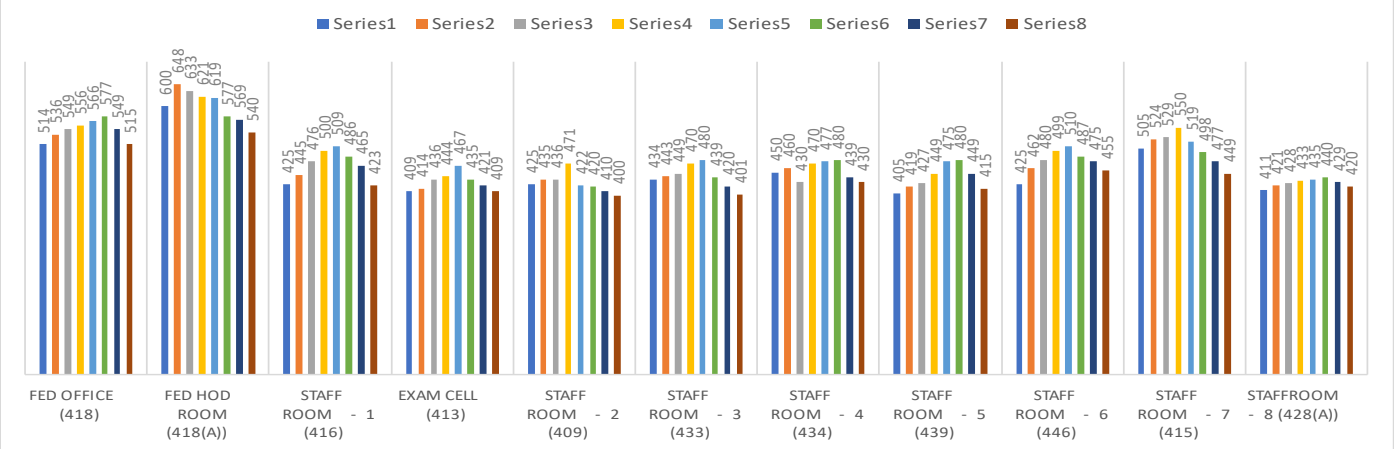

Fig57: CO2 in Staff Rooms of FED Dept

Table58: CO2 in Laboratories of FED Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
DRAWING HALL - 1 (428)	460	465	477	489	476	471	456	444
CHEMISTRY LAB (425)	401	409	411	423	420	418	411	408
PHYSICS LAB (424)	415	430	455	470	493	465	450	410
PROBLEM SOLVING AND PROGRAMMING LAB (414)	463	468	475	480	485	458	449	420
LIFE SCIENCES LAB (438)	459	460	477	482	500	491	470	459
DESIGN THINKING AND PRODUCT INNOVATION LAB (459)	410	428	470	490	506	475	455	429
ENGISH LAB (462)	1628	1744	1890	1955	1985	1537	1399	1298
DRAWING HALL - 2 (422)	448	481	475	470	491	462	447	440

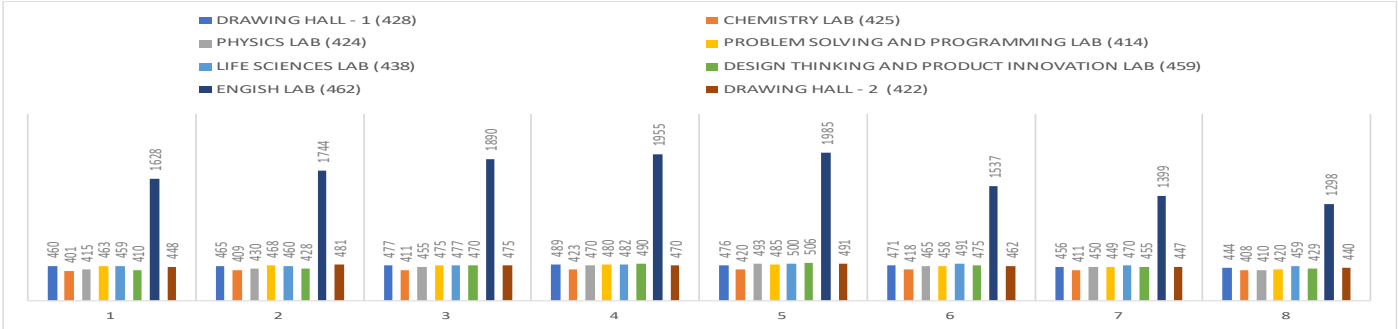

Fig58: CO2 in Laboratories of FED Dept

Table59: Humidity in Class Rooms of FED Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
IT FIRST YEAR (426) SECTION - 1	69.9	69.3	69.3	69.5	71.0	71.1	73.2	74.8
IT FIRST YEAR (427) SECTION - 2	73.9	74.4	74.6	71.8	65.4	71.2	71.1	71.5
CIVIL FIRST YEAR (422) SECTION -1	73.9	72.1	72.6	71.9	71.3	71.1	70.6	68.9
COMPUTER SCIENCE AND DATA SCIENCES (420)	74.0	73.5	73.8	71.2	69.9	69.5	71.0	72.1
COMPUTER SCIENCE AND MACHINE LEARNING (419)	75.2	75.1	74.6	74.4	72.1	71.5	70.9	69.4
CSE FIRST YEAR (417) SECTION - 3	73.9	73.5	72.6	71.5	68.6	69.9	69.1	68.5
CSE FIRST YEAR (411) SECTION - 2	71.3	71.1	71.9	72.1	72.0	72.1	72.1	72.0
CSE FIRST YEAR (410) SECTION - 1	71.3	70.9	70.5	70.2	69.8	64.8	71.2	71.1
MECH FIRST YEAR (408)	68.2	67.1	66.3	66.1	65.9	65.4	71.1	71.2
EEE FIRST YEAR (407)	71.6	71.1	70.9	69.4	68.1	67.3	66.0	69.1
ECE FIRST YEAR (436) SECTION - 1	71.3	71.1	70.6	70.5	70.2	69.8	66.2	71.2
ECE FIRST YEAR (437) SECTION - 2	69.7	69.1	69.1	69.8	69.9	68.4	68.1	68.7

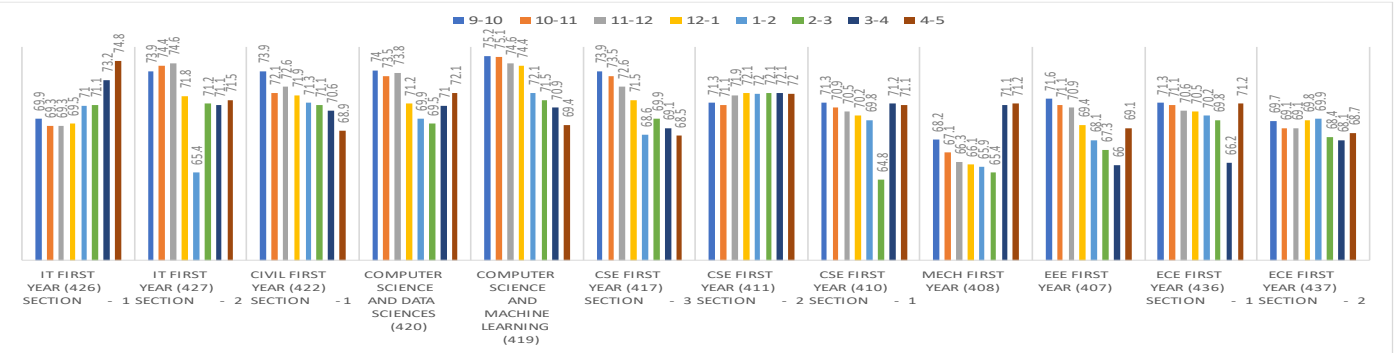

Fig59: Humidity in Class Rooms of FED Dept

Table60: Humidity in Staff Rooms of FED Dept

TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
FED OFFICE (418)	72.7	72.1	71.8	71.1	70.6	70.6	70.7	70.5
FED HOD ROOM (418(A))	71.2	70.9	70.9	70.5	70.3	70.1	70.2	70.0
STAFF ROOM - 1 (416)	71.4	71.5	71.9	72.1	72.0	72.1	71.6	71.2
EXAM CELL (413)	70.3	70.6	70.7	71.2	71.6	71.7	71.9	70.2
STAFF ROOM - 2 (409)	69.7	69.8	69.1	69.8	69.4	69.5	69.5	69.4
STAFF ROOM - 3 (433)	71.0	71.6	71.9	72.1	72.1	72.3	72.1	70.1
STAFF ROOM - 4 (434)	69.6	69.1	68.8	67.6	67.1	66.2	69.7	68.2
STAFF ROOM - 5 (439)	70.3	70.6	70.7	71.2	71.6	71.7	71.9	70.2
STAFF ROOM - 6 (446)	69.7	69.9	69.9	70.2	70.6	71.2	71.4	71.4
STAFF ROOM - 7 (415)	70.1	70.2	70.2	70.9	70.8	71.2	69.4	69.8
STAFF ROOM - 8 (428(A))	73.3	73.5	73.9	74.1	74.4	71.6	65.2	72.4

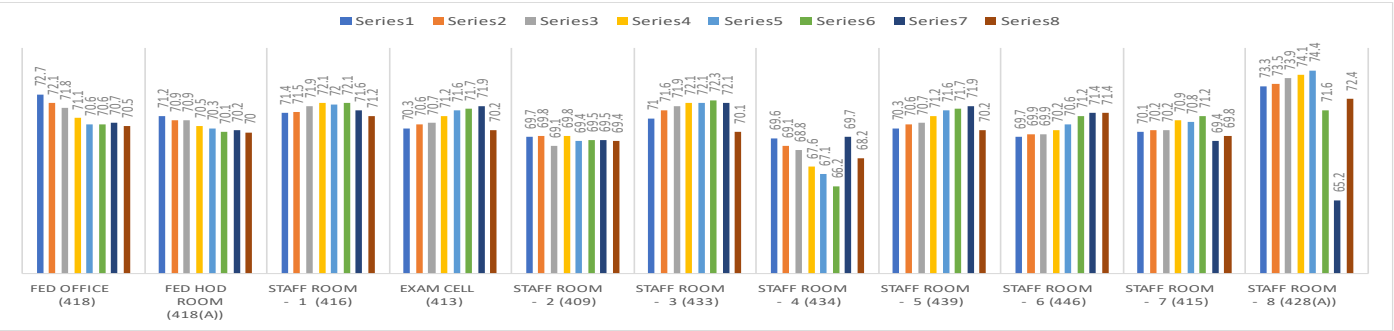

Fig60: Humidity in Staff Rooms of FED Dept

Table61: Humidity in Laboratories of FED Dept

TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
DRAWING HALL - 1 (428)	73.1	73.4	73.2	73.6	74.1	74.2	74.1	74.7
CHEMISTRY LAB (425)	70.3	70.6	70.7	71.2	71.6	71.7	71.9	70.2
PHYSICS LAB (424)	74.5	74.1	73.9	73.5	73.4	72.9	63.5	66.6
PROBLEM SOLVING AND PROGRAMMING LAB (414)	71.4	71.9	71.9	71.3	71.4	71.8	71.8	71.2
LIFE SCIENCES LAB (438)	71.2	70.9	70.9	70.5	70.3	70.1	70.2	70.0
DESIGN THINKING AND PRODUCT INNOVATION LAB (459)	71.3	70.9	70.5	70.2	69.8	64.8	71.2	71.1
ENGISH LAB (462)	56.8	56.9	57.1	57.6	51.1	52.3	52.6	52.9
DRAWING HALL - 2 (422)	68.1	68.3	68.2	68.2	67.9	67.7	68.1	68.9

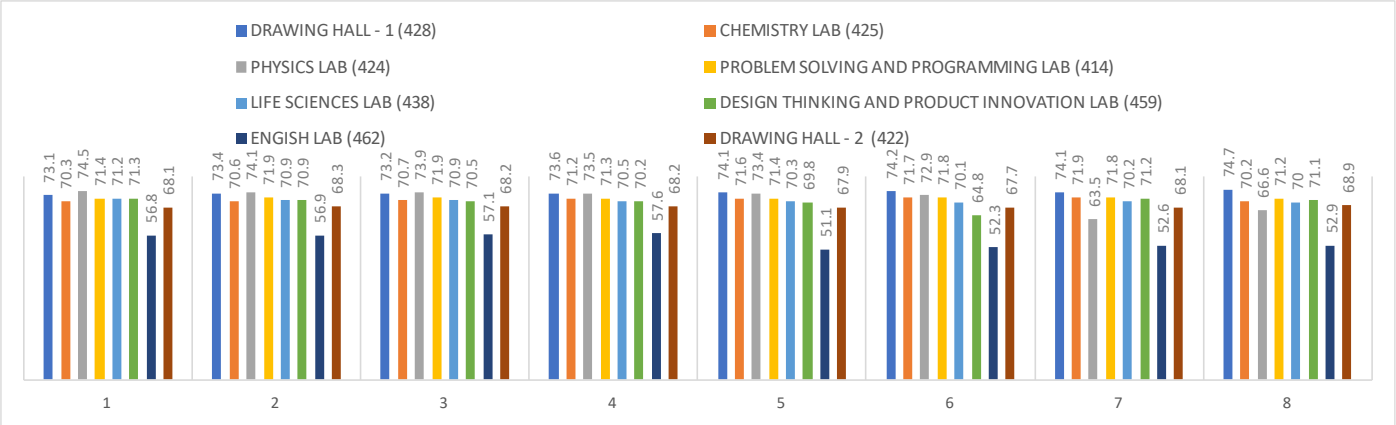

Fig61: Humidity in Laboratories of FED Dept

Table62: Temperature in Class Rooms of FED Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
IT FIRST YEAR (426) SECTION - 1	30.6	30.5	29.8	30.3	30.3	30.2	30.1	30.5
IT FIRST YEAR (427) SECTION - 2	29.7	29.8	28.7	30.1	30.2	30.2	30.9	31.2
CIVIL FIRST YEAR (422) SECTION -1	30.9	30.9	30.7	30.6	30.8	30.8	30.1	30.6
COMPUTER SCIENCE AND DATA SCIENCES (420)	31.4	31.6	31.5	32.0	30.9	30.7	31.0	31.1
COMPUTER SCIENCE AND MACHINE LEARNING (419)	31.7	31.6	31.6	31.9	32.5	32.4	32.1	32.0
CSE FIRST YEAR (417) SECTION - 3	28.6	29.1	29.5	29.8	30.7	30.7	30.1	30.5
CSE FIRST YEAR (411) SECTION - 2	31.5	31.6	31.9	32.1	32.1	31.7	31.5	31.9
CSE FIRST YEAR (410) SECTION - 1	30.3	30.5	30.4	31.9	30.5	30.5	30.9	30.5
MECH FIRST YEAR (408)	30.9	30.6	30.5	30.4	30.4	30.4	30.1	30.2
EEE FIRST YEAR (407)	31.2	31.2	31.5	31.4	31.0	30.9	30.7	30.6
ECE FIRST YEAR (436) SECTION - 1	29.6	30.1	30.2	30.6	30.9	31.1	31.1	31.4
ECE FIRST YEAR (437) SECTION - 2	29.2	29.1	29.5	29.6	29.8	30.0	30.1	30.1

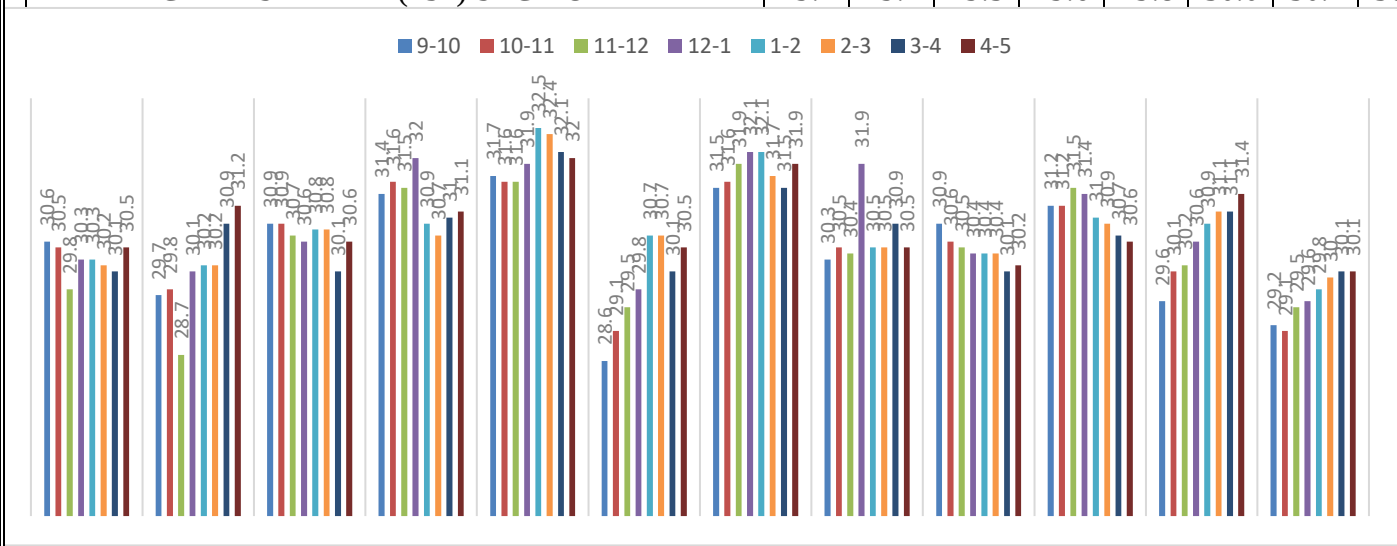

Fig62: Temperature in Class Rooms of FE Dept

Table63: Temperature in Staff Rooms of FE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
FED OFFICE (418)	29.3	29.1	28.3	28.1	28.2	28.6	29.4	29.1
FED HOD ROOM (418(A))	31.2	31.2	31.1	31.5	31.4	30.7	30.9	30.7
STAFF ROOM - 1 (416)	31.2	31.3	31.5	30.7	30.7	30.8	30.8	30.9
EXAM CELL (413)	31.3	31.5	31.9	32.1	32.1	32.3	31.2	31.1
STAFF ROOM - 2 (409)	29.2	29.9	30.5	30.5	30.6	31.2	31.6	30.3
STAFF ROOM - 3 (433)	31.3	31.3	31.4	31.5	31.1	30.9	30.1	30.1
STAFF ROOM - 4 (434)	30.0	30.4	30.4	31.1	31.2	30.6	31.1	30.8
STAFF ROOM - 5 (439)	32.0	30.4	30.6	31.2	29.3	30.9	30.4	30.2
STAFF ROOM - 6 (446)	30.5	31.0	31.2	31.2	30.6	30.7	30.9	31.0
STAFF ROOM - 7 (415)	31.9	30.9	30.1	30.5	30.5	30.5	30.8	31.0
STAFFROOM - 8 (428(A))	30.5	29.8	29.1	31.1	31.5	31.7	31.5	30.0

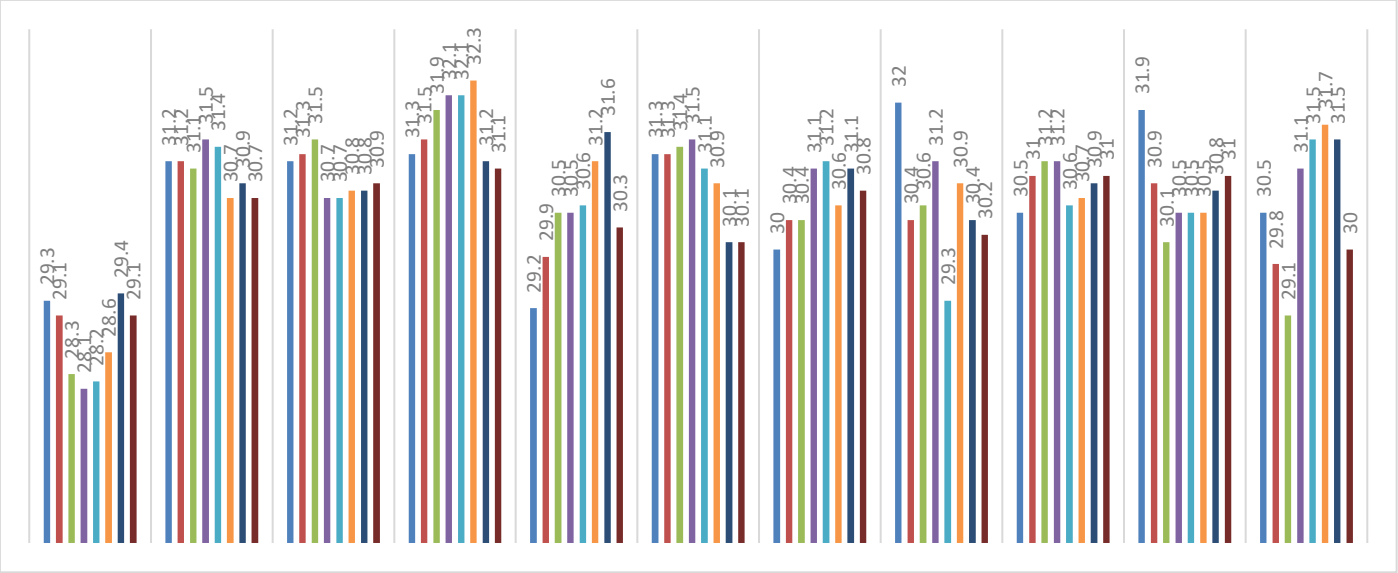

Fig63: Temperature in Staff Rooms of FE Dept

Table64: Temperature in Laboratories of FED Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
DRAWING HALL - 1 (428)	31.2	31.3	31.2	30.9	30.7	30.6	30.9	30.8
CHEMISTRY LAB (425)	31.8	31.2	30.7	30.5	30.5	30.1	30.1	30.2
PHYSICS LAB (424)	30.8	30.5	30.6	30.6	30.9	31.0	31.1	31.4
PROBLEM SOLVING AND PROGRAMMING LAB (414)	30.7	30.1	31.3	31.2	31.3	31.4	30.6	30.9
LIFE SCIENCES LAB (438)	30.1	30.1	30.2	30.6	30.9	31.2	31.1	30.2
DESIGN THINKING AND PRODUCT INNOVATION LAB (459)	30.2	30.2	30.3	30.5	30.7	31.2	30.9	31.0
ENGISH LAB (462)	30.2	30.1	30.2	30.1	30.5	30.5	31.2	31.0
DRAWING HALL - 2 (422)	31.5	31.6	31.6	31.8	31.7	31.1	30.5	30.0

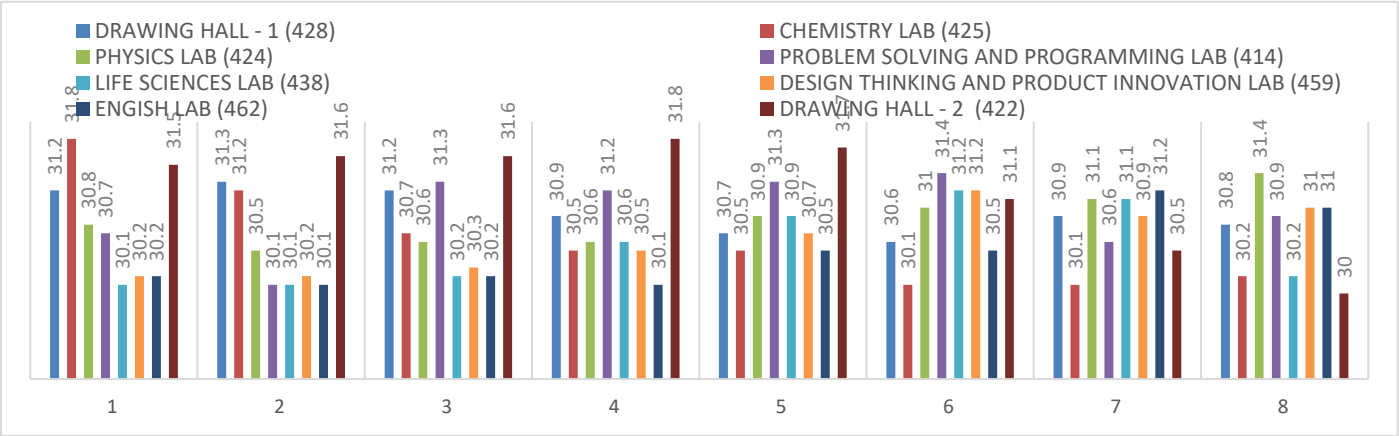

Fig64: Temperature in Laboratories of FE Dept

MASTER OF BUSINESS ADMINISTRATION

Table65: CO2 in Class Rooms of MBA Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA FIRST YEAR (460)	453	469	481	493	465	440	432	411
MBA SECOND YEAR (466)	459	460	477	481	496	485	477	433
MBA HR (461)	486	483	479	461	455	449	440	423

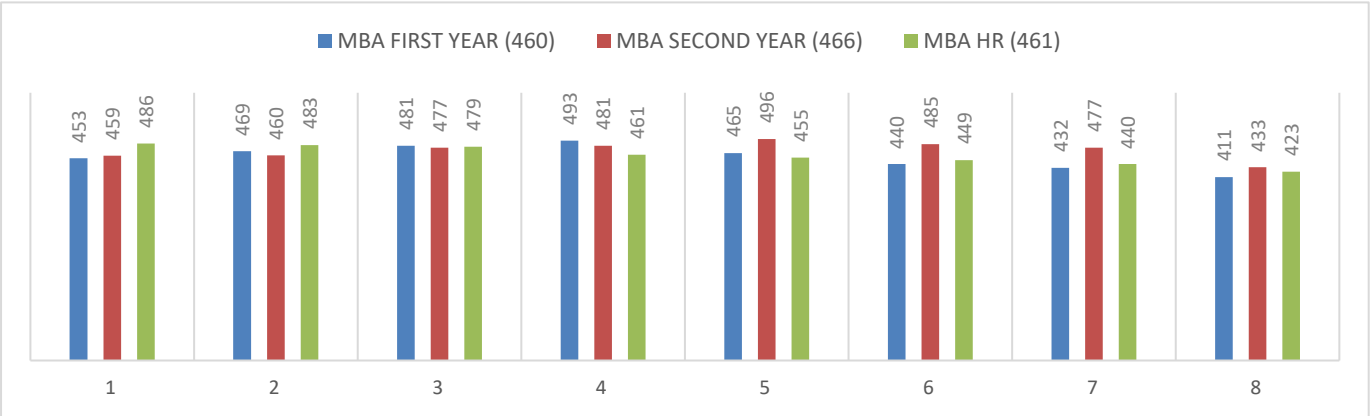

Fig65: CO2 in Class Rooms of MBA Dept

Table66: CO2 in Staff Rooms of MBA Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA HOD ROOM (464)	690	655	630	607	601	593	588	572
MBA OFFICE (463)	545	533	528	520	518	511	506	500
STAFF ROOM - 1 (451)	560	555	566	573	581	531	521	500
STAFF ROOM - 2 (453)	582	540	555	541	562	542	520	501

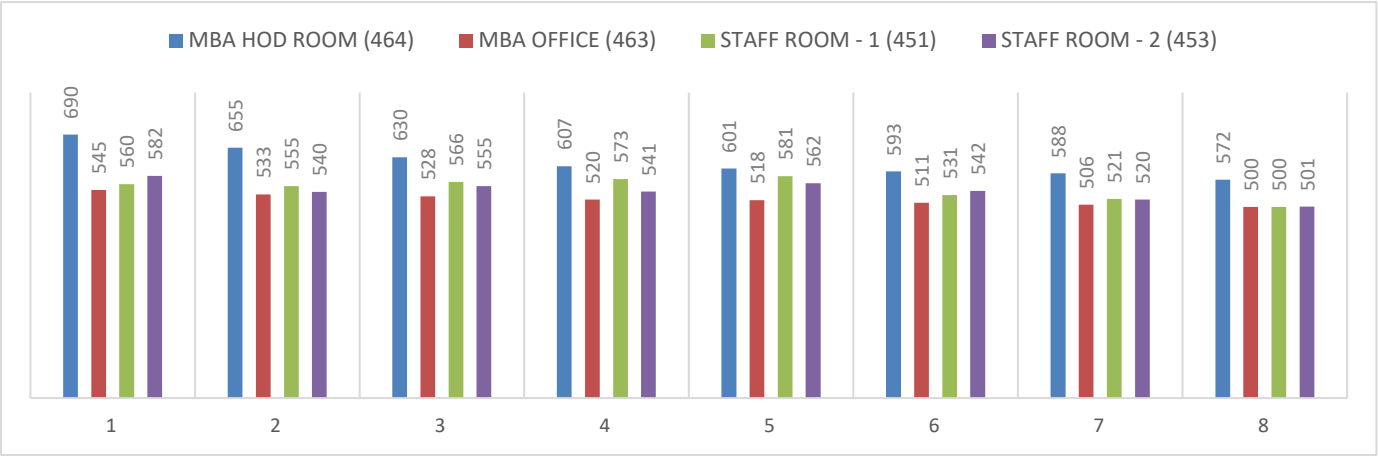

Fig66: CO2 in Staff Rooms of MBA Dept

Table67: Humidity in Class Rooms of MBA Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA FIRST YEAR (460)	70.8	71.1	71.2	67.6	68.3	68.9	70.1	69.8
MBA SECOND YEAR (466)	71.1	72.6	73.2	70.6	69.8	69.5	69.4	71.2
MBA HR (461)	70.8	70.5	70.2	69.5	69.3	66.2	67.3	69.8

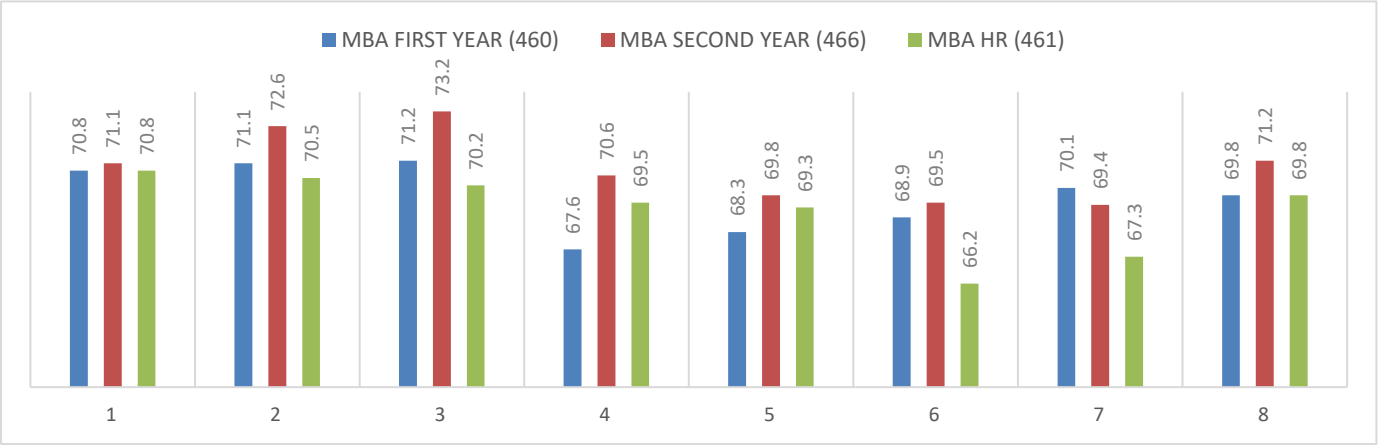

Fig67: Humidity in Class Rooms of MBA Dept

Table68: Humidity in Staff Rooms of MBA Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA HOD ROOM (464)	71.9	71.6	71.1	70.8	70.1	68.1	69.2	70.2
MBA OFFICE (463)	71.8	71.4	71.3	71.4	71.5	71.6	71.9	72.3
STAFF ROOM - 1 (451)	70.2	70.6	69.8	69.8	69.4	70.2	71.2	71.9
STAFF ROOM - 2 (453)	71.2	71.3	71.2	70.6	69.9	69.5	70.9	71.2

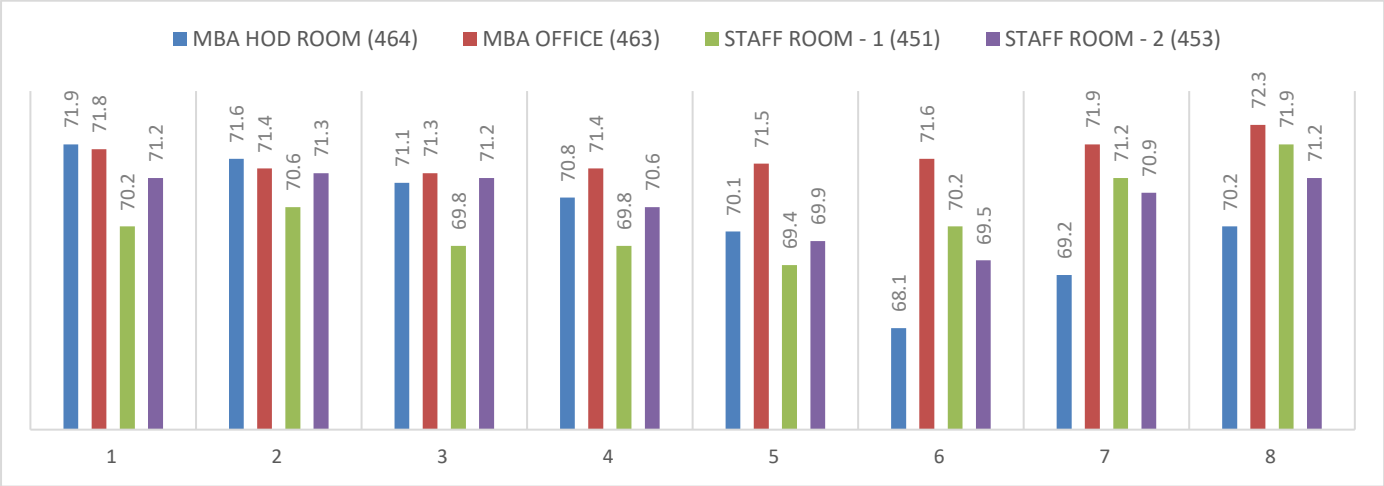

Fig68: Humidity in Staff Rooms of MBA Dept

Table69: Temperature in Class Rooms of MBA Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA FIRST YEAR (460)	30.1	30.6	30.9	30.9	31.1	31.1	31.2	31.5
MBA SECOND YEAR (466)	29.8	30.1	30.2	30.6	31.2	31.2	31.4	31.1
MBA HR (461)	30.1	30.4	30.7	30.9	31.2	30.6	30.7	30.2

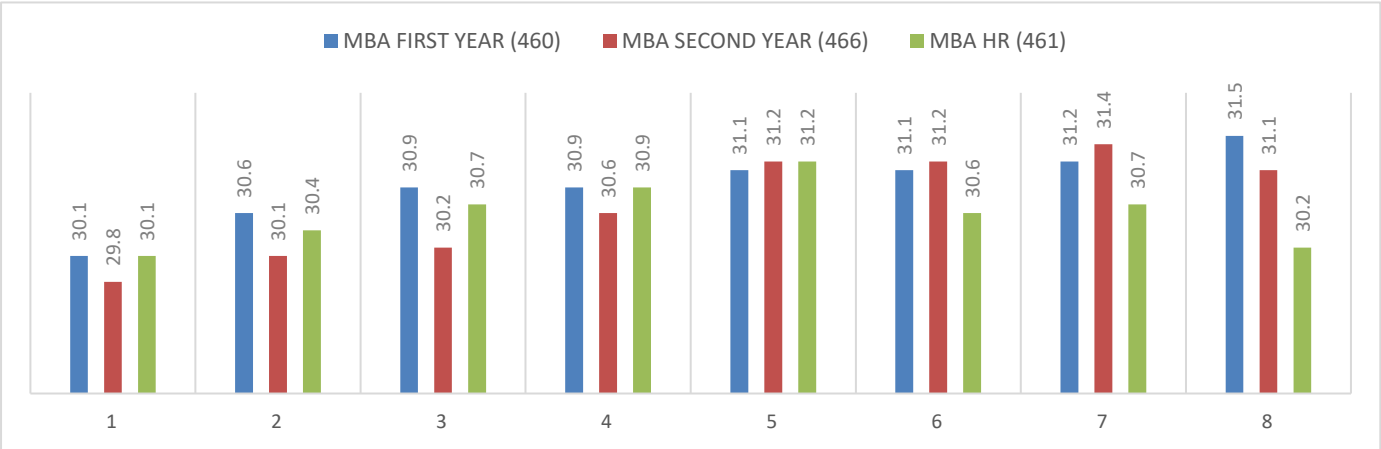

Fig69: Temperature in Class Rooms of MBA Dept

Table70: Temperature in Staff Rooms of MBA Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA HOD ROOM (464)	29.7	29.9	30.1	30.9	30.7	30.6	30.8	31.0
MBA OFFICE (463)	29.6	30.1	30.3	30.5	30.9	31.2	30.9	30.7
STAFF ROOM - 1 (451)	29.9	30.4	30.5	30.9	31.2	31.1	30.7	30.6
STAFF ROOM - 2 (453)	30.6	30.4	30.6	30.8	31.1	31.2	30.6	30.4

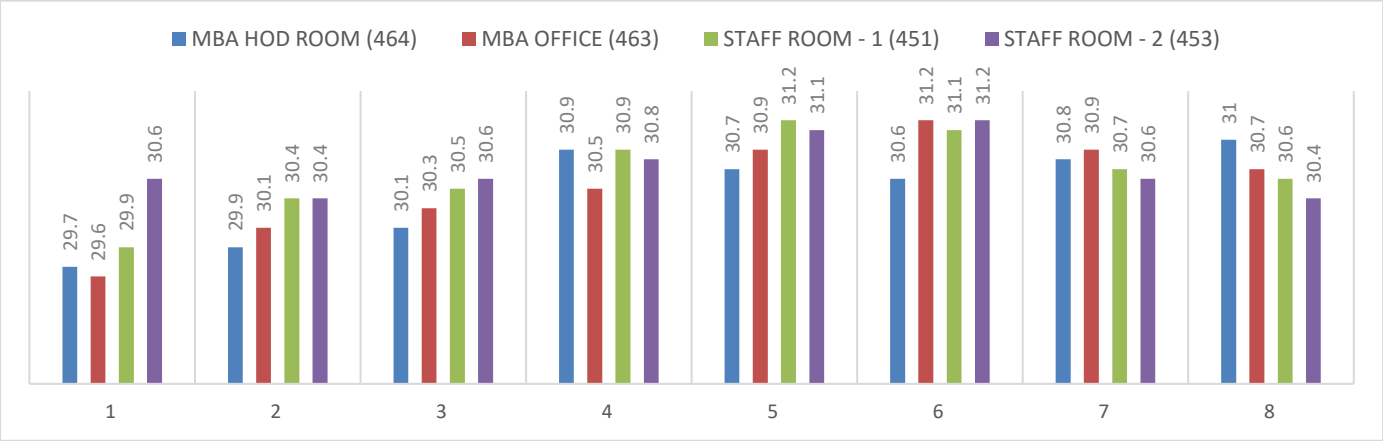

Fig70: Temperature in Staff Rooms of MBA Dept

PHASE-2(Winter Season)

CIVIL ENGINNERING

Table71: CO2 in Class Rooms of Civil Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (155)	540	516	520	498	456	424	439	458
THIRD YEAR (154)	560	586	623	592	564	555	453	430
FINAL YEAR (143)	1432	1356	1248	1123	1036	922	862	798

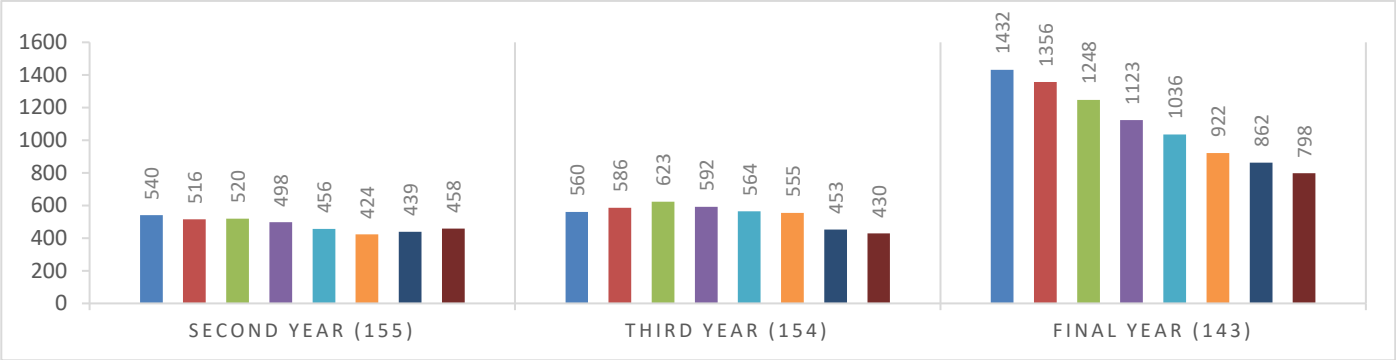

Fig7: CO2 in Class Rooms of Civil Dept

Table72: CO2 in Staff Rooms of Civil Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CIVIL HOD ROOM (158)	450	425	416	432	456	431	452	443
CIVIL OFFICE ROOM (157)	410	420	423	450	560	534	486	450
STAFF ROOM -1 (153(A))	550	546	549	672	653	614	610	590
STAFF ROOM -2 (153(B))	560	536	592	556	495	448	432	410
STAFF ROOM -3 (145)	550	553	560	612	625	658	595	548
TUTORIAL ROOM (152)	583	591	610	625	653	631	590	540
EXAM CELL (144)	580	576	560	558	530	529	516	501
CIVIL LIBRARY (151)	598	576	560	548	530	516	508	500

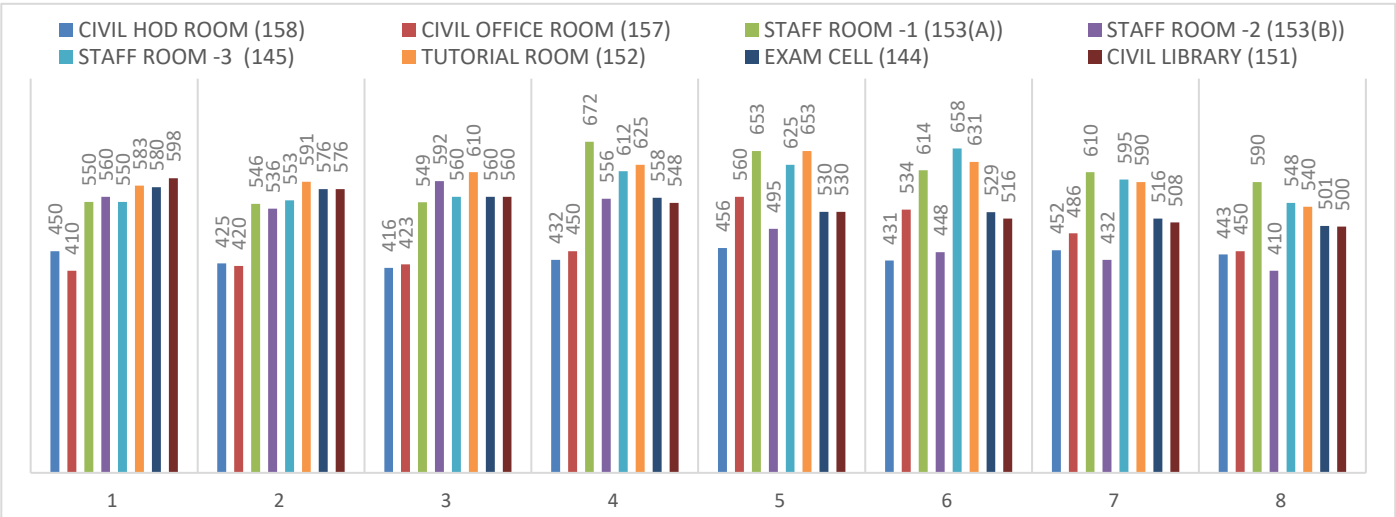

Fig72: CO2 in Staff Rooms of Civil Dept

Table73: CO2 in Class Laboratories of Civil Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CONCRTE TECHNOLOGY LAB (156)	580	565	550	540	530	456	424	458
TRANSPORTATION ENGINEERING LAB (153)	430	468	558	592	675	689	623	610
GEOTECHNICAL LAB (146)	490	498	500	493	435	453	468	480
COMPUTER AIDED DESIGN LAB (249)	590	586	570	578	585	552	510	489
FLUID MECHANICS LAB (119)	581	589	594	583	542	483	510	550
ENVIRONMENTAL ENGINEERING LAB - 1	591	601	620	658	695	653	628	520
ENVIRONMENTAL ENGINEERING LAB ROOM -2	570	590	651	623	650	692	586	521

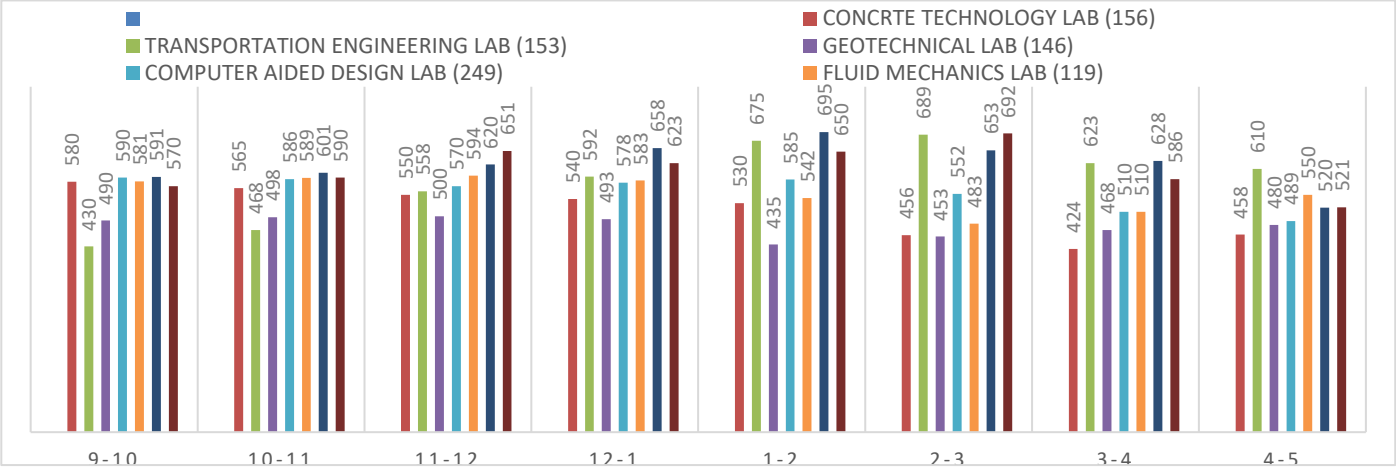

Fig73: CO2 in Class Laboratories of Civil Dept

Table74: Temperature in Class Rooms of Civil Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (155)	30.9	30.8	31.6	30.8	30.5	30.7	31.3	31.4
THIRD YEAR (154)	30.5	30.7	30.7	30.9	30.6	30.8	31.0	31.2
FINAL YEAR (143)	31.3	30.9	30.8	30.7	30.5	31.3	30.8	31.0

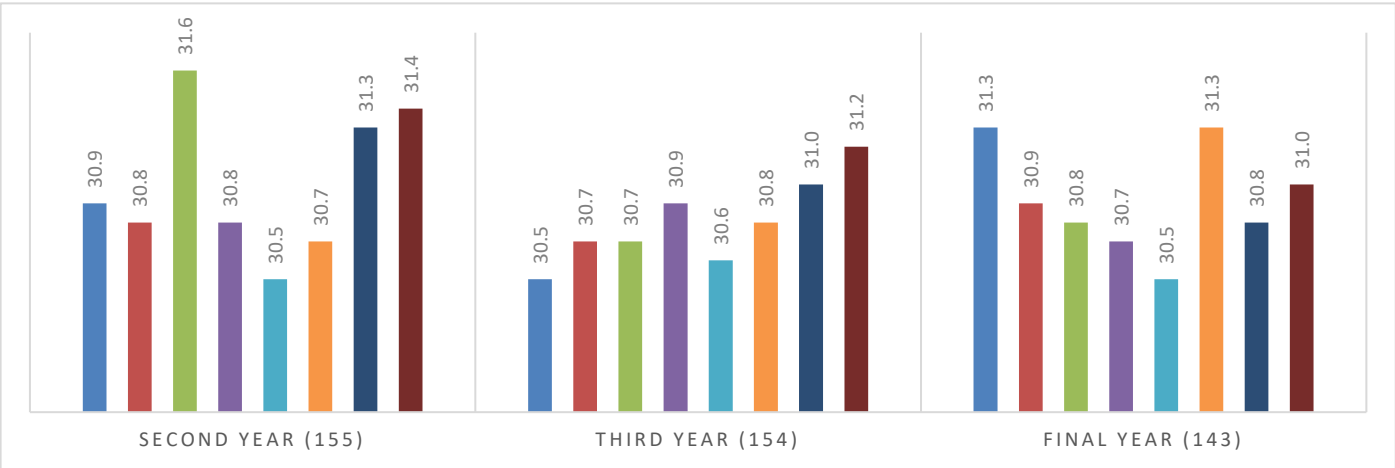

Fig74: Temperature in Class Rooms of Civil Dept

Table75: Temperature in Staff Rooms of Civil Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CIVIL HOD ROOM (158)	30.5	30.8	31.4	31.2	31.6	31.8	31.5	31.2
CIVIL OFFICE ROOM (157)	30.2	31.5	30.5	30.6	30.6	30.8	30.5	30.6
STAFF ROOM -1 (153(A))	31.9	31.5	31.7	31.8	31.6	31.5	31.8	31.5
STAFF ROOM -2 (153(B))	30.1	31.5	32	30.7	31.3	31.8	31.6	32.3
STAFF ROOM -3 (145)	30.8	30.6	30.9	30.6	30.8	30.3	31.2	30.1
TUTORIAL ROOM (152)	30.8	30.7	30.8	30.7	30.9	30.5	30.2	30.4
EXAM CELL (144)	30.8	31.2	31.4	31.2	30.6	31	30.5	30
CIVIL LIBRARY (151)	31.1	30.4	31.8	31.2	31.2	31.1	31.0	31.0

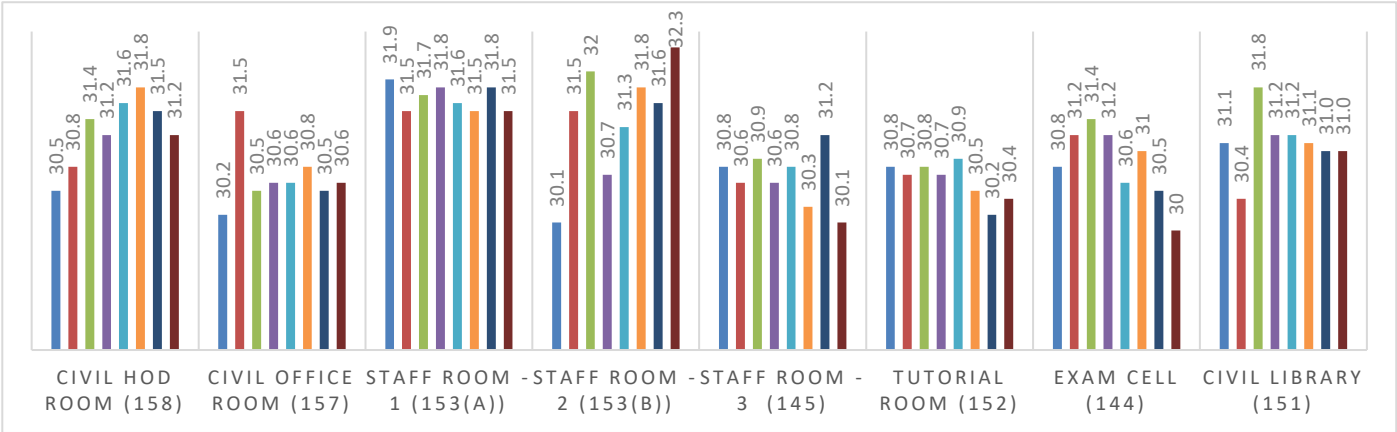

Fig75: Temperature in Staff Rooms of Civil Dept

Table76: Temperature in Laboratories of Civil Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CONCRTE TECHNOLOGY LAB (156)	31	30.8	31.2	31.3	30.8	31.3	31.2	30.8
TRANSPORTATION ENGINEERING LAB (153)	31	31.5	30.9	32.2	30.7	30.6	30.1	30.2
GEOTECHNICAL LAB (146)	30.8	30.9	30.4	30.5	30.9	30.2	30.1	30
COMPUTER AIDED DESIGN LAB (249)	31.3	30.1	30.2	31.5	31.9	31.8	31.6	31.0
FLUID MECHANICS LAB (119)	31.3	31.2	30.1	30.5	30.9	30.3	30.6	31.3
ENVIRONMENTAL ENGINEERING LAB - 1	31.2	31.2	31.1	31	31.2	31.3	30.9	30.6
ENVIRONMENTAL ENGINEERING LAB ROOM -2	31.3	31.2	31.1	31.1	30.9	30.6	30.4	30.6

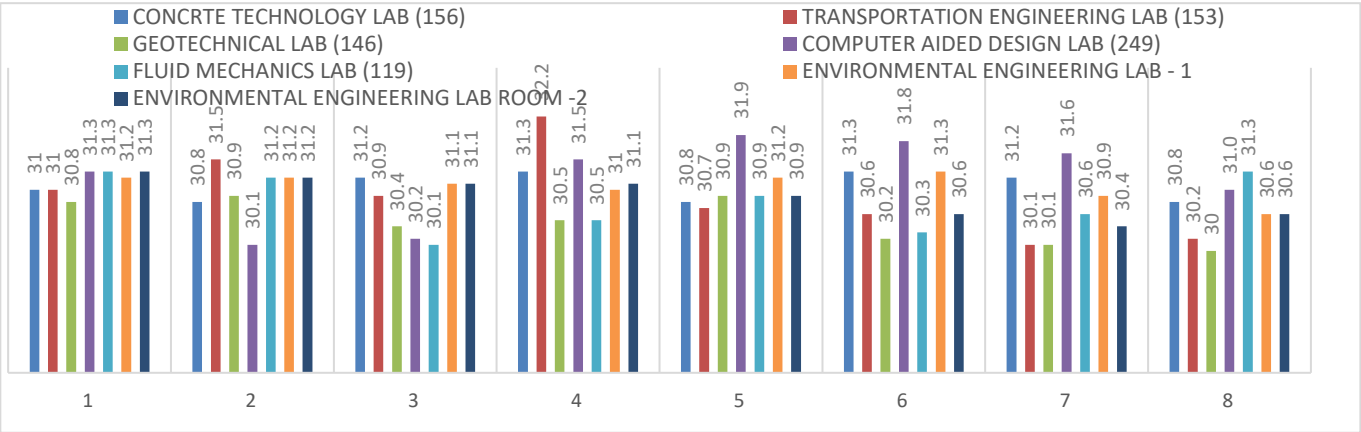

Fig76: Temperature in Laboratories of Civil Dept

Table77: Humidity in Class Rooms of Civil Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (155)	69	68.5	68.2	70	71.3	70.3	70.2	69.3
THIRD YEAR (154)	68.1	68.9	69.2	69.4	65.3	65.9	65.4	67.5
FINAL YEAR (143)	61.3	59.9	59.8	65.3	66.8	66.0	66.3	65.2

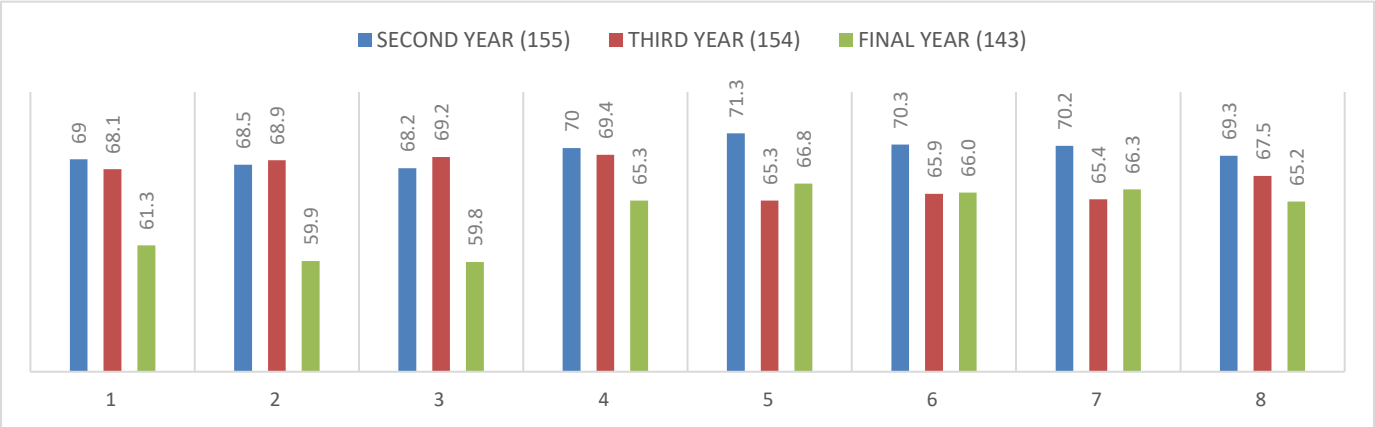

Fig78: Humidity in Class Rooms of Civil Dept

Table78: Humidity in Laboratories of Civil Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CONCRTE TECHNOLOGY LAB (156)	68.1	68.5	69.2	68.5	68.2	68.7	68.9	69
TRANSPORTATION ENGINEERING LAB (153)	69.1	69.5	69.9	71.2	71.6	72.1	71.9	71.4
GEOTECHNICAL LAB (146)	71.3	71.6	70.1	70.6	71.1	70.9	70.6	70.7
COMPUTER AIDED DESIGN LAB (249)	69.6	70.2	71.3	71.1	68.9	68.9	69.1	71.0
FLUID MECHANICS LAB (119)	69.3	69.5	70.1	70.8	70.8	71.5	71.1	70.9
ENVIRONMENTAL ENGINEERING LAB - 1	67.1	67.5	67.9	66.3	65.4	65.1	63.9	63.2
ENVIRONMENTAL ENGINEERING LAB ROOM -2	69.1	68.9	68.2	68.5	69.2	68.9	68.5	68.1

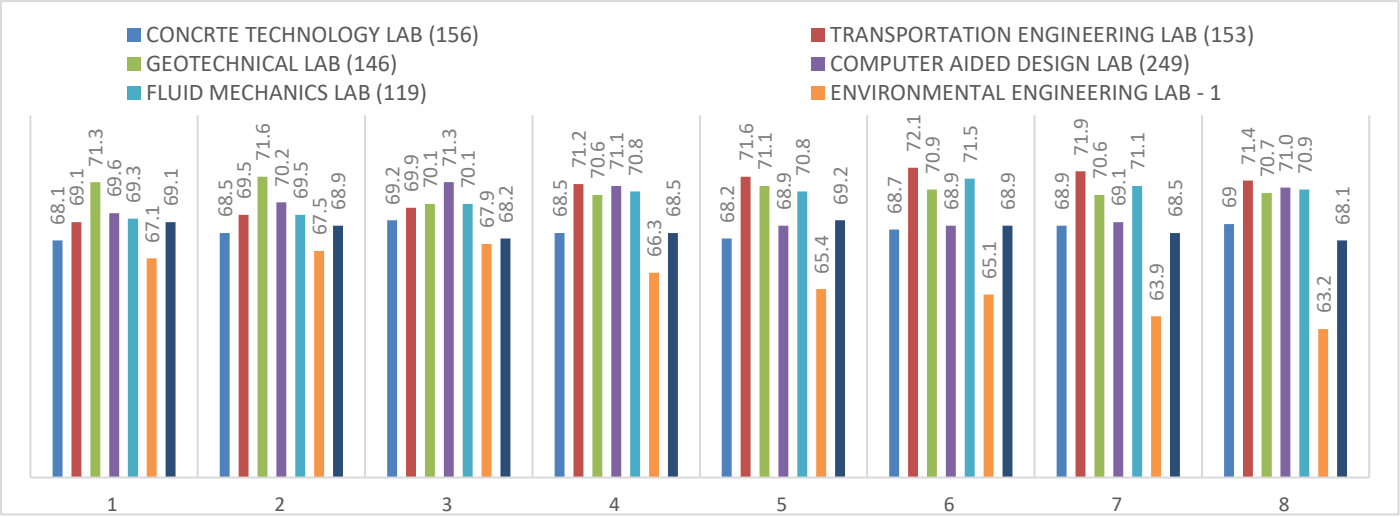

Fig78: Humidity in Laboratories of Civil Dept

Table79: Humidity in Staff Rooms of Civil Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CIVIL HOD ROOM (158)	60.9	62.3	63.5	63.8	64.2	65.2	65.9	66.1
CIVIL OFFICE ROOM (157)	65.3	65.8	65.9	68.1	68.6	69.3	68.2	67.9
STAFF ROOM -1 (153(A))	69.3	68.6	68.2	66.8	66.2	65.3	65.8	66.2
STAFF ROOM -2 (153(B))	68.1	68.9	69.2	69.5	70.1	71.6	71.2	70.8
STAFF ROOM -3 (145)	70	69.8	69.2	69	71.7	71.3	70.9	68.4
TUTORIAL ROOM (152)	70	69.6	69.1	71.3	71.6	72.1	71.5	69.1
EXAM CELL (144)	69.1	68.3	68.6	70.1	69.8	69.7	69.4	69.1
CIVIL LIBRARY (151)	68	68.9	68.4	69.3	69.7	69.4	69.6	69.8

Fig79: Humidity in Staff Rooms of Civil Dept

MECHANICAL ENGINEERING

Table80: CO2 in Class Rooms of Mech Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (123) SECTION -1	550	556	560	572	580	546	521	490
SECOND YEAR (123(A)) SECTION -2	513	524	529	576	584	596	623	650
THIRD YEAR (107) SECTION -1	525	536	540	532	504	498	492	490
THIRD YEAR (108) SECTION -2	590	572	560	565	541	536	498	490
FINAL YEAR (134) SECTION -1	510	536	584	575	550	539	526	535
FINAL YEAR (134(A)) SECTION -2	530	565	587	590	573	568	550	546

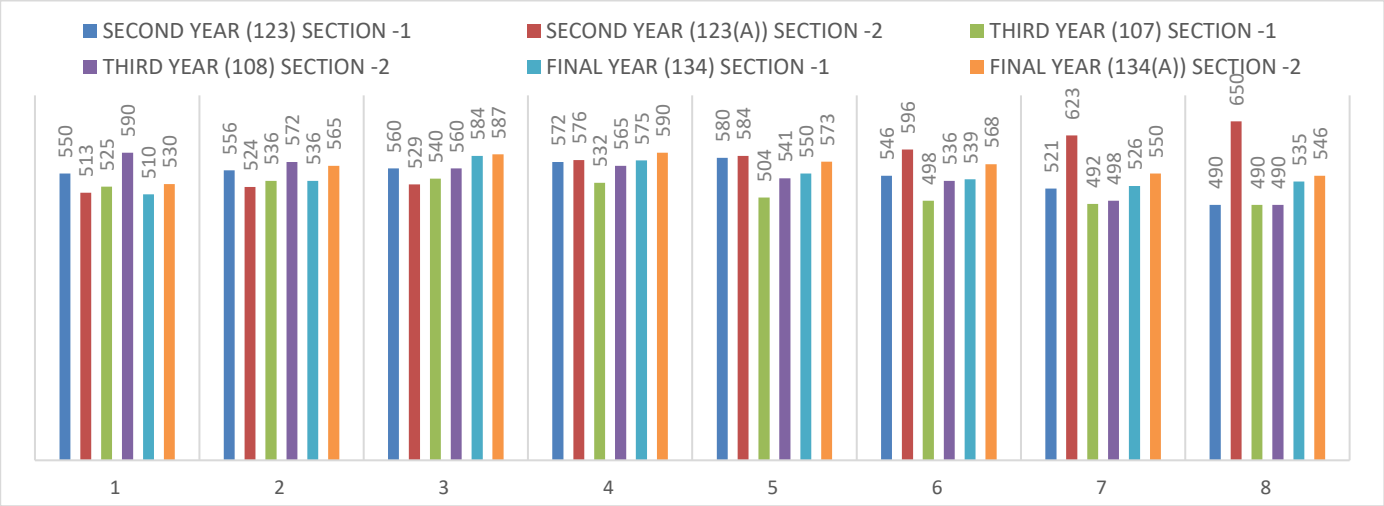

Fig80: CO2 in Class Rooms of Mech Dept

Table81: CO2 in Staff Rooms of Mech Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MECHANICAL HOD ROOM (125)	541	568	576	569	551	529	534	510
MECHANICAL OFFICE ROOM (126)	550	524	510	548	563	579	541	500
STAFF ROOM -1 (333)	544	532	519	541	550	583	591	600
STAFF ROOM -2 (334)	660	625	590	600	592	573	562	540

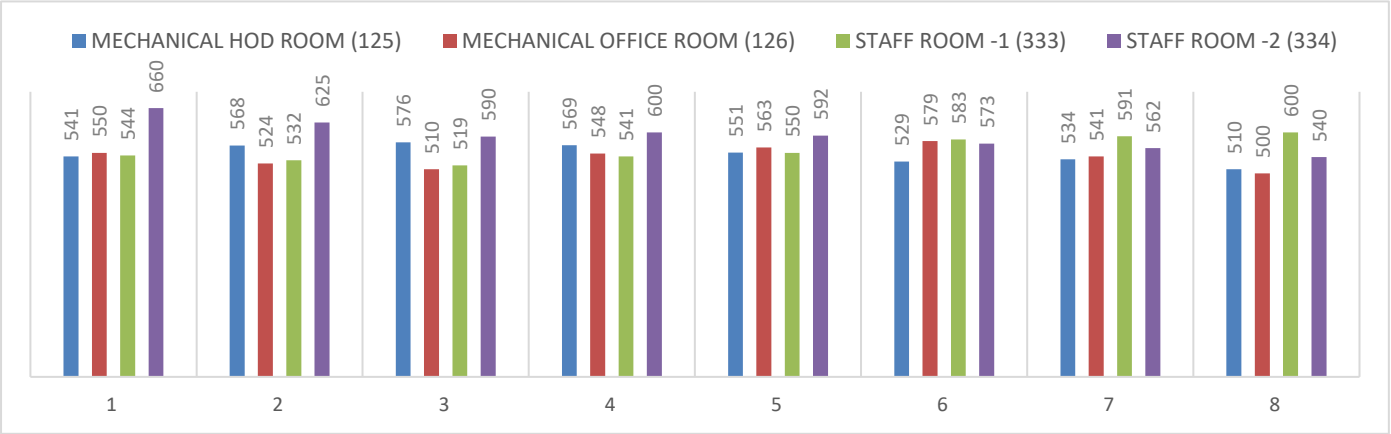

Fig81: CO2 in Staff Rooms of Mech Dept

Table82: CO2 in Class Laboratories of Mech Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
BASIC WORKSHOP (122(B))	585	568	553	545	505	536	506	529
MATERIAL TESTING LAB (117)	600	598	590	562	534	510	519	530
HEAT TRANSFER LAB (109)	550	586	600	598	580	546	536	530
INSTRUMENTATION AND METOROLGY LAB (328)	640	632	621	600	648	670	623	500
CAM LAB (321)	596	612	593	600	554	610	540	490
CAD LAB (348)	580	623	650	690	732	790	635	592
MACHINE TOOLS LAB -1 (124)	595	600	635	658	690	656	612	586
MACHINE TOOLS LAB -2 (122)	519	526	538	567	590	542	526	540

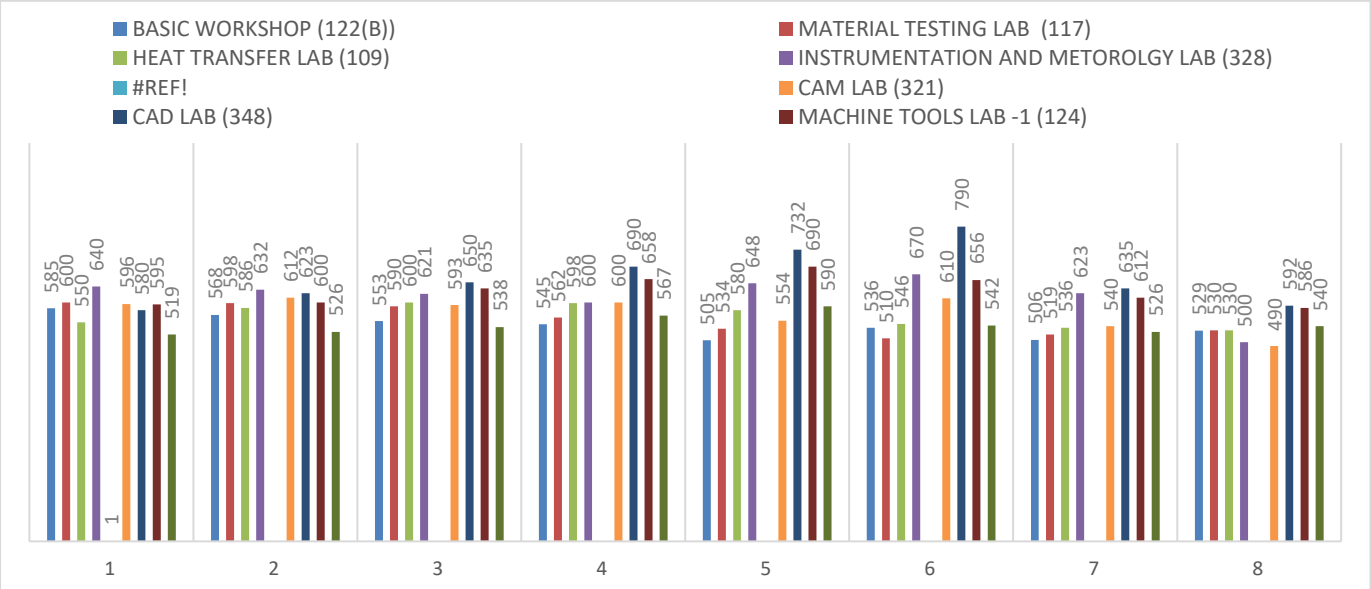

Fig82: CO2 in Class Laboratories of Mech Dept

Table83: Temperature in Class Rooms of Mech Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (123) SECTION -1	30.2	30.6	31.5	32.1	31.5	30.7	32.1	30.1
SECOND YEAR (123(A)) SECTION -2	30.5	30.6	31	31.5	31.7	31.5	31.4	31.2
THIRD YEAR (107) SECTION -1	31.6	31.2	31.6	31.5	31.7	31.6	31.4	31.2
THIRD YEAR (108) SECTION -2	31.3	31.2	31.6	30	31.5	30.5	30.4	30
FINAL YEAR (134) SECTION -1	30.0	31.5	31.9	31.1	31.5	31.2	31.2	31.0
FINAL YEAR (134(A)) SECTION -2	30.1	31.2	31.5	31.2	31.8	31.1	31.2	31.5

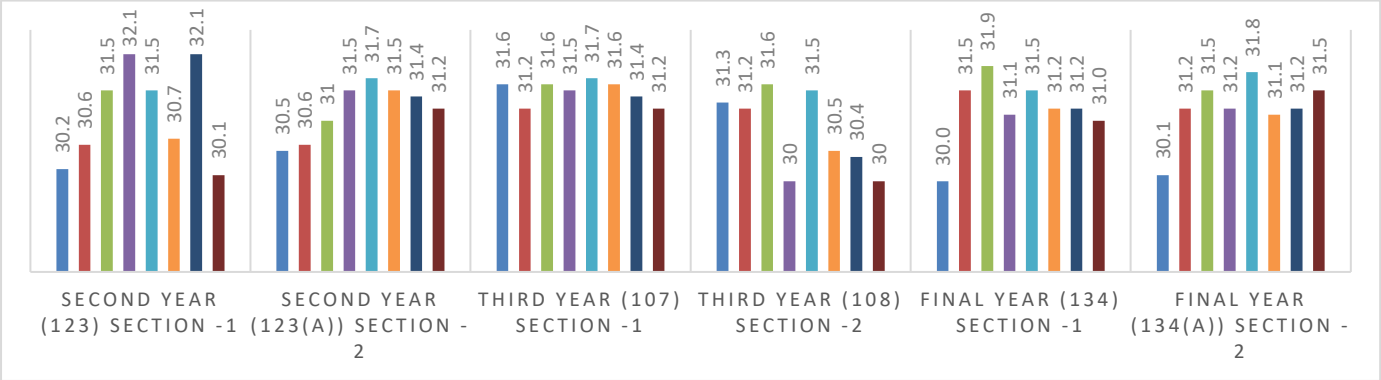

Fig83: Temperature in Class Rooms of Mech Dept

Table84: Temperature in Staff Rooms of Mech Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MECHANICAL HOD ROOM (125)	30.3	30.5	31.1	31.6	32.1	31.5	31.2	30.1
MECHANICAL OFFICE ROOM (126)	30	31.2	31.5	30	31.6	31.4	30.1	30
STAFF ROOM -1 (333)	32.1	32	31.9	31.9	31.8	31.7	31.6	31.5
STAFF ROOM -2 (334)	31.7	31.5	31.7	31.2	31.6	31.4	31.8	31.8

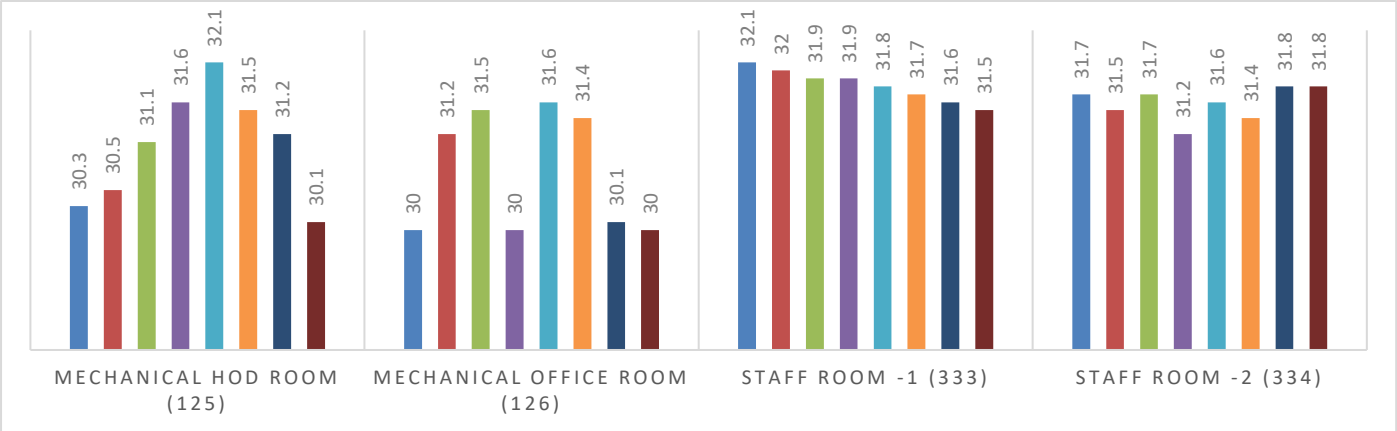

Fig84: Temperature in Staff Rooms of Mech Dept

Table85: Temperature in Laboratories of Mech Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
BASIC WORKSHOP (122(B))	30.4	30.6	30.2	31.3	31.6	30.1	30.6	30.3
MATERIAL TESTING LAB (117)	30.3	30.3	31.3	31.6	31.4	30.1	30.6	31
HEAT TRANSFER LAB (109)	31.1	31.2	31.3	30.1	30.1	30.6	30.2	30.2
INSTRUMENTATION AND METOROLGY LAB (328)	31	31.6	31.5	30	30.6	31.8	31.4	31
CAM LAB (321)	31.7	31.2	31.7	32.1	32.6	32.1	32	31.9
CAD LAB (348)	31.7	31.6	31.2	31.5	31.6	31.5	31.6	31.8
MACHINE TOOLS LAB -1 (124)	31.1	31.2	31.2	31.0	31.6	31.4	32.1	32.8
MACHINE TOOLS LAB -2 (122)	31.2	31.6	31.5	31.9	31.5	31.4	31.1	30

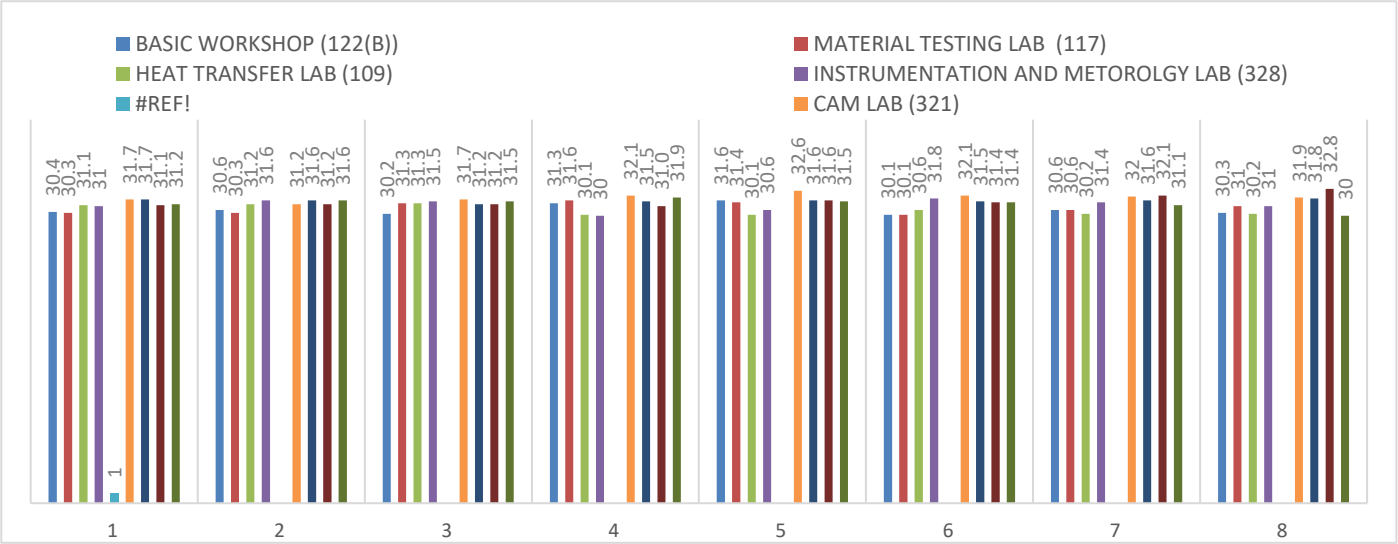

Fig85: Temperature in Laboratories of Mech Dept

Table86: Humidity in Class Rooms of Mech Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (123) SECTION -1	66.3	66.5	66.9	66.4	67.1	65.3	67.5	65.2
SECOND YEAR (123(A)) SECTION -2	69.3	69.1	68.9	69.8	69.4	69.9	69.1	69.9
THIRD YEAR (107) SECTION -1	67.4	67.3	67.2	67.3	66.5	66.2	67.3	68.3
THIRD YEAR (108) SECTION -2	68.8	67.3	67.1	66.1	66	66.5	66.2	66
FINAL YEAR (134) SECTION -1	67.8	67.2	66.3	66.4	66.2	68.2	69.2	69.4
FINAL YEAR (134(A)) SECTION -2	68.8	67.3	67.1	68.1	68.5	68.2	70.6	71.3

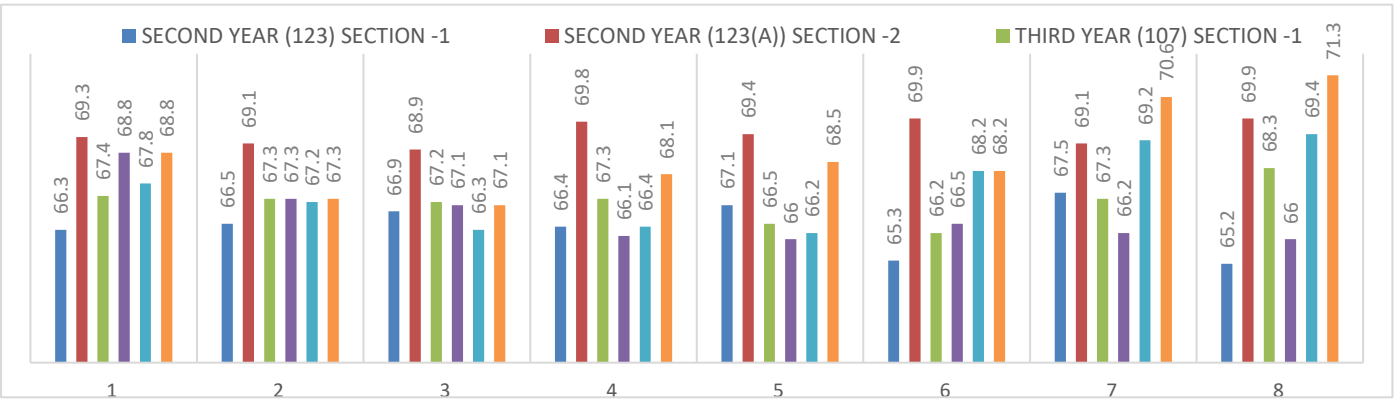

Fig86: Humidity in Class Rooms of Mech Dept

Table87: Humidity in Staff Rooms of Mech Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MECHANICAL HOD ROOM (125)	68.3	68.7	69.1	69.3	67.1	66.5	66.1	65.1
MECHANICAL OFFICE ROOM (126)	69.2	68.5	68	68.6	69.3	69.6	69.9	70.2
STAFF ROOM -1 (333)	69.9	69.2	68.8	68.4	70.1	68.2	67.1	66.8
STAFF ROOM -2 (334)	67.5	67.9	67.3	66.1	66.5	66.3	65.3	65.3

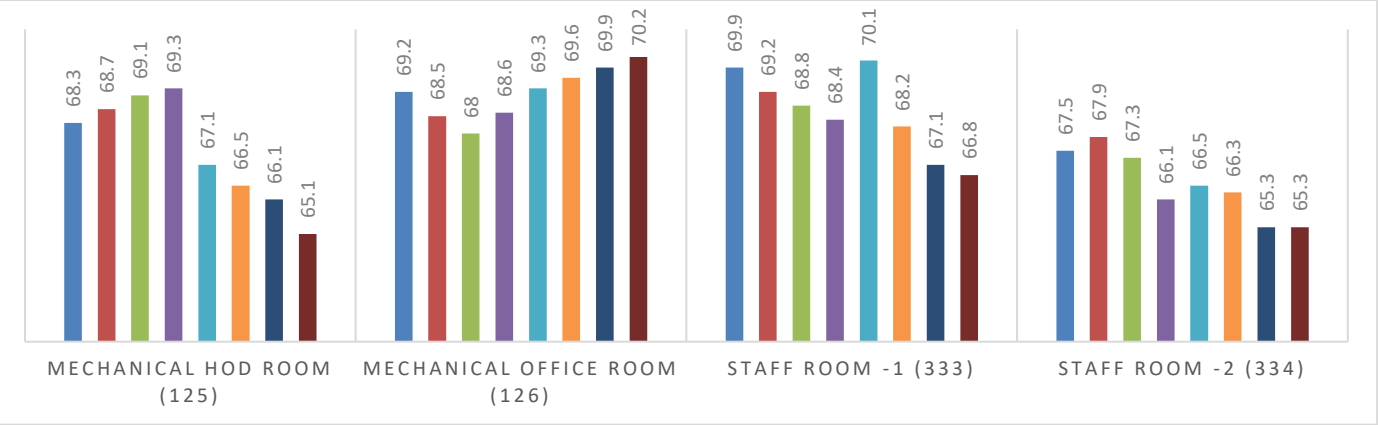

Fig87: Humidity in Staff Rooms of Mech Dept

Table88: Humidity in Laboratories of Mech Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
BASIC WORKSHOP (122(B))	69.1	68.5	68.1	67.5	66.2	66.1	66.0	67.2
MATERIAL TESTING LAB (117)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
HEAT TRANSFER LAB (109)	68.1	68.6	68.9	69.1	69.5	69.2	69.1	68
INSTRUMENTATION AND METOROLGY LAB (328)	69.9	69.2	68.4	68.8	70.1	70.2	70.9	71.8
CAM LAB (321)	66.8	66.3	66.8	68.1	66.5	67.3	68.2	69.3
CAD LAB (348)	68.1	68.6	69.1	67.3	67.9	67.5	67.8	67.3
MACHINE TOOLS LAB -1 (124)	67.8	67.9	68.1	67.9	67.2	67.3	67.2	66.3
MACHINE TOOLS LAB -2 (122)	67.9	66.3	66.8	64.3	65.3	65.4	65.9	66.9

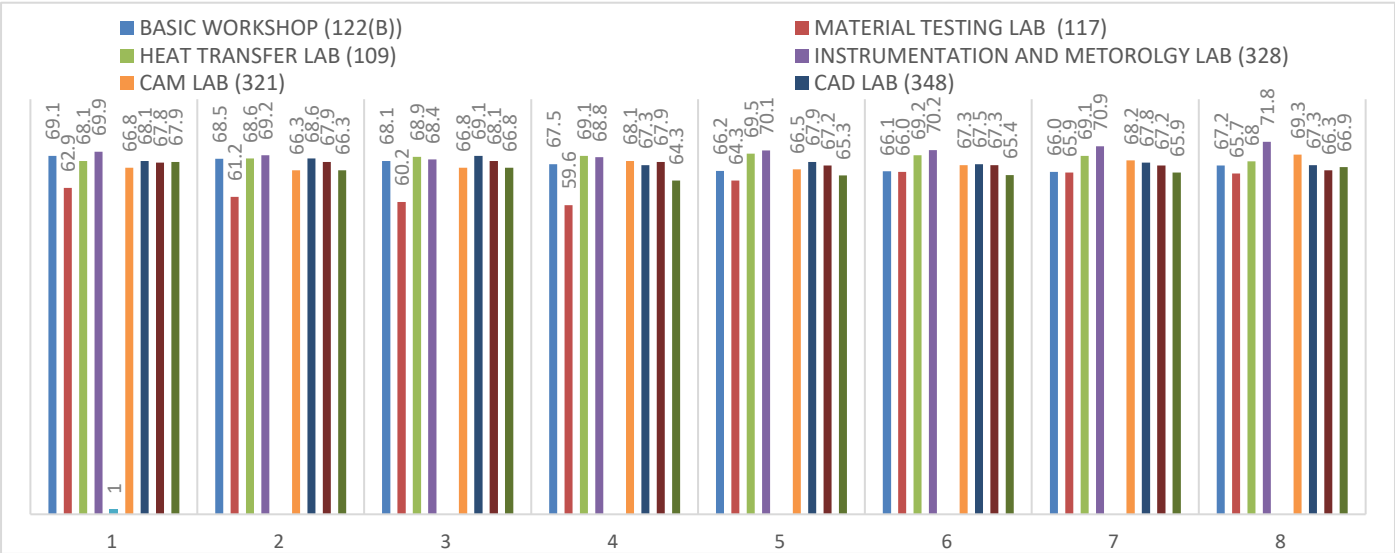

Fig88: Humidity in Laboratories of Mech Dept

COMPUTER SCIENCE AND ENGINEERING

Table89: CO2 in Class Rooms of CSE Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (209) SECTION -1	644	689	726	715	700	695	689	680
SECOND YEAR (210) SECTION -2	605	632	649	532	615	710	750	800
THIRD YEAR (SS) SECTION -1	469	453	449	490	580	596	620	590
THIRD YEAR (108) SECTION -2	410	450	576	585	610	623	630	610
FINAL YEAR (134) SECTION -1	424	430	545	575	660	532	540	410
FINAL YEAR (134(A)) SECTION -2	465	582	478	475	530	632	542	420

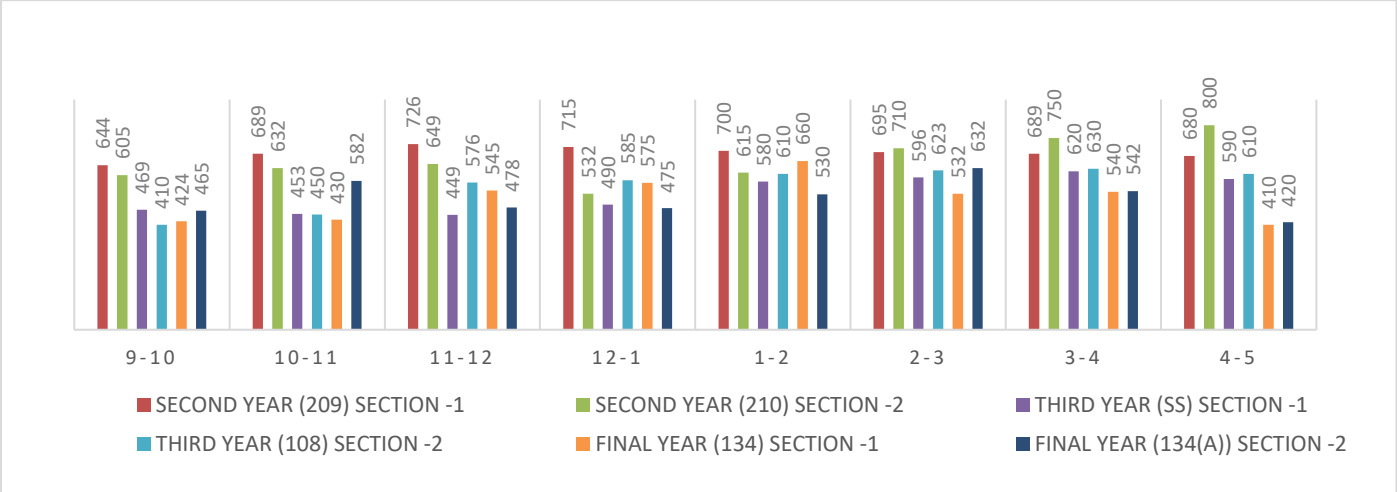

Fig89: CO2 in Class Rooms of CSE Dept

Table90: CO2 in Staff Rooms of CSE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(204)	664	675	771	730	710	650	510	500
STAFF ROOM -1 (205)	637	650	660	642	520	515	532	510
STAFF ROOM -2 (207)	623	653	715	726	623	656	595	580
CSE OFFICE (212)	502	536	542	598	570	568	610	622
CSE HOD (213)	519	535	548	568	510	524	530	530
STAFF ROOM -3 (220)	536	515	520	563	510	520	503	500
STAFF ROOM-4 (221)	479	475	479	510	531	525	519	510
STAFF ROOM -5 (222)	467	485	502	521	462	475	495	450
STAFF ROOM -6 (223)	540	562	531	546	551	560	534	520
PHOENIX DEV CENTRE (226)	793	852	885	653	610	594	535	520
STAFF ROOM -7 (219)	520	539	556	570	585	563	536	510
LIBRARY	520	562	586	543	558	590	551	534

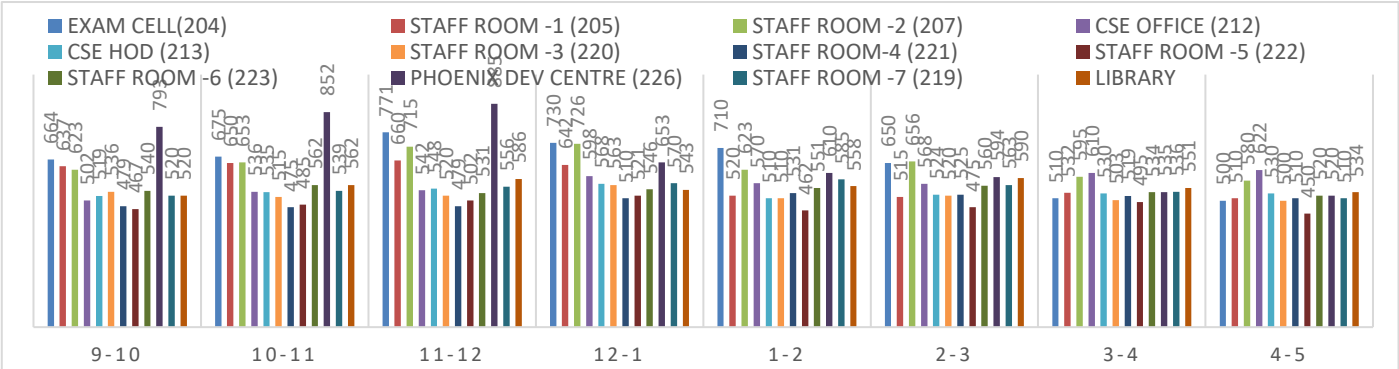

Fig90: CO2 in Staff Rooms of CSE Dept

Table91: CO2 in Class Laboratories of CSE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
AI & ML LAB(208)	636	690	735	795	835	952	923	883
INVENTION & INNOVATION CELL(211)	523	534	568	598	652	703	665	550
APPLICATION DEVELOPMENT LAB(216)	515	543	528	570	683	830	756	682
RESEARCH& DEVELOPMENT LAB(218)	667	701	768	803	1021	1352	1125	1021
SERVER ROOM (218(A))	528	550	509	520	556	598	585	542
PROGRAMMING LAB(224)	1340	1465	1656	1638	1526	1456	1389	1023
SKILL TRAINING LAB(323)	1649	1756	1865	1979	2550	1685	1552	1423

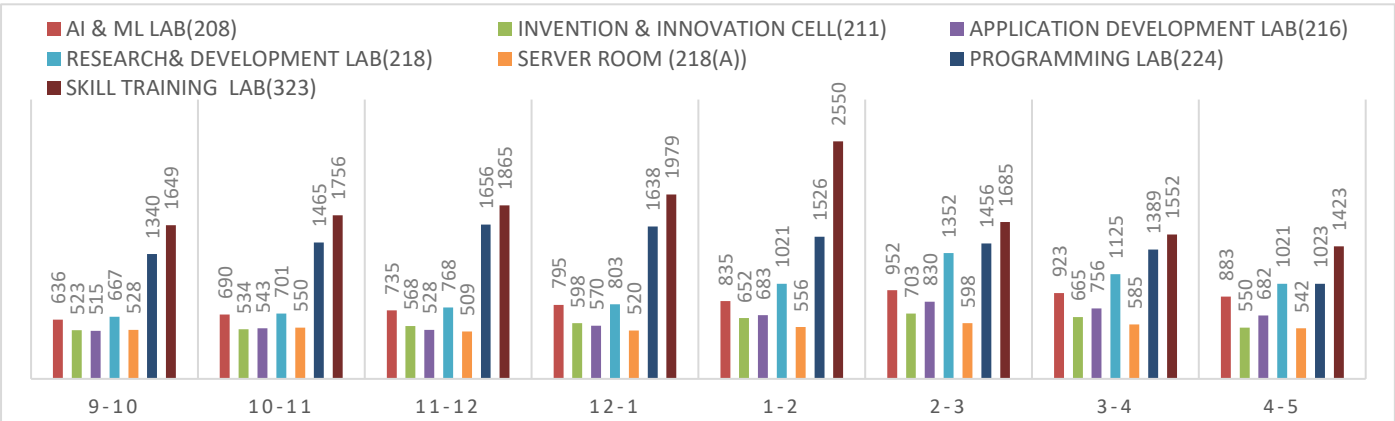

Fig91: CO2 in Class Laboratories of CSE Dept

Table92: Humidity in Class Rooms of CSE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (209) SECTION -1	64.5	64.1	63.5	65.2	66.1	68.1	68.7	67.2
SECOND YEAR (210) SECTION -2	64.4	63.9	63.4	62.3	62.6	65.1	66.8	69.1
THIRD YEAR (SS) SECTION -1	64.8	64.5	64.1	65.2	66.7	68.9	73.1	72.5
THIRD YEAR (108) SECTION -2	67.3	67.4	66.8	69.1	70.1	71.8	76.1	76.6
FINAL YEAR (134) SECTION -1	61.7	61.6	61.5	65.9	69.2	69.3	69.6	71.2
FINAL YEAR (134(A)) SECTION -2	62.7	63.5	64.8	67.5	66.4	65.5	62.4	61.1

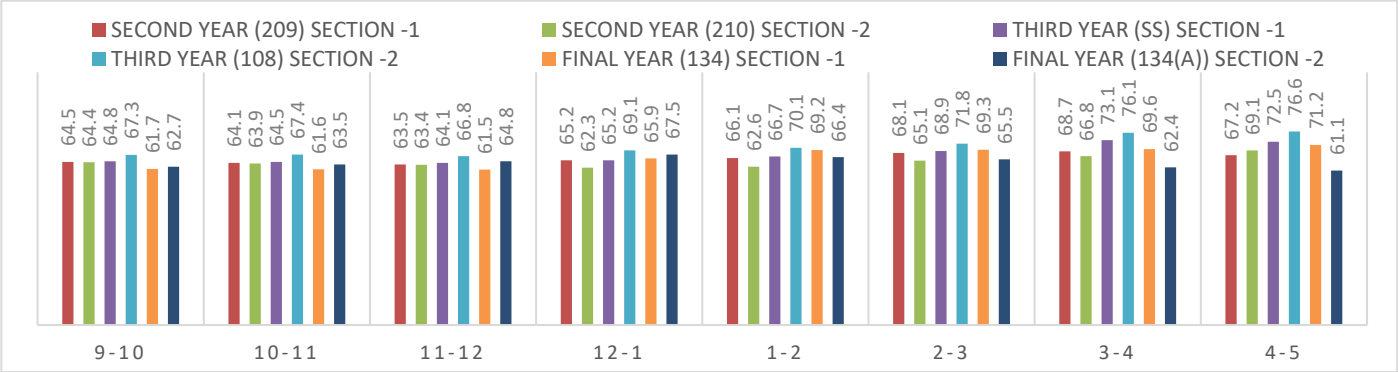

Fig92: Humidity in Class Rooms of CSE Dept

Table93: Humidity in Staff Rooms of CSE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(204)	66.6	66.7	66.8	68.6	67.2	75.1	74.1	73.5
STAFF ROOM -1 (205)	63.9	65.8	65.4	65.3	67.9	65.7	68.1	65.9
STAFF ROOM -2 (207)	66.8	66.9	67.3	67.6	68.1	68.5	69.2	68.9
CSE OFFICE (212)	64.2	64.5	63.2	63.5	65.1	65.4	67.8	68.2
CSE HOD (213)	64.9	65.3	65.8	64.5	62.3	62.6	63.4	64.8
STAFF ROOM -3 (220)	64.5	64.3	63.8	63.1	62.1	62.8	63.2	62.1
STAFF ROOM-4 (221)	63.7	63.2	62.4	62.9	61.3	61.8	60.9	60.4
STAFF ROOM -5 (222)	63.7	64	63.8	63.1	63.5	63.8	63.9	64.2
STAFF ROOM -6 (223)	63.6	63.9	62.1	62.6	63.5	63.4	62.6	62.1
PHOENIX DEV CENTRE (226)	63.9	62.8	62.4	61.6	65.3	66.5	64.2	63
STAFF ROOM -7 (219)	62	62.1	62.5	57.3	57.9	58.3	59.3	60.2
LIBRARY	66.6	66.2	66.8	75.1	74.1	73.5	72.1	70.9

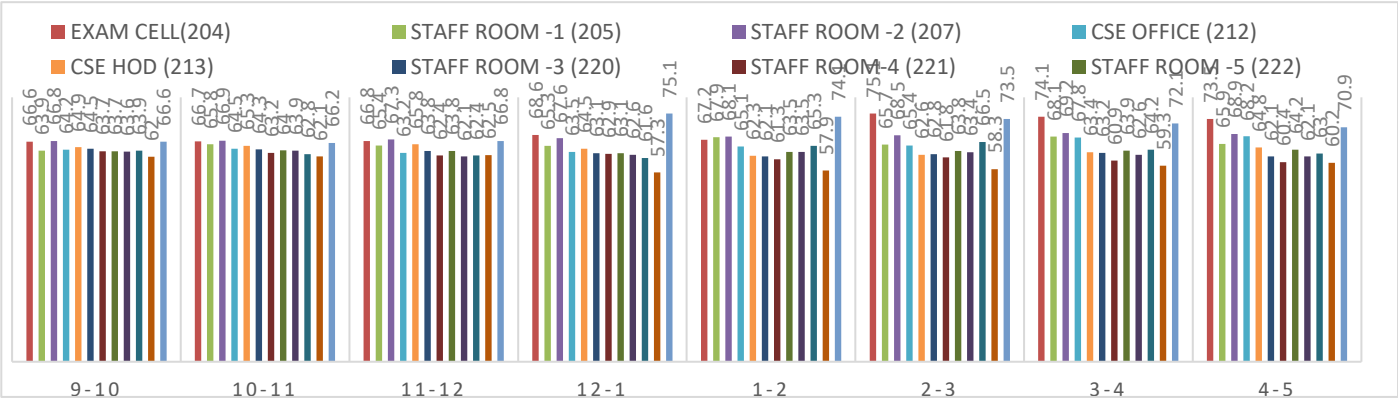

Fig93: Humidity in Staff Rooms of CSE Dept

Table94: Humidity in Laboratories of CSE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
AI & ML LAB(208)	56.2	56.3	61.3	62.3	65.1	65.3	63.5	63.1
INVENTION & INNOVATION CELL(211)	65.7	65.3	65.6	69.3	71.2	70.3	69.3	63.1
APPLICATION DEVELOPMENT LAB(216)	64.2	64.3	64.8	62.3	62.3	64.5	64.3	62.3
RESEARCH& DEVELOPMENT LAB(218)	52.5	52.1	51.8	51.4	55.2	55.3	62.3	61.1
SERVER ROOM (218(A))	62.2	63.3	63.8	52.7	52.3	52.4	57.4	57.2
PROGRAMMING LAB(224)	54.7	56.3	57.3	57.9	63.9	63.4	71.2	71.2
SKILL TRAINING LAB(323)	55.8	55.7	55.3	54.9	54.7	65.3	62.5	61.3

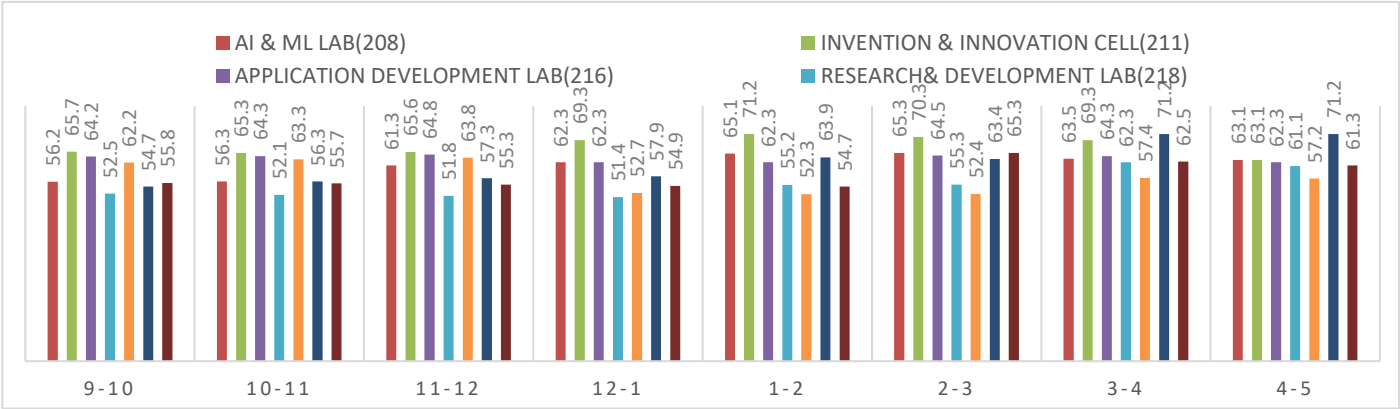

Fig94: Humidity in Laboratories of CSE Dept

Table95: Temperature in Class Rooms of CSE Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (209) SECTION -1	29.8	29.3	29.8	29.3	29.5	29.4	29.7	29.3
SECOND YEAR (210) SECTION -2	29.8	29.7	29.5	29.4	29.4	29.3	29.7	29.5
THIRD YEAR (SS) SECTION -1	29.9	29.5	29.3	29.8	31.2	31.8	32.1	31.8
THIRD YEAR (108) SECTION -2	29.3	29.5	29.6	29.8	30.2	30.9	31.2	30.1
FINAL YEAR (134) SECTION -1	30	30	30.3	30.5	30.6	30.7	35.6	35.9
FINAL YEAR (134(A)) SECTION -2	29.9	30	30.6	30.4	30.2	30	30.2	30.1

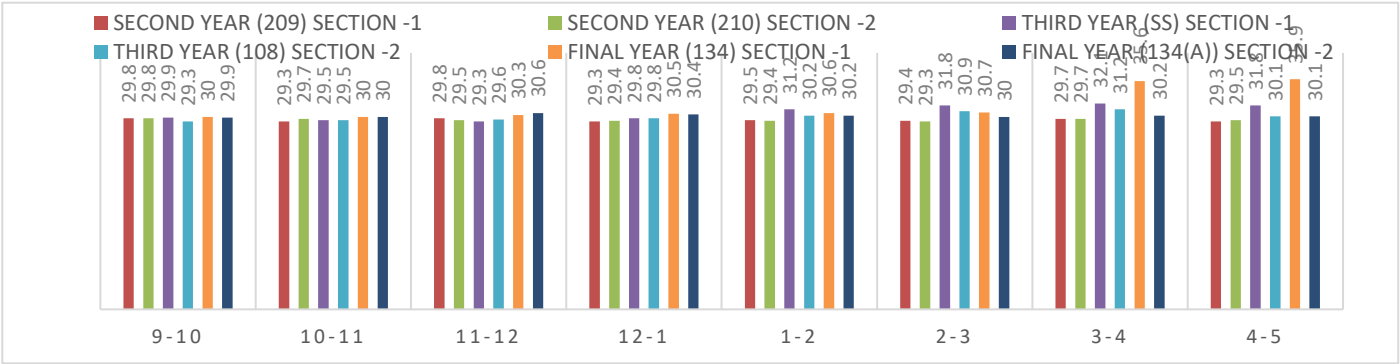

Fig95: Temperature in Class Rooms of CSE Dept

Table96: Temperature in Staff Rooms of CSE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(204)	29.8	29.7	29.8	29.9	28.1	28.3	28.2	28.4
STAFF ROOM -1 (205)	29.3	29.4	29.9	29.8	29.8	29.6	29.1	29.3
STAFF ROOM -2 (207)	29.9	29.8	30	30.1	29.1	29.3	28.8	28.7
CSE OFFICE (212)	29.8	29.8	30.5	30.2	31.4	31.2	30.1	29.8
CSE HOD (213)	29.8	29.8	29.5	30.2	30.6	30.6	29.5	29.1
STAFF ROOM -3 (220)	29.5	29.5	31.6	31.3	30.1	31.5	30.1	30.2
STAFF ROOM-4 (221)	29.6	29.4	29.6	29.4	29.6	29.7	29.6	29.5
STAFF ROOM -5 (222)	29.7	29.7	30.2	29.7	30.2	30.5	30.5	29.5
STAFF ROOM -6 (223)	29.8	29.3	29.9	29.8	29.8	29.4	29.9	29.8
PHOENIX DEV CENTRE (226)	29.8	29.8	29.6	29.4	30.6	30.4	30.5	31.2
STAFF ROOM -7 (219)	29.5	29.5	29.3	29.1	30.3	30.5	30.9	31
LIBRARY	29.1	29.5	30.6	30.64	30.5	31.2	31.4	30.7

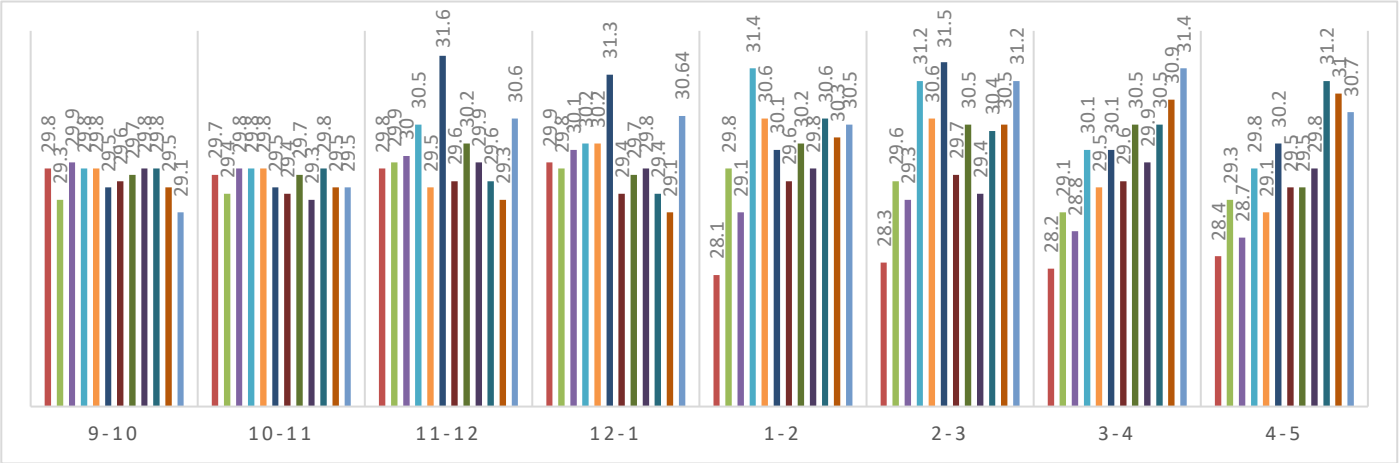

Fig96: Temperature in Staff Rooms of CSE Dept

Table97: Temperature in Laboratories of CSE Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
AI & ML LAB(208)	30	30.3	30.6	30.8	30.5	31.6	30.5	30.7
INVENTION & INNOVATION CELL(211)	29.7	29.7	31.2	31.6	30.5	30.6	31.2	31
APPLICATION DEVELOPMENT LAB(216)	29.8	29.8	29.6	29.1	30.2	30.7	31.2	30.2
RESEARCH& DEVELOPMENT LAB(218)	29.7	29.7	30.5	30.2	31.5	31.5	29.7	31.1
SERVER ROOM (218(A))	30.2	31.6	30.5	30.6	31	31.5	31.2	31.2
PROGRAMMING LAB(224)	29.9	29.6	30.5	30.6	30.5	30.2	30.5	30.8
SKILL TRAINING LAB(323)	29.9	29.6	30.7	30.6	30.7	35.9	32.1	30.1

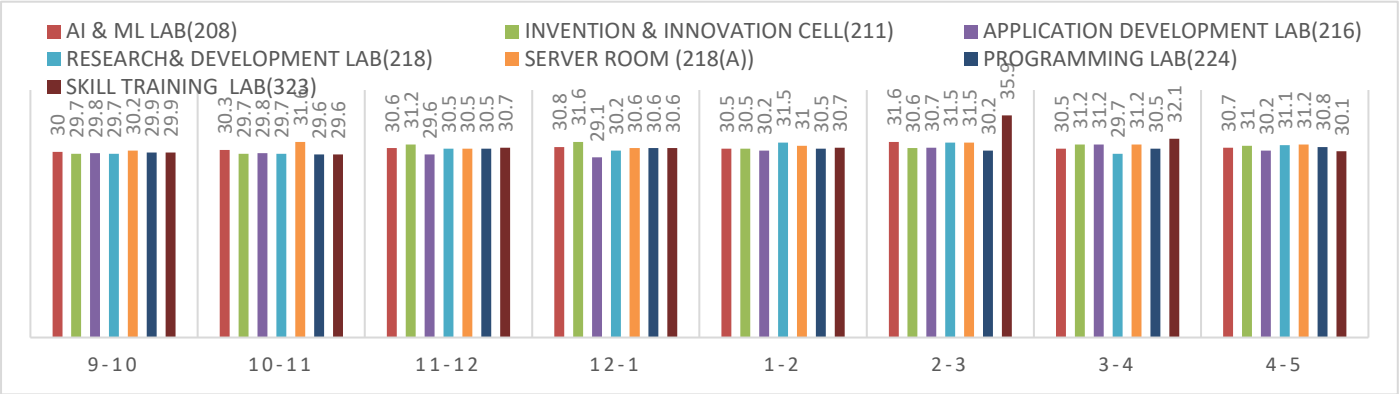

Fig97: Temperature in Laboratories of CSE Dept

INFORMATION TECHNOLOGY

Table98: CO2 in Class Rooms of IT Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (309) SECTION -1	456	486	521	539	586	440	453	401
SECOND YEAR (310) SECTION -2	532	510	459	435	452	436	460	442
THIRD YEAR (329) SECTION -1	550	535	595	582	600	653	590	552
THIRD YEAR (329(A)) SECTION -2	528	546	540	590	582	406	435	421
FINAL YEAR (301) SECTION -1	586	562	532	623	635	612	632	512
FINAL YEAR (303) SECTION -2	584	590	604	625	545	534	576	467

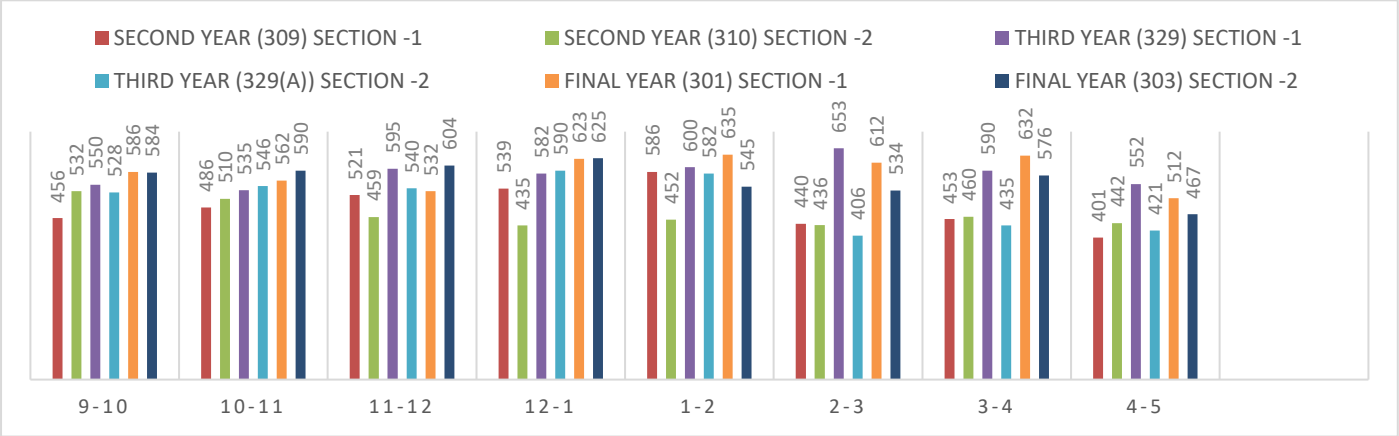

Fig98: CO2 in Class Rooms of IT Dept

Table99: CO2 in Staff Rooms of IT Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
STAFF ROOM-1(304)	456	485	542	513	568	498	435	425
STAFF ROOM -2 (305)	458	435	487	425	498	535	546	453
STAFF ROOM -3 (306)	425	488	458	470	468	482	421	410
IT OFFICE (312)	451	465	456	485	498	437	458	501
IT HOD (313)	545	568	536	526	512	546	524	500
LIBRARY(315)	441	443	415	516	549	425	462	412
EXAM CELL (320)	564	528	546	509	540	525	526	536
STAFF ROOM -4 (322)	512	520	536	584	546	513	500	478
STAFF ROOM -5(319)	586	612	590	546	536	682	613	596

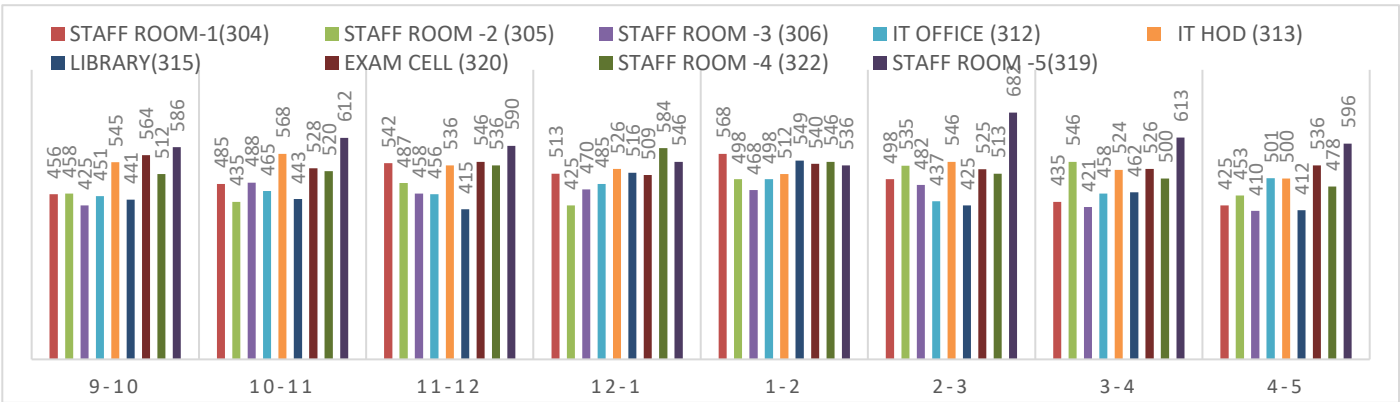

Fig99: CO2 in Staff Rooms of IT Dept

Table100: CO2 in Class Laboratories of IT Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
PROGRAMMING LANGUAGE &PROJECT LAB(308)	1125	1025	1000	956	926	869	826	810
INSTALLATION LAB(311)	890	956	925	935	623	758	723	625
IDE LAB (316)	1356	1253	1125	1005	956	925	892	865
APSSDC (318)	521	568	612	653	643	546	523	417
INCUBATION CENTRE (326)	436	652	525	546	582	542	513	492

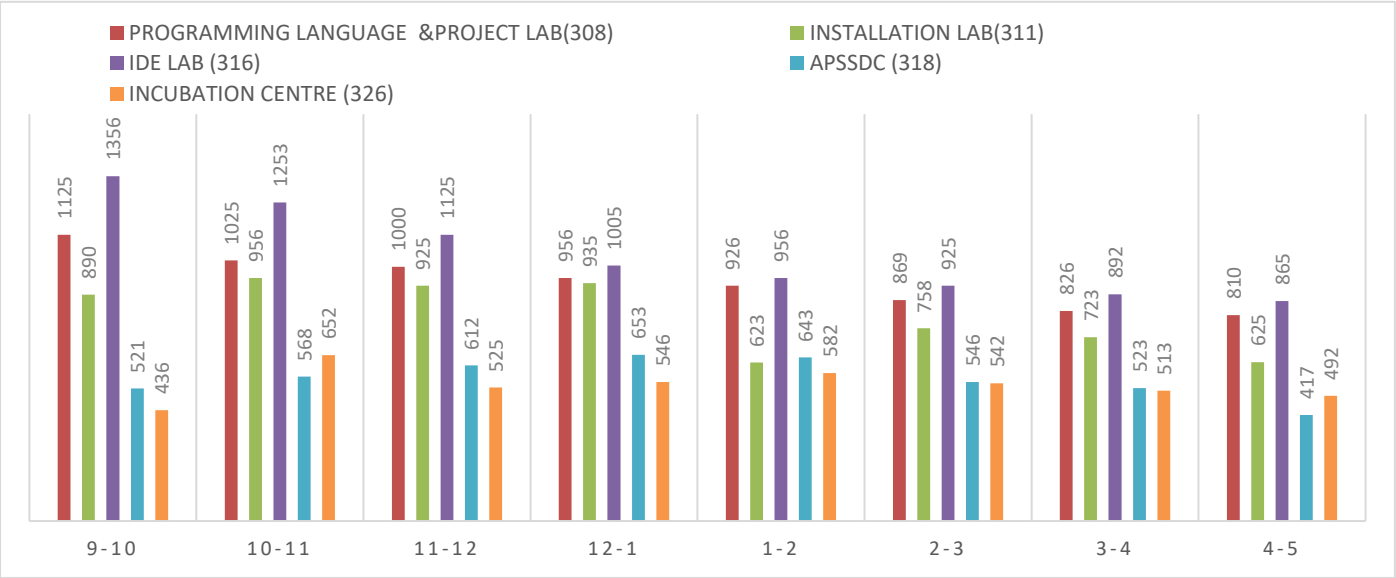

Fig100: CO2 in Class Laboratories of IT Dept

Table101: Humidity in Class Rooms of IT Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (309) SECTION -1	69.3	69.5	69.1	68.2	68.4	68.3	69.5	68.1
SECOND YEAR (310) SECTION -2	72.6	72.5	69.2	71.2	74.1	74.2	72.9	68.1
THIRD YEAR (329) SECTION -1	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
THIRD YEAR (329(A)) SECTION -2	69.3	70.9	70.1	69.7	70.2	72.8	69.2	68.6
FINAL YEAR (301) SECTION -1	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
FINAL YEAR (303) SECTION -2	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7

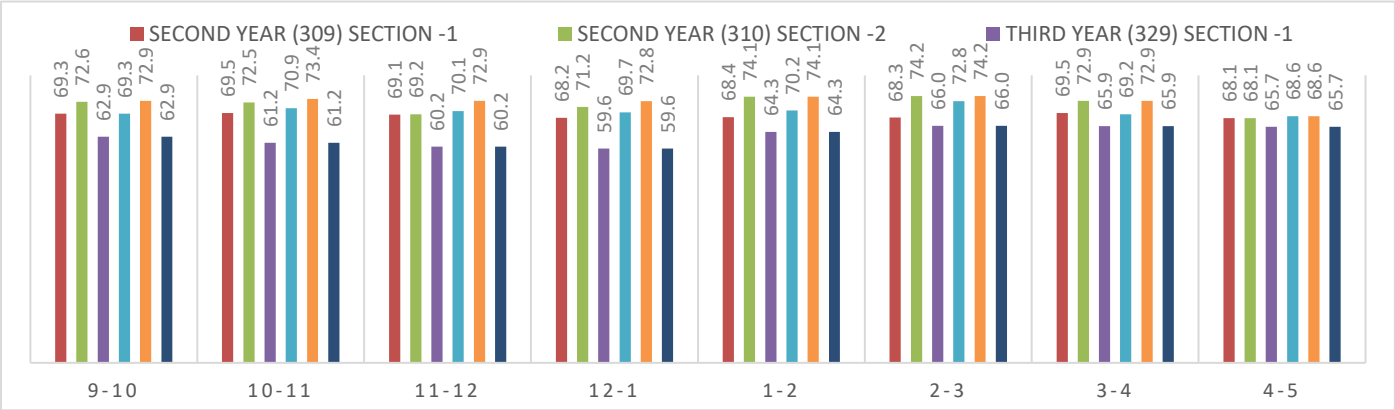

Fig101: Humidity in Class Rooms of IT Dept

Table102: Humidity in Staff Rooms of IT Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
STAFF ROOM-1(304)	69.3	69.3	68.5	38.4	68.2	73.2	72.6	71
STAFF ROOM -2 (305)	69.3	69.5	69.4	69.2	69.2	68.2	68	61
STAFF ROOM -3 (306)	70.3	70.6	70.2	70.2	73.4	73.5	72.6	69.2
IT OFFICE (312)	75.9	75.6	75.8	76.1	76.5	75.6	75.2	68.1
IT HOD (313)	69.5	72.9	69.1	68.2	72.5	72.9	72.4	65.2
LIBRARY(315)	69.1	73.9	75.9	65.2	75.5	73.5	73.2	67.2
EXAM CELL (320)	67.2	72.6	72.5	69.1	69.1	67.2	72.6	65.2
STAFF ROOM -4 (322)	68.2	72.8	72.7	75.8	75.3	76.5	69.1	68.9
STAFF ROOM -5(319)	69.8	72.8	71.3	70.2	73.4	73.5	72.6	69.1

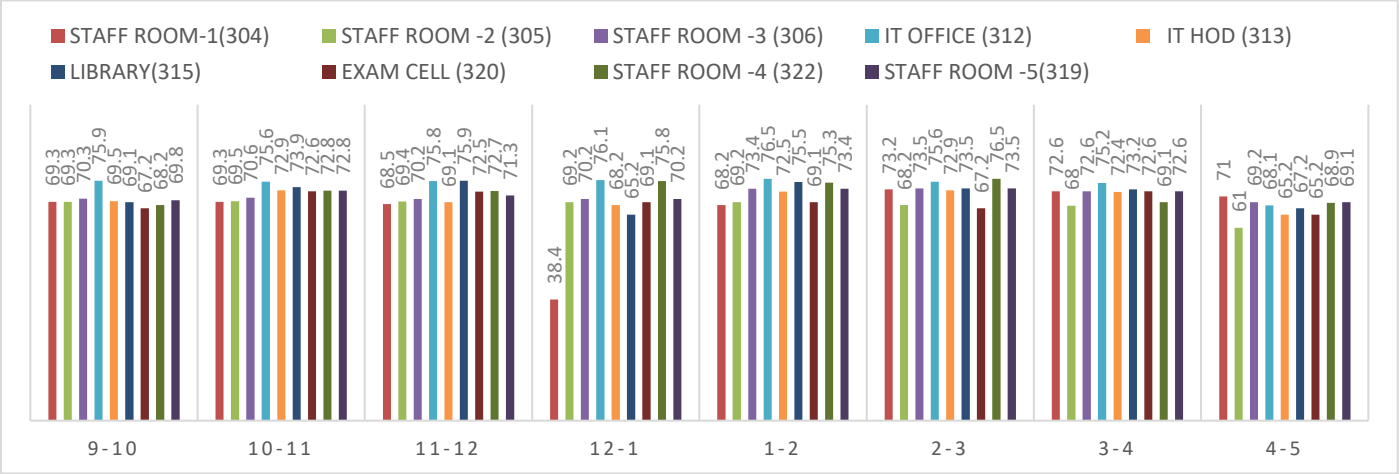

Fig102: Humidity in Staff Rooms of IT Dept

Table:103 Humidity in Laboratories of IT Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
PROGRAMMING LANGUAGE &PROJECT LAB(308)	69.2	68.3	70.1	69.7	71.3	72.8	68.2	68.1
INSTALLATION LAB(311)	68.2	68.7	69.2	68.2	69.2	68.1	69.4	68.6
IDE LAB (316)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
APSSDC (318)	69.4	60.3	60.9	62.6	62.8	64.5	64.3	62.5
INCUBATION CENTRE (326)	68.5	68.2	73.1	73.5	68.2	69.2	62.3	62.1

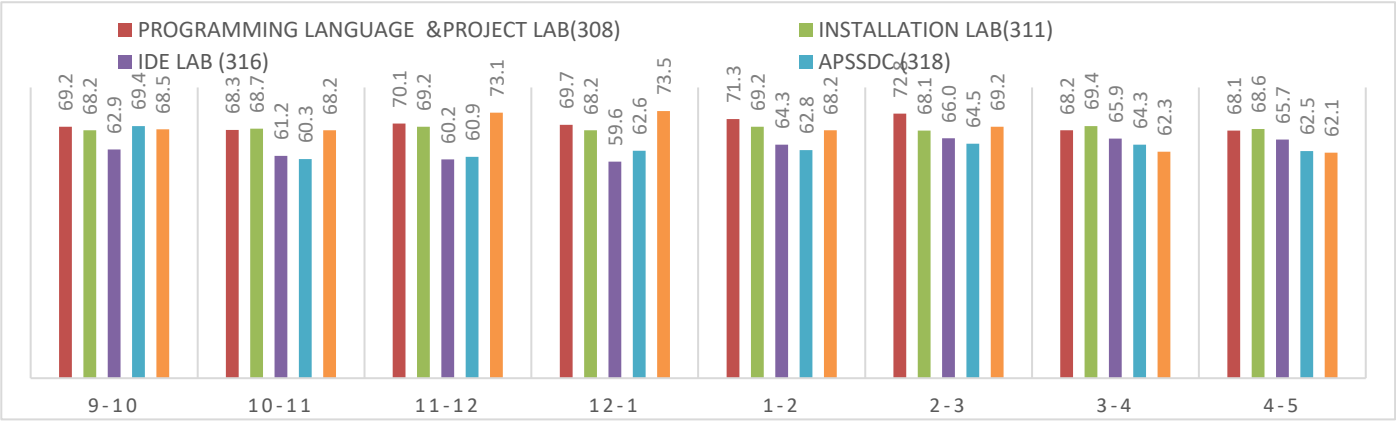

Fig103: Humidity in Laboratories of IT Dept

Table104: Temperature in Class Rooms of IT Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (309) SECTION -1	31.1	31.2	30.8	30.7	30.7	30.7	30.8	30.9
SECOND YEAR (310) SECTION -2	31.2	30.6	31.2	31.2	31.4	31.8	31.5	31.3
THIRD YEAR (329) SECTION -1	30.9	30.9	31.8	31.6	31.8	31.8	31.1	31.2
THIRD YEAR (329(A)) SECTION -2	30.6	30.7	30.5	30.7	30.5	30.5	30.4	30.9
FINAL YEAR (301) SECTION -1	31.0	30.1	31.8	31.8	31.5	31.2	31.0	31.0
FINAL YEAR (303) SECTION -2	30.1	30.1	31.8	31.2	31.2	31.9	31.7	31.8

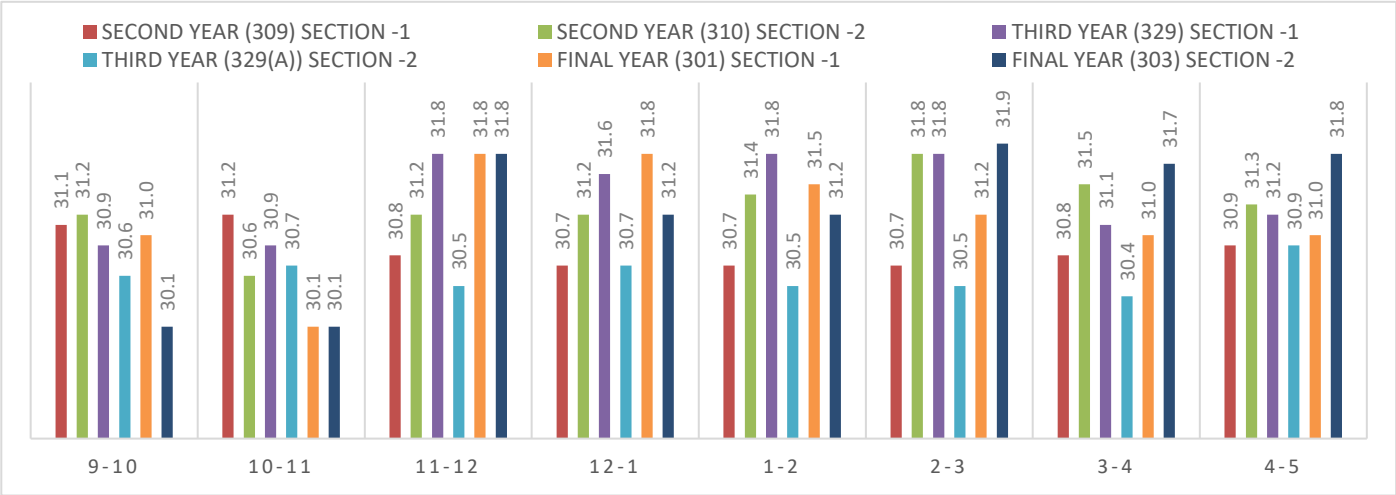

Fig104: Temperature in Class Rooms of IT Dept

Table105: Temperature in Staff Rooms of IT Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
STAFF ROOM-1(304)	30.6	30.5	30.5	30.9	30.1	31.8	31.5	31.3
STAFF ROOM -2 (305)	32.1	30.3	30.9	31.1	30.7	30.6	30.8	30.6
STAFF ROOM -3 (306)	31.5	30.9	30.7	30.7	30.6	30.6	30.4	30.5
IT OFFICE (312)	31.1	31.6	30.8	30.7	30.7	30.7	30.8	30.8
IT HOD (313)	30.8	30.9	30.7	30.6	30.8	30.3	31.2	32.1
LIBRARY(315)	30.6	30.7	30.5	30.7	30.5	30.5	30.4	30.2
EXAM CELL (320)	30.6	30.7	31.4	31.2	30.6	30.2	30.9	30.8
STAFF ROOM -4 (322)	31.2	31.0	31.2	30.6	31.2	31.1	31.0	31.0
STAFF ROOM -5(319)	31.1	30.2	31.5	31.8	31.6	31.5	31.7	31.6

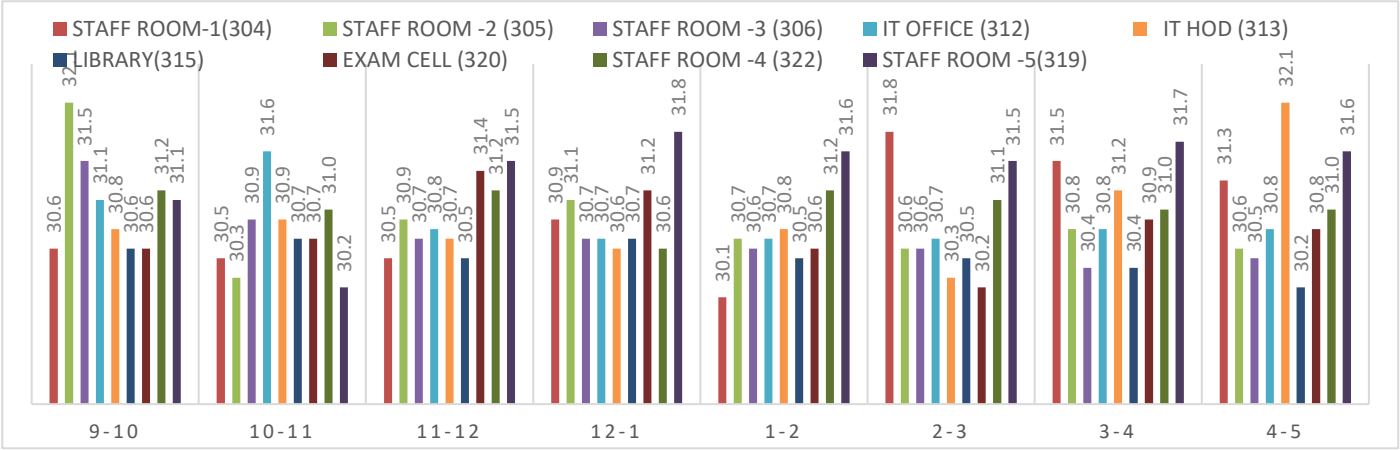

Fig105: Temperature in Staff Rooms of IT Dept

Table106: Temperature in Laboratories of IT Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
PROGRAMMING LANGUAGE &PROJECT LAB(308)	30.2	31.1	30.3	31.1	31.5	31.3	30.9	31.7
INSTALLATION LAB(311)	31.4	30.7	31.4	31.2	32.5	30.2	30.9	31.6
IDE LAB (316)	31.6	31.0	31.2	30.6	32.4	31.1	31.0	31.5
APSSDC (318)	31.6	30.8	30.5	30.8	30.4	30.9	31.3	31.5
INCUBATION CENTRE (326)	30.1	30.7	30.7	30.9	31.2	30.8	31.0	30.2

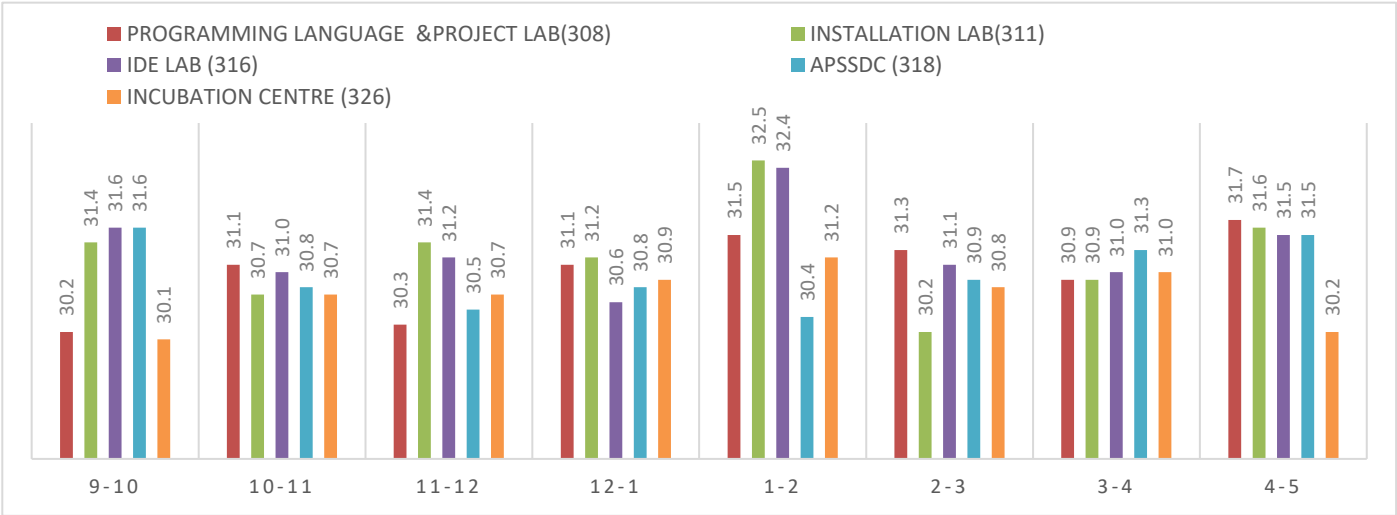

Fig106: Temperature in Laboratories of IT Dept

ELECTRONICS AND COMMUNICATION ENGINEERING

Table107: CO2 in Class Rooms of ECE Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (365) SECTION -1	565	458	454	451	564	425	453	423
SECOND YEAR (366) SECTION -2	523	510	519	556	498	421	456	451
THIRD YEAR (353(A)) SECTION -1	490	520	515	565	598	600	539	551
THIRD YEAR (353) SECTION -2	425	583	475	465	459	406	435	401
FINAL YEAR (341) SECTION -1	435	568	503	533	586	582	598	550
FINAL YEAR (341(A)) SECTION -2	500	526	502	416	435	401	389	350

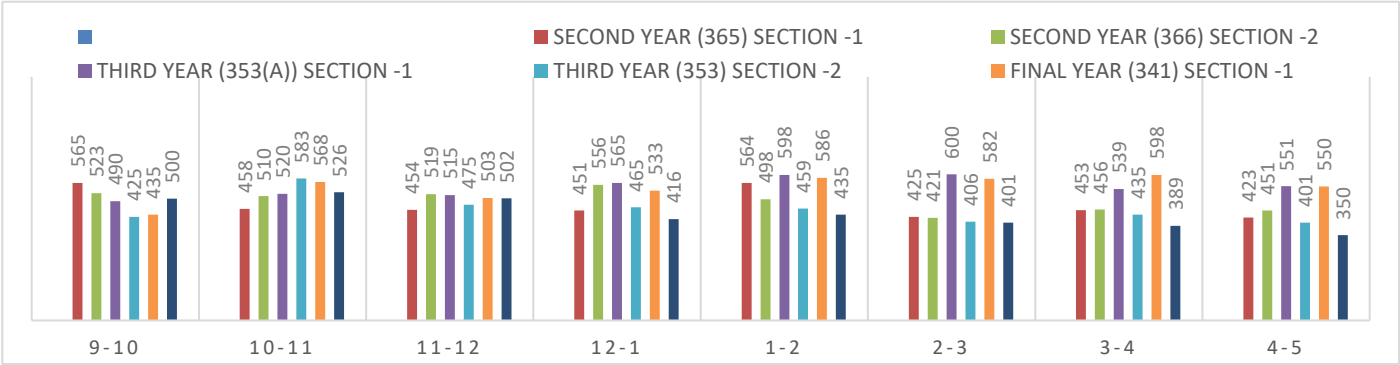

Fig107: CO2 in Class Rooms of ECE Dept

Table108: CO2 in Staff Rooms of ECE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(370)	545	546	539	521	526	536	524	523
ECE OFFICE (368)	489	443	415	516	534	410	462	498
LIBRARY(361)	435	586	541	509	541	536	526	524
STAFF ROOM -1 (358)	510	520	536	589	568	513	500	493
STAFF ROOM -2(340)	486	456	539	521	586	598	562	523
STAFF ROOM -3(254)	425	405	415	516	435	410	462	542
STAFF ROOM -4 (256)	475	492	500	509	540	516	586	512
E-CLASS ROOM (244(A))	512	592	653	689	658	751	786	658
STAFF ROOM -5(363)	493	588	471	481	440	411	430	498
ECE HOD (369)	465	421	446	438	471	480	585	501
STAFF ROOM -6 (362)	485	440	501	496	504	490	483	486

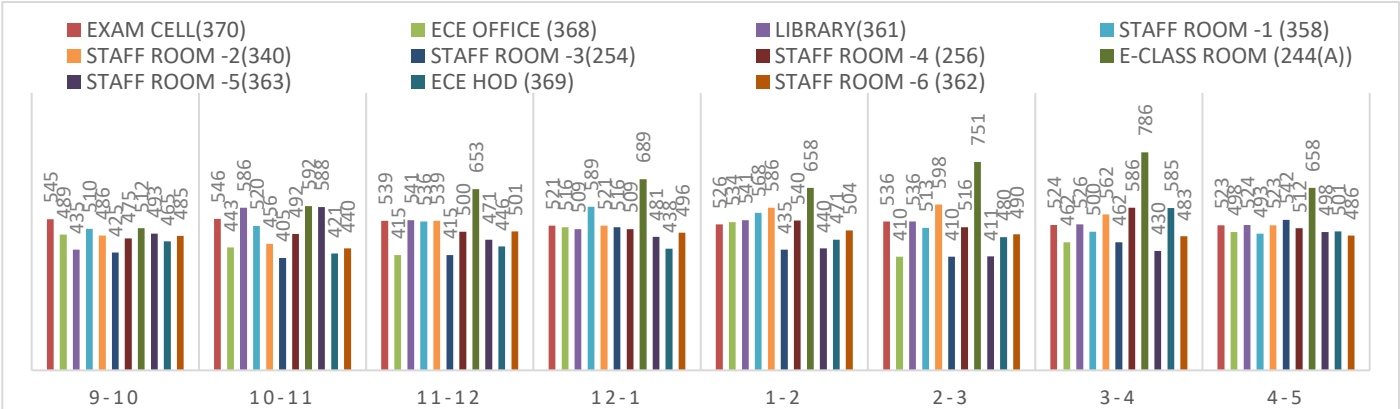

Fig108: CO2 in Staff Rooms of ECE Dept

Table109: CO2 in Laboratories of ECE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE R&D LAB(367)	956	895	841	759	689	758	723	612
VLSI LAB(364)	986	865	952	579	594	568	511	532
EMBEDED SYSTEM LAB (357)	568	625	532	560	548	542	519	498
RESEARCH DEVELOPMENT CELL(344)	489	584	472	456	427	491	470	451
ANALOG & DIGITAL LAB (253)	526	535	541	509	540	536	526	572
JC BOSE HALL (255)	654	623	652	583	652	745	895	812
COMMUNICATION SYSTEM LAB (261)	598	598	593	600	664	695	540	502
MICROWAVE LAB (264)	537	576	540	623	915	849	756	528

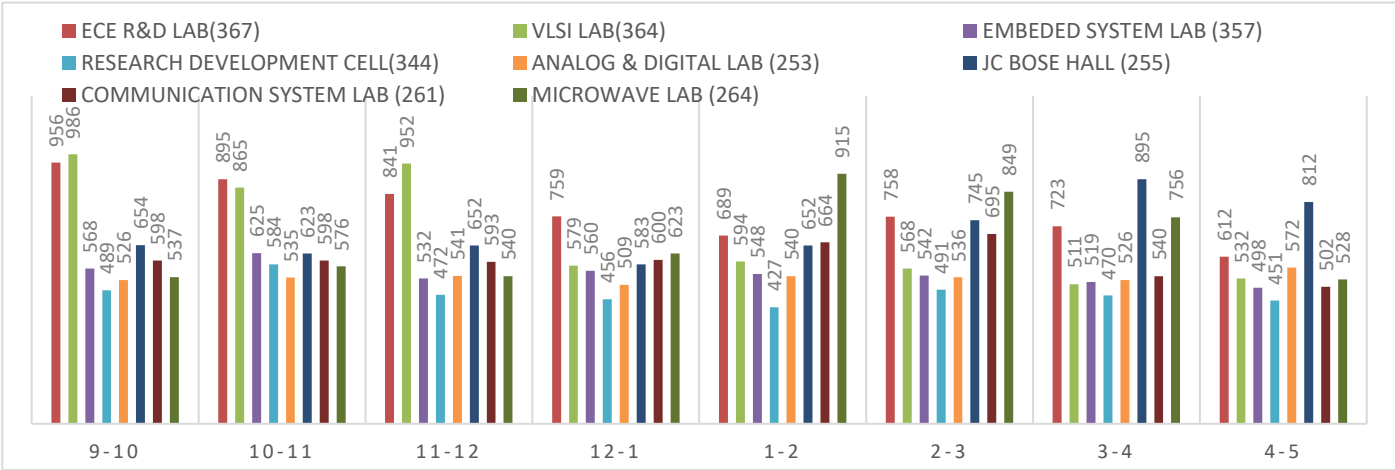

Fig109: CO2 in Laboratories of ECE Dept

Table110: Humidity in Class Rooms of ECE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (365) SECTION -1	71.3	70.0	70.3	70.3	71.3	71.6	71.6	69.1
SECOND YEAR (366) SECTION -2	69.9	68.8	70.1	70.1	70.6	66.8	66.9	66.8
THIRD YEAR (353(A)) SECTION -1	70.4	71.2	71.6	70.3	70.9	71	71.6	71.9
THIRD YEAR (353) SECTION -2	64.9	64.3	64.5	69.3	64.5	67.5	67.4	66.4
FINAL YEAR (341) SECTION -1	70.3	70.9	70.6	71.2	71.9	71.5	71.4	72.1
FINAL YEAR (341(A)) SECTION -2	70.1	66.1	66.9	64.2	65.3	65.5	67.8	67.2

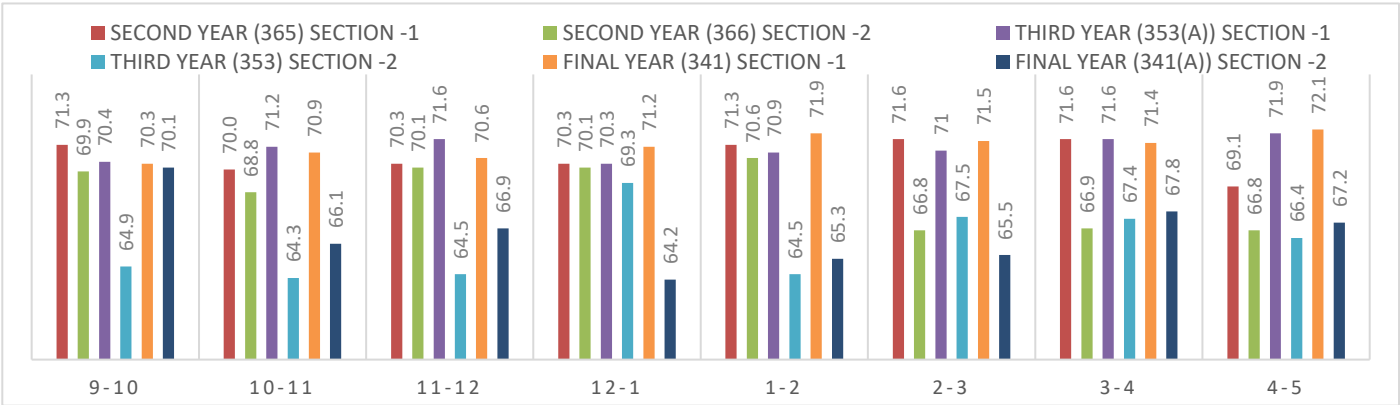

Fig110: Humidity in Class Rooms of ECE Dept

Table111: Humidity in Staff Rooms of ECE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(370)	58.9	58.9	64.2	62.3	65.1	65.3	63.5	63.1
ECE OFFICE (368)	76.1	76.7	64.8	64.9	72.3	72.6	74.1	73.6
LIBRARY(361)	67.1	60.3	60.9	62.6	62.8	64.5	64.3	62.3
STAFF ROOM -1 (358)	68.5	68.2	73.3	73.6	55.2	55.3	62.3	62.1
STAFF ROOM -2(340)	62.2	63.3	63.8	52.7	52.3	52.4	57.4	57.2
STAFF ROOM -3(254)	60.9	60.2	56.6	56.3	63.9	63.4	71.2	71.3
STAFF ROOM -4 (256)	53.8	51.6	54.7	54.9	65.8	65.3	62.5	61.3
E-CLASS ROOM (244(A))	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
STAFF ROOM -5(363)	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
ECE HOD (369)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
STAFF ROOM -6 (362)	67.4	67.3	68.2	66.5	66.2	68.2	68.2	68.3

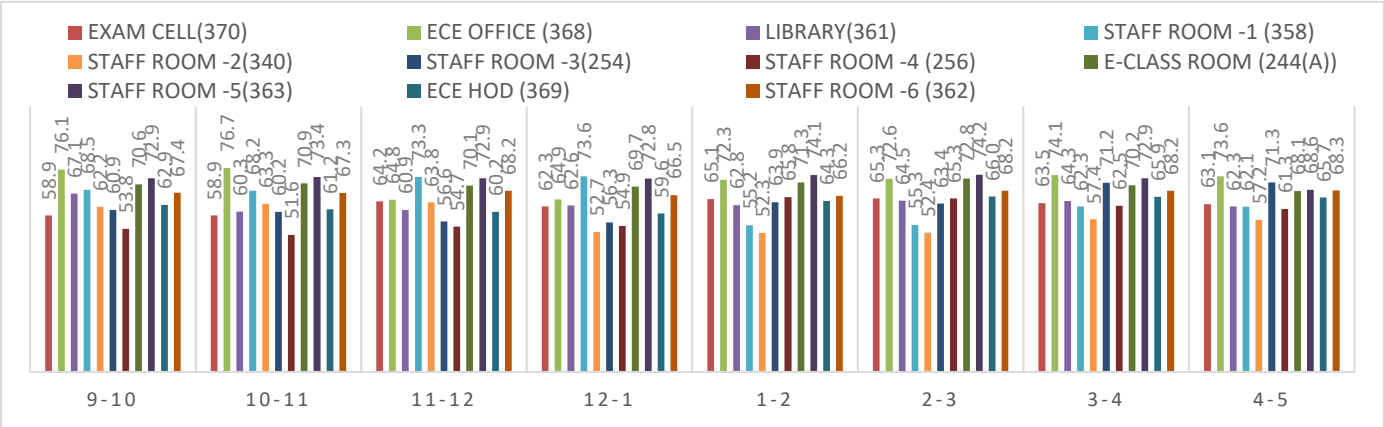

Fig111: Humidity in Staff Rooms of ECE Dept

Table112: Humidity in Laboratories of ECE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE R&D LAB(367)	70.1	71.3	71.6	71.9	70.4	70.1	71.2	71.1
VLSI LAB(364)	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
EMBEDED SYSTEM LAB (357)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
RESEARCH DEVELOPMENT CELL(344)	71.1	71.5	73.8	74.2	74.3	74.5	74.2	74.6
ANALOG & DIGITAL LAB (253)	70.2	70.5	68.9	71.9	75.9	76.7	74.3	71.7
JC BOSE HALL (255)	71.3	71.5	71.1	69.3	71.9	72.8	70.9	68.4
COMMUNICATION SYSTEM LAB (261)	72.1	72.3	71.4	71.1	73.6	75.5	74.9	72.1
MICROWAVE LAB (264)	71.9	71.4	69.9	69.6	72.1	72.6	70.9	70.9

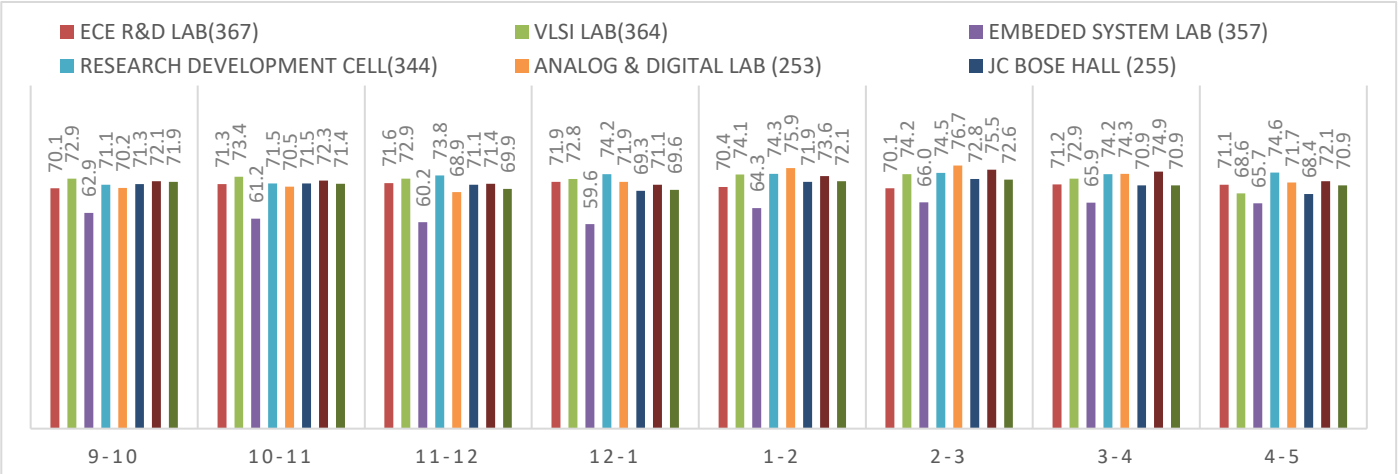

Fig112: Humidity in Laboratories of ECE Dept

Table113: Humidity in Staff Rooms of ECE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(370)	58.9	58.9	64.2	62.3	65.1	65.3	63.5	63.1
ECE OFFICE (368)	76.1	76.7	64.8	64.9	72.3	72.6	74.1	73.6
LIBRARY(361)	67.1	60.3	60.9	62.6	62.8	64.5	64.3	62.3
STAFF ROOM -1 (358)	68.5	68.2	73.3	73.6	55.2	55.3	62.3	62.1
STAFF ROOM -2(340)	62.2	63.3	63.8	52.7	52.3	52.4	57.4	57.2
STAFF ROOM -3(254)	60.9	60.2	56.6	56.3	63.9	63.4	71.2	71.3
STAFF ROOM -4 (256)	53.8	51.6	54.7	54.9	65.8	65.3	62.5	61.3
E-CLASS ROOM (244(A))	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
STAFF ROOM -5(363)	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
ECE HOD (369)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
STAFF ROOM -6 (362)	67.4	67.3	68.2	66.5	66.2	68.2	68.2	68.3

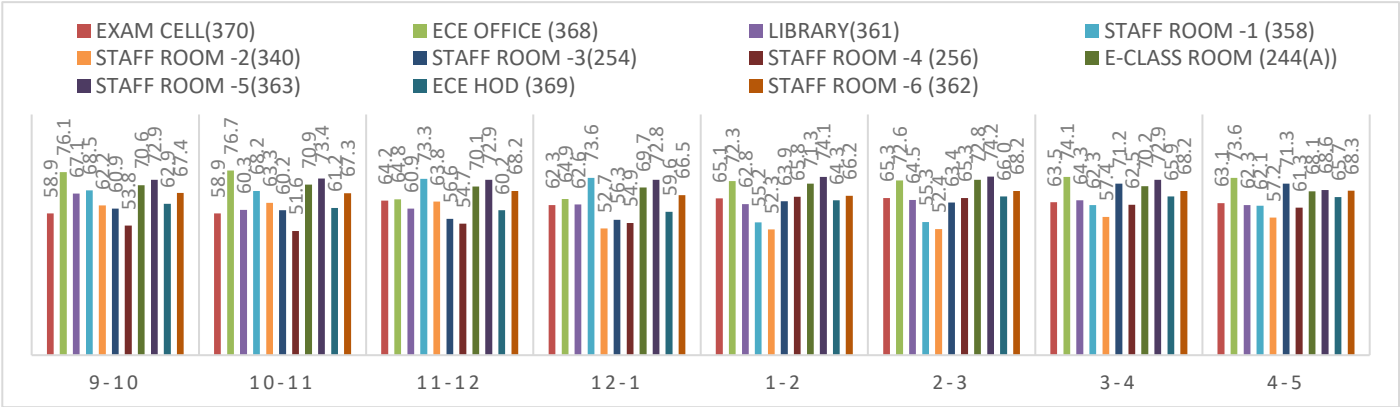

Fig113: Humidity in Staff Rooms of ECE Dept

Table114: Temperature in Class Rooms of ECE Dept

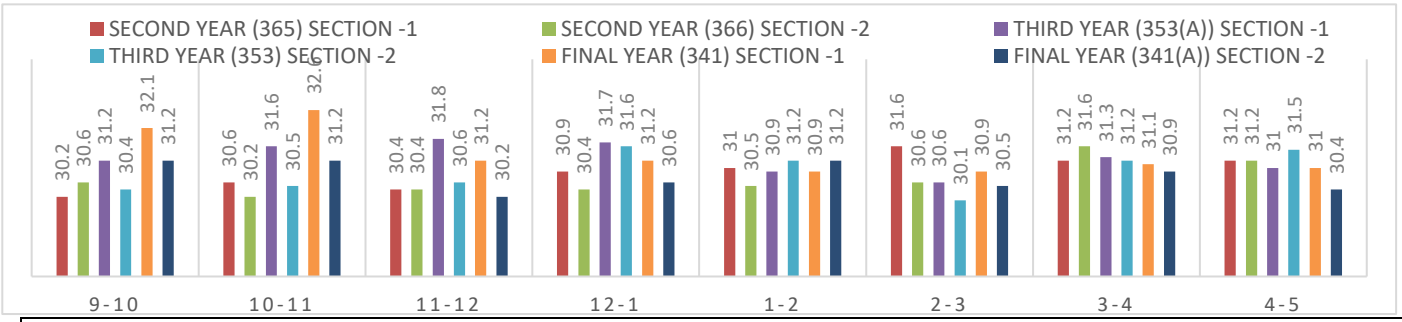

TEMPERATURE VALUES

TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (365) SECTION -1	30.2	30.6	30.4	30.9	31	31.6	31.2	31.2
SECOND YEAR (366) SECTION -2	30.6	30.2	30.4	30.4	30.5	30.6	31.6	31.2
THIRD YEAR (353(A)) SECTION -1	31.2	31.6	31.8	31.7	30.9	30.6	31.3	31
THIRD YEAR (353) SECTION -2	30.4	30.5	30.6	31.6	31.2	30.1	31.2	31.5
FINAL YEAR (341) SECTION -1	32.1	32.6	31.2	31.2	30.9	30.9	31.1	31
FINAL YEAR (341(A)) SECTION -2	31.2	31.2	30.2	30.6	31.2	30.5	30.9	30.4

Fig114: Temperature in Class Rooms of ECE Dept

Table115: Temperature in Staff Rooms of ECE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(370)	31.2	31.6	31.5	31.8	31.4	30.1	30.7	30.9
ECE OFFICE (368)	30.2	31.5	30.6	31.2	31.6	31.4	31.2	30.6
LIBRARY(361)	30.2	30.5	31.2	30.6	30.2	30.1	30.7	32.6
STAFF ROOM -1 (358)	30.2	30.6	30.4	30.9	31	31.6	31.2	31.2
STAFF ROOM -2(340)	30.6	30.2	30.4	30.4	30.5	30.6	31.6	31.2
STAFF ROOM -3(254)	30.2	31.2	31.8	31.5	31.9	31.6	31.2	30.2
STAFF ROOM -4 (256)	30.2	30.6	30.1	30.2	31.5	31	31.6	31.4
E-CLASS ROOM (244(A))	30.2	31.6	30.5	30.6	31	31.5	31.2	31.2
STAFF ROOM -5(363)	31.2	30.6	30.6	31.6	30.5	30.2	30.5	30.2
ECE HOD (369)	31.2	31.5	31.7	31	30.2	31.2	31.4	31.8
STAFF ROOM -6 (362)	30.2	31.5	31.5	31.6	31.5	31.9	31.7	31.8

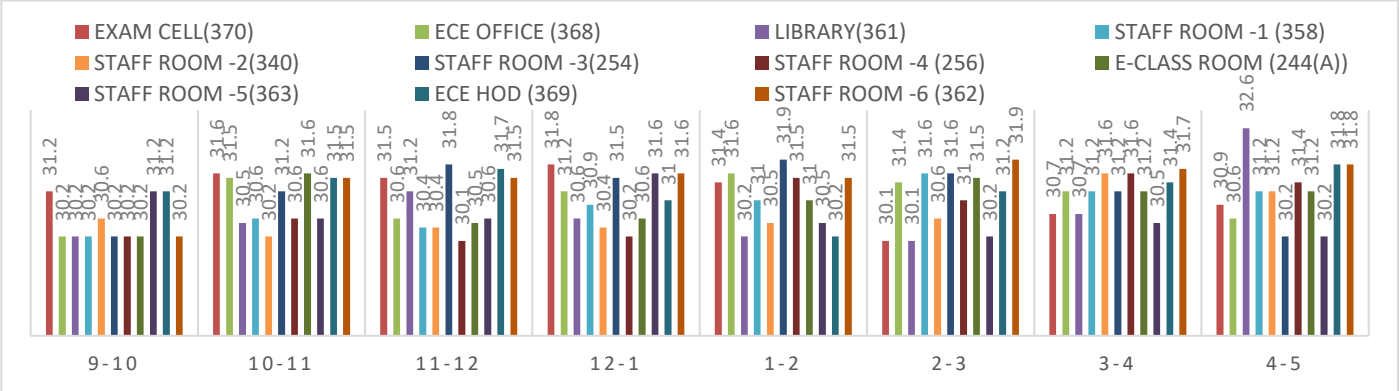

Fig115: Temperature in Staff Rooms of ECE Dept

Table116: Temperature in Laboratories of ECE Dept

TEMPERATURE VALUES	
TIME SLOT	

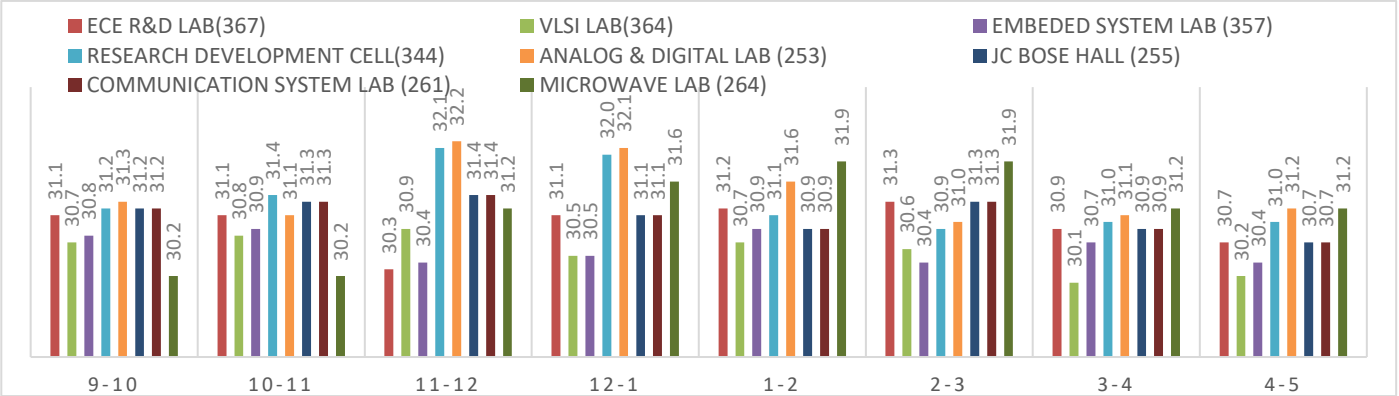

LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE R&D LAB(367)	31.1	31.1	30.3	31.1	31.2	31.3	30.9	30.7
VLSI LAB(364)	30.7	30.8	30.9	30.5	30.7	30.6	30.1	30.2
EMBEDED SYSTEM LAB (357)	30.8	30.9	30.4	30.5	30.9	30.4	30.7	30.4
RESEARCH DEVELOPMENT CELL(344)	31.2	31.4	32.1	32.0	31.1	30.9	31.0	31.0
ANALOG & DIGITAL LAB (253)	31.3	31.1	32.2	32.1	31.6	31.0	31.1	31.2
JC BOSE HALL (255)	31.2	31.3	31.4	31.1	30.9	31.3	30.9	30.7
COMMUNICATION SYSTEM LAB (261)	31.2	31.3	31.4	31.1	30.9	31.3	30.9	30.7
MICROWAVE LAB (264)	30.2	30.2	31.2	31.6	31.9	31.9	31.2	31.2

Fig: 116 Temperature in Laboratories of ECE Dept

ELECTRICAL AND ELECTRONICS ENGINEERING

Table116: CO2 in Class Rooms of EEE Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (242) SECTION -1	397	405	420	443	469	490	515	522
SECOND YEAR (242(A)) SECTION -2	592	565	518	529	552	530	505	489
THIRD YEAR (262) SECTION -1	425	488	458	470	468	482	421	393
THIRD YEAR (263) SECTION -2	430	450	440	413	440	449	445	438
FINAL YEAR (252) SECTION -1	463	479	498	489	480	593	515	493
FINAL YEAR (269) SECTION -2	471	519	502	438	435	490	445	408

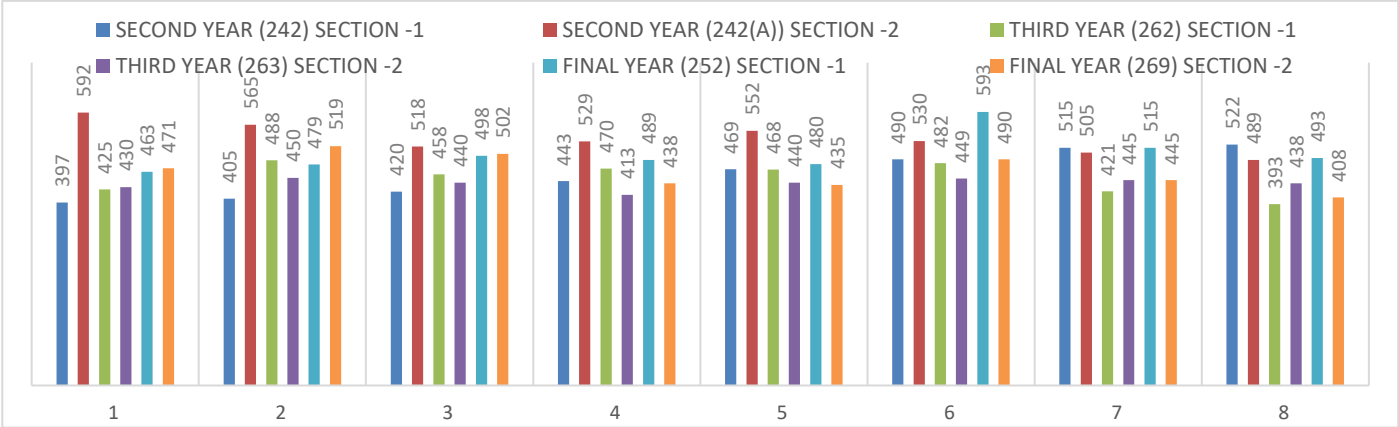

Fig116: CO2 in Class Rooms of EEE Dept

Table117: CO2 in Laboratories of EEE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5

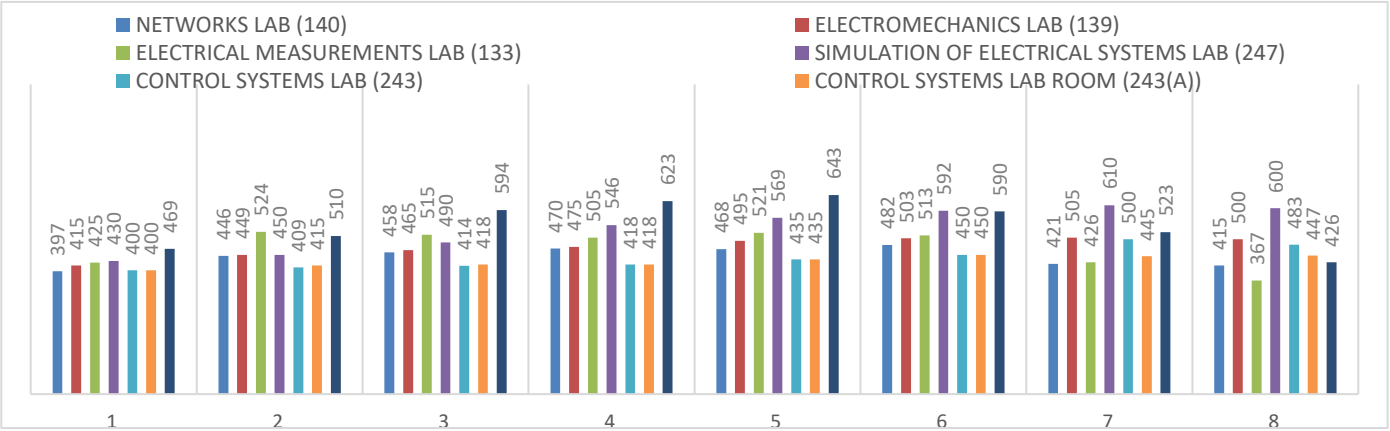

NETWORKS LAB (140)	397	446	458	470	468	482	421	415
ELECTROMECHANICS LAB (139)	415	449	465	475	495	503	505	500
ELECTRICAL MEASUREMENTS LAB (133)	425	524	515	505	521	513	426	367
SIMULATION OF ELECTRICAL SYSTEMS LAB (247)	430	450	490	546	569	592	610	600
CONTROL SYSTEMS LAB (243)	400	409	414	418	435	450	500	483
CONTROL SYSTEMS LAB ROOM (243(A))	400	415	418	418	435	450	445	447
POWER ELECTRONICS LAB (241)	469	510	594	623	643	590	523	426

Fig117: CO2 in Class Laboratories of EEE Dept

Table118: CO2 in Staff Rooms of EEE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE OFFICE (132)	443	471	480	493	509	520	505	498
LIBRARY(245)	540	594	541	467	485	493	526	570
STAFF ROOM -1 (268)	438	459	447	423	440	449	409	393
STAFF ROOM -2(260)	392	430	439	445	475	490	465	450
STAFF ROOM -3(259)	401	419	476	493	485	480	523	500
STAFF ROOM -4 (244)	449	460	469	477	480	482	459	449
STAFF ROOM -5(239)	393	402	409	420	415	410	419	418
ECE HOD (131)	515	577	585	590	590	591	585	573
STAFF ROOM -6 (251)	502	523	481	450	504	490	483	489

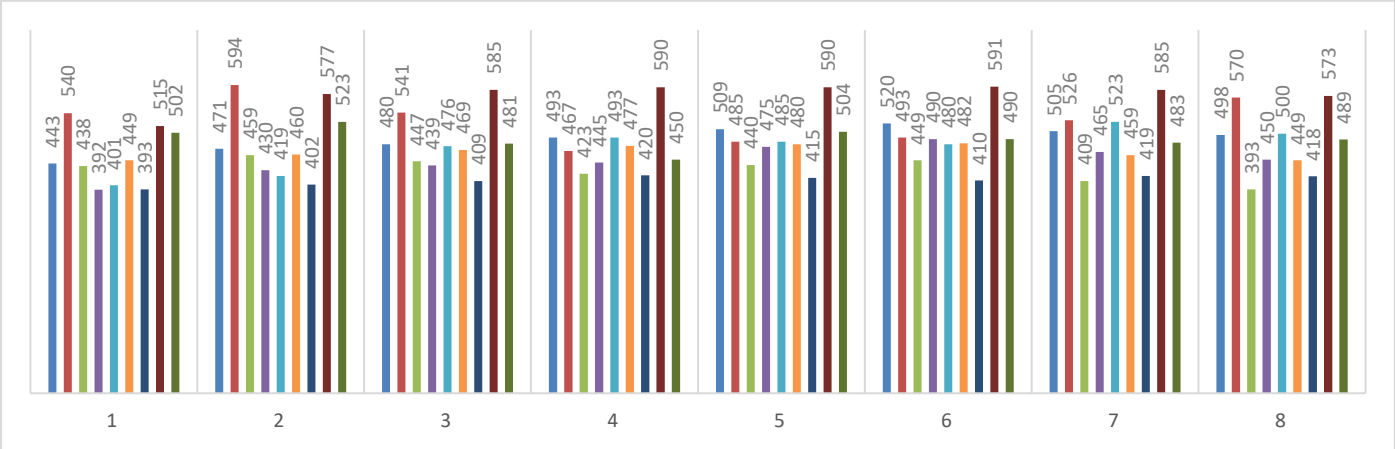

Fig118: CO2 in Staff Rooms of EEE Dept

Table119: Temperature in Class Rooms of EEE Dept

TEMPERATURE VALUES	
TIME SLOT	

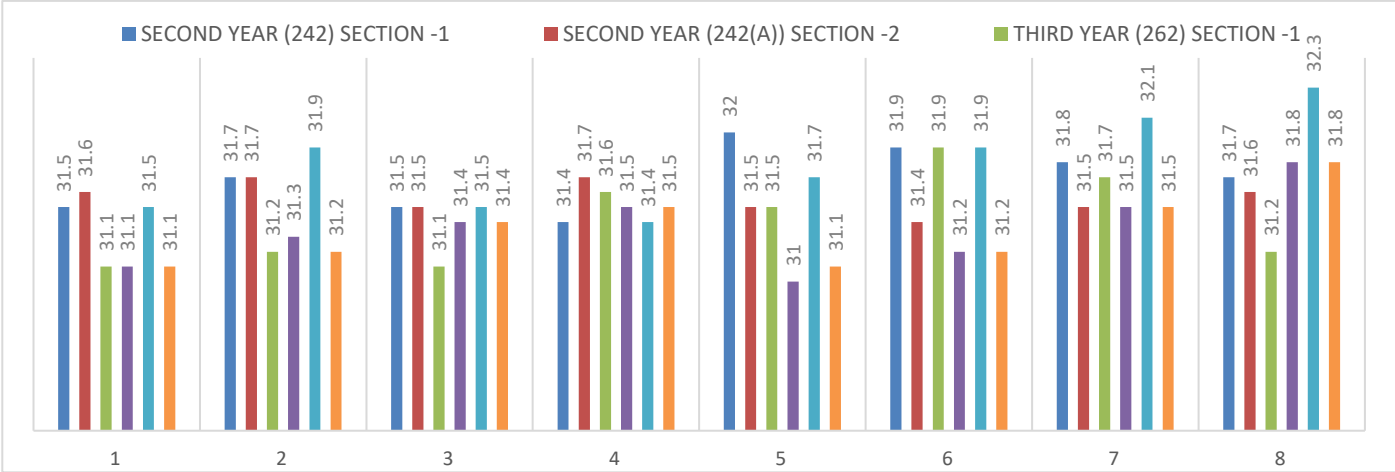

CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (242) SECTION -1	31.5	31.7	31.5	31.4	32	31.9	31.8	31.7
SECOND YEAR (242(A)) SECTION -2	31.6	31.7	31.5	31.7	31.5	31.4	31.5	31.6
THIRD YEAR (262) SECTION -1	31.1	31.2	31.1	31.6	31.5	31.9	31.7	31.2
THIRD YEAR (263) SECTION -2	31.1	31.3	31.4	31.5	31	31.2	31.5	31.8
FINAL YEAR (252) SECTION -1	31.5	31.9	31.5	31.4	31.7	31.9	32.1	32.3
FINAL YEAR (269) SECTION -2	31.1	31.2	31.4	31.5	31.1	31.2	31.5	31.8

Fig119: Temperature in Class Rooms of EEE Dept

Table120: Temperature in Laboratories of EEE Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
NETWORKS LAB (140)	30.9	30.6	30.8	30.9	30.6	30.7	30.2	30.1
ELECTROMECHANICS LAB (139)	30.1	30.1	31.6	31.8	31.7	31.6	31.5	31.3
ELECTRICAL MEASUREMENTS LAB (133)	31.6	31.7	31.5	31.7	31.5	31.2	30.9	30.1
SIMULATION OF ELECTRICAL SYSTEMS LAB (247)	31	31.2	31.6	31.6	31.7	31.8	31.9	32
CONTROL SYSTEMS LAB (243)	31.1	31.2	31.1	31.6	31.8	31.7	31.9	31.7
CONTROL SYSTEMS LAB ROOM (243(A))	31.9	31.7	31.1	31.2	31.6	31.5	31.8	31.8
POWER ELECTRONICS LAB (241)	31.1	31.2	31.1	31.3	31.5	31.9	31.7	31.8

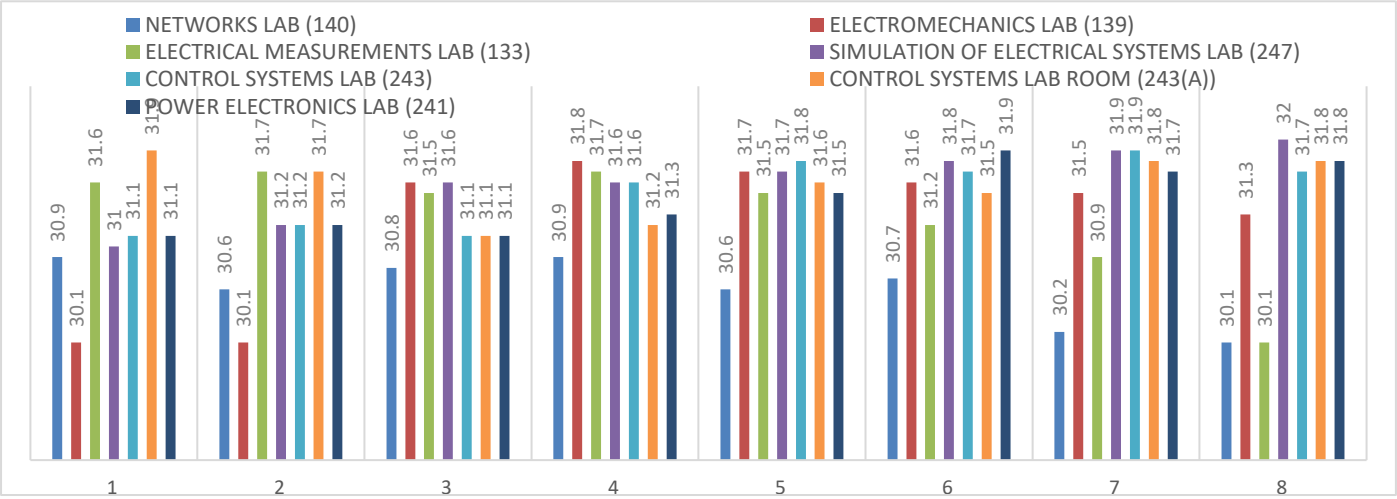

Fig120: Temperature in Laboratories of EEE Dept

Table121: Temperature in Staff Rooms of EEE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE OFFICE (132)	30.6	30.2	31.1	31	31.4	31.3	31.7	31.8
LIBRARY(245)	31.3	31.6	31.5	31.7	31.2	31.5	31.7	31.9
STAFF ROOM -1 (268)	31.1	31.1	31.3	31.5	31.2	31.6	31.2	31.2
STAFF ROOM -2(260)	31	31.2	31.3	31.5	31.7	31.9	31.5	31.6
STAFF ROOM -3(259)	31	31.1	31.3	31.2	31	31	32.3	32.8
STAFF ROOM -4 (244)	31.4	31.7	31.5	31.7	32	32.1	31.9	31.9
STAFF ROOM -5(239)	31.6	31.8	31.6	31.7	31.9	31.7	31.5	31.7
ECE HOD (131)	30.9	30.3	31.2	31.2	31	31.2	31.1	31.3

STAFF ROOM -6 (251)	31.5	31.8	31.4	31.4	31.6	31.5	31.4	31.2

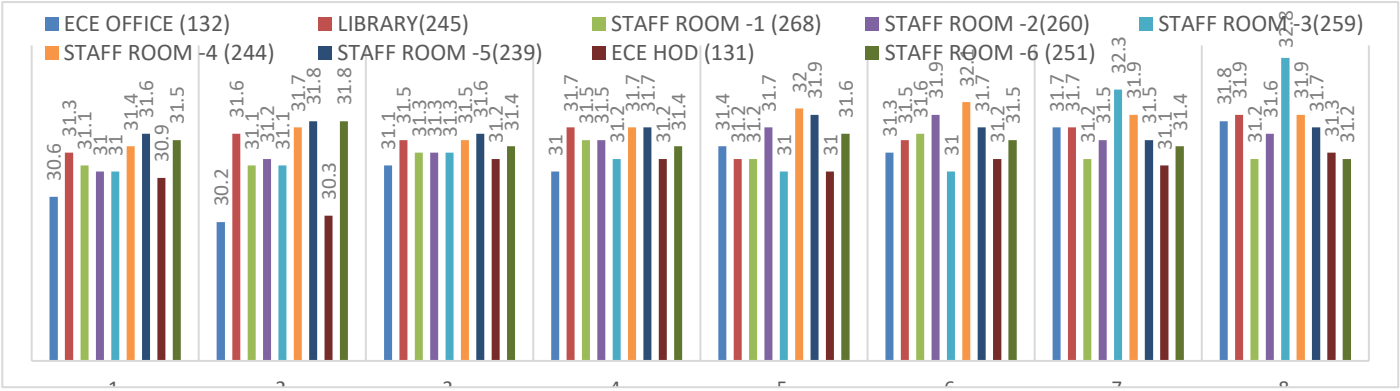

Fig121: Temperature in Staff Rooms of EEE Dept

Table122: Humidity in Class Rooms of EEE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (242) SECTION -1	64.9	64.3	64.5	69.3	64.5	67.5	67.4	66.4
SECOND YEAR (242(A)) SECTION -2	69.9	68.8	70.1	70.1	70.6	66.8	66.9	66.8
THIRD YEAR (262) SECTION -1	67.1	60.3	60.9	62.6	62.8	64.5	64.3	62.3
THIRD YEAR (263) SECTION -2	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
FINAL YEAR (252) SECTION -1	67.4	67.3	68.2	66.5	66.2	68.2	68.2	68.3
FINAL YEAR (269) SECTION -2	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7

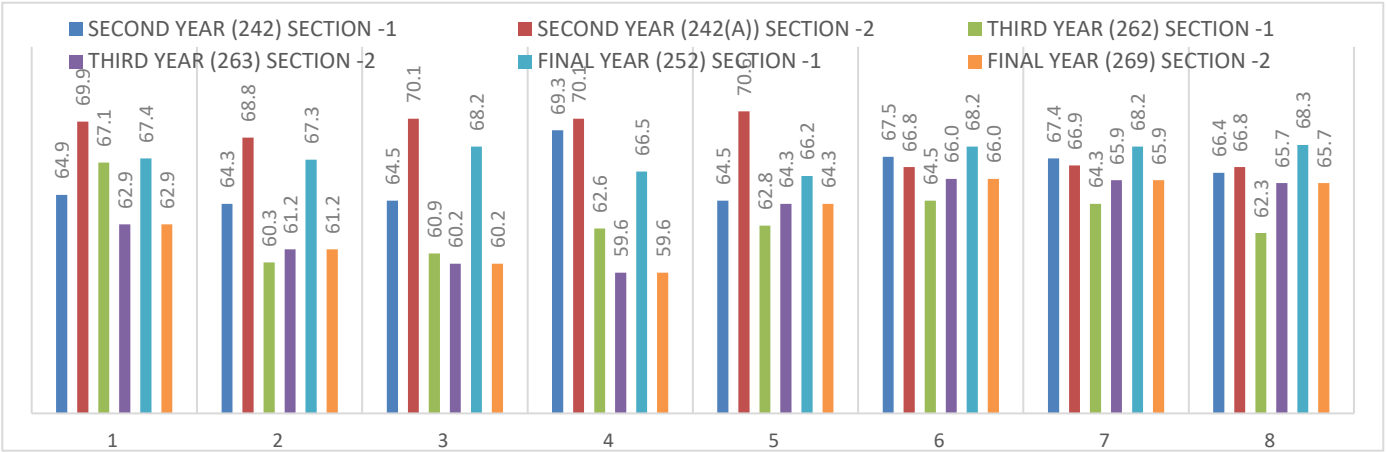

Fig122: Humidity in Class Rooms of EEE Dept

Table123: Humidity in Laboratories of EEE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
NETWORKS LAB (140)	71.6	71.8	70.6	70.9	70.1	69.7	71.3	71.9
ELECTROMECHANICS LAB (139)	64.9	69.6	64.5	67.3	67.3	68.2	69.1	69.3
ELECTRICAL MEASUREMENTS LAB (133)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
SIMULATION OF ELECTRICAL SYSTEMS LAB (247)	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
CONTROL SYSTEMS LAB (243)	71.3	70.0	70.3	70.3	71.3	71.6	71.6	69.1
CONTROL SYSTEMS LAB ROOM (243(A))	76.1	76.7	64.8	64.9	72.3	72.6	74.1	73.6
POWER ELECTRONICS LAB (241)	70.2	70.5	68.9	71.9	75.9	76.7	74.3	71.7

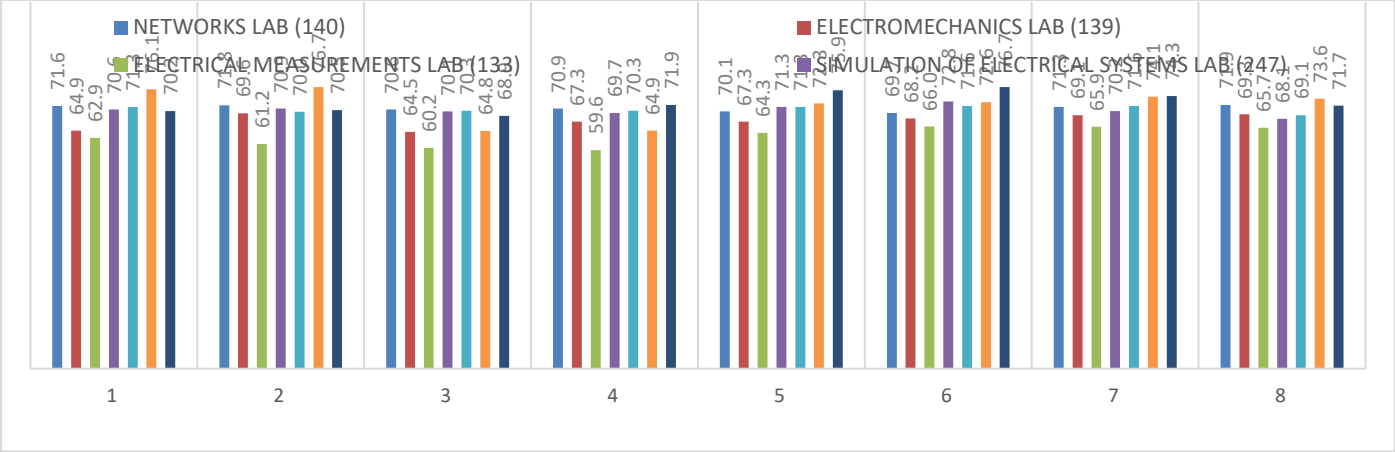

Fig123: Humidity in Laboratories of EEE Dept

Table124: Humidity in Staff Rooms of EEE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE OFFICE (132)	67.1	60.3	60.9	62.6	62.8	64.5	64.3	62.3
LIBRARY(245)	68.5	68.2	73.3	73.6	55.2	55.3	62.3	62.1
STAFF ROOM -1 (268)	62.2	63.3	63.8	52.7	52.3	52.4	57.4	57.2
STAFF ROOM -2(260)	60.9	60.2	56.6	56.3	63.9	63.4	71.2	71.3
STAFF ROOM -3(259)	66.9	67.5	67.9	67.3	66.9	66.1	65.3	65.8
STAFF ROOM -4 (244)	67.2	67.2	66.9	66.3	67.2	67.8	66.7	66.3
STAFF ROOM -5(239)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
ECE HOD (131)	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
STAFF ROOM -6 (251)	70.2	70.5	68.9	71.9	75.9	76.7	74.3	71.7

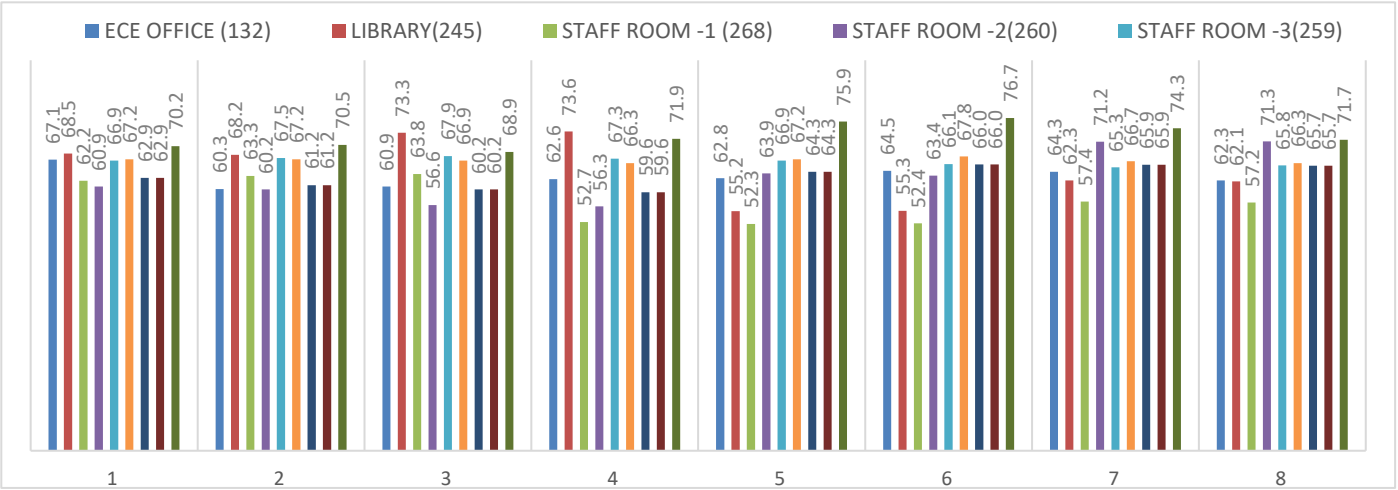

Fig124: Humidity in Staff Rooms of EEE Dept

FRESHMAN ENGINEERING

Table125: CO2 in Class Rooms of FE Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
IT FIRST YEAR (426) SECTION - 1	430	449	478	498	513	520	512	499
IT FIRST YEAR (427) SECTION - 2	474	488	498	500	516	481	470	461
CIVIL FIRST YEAR (422) SECTION -1	423	440	465	477	504	491	477	440
COMPUTER SCIENCE AND DATA SCIENCES (420)	486	501	531	555	585	533	501	490
COMPUTER SCIENCE AND MACHINE LEARNING (419)	480	521	549	539	525	520	500	488
CSE FIRST YEAR (417) SECTION - 3	560	566	590	595	531	544	550	533
CSE FIRST YEAR (411) SECTION - 2	471	483	502	601	668	566	515	471
CSE FIRST YEAR (410) SECTION - 1	544	569	577	592	600	581	572	563
MECH FIRST YEAR (408)	547	565	549	533	531	515	499	473
EEE FIRST YEAR (407)	576	555	520	535	545	540	529	508
ECE FIRST YEAR (436) SECTION - 1	490	505	520	489	490	477	461	440
ECE FIRST YEAR (437) SECTION - 2	513	490	545	500	521	598	500	461

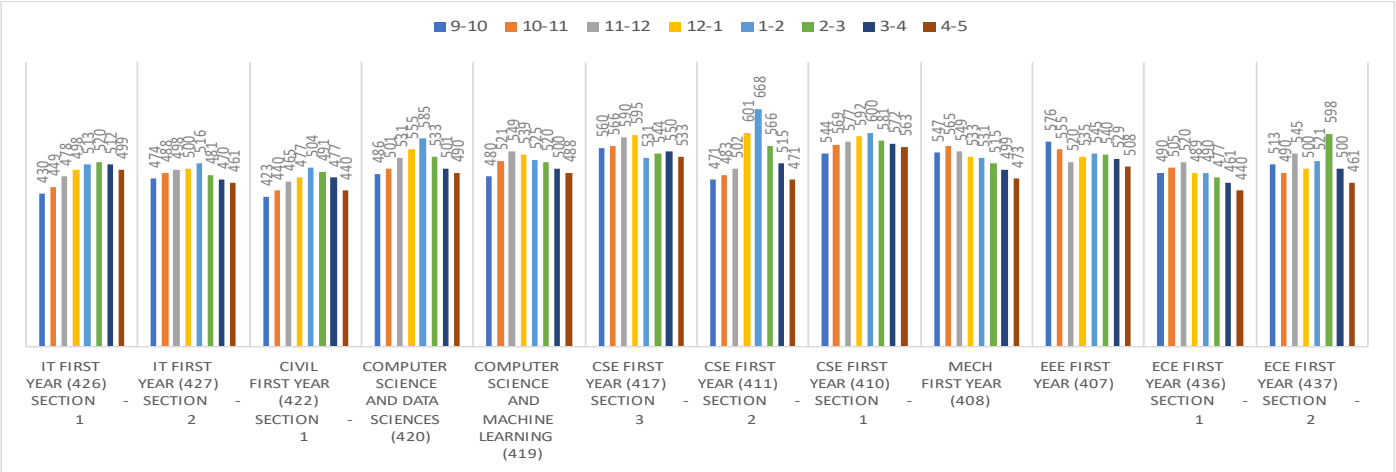

Fig125: CO2 in Class Rooms of FE Dept

Table126: CO2 in Staff Rooms of FE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
FED OFFICE (418)	546	555	599	601	630	615	600	590
FED HOD ROOM (418(A))	600	617	633	690	587	555	523	500
STAFF ROOM - 1 (416)	425	437	491	500	550	600	567	527
EXAM CELL (413)	582	514	553	560	566	555	531	519
STAFF ROOM - 2 (409)	551	535	508	500	498	490	481	477
STAFF ROOM - 3 (433)	429	429	440	493	480	439	420	400
STAFF ROOM - 4 (434)	450	460	430	470	477	480	439	430
STAFF ROOM - 5 (439)	458	461	500	530	542	500	490	466
STAFF ROOM - 6 (446)	410	425	466	499	510	487	459	410
STAFF ROOM - 7 (415)	505	524	529	550	519	498	477	449
STAFFROOM - 8 (428(A))	411	442	468	499	507	576	510	490

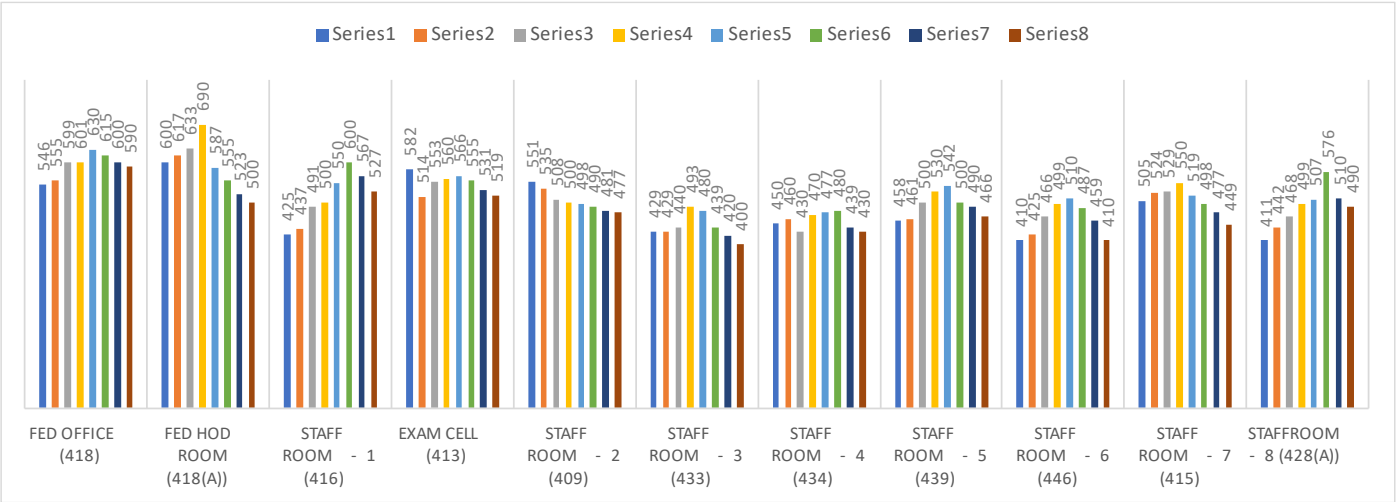

Fig126: CO2 in Staff Rooms of FE Dept

Table127: CO2 in Class Laboratories of FE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
DRAWING HALL - 1 (428)	460	465	477	489	476	471	456	444
CHEMISTRY LAB (425)	401	440	450	478	516	498	489	466
PHYSICS LAB (424)	435	576	508	488	467	440	500	451
PROBLEM SOLVING AND PROGRAMMING LAB (414)	743	819	957	1006	1097	996	945	889
LIFE SCIENCES LAB (438)	422	439	450	500	590	530	500	474
DESIGN THINKING AND PRODUCT INNOVATION LAB (459)	410	428	470	490	506	475	455	429
ENGISH LAB (462)	891	956	1000	891	1125	1325	1296	900
DRAWING HALL - 2 (422)	468	461	460	453	46	493	447	440

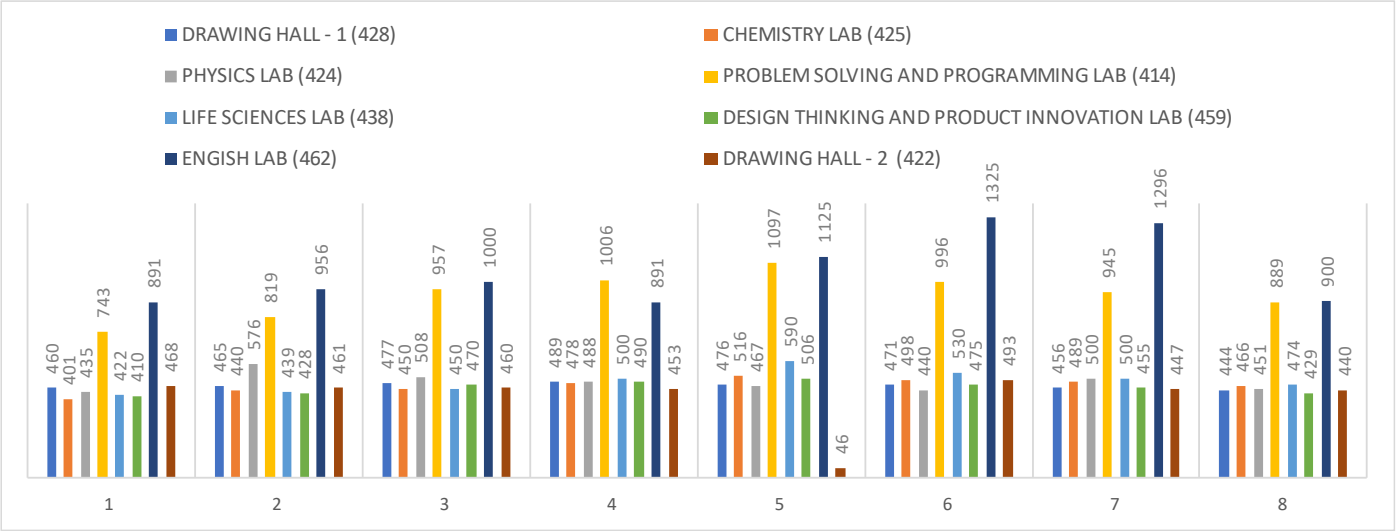

Fig127: CO2 in Class Laboratories of FE Dept

Table128: Humidity in Class Rooms of FE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
IT FIRST YEAR (426) SECTION - 1	70.4	70.4	70.2	70.1	69.6	69.3	70.1	70.9
IT FIRST YEAR (427) SECTION - 2	70.1	70.0	69.5	69.0	68.9	68.3	70.1	70.3
CIVIL FIRST YEAR (422) SECTION -1	73.9	72.1	72.6	71.9	71.3	71.1	70.6	68.9
COMPUTER SCIENCE AND DATA SCIENCES (420)	71.2	71.2	71.2	71.1	71.0	70.9	71.0	71.5
COMPUTER SCIENCE AND MACHINE LEARNING (419)	71.0	71.2	71.2	71.5	71.4	71.0	70.9	71.2
CSE FIRST YEAR (417) SECTION - 3	72.9	72.6	72.5	72.1	73.1	72.9	72.1	72.1
CSE FIRST YEAR (411) SECTION - 2	71.3	71.1	71.9	72.1	72.0	72.1	72.1	72.0
CSE FIRST YEAR (410) SECTION - 1	74.9	74.6	74.0	71.5	71.5	72.1	72.2	73.1
MECH FIRST YEAR (408)	73.2	74.1	74.1	73.6	73.1	74.5	74.6	74.9
EEE FIRST YEAR (407)	73.2	73.1	73.4	73.1	72.3	72.1	71.9	72.2
ECE FIRST YEAR (436) SECTION - 1	69.0	69.1	69.4	69.5	72.9	72.4	71.3	71.2
ECE FIRST YEAR (437) SECTION - 2	70.1	69.3	69.1	69.8	71.0	71.5	72.2	72.6

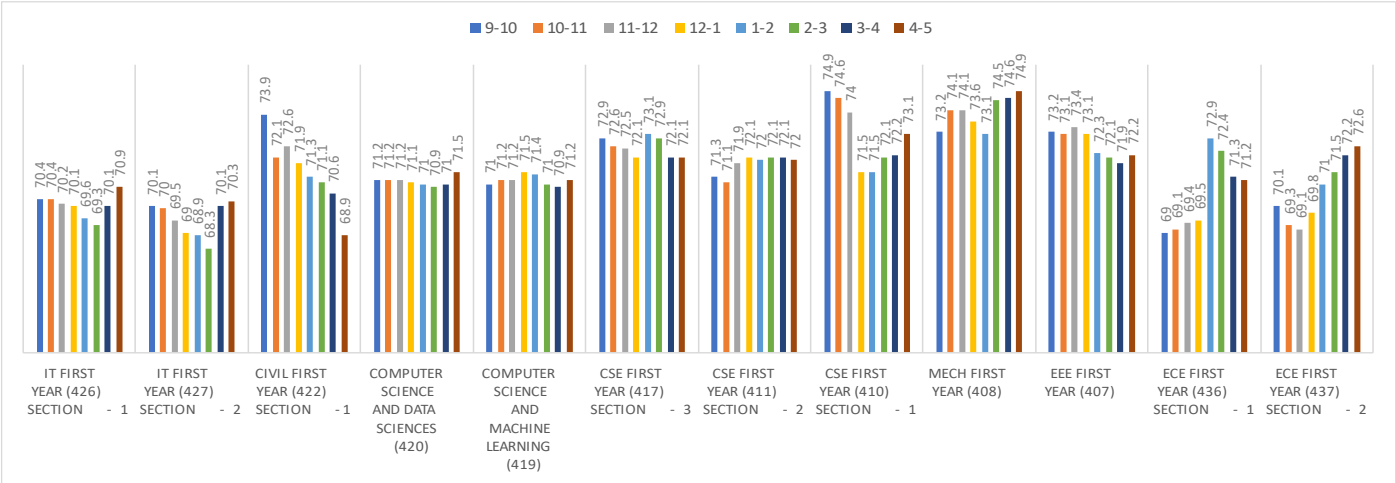

Fig128: Fig: Humidity in Class Rooms of FE Dept

Table129: Humidity in Staff Rooms of FE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
FED OFFICE (418)	75.2	75.3	75.5	74.2	74.1	74.9	75.1	74.9
FED HOD ROOM (418(A))	72.5	75.6	72.4	72.1	72.4	72.3	72.1	72.0
STAFF ROOM - 1 (416)	73.6	73.6	73.5	73.2	73.7	73.8	74.1	73.2
EXAM CELL (413)	72.1	72.2	71.9	71.5	71.6	71.7	71.9	72.3
STAFF ROOM - 2 (409)	74.6	74.7	74.7	74.8	75.1	75.7	74.7	73.1
STAFF ROOM - 3 (433)	69.6	69.5	69.3	70.1	70.1	70.2	70.3	70.6
STAFF ROOM - 4 (434)	69.6	69.8	69.9	71.7	71.4	70.6	70.0	71.1
STAFF ROOM - 5 (439)	68.7	68.2	71.6	71.6	70.9	70.2	70.9	71.1
STAFF ROOM - 6 (446)	69.7	69.9	69.9	70.2	68.3	69.2	69.8	71.4
STAFF ROOM - 7 (415)	70.1	70.2	70.2	70.9	70.8	71.2	69.4	69.8
STAFF ROOM - 8 (428(A))	70.7	70.9	71.3	71.3	70.1	69.0	69.5	70.6

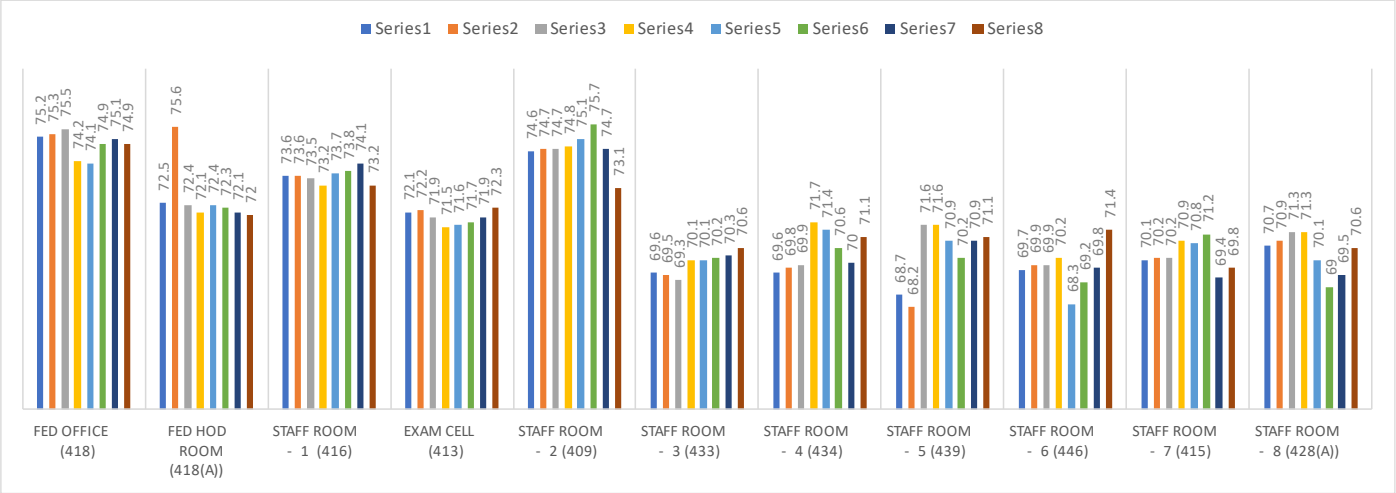

Fig129: Humidity in Staff Rooms of FE Dept

Table130: Humidity in Laboratories of FE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
DRAWING HALL - 1 (428)	73.1	73.4	73.2	73.6	74.1	74.2	74.1	74.7
CHEMISTRY LAB (425)	69.4	69.5	69.5	69.1	68.7	68.1	62.6	67.1
PHYSICS LAB (424)	72.3	72.5	72.7	72.8	69.2	69.6	70.1	70.9
PROBLEM SOLVING AND PROGRAMMING LAB (414)	56.8	56.9	57.1	57.6	51.1	52.3	52.6	52.9
LIFE SCIENCES LAB (438)	68.7	68.5	68.2	71.6	70.5	70.4	70.7	70.0
DESIGN THINKING AND PRODUCT INNOVATION LAB (459)	71.3	70.9	70.5	70.2	69.8	64.8	71.2	71.1
ENGISH LAB (462)	61.8	6.3	62.5	61.9	61.8	62.5	61.7	61.2
DRAWING HALL - 2 (422)	68.9	68.5	69.6	69.8	69.7	69.9	68.1	68.9

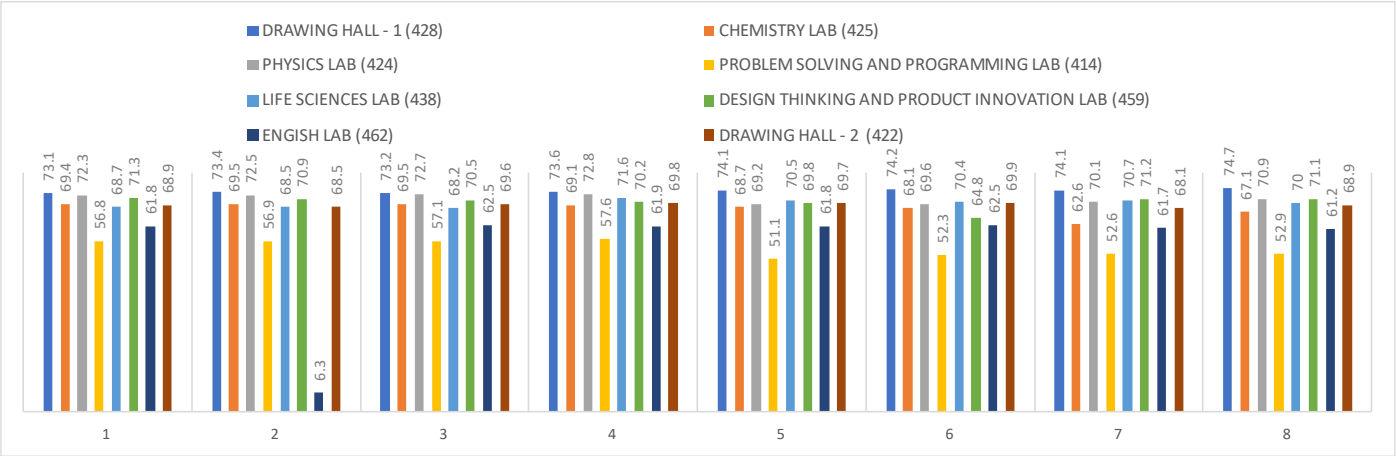

Fig130: Humidity in Laboratories of FE Dept

Table131: Temperature in Class Rooms of FE Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
IT FIRST YEAR (426) SECTION - 1	30.6	30.5	29.8	30.3	30.3	30.2	30.1	30.5
IT FIRST YEAR (427) SECTION - 2	29.3	29.1	28.3	28.1	28.2	28.6	29.4	29.1
CIVIL FIRST YEAR (422) SECTION -1	31.2	31.2	31.1	31.5	31.4	30.7	30.9	30.7
COMPUTER SCIENCE AND DATA SCIENCES (420)	31.2	31.3	31.5	30.7	30.7	30.8	30.8	30.9
COMPUTER SCIENCE AND MACHINE LEARNING (419)	31.3	31.5	31.9	32.1	32.1	32.3	31.2	31.1
CSE FIRST YEAR (417) SECTION - 3	28.6	29.1	29.5	29.8	30.7	30.7	30.1	30.5
CSE FIRST YEAR (411) SECTION - 2	30.8	30.5	30.6	30.6	30.9	31.0	31.1	31.4
CSE FIRST YEAR (410) SECTION - 1	30.7	30.1	31.3	31.2	31.3	31.4	30.6	30.9
MECH FIRST YEAR (408)	30.9	30.6	30.5	30.4	30.4	30.4	30.1	30.2
EEE FIRST YEAR (407)	30.7	30.1	31.3	31.2	31.3	31.4	30.6	30.9
ECE FIRST YEAR (436) SECTION - 1	29.6	30.1	30.2	30.6	30.9	31.1	31.1	31.4
ECE FIRST YEAR (437) SECTION - 2	30.7	30.1	31.3	31.2	31.3	31.4	30.6	30.9

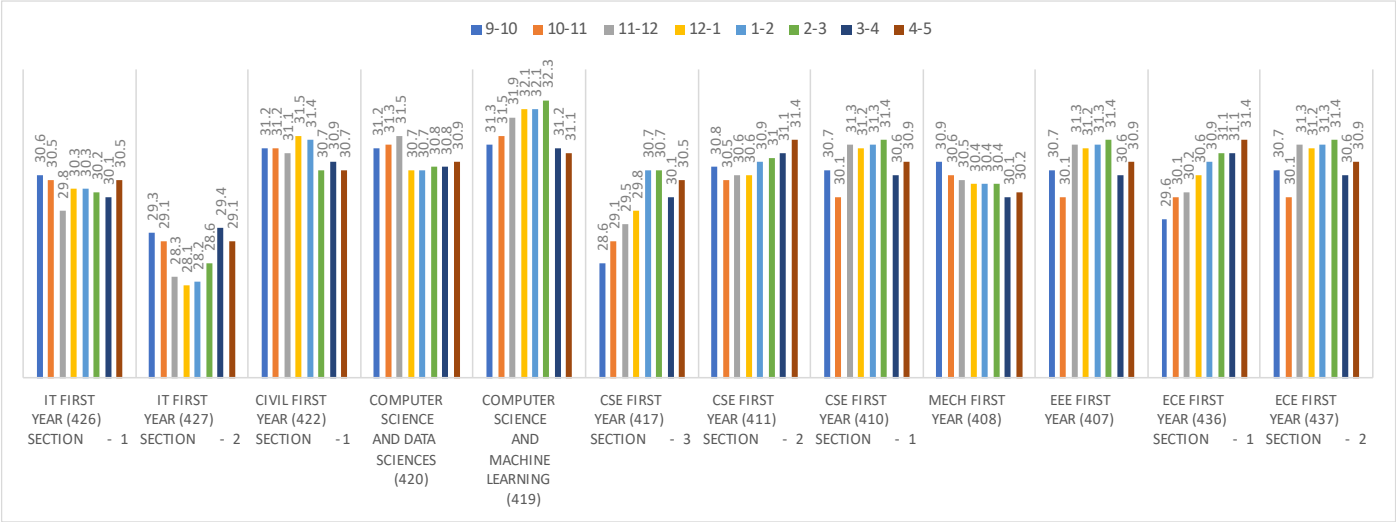

Fig131: Temperature in Class Rooms of FE Dept

Table132: Temperature in Staff Rooms of FE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
FED OFFICE (418)	31.2	31.2	31.1	31.5	31.4	30.7	30.9	30.7
FED HOD ROOM (418(A))	31.2	31.2	31.1	31.5	31.4	30.7	30.9	30.7
STAFF ROOM - 1 (416)	31.2	31.3	31.5	30.7	30.7	30.8	30.8	30.9
EXAM CELL (413)	31.3	31.5	31.9	32.1	32.1	32.3	31.2	31.1
STAFF ROOM - 2 (409)	29.2	29.9	30.5	30.5	30.6	31.2	31.6	30.3
STAFF ROOM - 3 (433)	30.6	30.5	29.8	30.3	30.3	31.1	30.5	30.0
STAFF ROOM - 4 (434)	29.3	29.1	28.3	28.1	28.2	30.5	30.9	30.5
STAFF ROOM - 5 (439)	30.1	30.2	30.5	30.4	30.4	30.4	30.1	30.2
STAFF ROOM - 6 (446)	30.6	30.9	31.5	31.3	31.0	30.9	30.7	30.6
STAFF ROOM - 7 (415)	31.1	31.4	30.2	30.9	30.9	31.1	31.1	31.4
STAFFROOM - 8 (428(A))	30.6	30.9	29.1	31.3	31.5	31.7	31.5	30.0

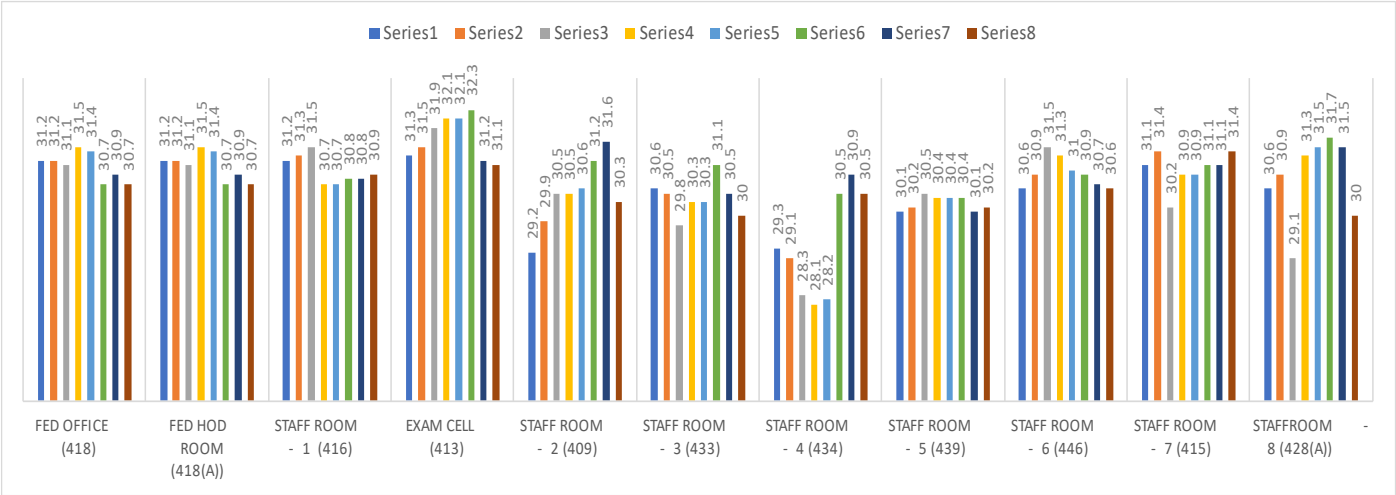

Fig132: Temperature in Staff Rooms of FE Dept

Table133: Temperature in Laboratories of FE Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
DRAWING HALL - 1 (428)	30.6	30.9	29.1	31.3	31.5	31.7	31.5	30.0
CHEMISTRY LAB (425)	30.1	30.2	30.5	30.4	30.4	30.1	30.1	30.2
PHYSICS LAB (424)	30.6	30.9	31.5	31.3	31.0	31.0	31.1	31.4
PROBLEM SOLVING AND PROGRAMMING LAB (414)	29.2	29.9	30.5	30.5	30.6	31.2	31.6	30.3
LIFE SCIENCES LAB (438)	30.1	30.1	30.2	30.6	30.9	31.2	31.1	30.2
DESIGN THINKING AND PRODUCT INNOVATION LAB (459)	30.2	30.2	30.3	30.5	30.7	31.2	30.9	31.0
ENGISH LAB (462)	28.6	29.1	29.5	29.8	30.7	30.7	30.1	30.5
DRAWING HALL - 2 (422)	31.5	31.6	31.6	31.8	31.7	31.1	30.5	30.0

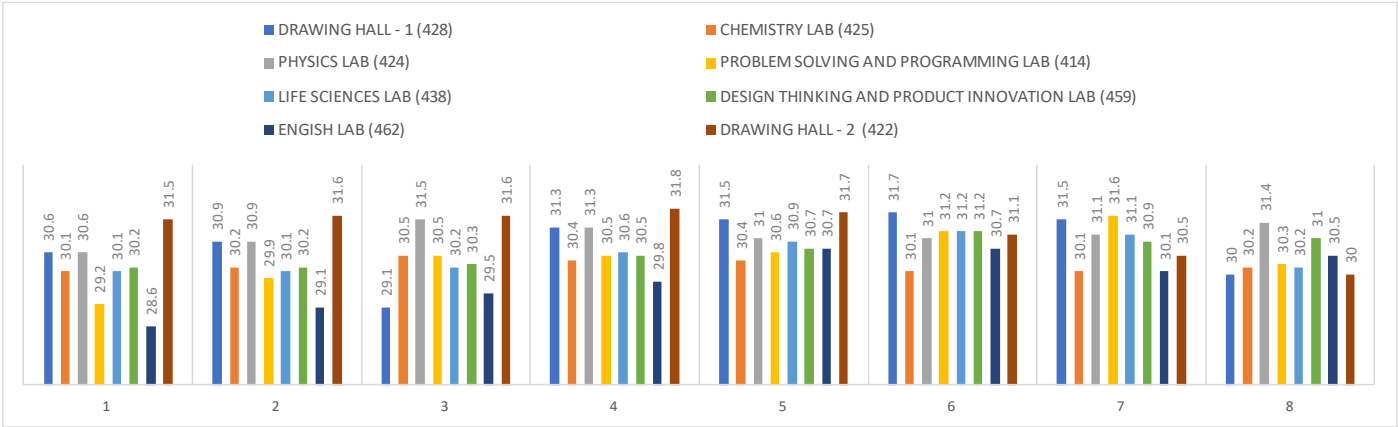

Fig133: Temperature in Laboratories of FE Dept

MASTER OF BUSINESS ADMINISTRATION

Table134: CO2 in Class Rooms of MBA Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA FIRST YEAR (460)	488	495	500	515	529	511	503	490
MBA SECOND YEAR (466)	531	555	577	581	561	535	539	521
MBA HR (461)	468	479	492	500	515	501	493	485

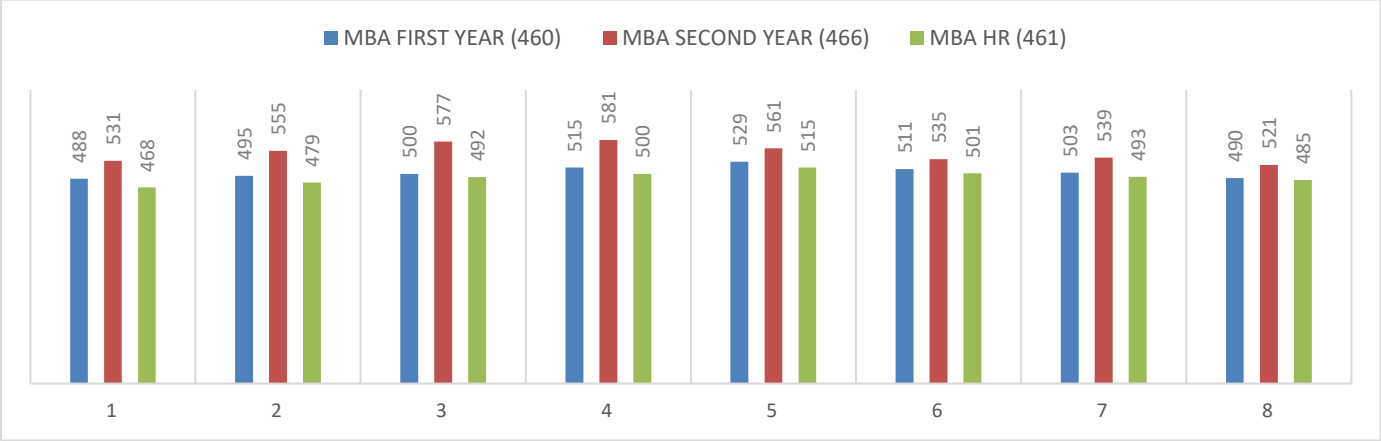

Fig134: CO2 in Class Rooms of MBA Dept

Table135: CO2 in Staff Rooms of MBA Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA HOD ROOM (464)	505	525	528	539	550	565	555	540
MBA OFFICE (463)	478	480	489	499	510	500	489	480
STAFF ROOM - 1 (451)	439	455	466	484	471	455	453	440
STAFF ROOM - 2 (453)	447	461	467	460	500	491	483	467

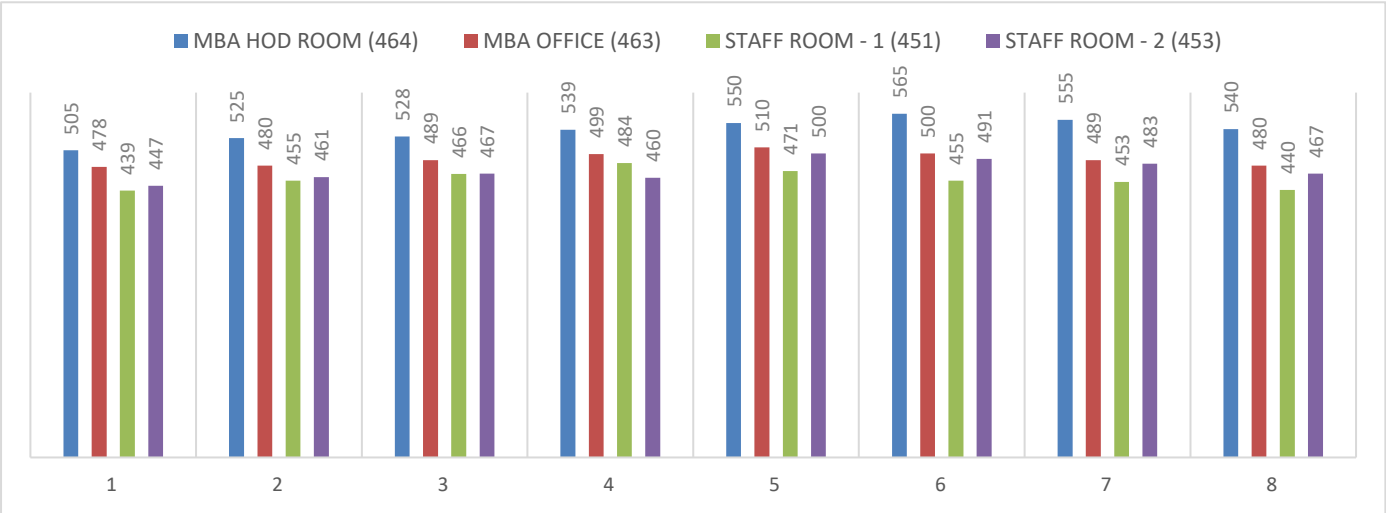

Fig135: CO2 in Staff Rooms of MBA Dept

Table136: Humidity in Class Rooms of MBA Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA FIRST YEAR (460)	68.1	68.3	69.3	68.3	68.5	68.9	69.1	69.9
MBA SECOND YEAR (466)	69.1	68.6	68.7	69.3	68.3	68.9	69.1	70.1
MBA HR (461)	67.5	68.7	68.6	68.9	69.1	70.2	70.2	71.0

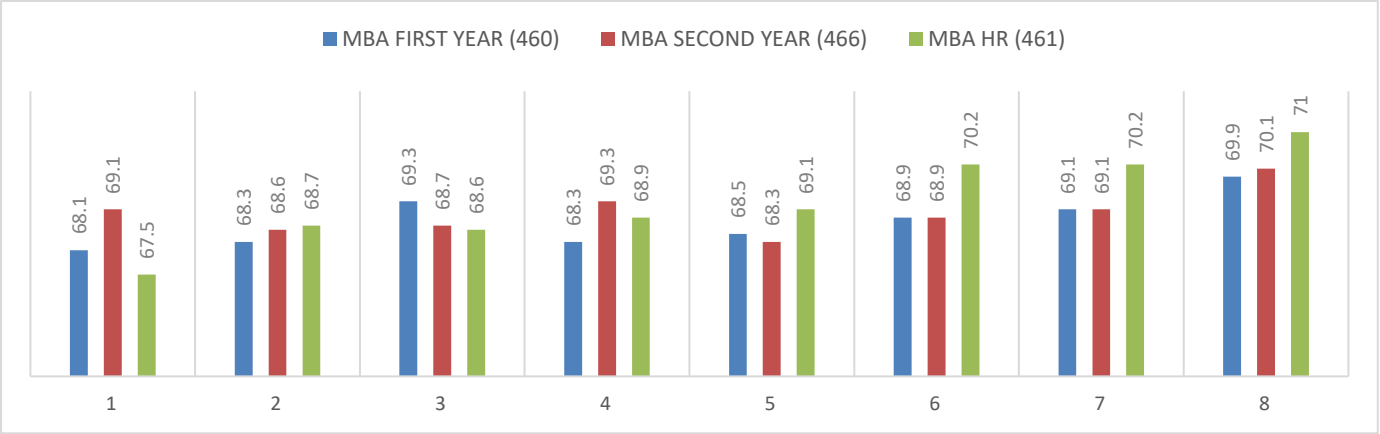

Fig136: Humidity in Class Rooms of MBA Dept

Table137: Humidity in Staff Rooms of MBA Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA HOD ROOM (464)	70.2	70.2	70.1	70.2	70.1	70.1	70.0	71.0
MBA OFFICE (463)	69.8	69.5	69.1	69.1	70.1	70.2	69.7	69.9
STAFF ROOM - 1 (451)	68.9	68.5	68.4	68.1	68.9	68.2	68.2	68.5
STAFF ROOM - 2 (453)	69.1	69.3	69.3	68.9	68.5	68.3	69.1	69.6

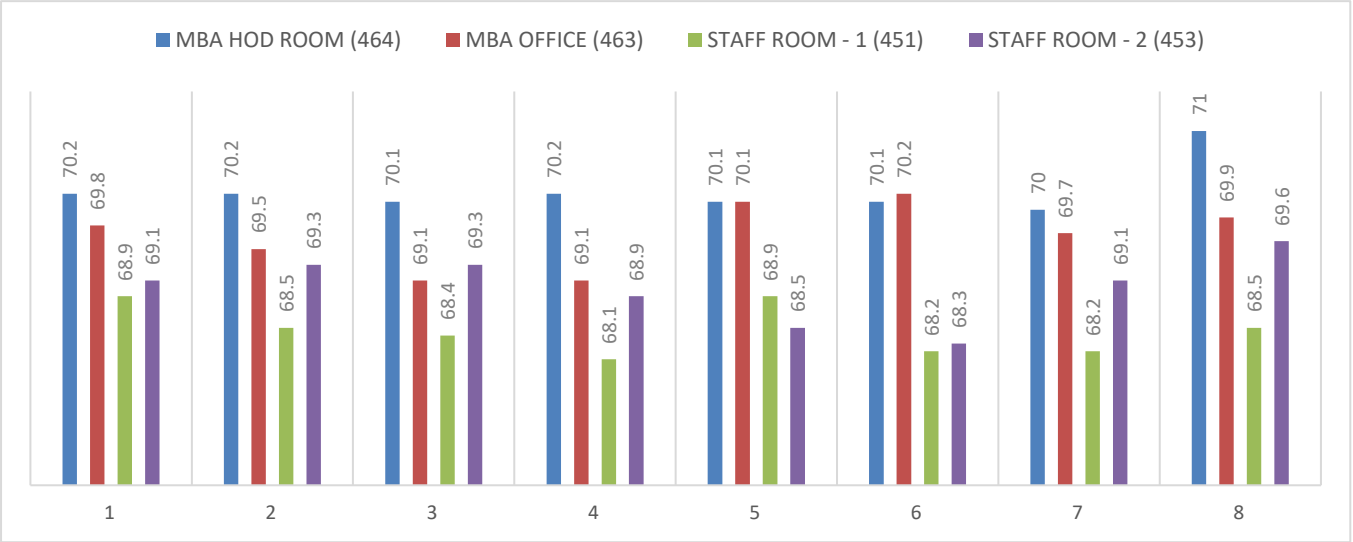

Fig137: Humidity in Staff Rooms of MBA Dept

PHASE 3- Summer Season
CIVIL ENGINEERING

Table140: CO2 in Class Rooms of Civil Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (155)	507	525	531	631	586	540	515	500
THIRD YEAR (154)	527	592	650	691	645	598	540	515
FINAL YEAR (143)	1391	1307	1201	1110	947	800	762	654

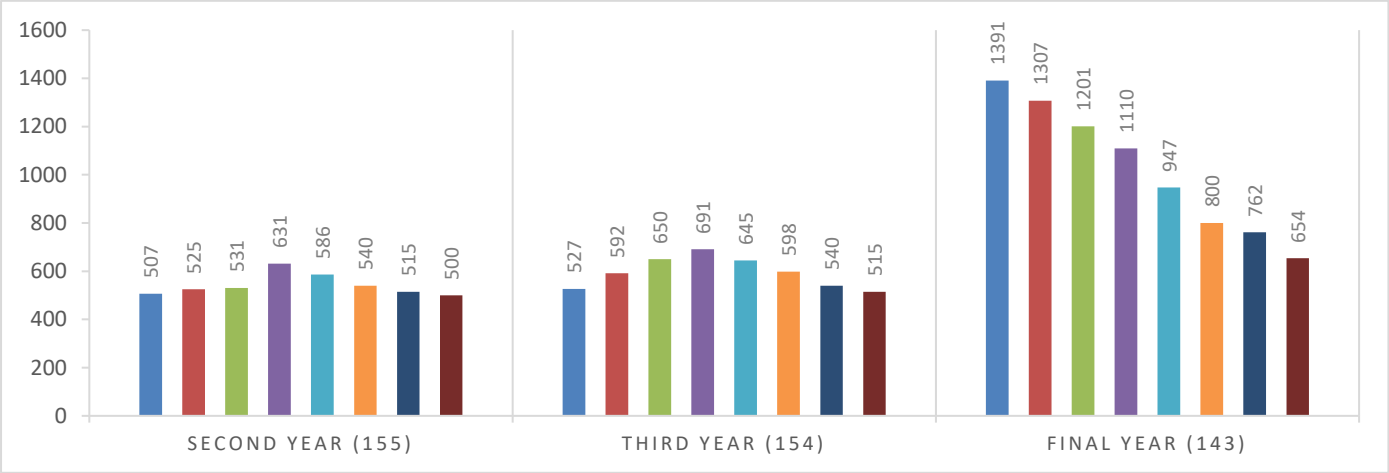

Fig140: CO2 in Class Rooms of Civil Dept

Table141: CO2 in Staff Rooms of Civil Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CIVIL HOD ROOM (158)	495	540	535	520	525	597	610	555
CIVIL OFFICE ROOM (157)	413	420	520	555	580	545	515	480
STAFF ROOM -1 (153(A))	443	486	539	575	600	576	549	500
STAFF ROOM -2 (153(B))	448	420	432	400	420	433	415	334
STAFF ROOM -3 (145)	496	538	590	615	576	566	546	520
TUTORIAL ROOM (152)	500	535	576	653	621	589	559	532
EXAM CELL (144)	510	501	490	515	522	525	529	539
CIVIL LIBRARY (151)	510	531	550	537	529	528	540	543

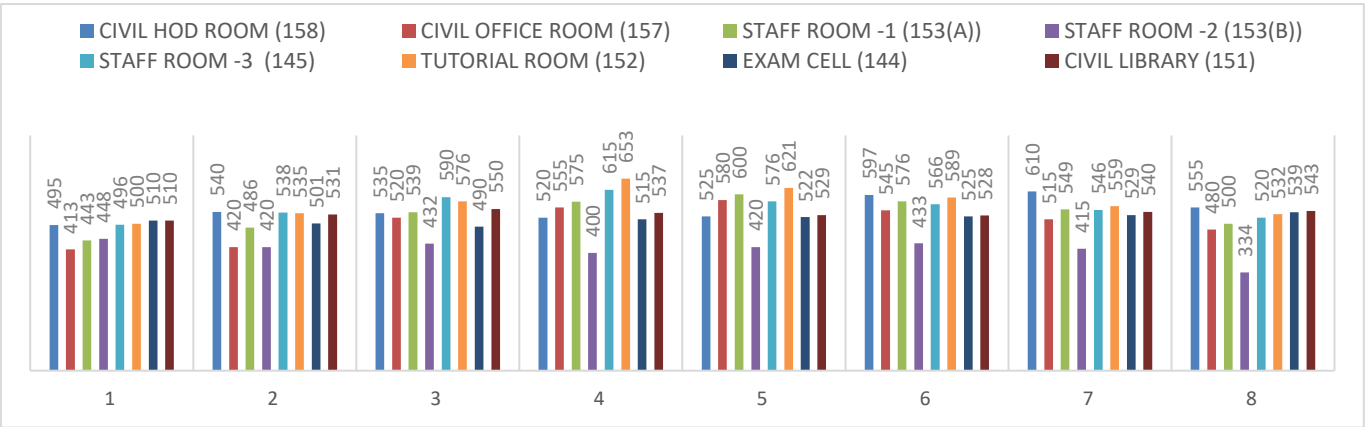

Fig141: CO2 in Staff Rooms of Civil Dept

Table142: CO2 in Class Rooms of Civil Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CONCRTE TECHNOLOGY LAB (156)	590	600	585	535	540	515	501	480
TRANSPORTATION ENGINEERING LAB (153)	443	450	495	530	555	600	545	510
GEOTECHNICAL LAB (146)	430	456	486	515	530	565	573	539
COMPUTER AIDED DESIGN LAB (249)	610	645	690	710	650	589	580	550
FLUID MECHANICS LAB (119)	618	588	559	538	590	616	632	654
ENVIRONMENTAL ENGINEERING LAB - 1	680	635	615	577	539	531	520	515
ENVIRONMENTAL ENGINEERING LAB ROOM -2	583	595	621	635	640	620	577	535

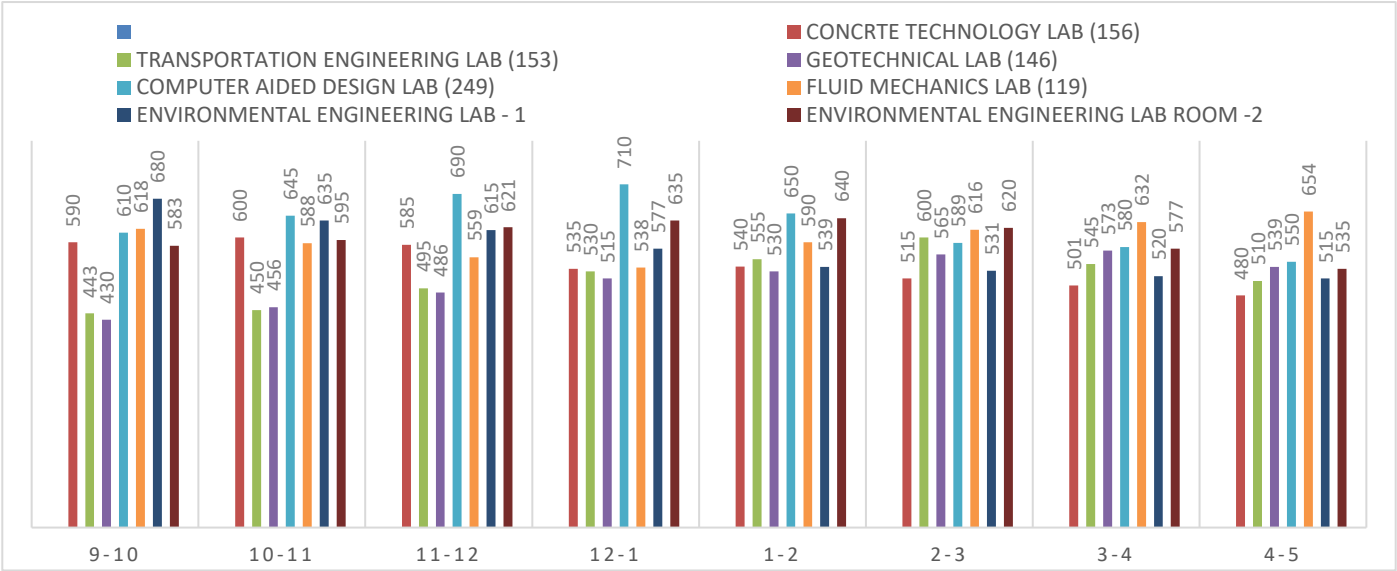

Fig142: CO2 in Class Rooms of Civil Dept

Table143: Humidity in Class Rooms of Civil Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (155)	72.5	72.6	72.5	72.6	73.6	73.2	72.6	72.5
THIRD YEAR (154)	72.9	72.8	72.7	71.9	71.6	71	70.9	70.6
FINAL YEAR (143)	72.9	72.8	71.3	70.2	71.1	71.9	71.1	71.2

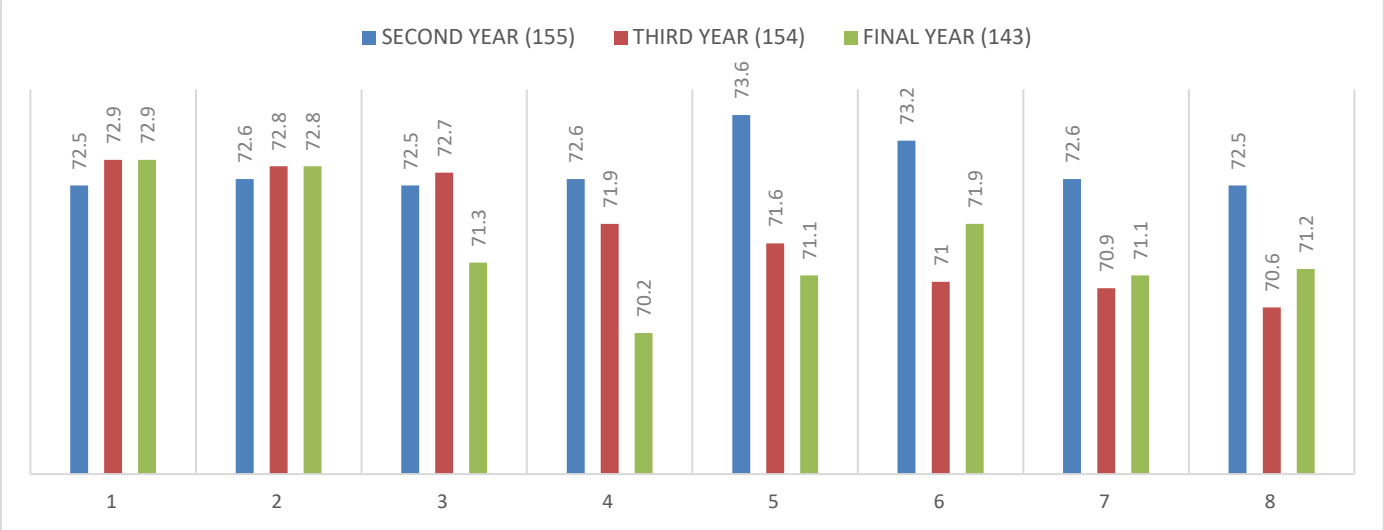

Fig143: Humidity in Class Rooms of Civil Dept

Table144: Humidity in Laboratories of Civil Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CONCRTE TECHNOLOGY LAB (156)	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
TRANSPORTATION ENGINEERING LAB (153)	71.8	71.3	70.5	69.8	69.4	69.5	69.1	69.3
GEOTECHNICAL LAB (146)	68.6	68.1	69.4	69.3	67.9	67.3	67.3	66.6
COMPUTER AIDED DESIGN LAB (249)	72	71.9	72.9	72.8	74.1	72.1	72.9	68.6
FLUID MECHANICS LAB (119)	69.9	68.9	67.9	67.3	69.2	69.2	69.9	69.4
ENVIRONMENTAL ENGINEERING LAB - 1	70.1	69.9	68.9	68.1	68.5	68.2	70.6	70.3
ENVIRONMENTAL ENGINEERING LAB ROOM - 2	72.1	71.9	71.2	73.5	71.6	71.1	70.8	71

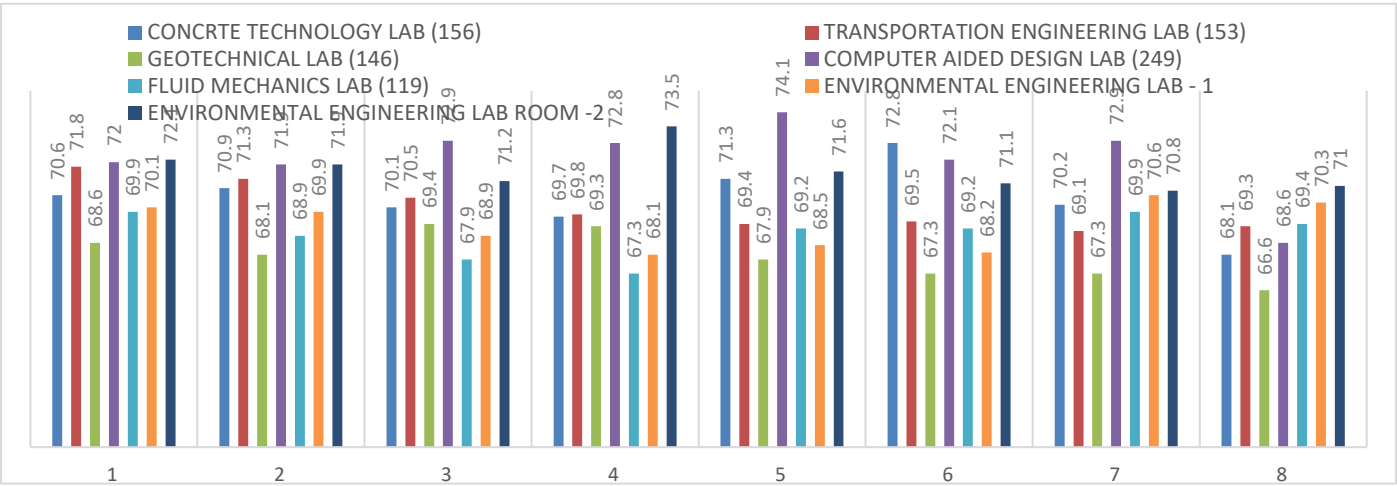

Fig144: Humidity in Laboratories of Civil Dept

Table145: Humidity in Staff Rooms of Civil Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CIVIL HOD ROOM (158)	72.1	72.1	71.9	71.6	71.9	71.9	71.4	71.1
CIVIL OFFICE ROOM (157)	70.1	70.6	70.2	71	70.9	70.7	71.3	71.1
STAFF ROOM -1 (153(A))	71.1	71.5	71.4	71.3	71.1	70.9	71	71
STAFF ROOM -2 (153(B))	70.2	70.5	71.2	71.9	71.9	72.1	71.6	71.7
STAFF ROOM -3 (145)	71.3	71.5	71.1	69.3	71.9	72.8	70.9	68.4
TUTORIAL ROOM (152)	72.1	72.3	71.4	71.1	72.1	71.6	71.7	72.1
EXAM CELL (144)	71.9	71.4	69.9	69.6	72.1	72.6	70.9	70.9
CIVIL LIBRARY (151)	70.1	70.3	70.9	71.2	70.9	70.7	70.6	71.2

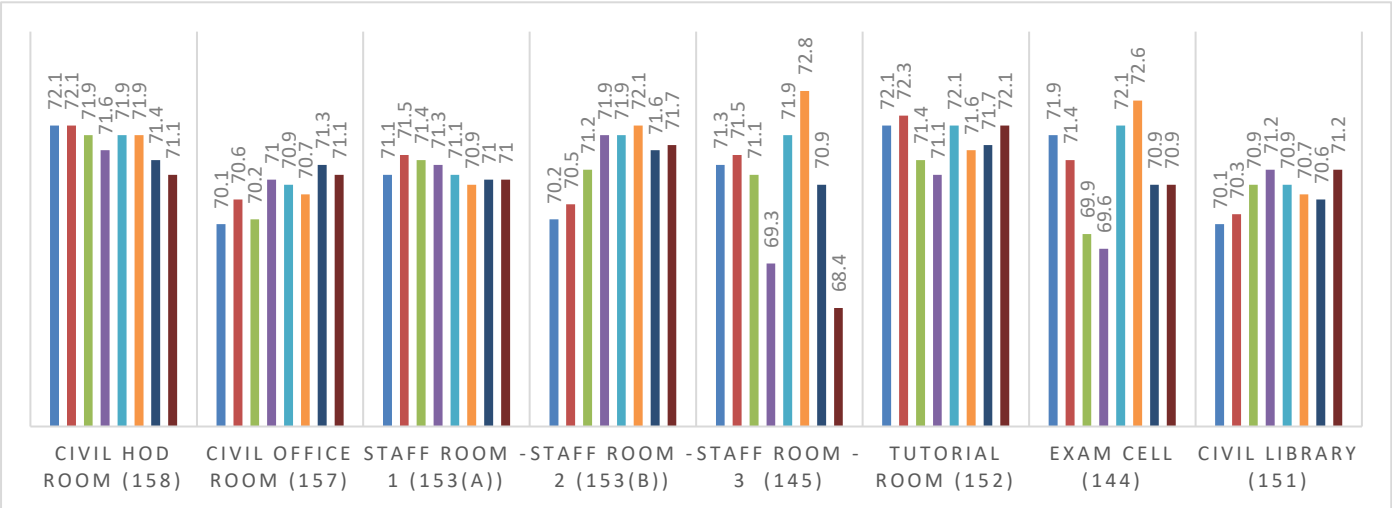

Fig145: Humidity in Staff Rooms of Civil Dept

Table146: Temperature in Class Rooms of Civil Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (155)	31.5	31.7	31.5	31.4	32	31.9	31.8	31.7
THIRD YEAR (154)	31.6	31.7	31.5	31.7	31.5	31.4	31.5	31.6
FINAL YEAR (143)	31.1	31.2	31.1	31.6	31.5	31.9	31.7	31.2

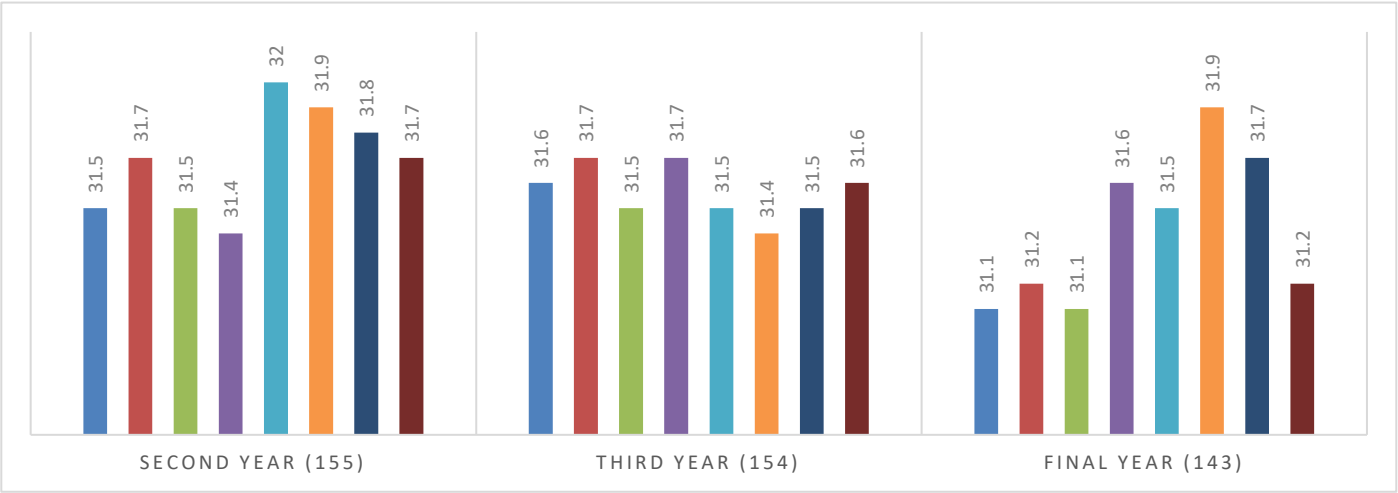

Fig146: Temperature in Class Rooms of Civil Dept

Table147: Temperature in Staff Rooms of Civil Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CIVIL HOD ROOM (158)	30.7	30.8	30.9	30.5	30.7	30.6	30.1	30.2
CIVIL OFFICE ROOM (157)	31.3	31.1	32.2	32.1	31.6	31.0	31.1	31.2
STAFF ROOM -1 (153(A))	30.1	30.1	31.8	31.2	31.2	31.9	31.7	31.8
STAFF ROOM -2 (153(B))	31.2	31.3	31.4	31.1	30.9	31.3	30.9	30.7
STAFF ROOM -3 (145)	31.1	31.1	30.3	31.1	31.2	31.3	30.9	30.7
TUTORIAL ROOM (152)	30.6	30.7	30.5	30.7	30.5	30.5	30.4	30.2
EXAM CELL (144)	30.6	30.7	31.4	31.2	30.6	30.2	30.9	30.8
CIVIL LIBRARY (151)	31.2	31.0	31.2	30.6	31.2	31.1	31.0	31.0

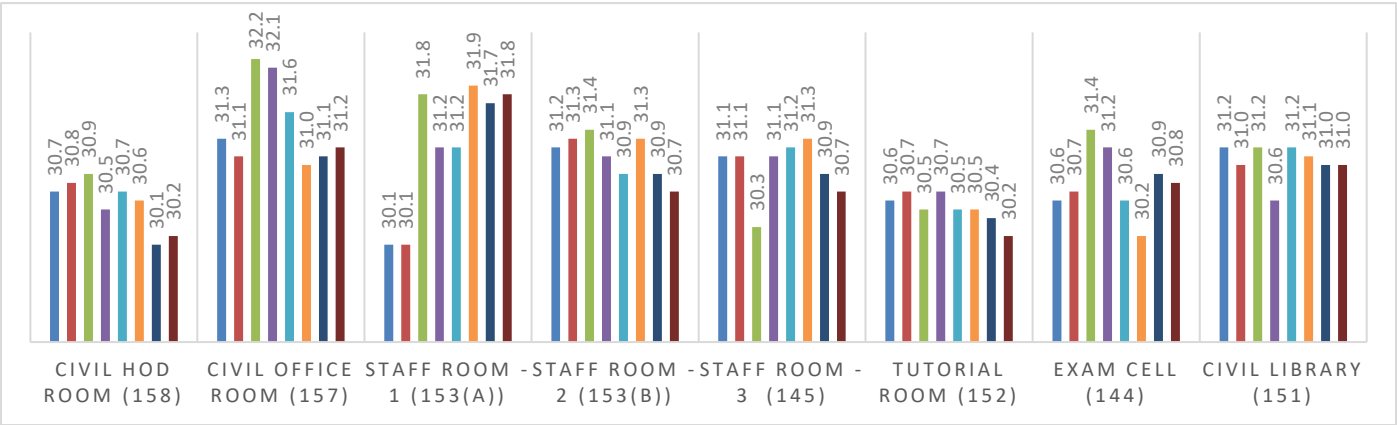

Fig147: Temperature in Staff Rooms of Dept

Table148: Temperature in Laboratories of Civil Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
CONCRTE TECHNOLOGY LAB (156)	31.1	31.1	30.3	31.1	31.2	31.3	30.9	30.7
TRANSPORTATION ENGINEERING LAB (153)	31.3	31.6	31.5	31.2	31.6	31.4	31.9	30.1
GEOTECHNICAL LAB (146)	30.8	30.9	30.4	30.5	30.9	30.4	30.7	30.4
COMPUTER AIDED DESIGN LAB (249)	30.9	30.9	31.8	31.6	31.8	31.8	31.1	31.2
FLUID MECHANICS LAB (119)	31.3	31.1	32.2	32.1	31.6	31.0	31.1	31.2
ENVIRONMENTAL ENGINEERING LAB - 1	30.6	30.7	31.4	31.2	30.6	30.2	30.9	30.8
ENVIRONMENTAL ENGINEERING LAB ROOM -2	31.2	31.0	31.2	30.6	31.2	31.1	31.0	31.0

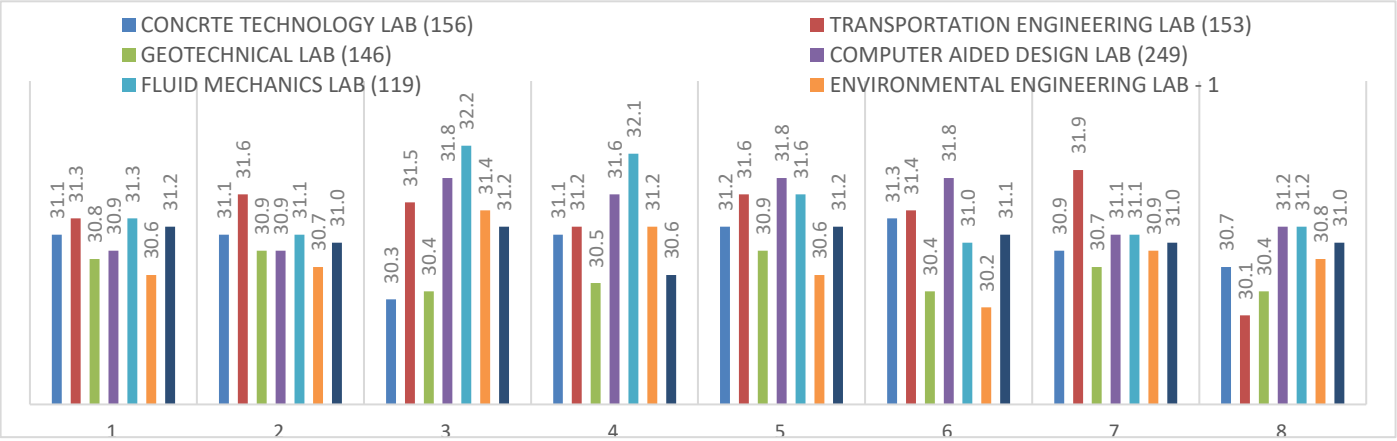

Fig148: Temperature in Laboratories of Civil Dept

MECHANICAL ENGINEERING

Table149: CO2 in Class Rooms of Mech Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (123) SECTION -1	541	550	576	515	511	520	500	489
SECOND YEAR (123(A)) SECTION -2	527	565	577	585	571	584	571	503
THIRD YEAR (107) SECTION -1	550	555	565	579	590	515	505	500
THIRD YEAR (108) SECTION -2	502	528	540	555	590	549	528	510
FINAL YEAR (134) SECTION -1	439	455	478	480	489	490	475	463
FINAL YEAR (134(A)) SECTION -2	530	519	510	545	560	533	509	490

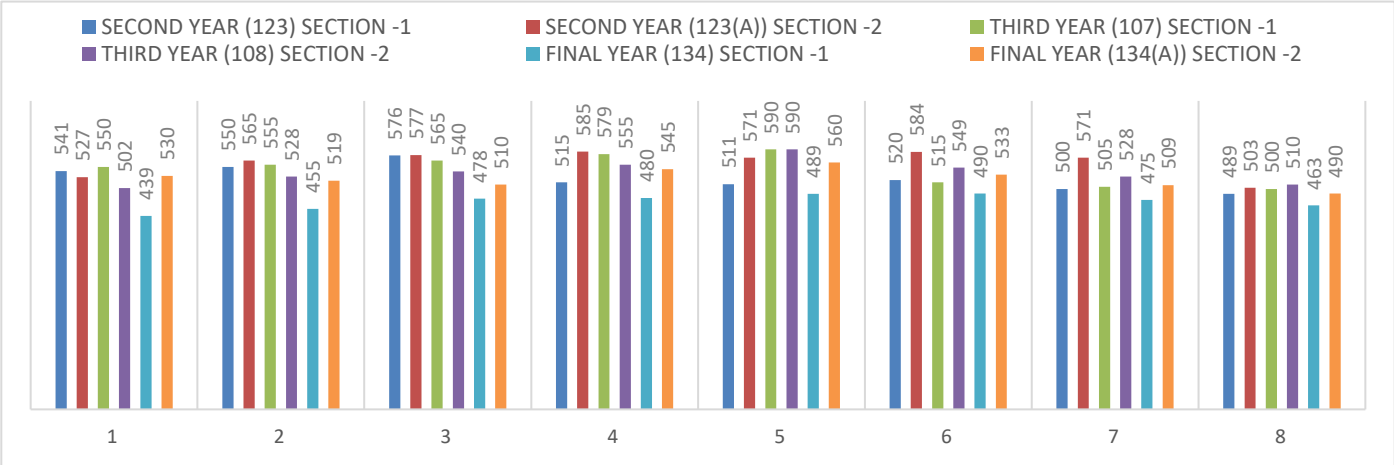

Fig149: CO2 in Class Rooms of Mech Dept

Table150: CO2 in Staff Rooms of Mech Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MECH HOD ROOM (125)	430	441	457	421	440	435	438	428
MECH OFFICE ROOM (126)	541	550	560	555	540	523	501	497
STAFF ROOM -1 (333)	512	569	588	610	594	587	533	500
STAFF ROOM -2 (334)	524	542	571	590	529	500	491	477

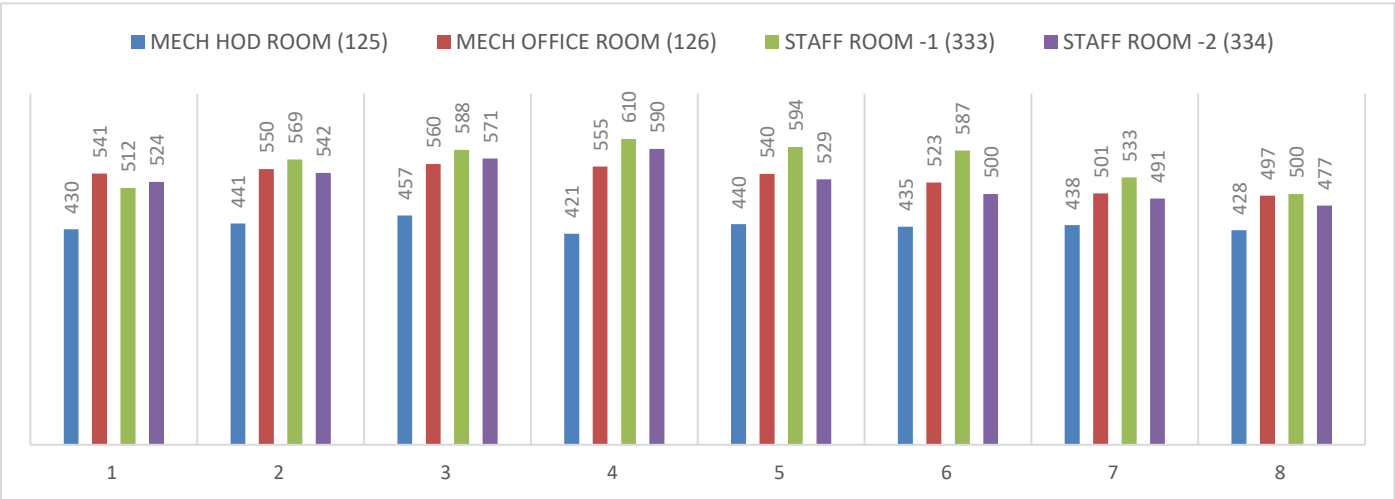

Fig150: CO2 in Staff Rooms of Mech Dept

Table151: CO2 in Class Laboratories of Mech Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
BASIC WORKSHOP (122(B))	573	559	550	589	610	533	568	510
MATERIAL TESTING LAB (117)	443	527	560	562	615	510	500	498
HEAT TRANSFER LAB (109)	430	483	501	523	500	490	473	539
INSTRUMENTATION AND METOROLGY LAB (328)	555	569	580	588	660	690	530	500
CAM LAB (321)	584	590	538	530	521	525	520	515
CAD LAB (348)	583	595	600	623	563	540	510	499
MACHINE TOOLS LAB -1 (124)	527	577	590	612	595	573	525	490
MACHINE TOOLS LAB -2 (122)	430	471	493	500	520	498	478	465

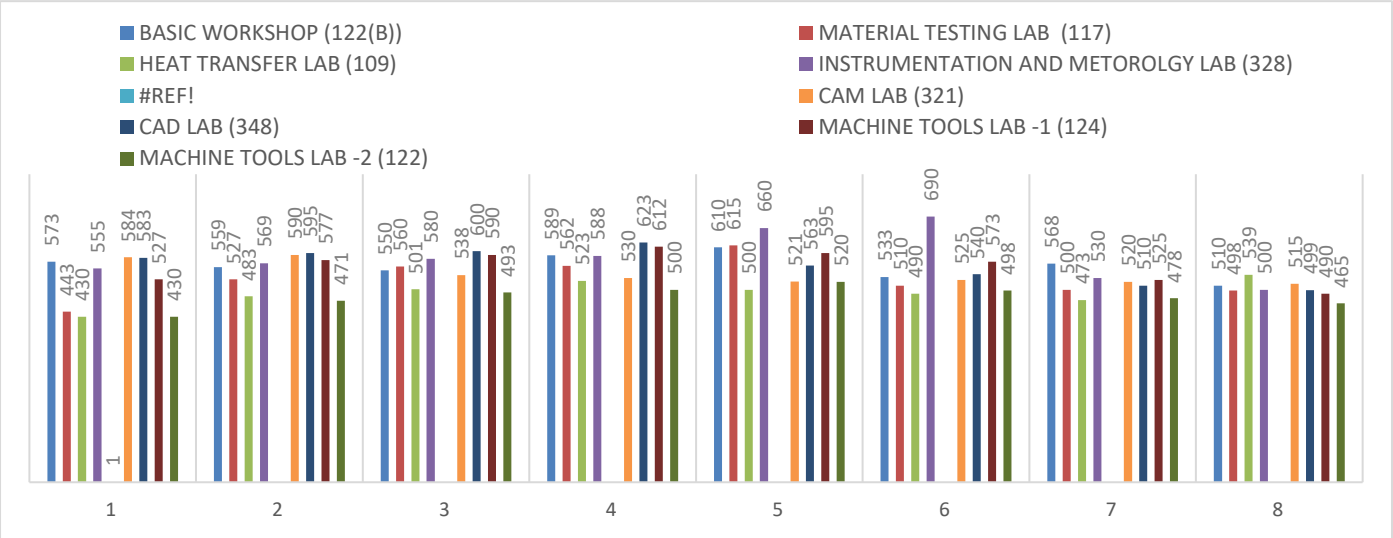

Fig151: CO2 in Class Laboratories of Mech Dept

Table152: Humidity in Class Rooms of Mech Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (123) SECTION -1	65.2	65.8	65.9	69.3	67.4	67.5	67.4	66.4
SECOND YEAR (123(A)) SECTION -2	69.9	68.8	70.1	71.1	70.6	66.8	66.9	66.8
THIRD YEAR (107) SECTION -1	67.1	69.1	70.1	66.0	67.1	66.1	65.0	65.2
THIRD YEAR (108) SECTION -2	67.9	65.2	66.3	66.3	66.5	66.0	65.9	65.7
FINAL YEAR (134) SECTION -1	67.4	67.3	68.2	66.5	66.2	68.2	68.2	68.3
FINAL YEAR (134(A)) SECTION -2	66.3	66.4	66.9	70.1	68.2	67.9	65.9	65.7

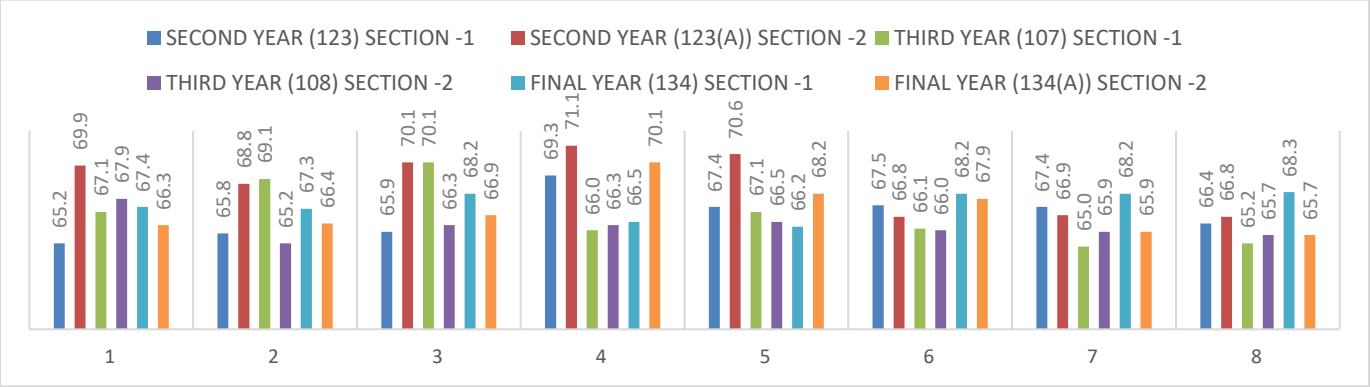

Fig152: Humidity in Class Rooms of Mech Dept

Table153: Humidity in Staff Rooms of Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MECHANICAL HOD ROOM (125)	71.3	72.3	69.9	69.3	72.5	72.4	71.9	71.2
MECHANICAL OFFICE ROOM (126)	70.2	70.5	68.9	71.9	71.1	69.9	69.3	70.1
STAFF ROOM -1 (333)	66.9	67.5	67.9	67.3	66.9	66.1	65.3	65.8
STAFF ROOM -2 (334)	67.2	67.2	66.9	66.3	67.2	67.8	66.7	66.3

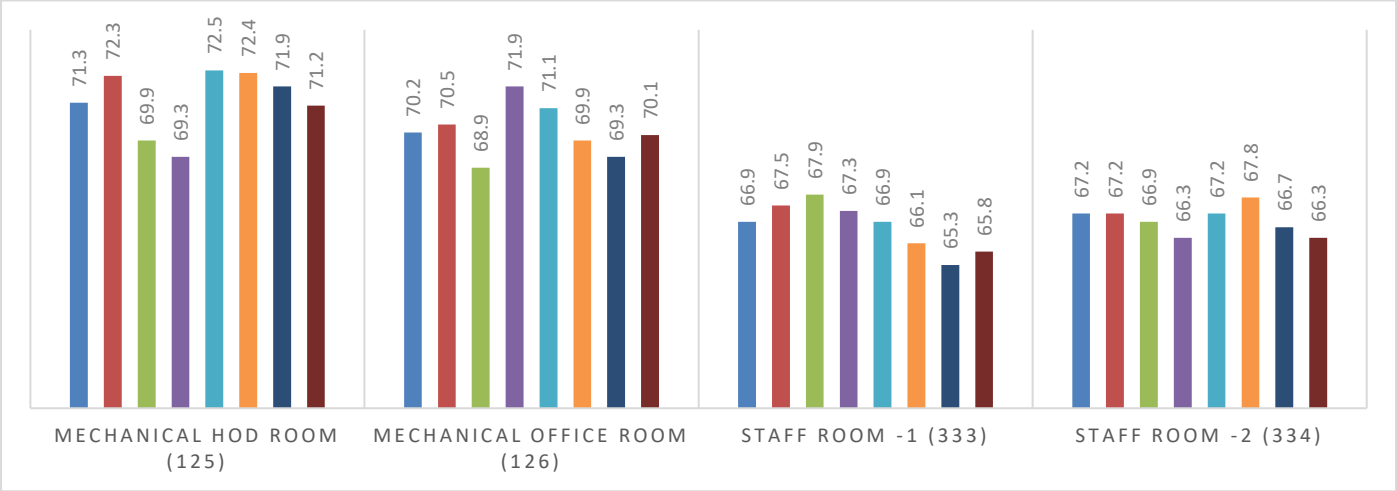

Fig153: Humidity in Staff Rooms of Mech Dept

Table154: Humidity in Laboratories of Mech Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
BASIC WORKSHOP (122(B))	67.2	69.2	68.1	66.5	64.3	66.0	65.9	65.7
MATERIAL TESTING LAB (117)	70.2	70.5	68.9	71.9	71.1	71.8	71.8	71.7
HEAT TRANSFER LAB (109)	69.9	69.5	69.1	69.7	70.2	70.9	71.2	69.8
INSTRUMENTATION AND METOROLGY LAB (328)	70.2	70.5	68.9	71.9	69.9	71.1	74.3	71.7
CAM LAB (321)	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
CAD LAB (348)	71.3	70.0	70.3	70.3	71.3	71.6	71.6	69.1
MACHINE TOOLS LAB -1 (124)	76.1	76.7	64.8	64.9	72.3	72.6	74.1	73.6
MACHINE TOOLS LAB -2 (122)	70.2	70.5	68.9	71.9	75.9	76.7	74.3	71.7

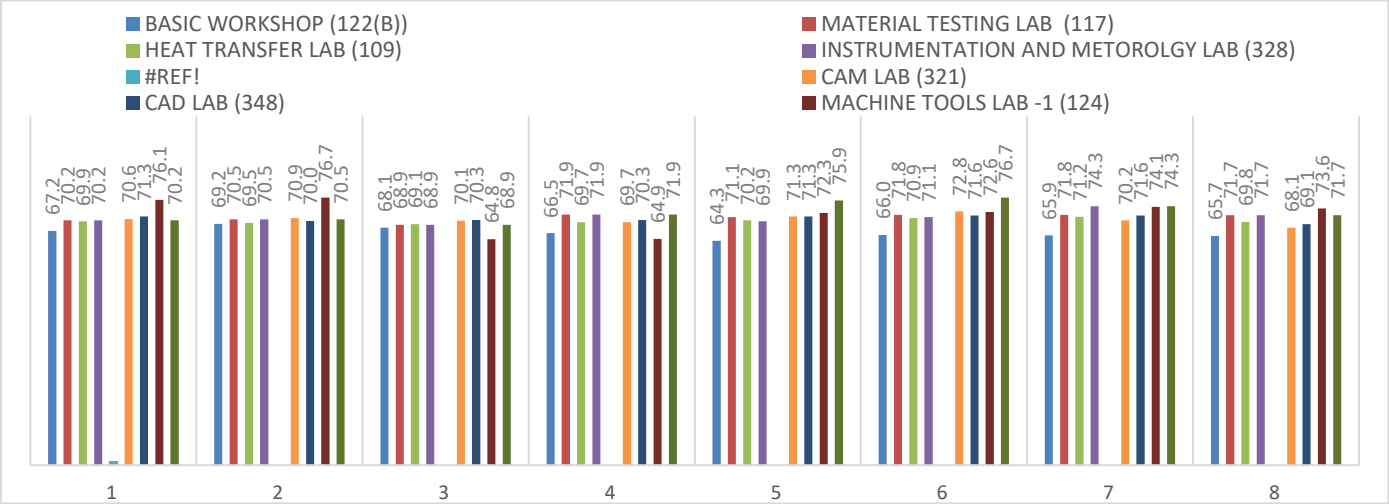

Fig154: Humidity in Laboratories of Mech Dept

Table155: Temperature in Class Rooms of Mech Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (123) SECTION -1	30.5	30.9	31.2	31.6	31.1	32.1	31.0	31.1
SECOND YEAR (123(A)) SECTION -2	31.5	31.5	31.5	31.7	31.9	31.2	31.1	31.3
THIRD YEAR (107) SECTION -1	30.9	30.9	31.8	31.6	31.8	31.8	31.1	31.2
THIRD YEAR (108) SECTION -2	30.6	30.7	30.5	30.7	30.5	30.5	30.4	30.9
FINAL YEAR (134) SECTION -1	31.1	31.1	31.2	31.3	31.5	31.2	31.0	31.1
FINAL YEAR (134(A)) SECTION -2	30.1	31.9	31.8	31.8	31.2	31.0	31.2	31.1

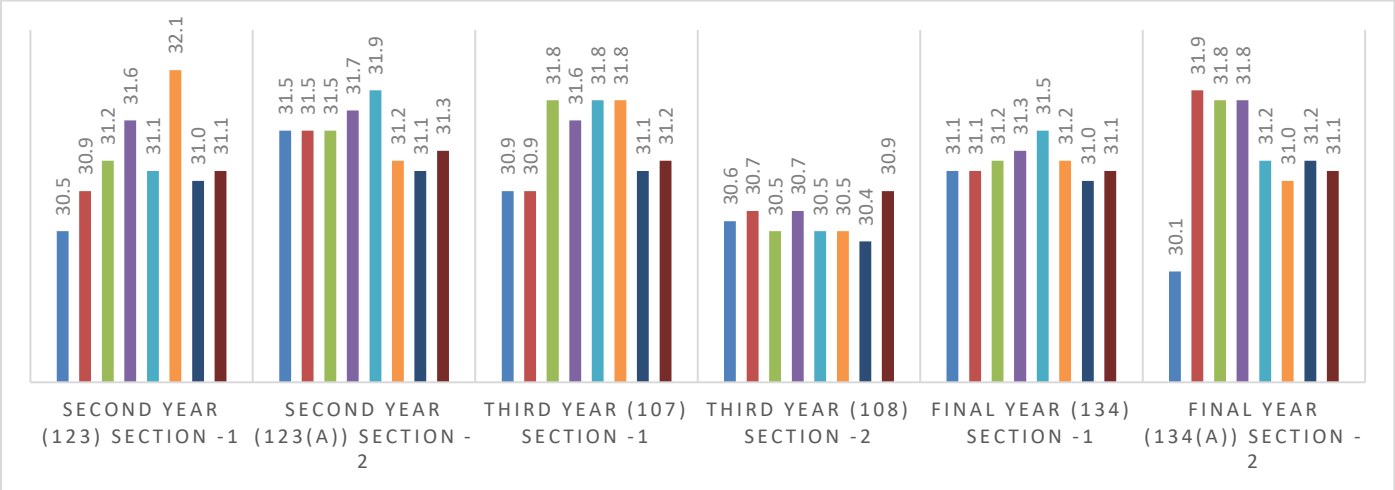

Fig155: Temperature in Class Rooms of Mech Dept

Table156: Temperature in Staff Rooms of Mech Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MECH HOD ROOM (125)	31.8	31.9	31.8	31.4	31.5	31.6	31.4	31.3
MECH OFFICE ROOM (126)	31.3	31.2	31.2	32.0	32.0	31.2	31.9	31.6
STAFF ROOM -1 (333)	31.0	31.3	31.5	31.6	30.6	31.2	31.2	31.0
STAFF ROOM -2 (334)	31.7	31.8	31.8	31.5	31.5	31.6	31.7	31.8

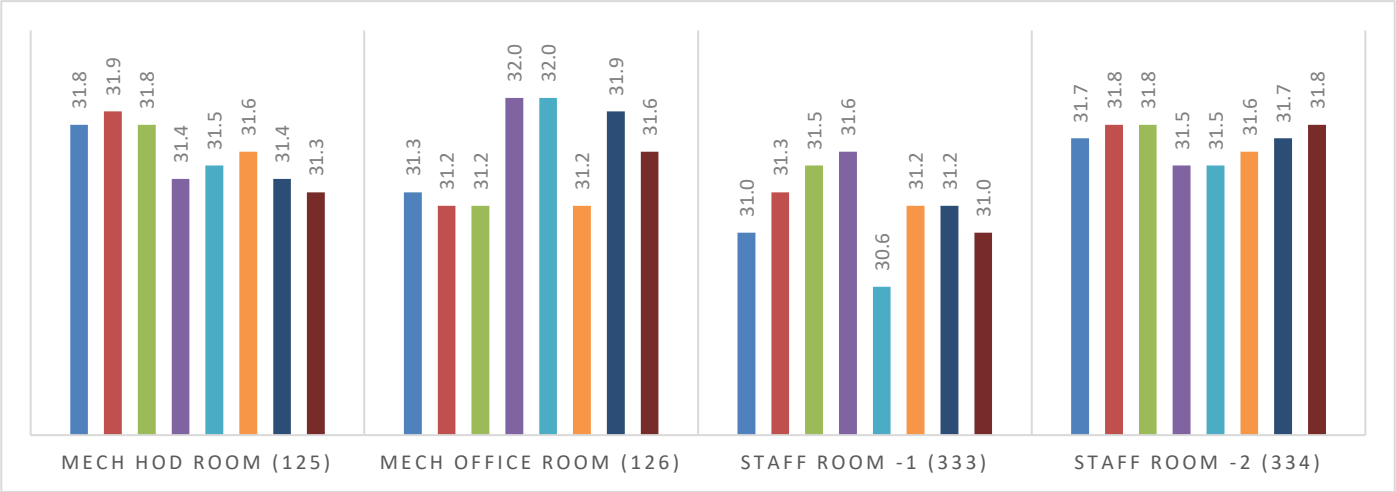

Fig156: Temperature in Staff Rooms of Mech Dept

Table157: Temperature in Laboratories of Mech Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
BASIC WORKSHOP (122(B))	31.6	31.3	31.1	31.0	31.6	32.1	32.5	31.3
MATERIAL TESTING LAB (117)	31.8	31.6	31.6	32.4	32.1	31.0	31.1	30.9
HEAT TRANSFER LAB (109)	31.1	31.6	31.5	31.5	31.2	31.4	32.1	31.4
INSTRUMENTATION AND METOROLGY LAB (328)	32.0	31.9	31.9	31.8	31.9	31.8	31.7	31.8
CAM LAB (321)	30.9	31.6	31.1	30.8	31.2	31.1	31.3	31.2
CAD LAB (348)	30.9	30.9	31.1	31.5	31.4	31.4	31.1	31.2
MACHINE TOOLS LAB -1 (124)	31.2	31.4	32.1	32.0	31.1	30.9	31.0	31.0
MACHINE TOOLS LAB -2 (122)	30.2	31.1	31.3	31.1	31.5	31.8	31.1	30.9

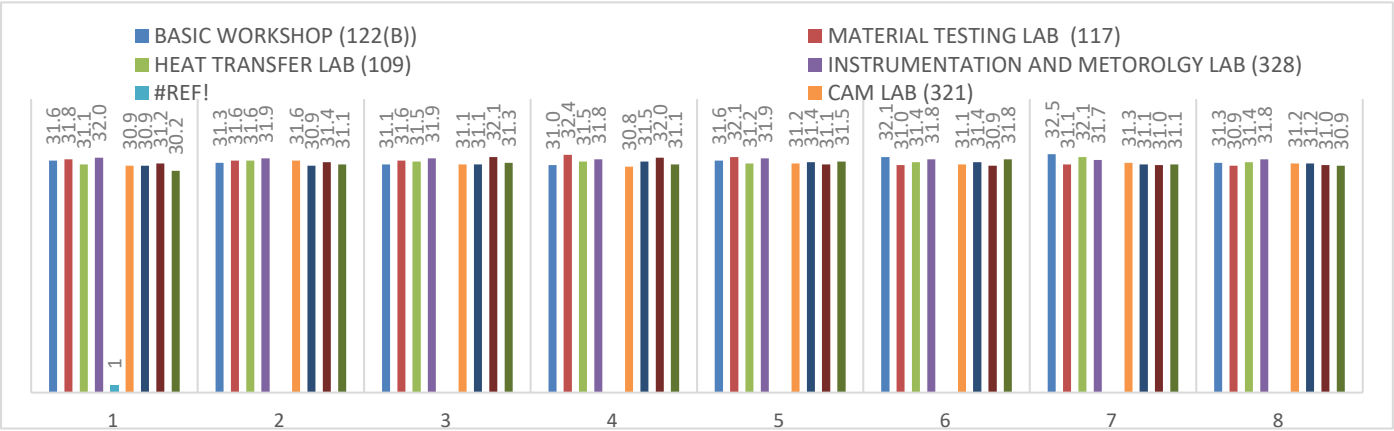

Fig157: Temperature in Laboratories of Mech Dept

COMPUTER SCIENCE AND ENGINEERING

Table158: CO2 in Class Rooms of CSE Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (209) SECTION -1	465	490	627	698	900	878	780	650
SECOND YEAR (210) SECTION -2	599	631	651	700	700	725	715	690
THIRD YEAR (SS) SECTION -1	420	497	530	566	633	715	720	689
THIRD YEAR (108) SECTION -2	467	497	533	569	780	726	680	635
FINAL YEAR (230) SECTION -1	400	525	545	581	561	560	540	535
FINAL YEAR (230(A)) SECTION -2	439	524	590	630	863	780	610	598

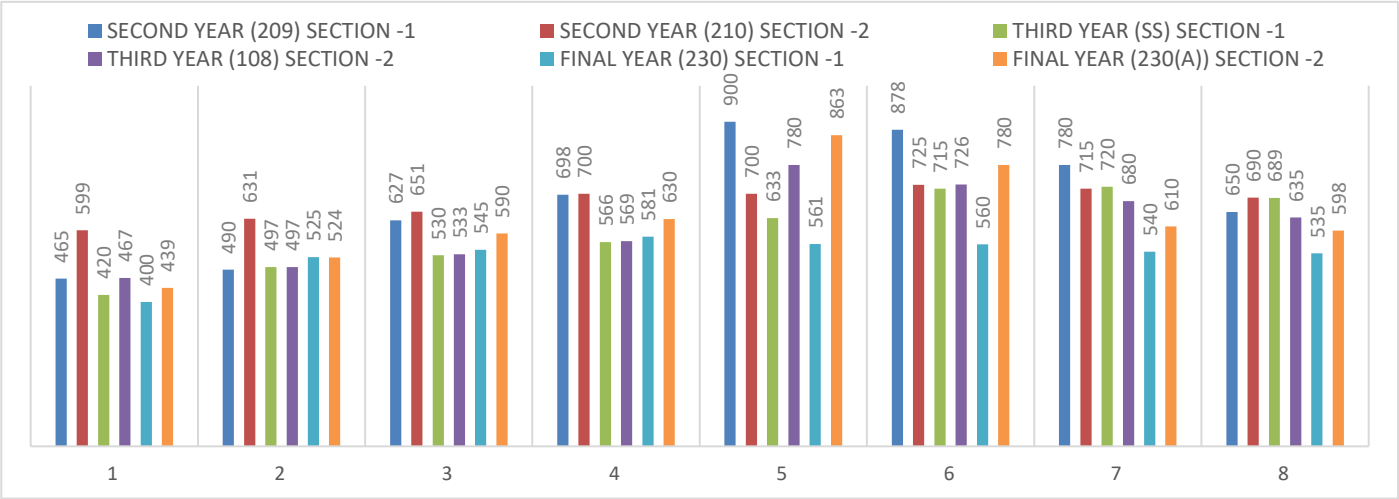

Fig158: CO2 in Class Rooms of CSE Dept

Table159: CO2 in Staff Rooms of CSE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(204)	600	794	758	696	890	735	700	620
STAFF ROOM -1 (205)	548	520	510	634	650	629	590	536
STAFF ROOM -2 (207)	453	460	467	540	672	651	600	580
CSE OFFICE (212)	490	480	487	544	590	622	650	680
CSE HOD ROOM (213)	528	550	509	515	560	590	595	600
STAFF ROOM -3 (220)	632	520	516	521	515	520	501	496
STAFF ROOM-4 (221)	509	548	551	565	580	576	569	545
STAFF ROOM -5 (222)	490	555	590	656	660	661	630	590
STAFF ROOM -6 (223)	510	545	560	545	570	577	600	630
PHOENIX DEV CENTRE (226)	588	580	586	597	600	620	540	510
STAFF ROOM -7 (219)	530	590	501	450	750	900	690	530
LIBRARY	520	568	590	545	556	620	527	516
STAFF ROOM -8 (206)	453	460	463	501	555	620	672	580
TUTORIAL ROOM (215)	449	460	452	475	500	506	525	490
E CLASSROOM (203)	515	528	700	950	915	873	755	700

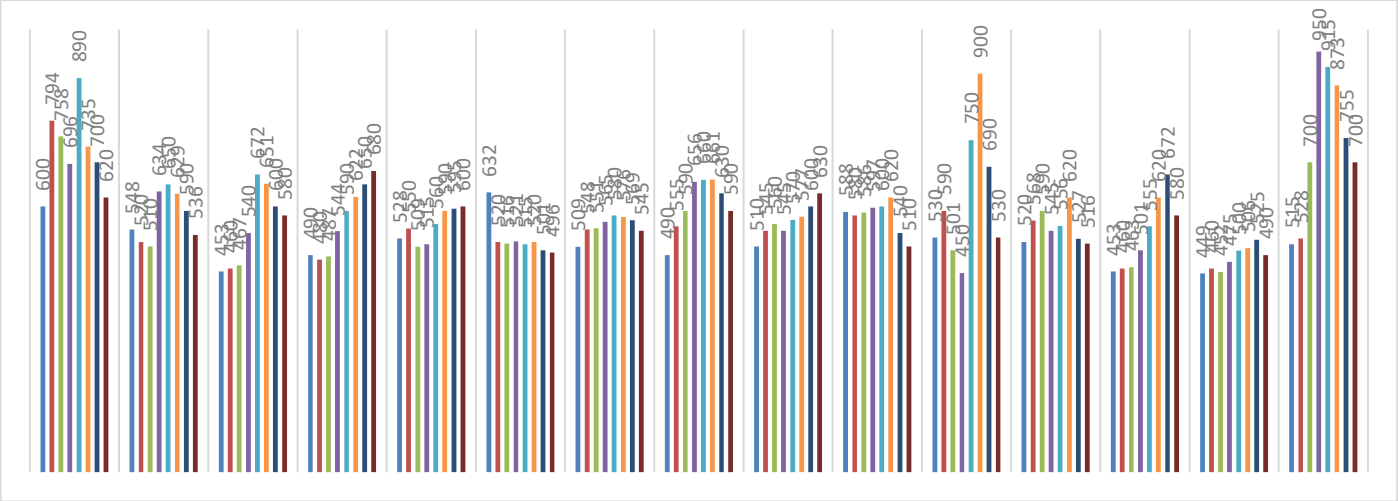

Fig159: CO2 in Staff Rooms of CSE Dept

Table160: CO2 in Class Laboratories of CSE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
AI & ML LAB(208)	700	789	840	1100	1428	1010	923	700
INVENTION & INNOVATION CELL(211)	501	515	523	725	800	856	910	770
APPLICATION DEVELOPMENT LAB(216)	503	498	490	700	870	818	750	715
RESEARCH& DEVELOPMENT LAB(218)	532	710	690	1002	1233	1163	1015	900
SERVER ROOM (218(A))	528	550	509	520	556	590	585	542
PROGRAMMING LAB(224)	1390	1459	1509	1638	1658	1549	1300	1229
SKILL TRAINING LAB(323)	2170	2165	2189	2577	2493	2221	1668	1523

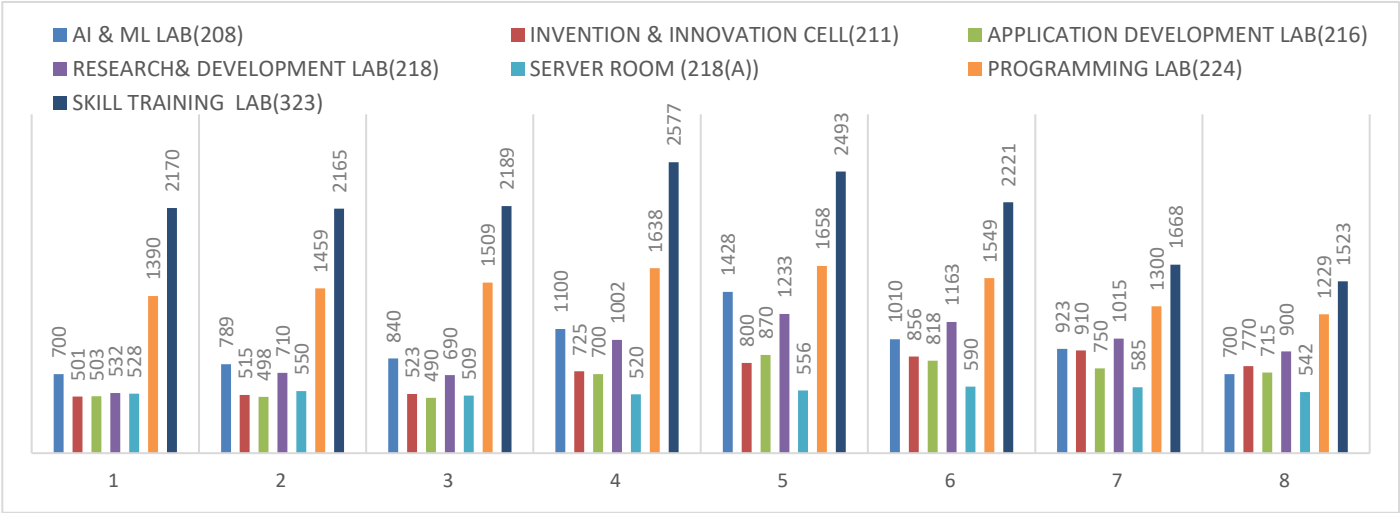

Fig160: CO2 in Class Laboratories of CSE Dept

Table161: Humidity in Class Rooms of CSE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (209) SECTION -1	71.3	71.6	71.7	71.6	71.9	72.1	72.3	73.1
SECOND YEAR (210) SECTION -2	71.3	71.4	71.6	71.6	71.9	72.1	72.3	72.1
THIRD YEAR (202) SECTION -1	72.9	72.5	72.1	72.5	73.4	73.5	75.1	75.2
THIRD YEAR (201) SECTION -2	74.0	75.6	75.8	79.1	76.5	75.6	75.2	75.2
FINAL YEAR (230) SECTION -1	72.3	72.9	73.6	73.4	72.5	72.9	72.4	72.5
FINAL YEAR (230(A)) SECTION -2	73.6	73.9	75.9	73.5	75.5	73.5	73.2	72.1

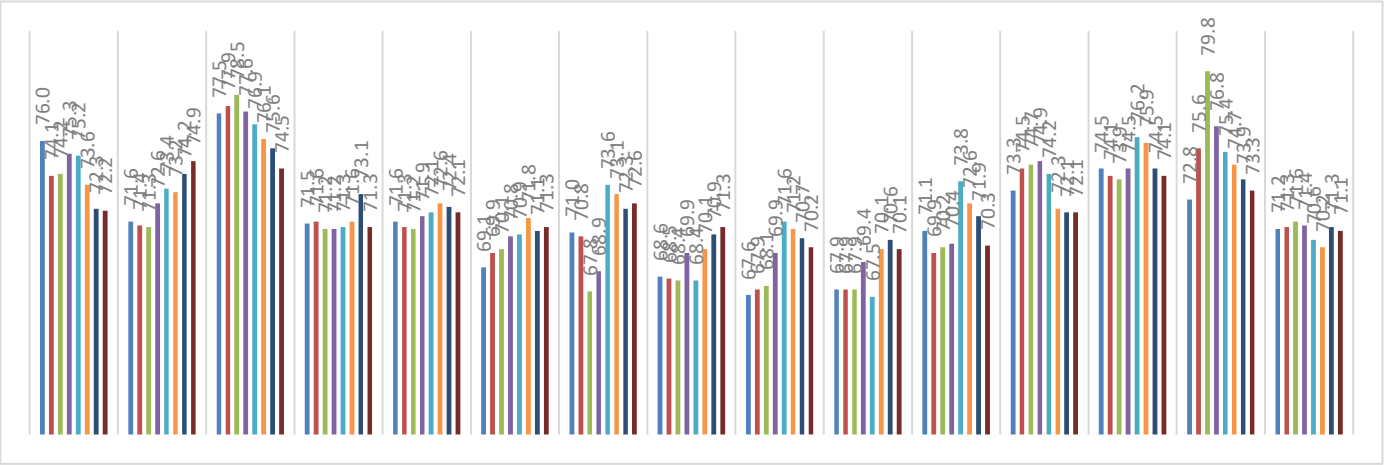

Fig161: Humidity in Class Rooms of CSE Dept

Table162: Humidity in Staff Rooms of CSE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(204)	76.0	74.1	74.2	75.3	75.2	73.6	72.3	72.2
STAFF ROOM -1 (205)	71.6	71.4	71.3	72.6	73.4	73.2	74.2	74.9
STAFF ROOM -2 (207)	77.5	77.9	78.5	77.6	76.9	76.1	75.6	74.5
CSE OFFICE (212)	71.5	71.6	71.2	71.2	71.3	71.6	73.1	71.3
CSE HOD ROOM (213)	71.6	71.3	71.2	71.9	72.1	72.6	72.4	72.1
STAFF ROOM -3 (220)	69.1	69.9	70.1	70.8	70.9	71.8	71.1	71.3
STAFF ROOM-4 (221)	71.0	70.8	67.8	68.9	73.6	73.1	72.3	72.6
STAFF ROOM -5 (222)	68.6	68.5	68.4	69.9	68.4	70.1	70.9	71.3
STAFF ROOM -6 (223)	67.6	67.9	68.1	69.9	71.6	71.2	70.7	70.2
PHOENIX DEV CENTRE (226)	67.9	67.9	67.9	69.4	67.5	70.1	70.6	70.1
STAFF ROOM -7 (219)	71.1	69.9	70.2	70.4	73.8	72.6	71.9	70.3
LIBRARY	73.3	74.5	74.7	74.9	74.2	72.3	72.1	72.1
E CLASSROOM (203)	74.5	74.1	73.9	74.5	76.2	75.9	74.5	74.1
STAFF ROOM -8 (206)	72.8	75.6	79.8	76.8	75.4	74.7	73.9	73.3
TUTORIAL ROOM (215)	71.2	71.3	71.6	71.4	70.6	70.2	71.3	71.1

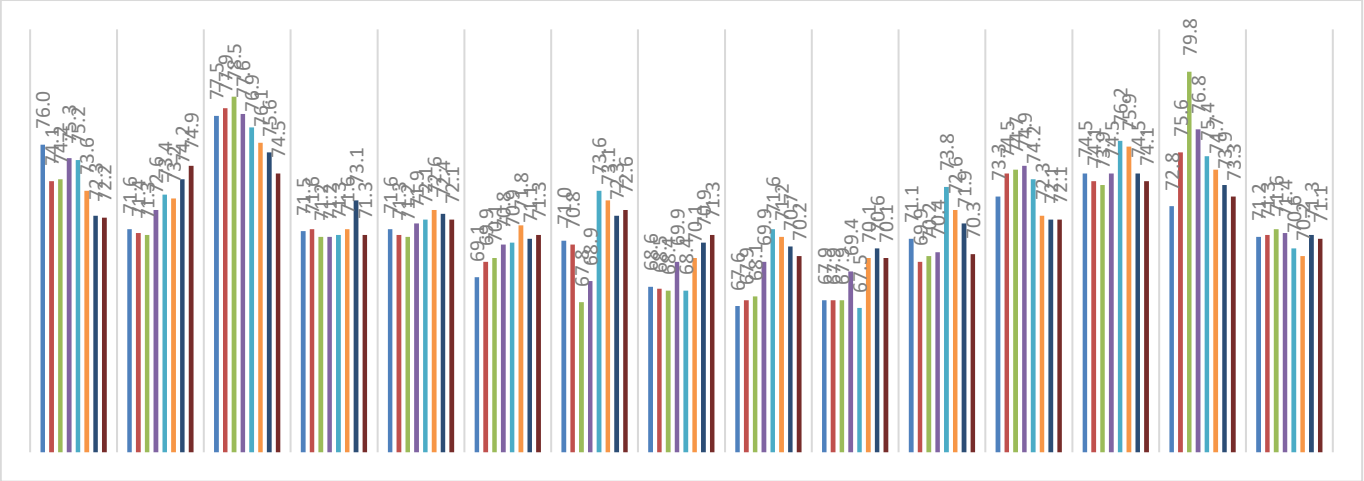

Fig162: Humidity in Staff Rooms of CSE Dept

Table163: Humidity in Laboratories of CSE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
AI & ML LAB(208)	72.0	72.3	72.1	72.9	73.1	72.9	70.1	70.1
INVENTION & INNOVATION CELL(211)	72.1	71.5	75.1	75.1	74.9	74.1	73.9	73.6
APPLICATION DEVELOPMENT LAB(216)	71.8	72.6	73.4	72.9	72.5	72.1	71.8	71.6
RESEARCH& DEVELOPMENT LAB(218)	70.8	70.7	70.7	70.6	57.2	55.3	62.3	69.2
SERVER ROOM (218(A))	62.2	63.3	63.8	64.3	64.9	63.1	64.6	64.2
PROGRAMMING LAB(224)	68.2	68.5	68.9	65.8	65.5	64.9	63.2	64.1
SKILL TRAINING LAB(323)	60.2	60.9	60.4	61.1	61.3	63.4	62.5	61.3

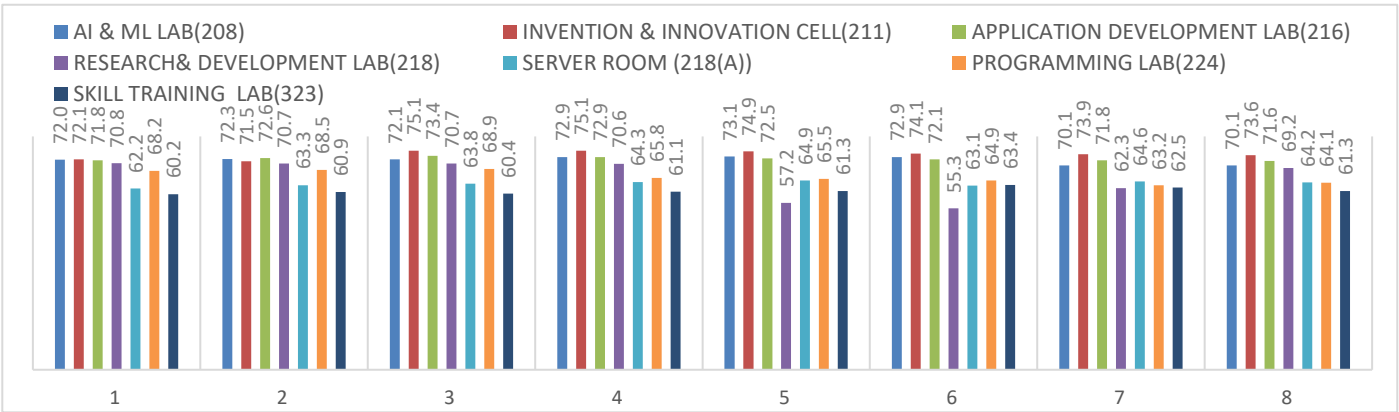

Fig163: Humidity in Laboratories of CSE Dept

Table164: Temperature in Class Rooms of CSE Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (209) SECTION -1	31.4	31.5	31.5	31.4	30.9	30.6	31.1	31.0
SECOND YEAR (210) SECTION -2	31.4	31.6	31.4	31.2	31.0	30.9	31.1	31.2
THIRD YEAR (SS) SECTION -1	29.9	29.9	29.8	29.9	30.1	30.2	30.5	30.6
THIRD YEAR (108) SECTION -2	30.1	30.1	30.5	30.5	30.6	30.1	30.6	30.4
FINAL YEAR (134) SECTION -1	33.1	33.1	32.7	32.4	30.6	30.1	30.6	31.1
FINAL YEAR (134(A)) SECTION -2	32.9	32.9	32.1	31.9	31.6	31.2	30.6	30.1

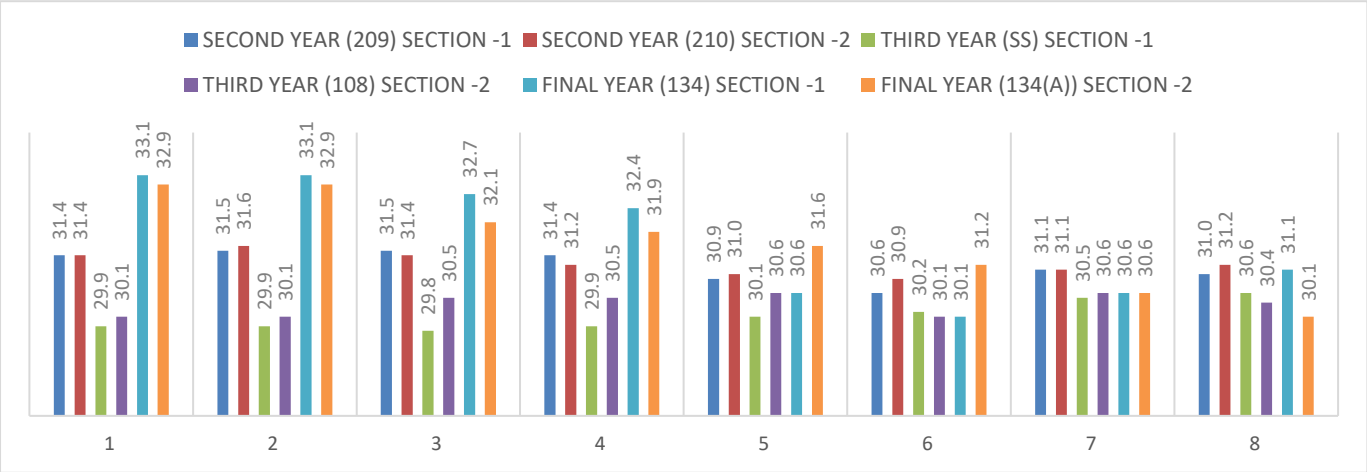

Fig164: Temperature in Class Rooms of CSE Dept

Table165: Temperature in Staff Rooms of CSE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(204)	30.1	30.2	30.6	30.5	30.1	31.2	31.1	30.9
STAFF ROOM -1 (205)	30.7	30.7	30.4	30.5	30.4	30.2	30.1	30.4
STAFF ROOM -2 (207)	31.4	31.2	31.4	31.2	31.6	30.6	30.6	30.9
CSE OFFICE (212)	31.3	31.2	31.2	31.4	30.2	30.9	30.2	30.6
CSE HOD ROOM (213)	31.2	31.2	31.3	31.2	31.4	31.4	31.5	31.1
STAFF ROOM -3 (220)	32.5	32.5	32.4	32.4	30.1	30.1	30.1	30.1
STAFF ROOM-4 (221)	32.8	32.8	32.4	32.5	30.2	30.6	30.5	30.2
STAFF ROOM -5 (222)	33.1	33.0	32.9	32.8	30.2	30.1	30.5	31.1
STAFF ROOM -6 (223)	32.9	32.9	32.8	32.9	30.9	30.6	30.9	31.1
PHOENIX DEV CENTRE (226)	32.8	32.8	32.6	32.6	32.8	31.5	30.6	30.6
STAFF ROOM -7 (219)	31.9	31.9	31.5	31.6	30.1	30.0	30.1	29.9
LIBRARY	30.2	30.5	30.4	30.6	30.5	31.2	31.4	30.7
E CLASSROOM (203)	30.6	30.6	30.7	30.6	30.4	30.5	30.1	30.0
STAFF ROOM -8 (206)	30.8	30.7	30.9	30.8	30.4	30.5	30.2	30.1
TUTORIAL ROOM (215)	31.3	31.2	31.3	31.1	30.9	31.1	31.2	31.0

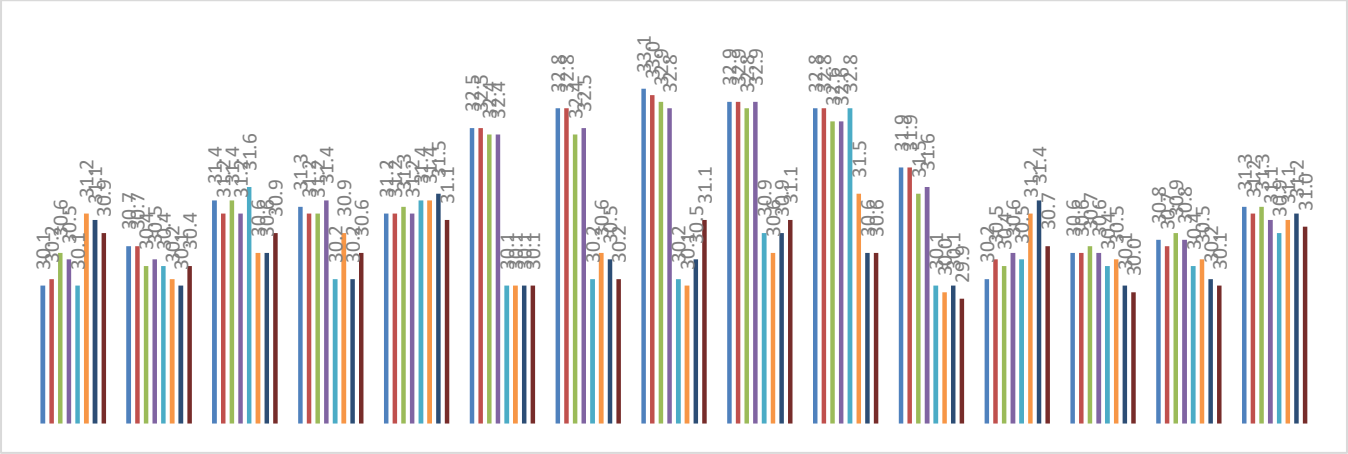

Fig165: Temperature in Staff Rooms of CSE Dept

Table166: Temperature in Laboratories of CSE Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
AI & ML LAB(208)	31.2	31.6	31.4	31.5	31.1	30.8	30.9	30.8
INVENTION & INNOVATION CELL(211)	30.6	31.1	31.2	31.3	30.2	30.2	30.2	30.4
APPLICATION DEVELOPMENT LAB(216)	31.3	31.2	31.3	31.2	31.1	31.1	30.9	31.0
RESEARCH& DEVELOPMENT LAB(218)	31.7	31.7	31.5	31.6	31.3	31.2	31.2	31.1
SERVER ROOM (218(A))	30.2	31.6	30.5	30.6	31.0	31.5	31.2	31.2
PROGRAMMING LAB(224)	32.9	32.9	32.8	32.8	30.7	32.5	34.7	35.9
SKILL TRAINING LAB(323)	31.0	31.8	31.9	31.2	31.2	32.6	32.4	31.2

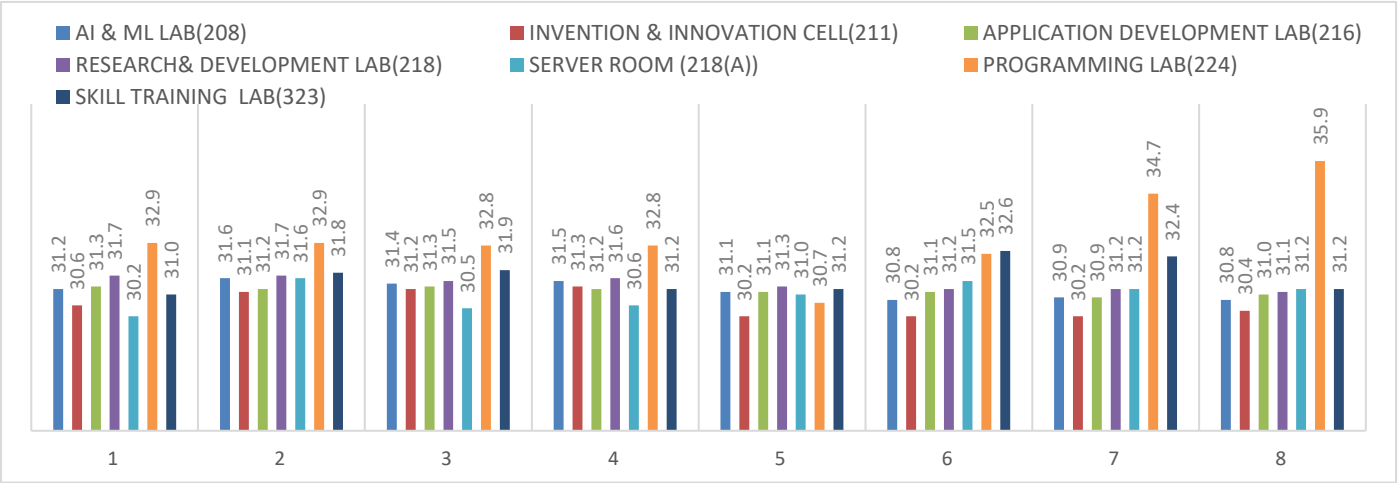

Fig166: Temperature in Laboratories of CSE Dept

Table167: CO2 in Class Rooms of IT Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (309) SECTION -1	465	489	499	523	590	645	612	596
SECOND YEAR (310) SECTION -2	532	510	459	435	454	462	490	423
THIRD YEAR (329) SECTION -1	569	523	579	582	600	653	513	450
THIRD YEAR (329(A)) SECTION -2	528	546	540	590	582	406	435	401
FINAL YEAR (301) SECTION -1	770	818	790	710	635	612	580	529
FINAL YEAR (303) SECTION -2	482	515	560	584	615	761	635	565

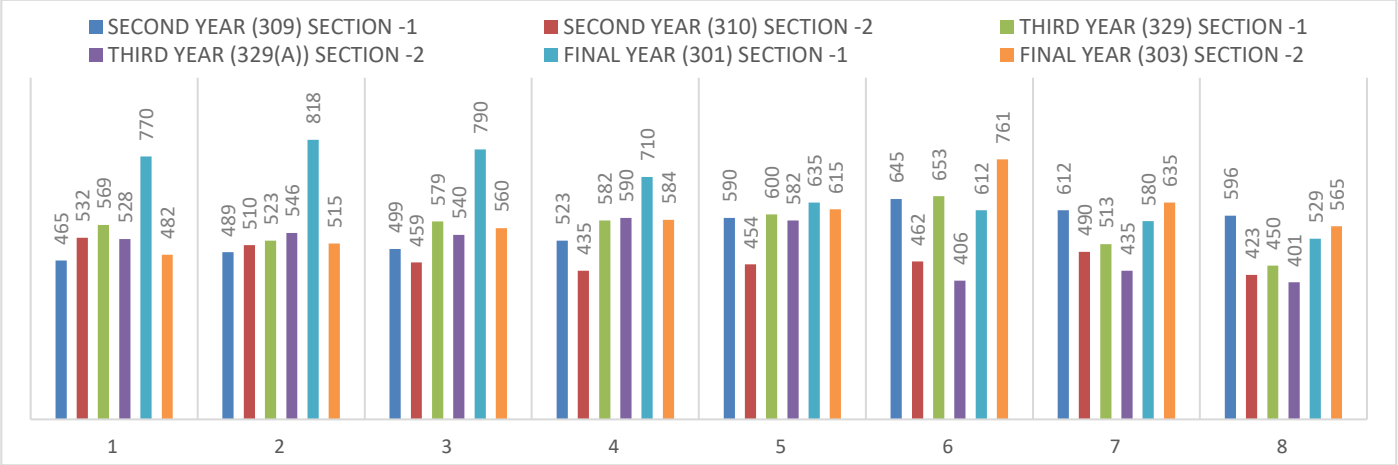

Fig167: CO2 in Class Rooms of IT Dept

Table168: CO2 in Staff Rooms of IT Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
STAFF ROOM-1(304)	461	460	465	575	615	660	725	689
STAFF ROOM -2 (305)	455	457	610	625	635	680	636	580
STAFF ROOM -3 (306)	505	511	515	510	565	600	596	590
IT OFFICE (312)	451	498	520	564	590	565	540	515
IT HOD ROOM (313)	469	486	505	615	700	640	590	535
LIBRARY(315)	443	443	525	498	586	610	560	542
EXAM CELL (320)	540	586	541	509	540	536	526	542
STAFF ROOM -4 (322)	518	520	536	589	546	513	500	490
STAFF ROOM -5(319)	589	623	590	555	529	520	526	515
E CLASSROOM (302)	556	575	589	690	761	650	555	535
STAFF ROOM -6 (307)	420	444	475	490	503	520	501	498
TUTORIAL (327)	530	590	623	680	601	590	575	540
STAFF ROOM -7 (326)	520	533	515	480	595	600	653	615

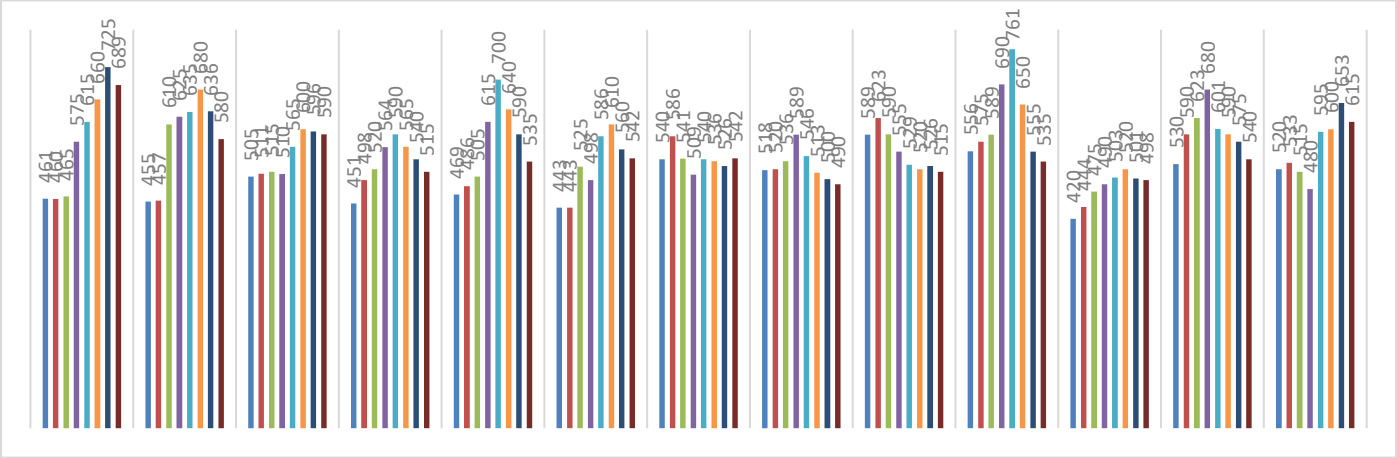

Fig168: CO2 in Staff Rooms of IT Dept

Table169: CO2 in Class Laboratories of IT Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
PROGRAMMING LANGUAGE &PROJECT LAB(308)	439	475	546	606	595	581	569	530
INSTALLATION LAB(311)	435	453	540	600	652	690	640	598
IDE LAB (316)	550	586	630	666	690	653	598	542
APSSDC (318)	469	598	682	689	643	546	523	472
INCUBATION CENTRE (326)	477	688	565	560	548	542	519	490
CAM LAB (321)	465	481	492	500	543	600	676	696

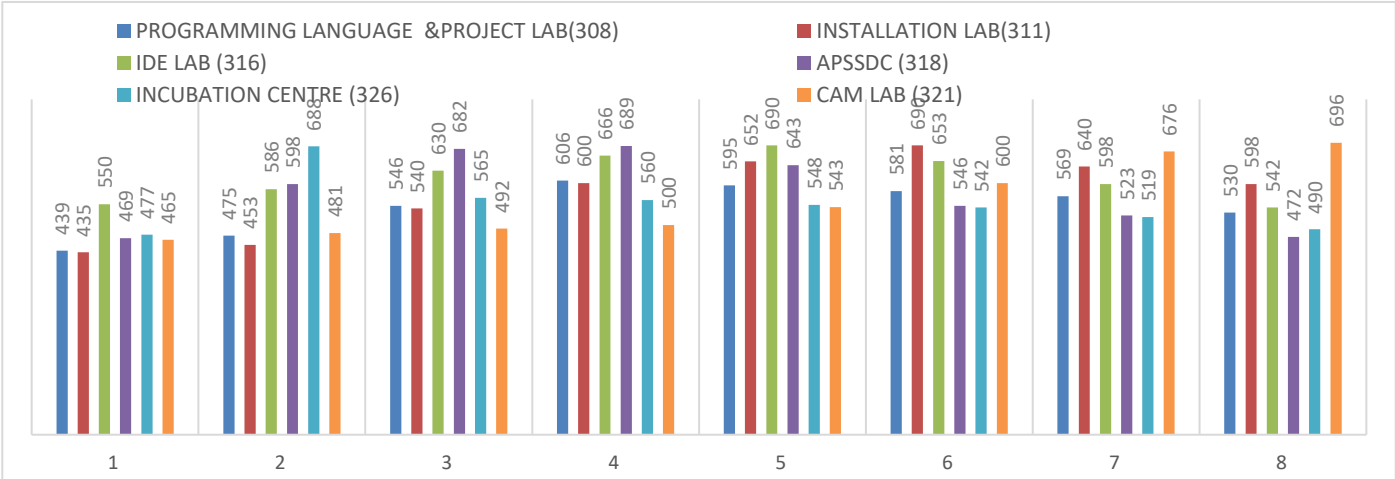

Fig169: CO2 in Class Laboratories of IT Dept

Table170: Humidity in Class Rooms of IT Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (309) SECTION -1	68.5	68.2	70.2	70.1	70.3	69.9	69.9	70.0
SECOND YEAR (310) SECTION -2	72.9	73.4	71.0	71.2	74.1	74.2	72.9	68.6
THIRD YEAR (329) SECTION -1	68.3	68.2	68.6	68.3	68.9	70.1	69.8	69.9
THIRD YEAR (329(A)) SECTION -2	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
FINAL YEAR (301) SECTION -1	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
FINAL YEAR (303) SECTION -2	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1

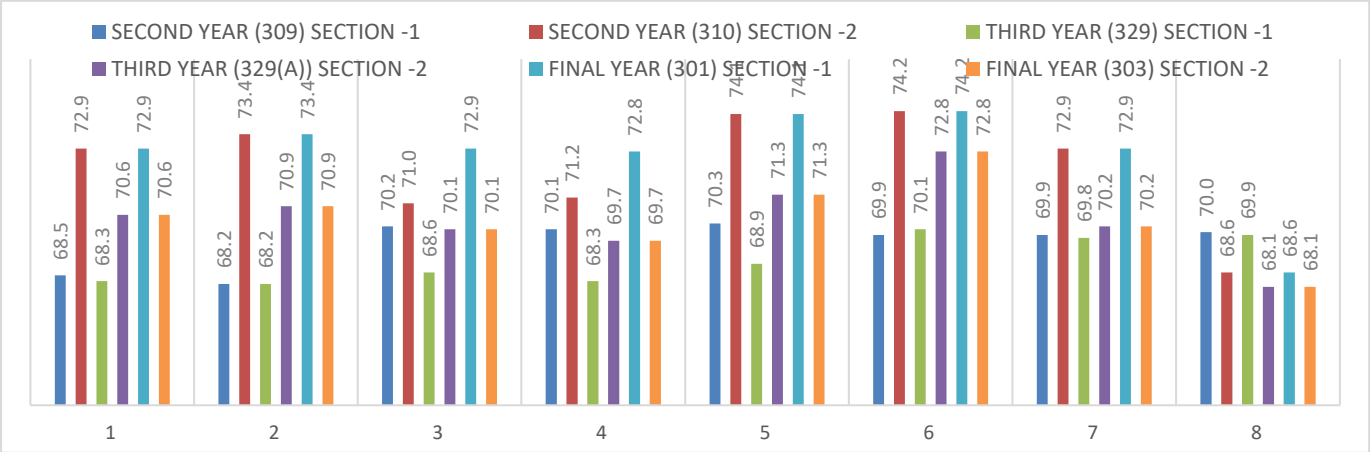

Fig170: Humidity in Class Rooms of IT Dept

Table171: Humidity in Staff Rooms of IT Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
STAFF ROOM-1(304)	72.5	72.6	72.5	72.6	73.6	73.2	72.6	72.5
STAFF ROOM -2 (305)	72.9	72.8	72.7	75.8	75.3	76.5	76.2	76.3
STAFF ROOM -3 (306)	72.9	72.8	71.3	70.2	73.4	73.5	72.6	72.2
IT OFFICE (312)	75.9	75.6	75.8	76.1	76.5	75.6	75.2	75.2
IT HOD ROOM (313)	72.3	72.9	73.6	73.4	72.5	72.9	72.4	72.5
LIBRARY(315)	76.1	73.9	70.1	73.5	75.5	73.5	73.2	72.1
EXAM CELL (320)	72.5	72.6	72.5	72.6	73.6	73.2	72.6	72.5
STAFF ROOM -4 (322)	72.9	72.8	72.7	75.8	75.3	76.5	76.2	76.3
STAFF ROOM -5(319)	72.9	72.8	71.3	70.2	73.4	73.5	72.6	72.2
E CLASSROOM (302)	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
STAFF ROOM -6 (307)	70.1	70.3	69.9	69.4	69.6	70.0	70.1	69.9
TUTORIAL (327)	71.2	71.3	71.1	71.4	69.9	70.1	70.1	70.2
STAFF ROOM -7 (326)	68.9	68.7	68.6	68.9	69.9	70.1	69.7	68.2

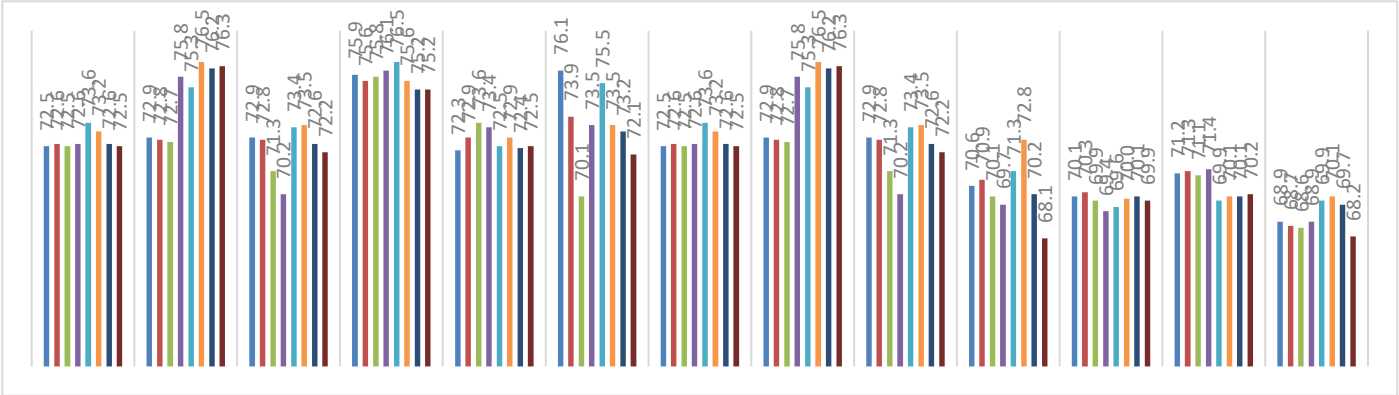

Fig171: Humidity in Staff Rooms of IT Dept

Table172: Humidity in Laboratories of IT Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
PROGRAMMING LANGUAGE &PROJECT LAB(308)	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
INSTALLATION LAB(311)	72.9	73.4	72.9	72.8	74.1	74.2	72.9	68.6
IDE LAB (316)	72.3	72.9	73.6	73.4	72.5	72.9	72.4	72.5
APSSDC (318)	67.1	60.3	60.9	62.6	62.8	64.5	64.3	62.3
INCUBATION CENTRE (326)	68.5	68.2	73.3	73.6	68.6	68.6	69.7	70.1
CAM LAB (321)	72.3	72.9	73.6	72.9	67.1	69.7	68.2	68.6

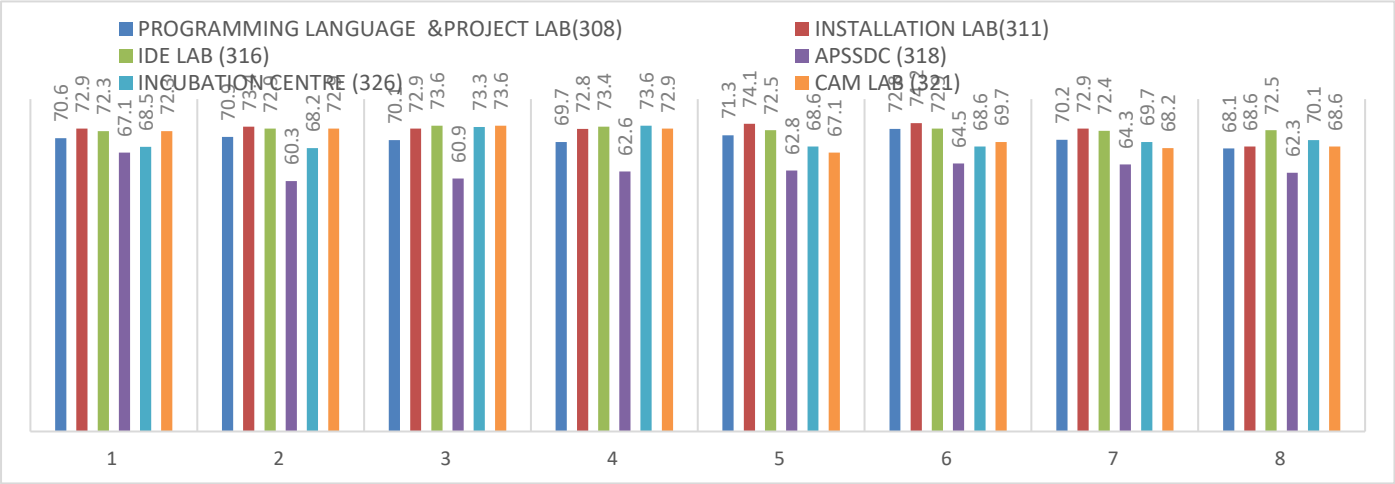

Fig172: Humidity in Laboratories of IT Dept

Table173: Temperature in Class Rooms of IT Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (309) SECTION -1	31.2	31.2	31.5	31.4	31.2	31.1	31.6	31.8
SECOND YEAR (310) SECTION -2	31.2	31.2	31.1	31.0	30.9	30.6	30.4	30.1
THIRD YEAR (329) SECTION -1	30.7	30.9	30.7	30.4	31.1	31.2	31.1	31.2
THIRD YEAR (329(A)) SECTION -2	30.2	30.6	30.7	31.2	31.3	31.7	31.9	32.1
FINAL YEAR (301) SECTION -1	31.8	31.7	30.7	30.6	30.5	30.5	30.4	30.2
FINAL YEAR (303) SECTION -2	30.9	31.1	31.2	31.1	30.4	30.4	31.3	31.5

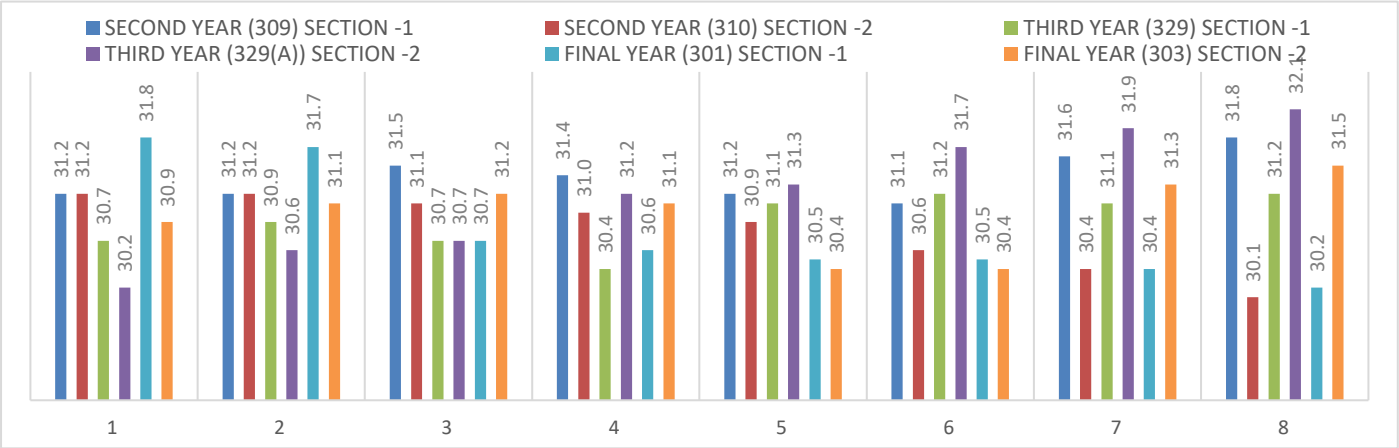

Fig173: Temperature in Class Rooms of IT Dept

Table174: Temperature in Staff Rooms of IT Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
STAFF ROOM-1(304)	30.1	30.8	31.8	31.8	31.6	31.7	31.4	31.3
STAFF ROOM -2 (305)	31.1	31.2	31.5	31.3	31.2	31.2	31.1	31.2
STAFF ROOM -3 (306)	31.7	31.7	31.7	31.5	31.3	31.2	30.9	30.5
IT OFFICE (312)	31.1	31.2	31.1	31.6	30.7	31.5	31.4	32.9
IT HOD ROOM (313)	31.9	31.8	31.5	31.4	31.5	31.9	32.0	32.1
LIBRARY(315)	30.6	30.7	30.5	30.7	30.5	30.5	30.4	30.2
EXAM CELL (320)	30.6	30.7	31.4	31.2	30.6	30.2	30.9	30.8
STAFF ROOM -4 (322)	31.2	31.0	31.2	30.6	31.2	31.1	31.0	31.0
STAFF ROOM -5(319)	31.1	30.2	30.9	30.8	31.1	31.2	31.1	31.2
E CLASSROOM (302)	31.6	31.5	30.9	30.7	30.5	30.5	30.8	30.7
STAFF ROOM -6 (307)	30.1	30.2	30.9	31.1	31.3	31.5	31.6	31.8
TUTORIAL (327)	31.7	31.4	31.7	31.6	31.3	31.4	31.2	31.1
STAFF ROOM -7 (326)	31.2	31.1	31.3	30.9	31.1	31.2	30.4	30.5

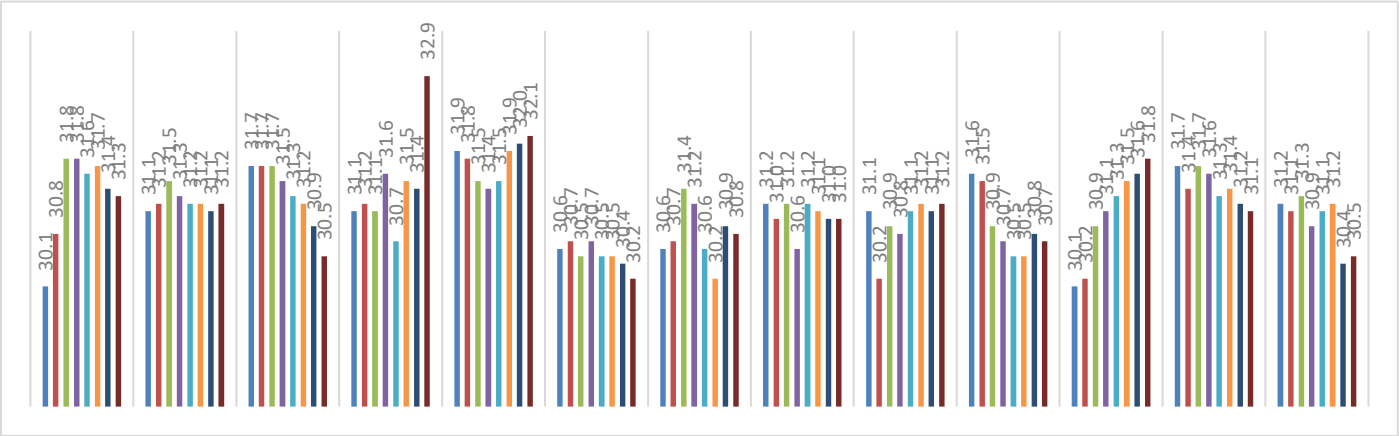

Fig174: Temperature in Staff Rooms of IT Dept

Table175: Temperature in Laboratories of IT Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
PROGRAMMING LANGUAGE & PROJECT LAB(308)	30.1	30.3	30.9	31.2	31.1	30.9	31.2	31.3
INSTALLATION LAB(311)	31.2	31.2	31.1	31.6	31.0	30.9	31.1	31.1
IDE LAB (316)	31.2	31.0	31.2	31.0	32.0	32.1	32.1	31.7
APSSDC (318)	30.4	30.8	30.5	30.8	30.8	30.9	31.3	31.2
INCUBATION CENTRE (326)	30.5	30.7	30.7	30.9	30.6	30.8	31.0	31.2
CAM LAB (321)	31.1	31.1	30.9	30.7	30.4	30.4	30.3	30.1

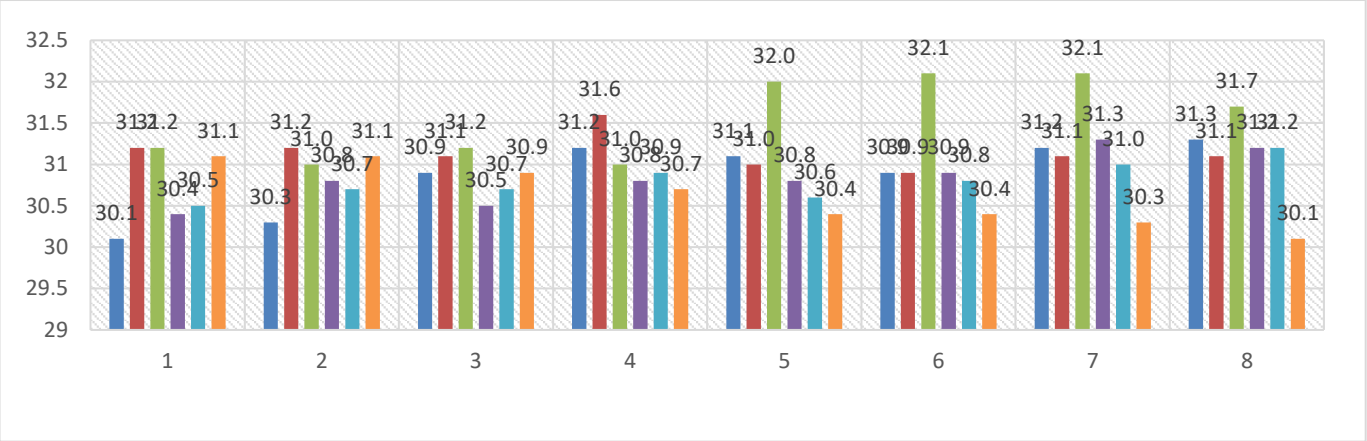

Fig175: Temperature in Laboratories of IT Dept

ELECTRONICS AND COMMUNICATION ENGINEERING

Table176: CO2 in Class Rooms of ECE Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (365) SECTION -1	527	570	565	550	586	600	555	510
SECOND YEAR (366) SECTION -2	532	610	644	595	549	520	456	444
THIRD YEAR (353(A)) SECTION -1	498	520	555	600	598	610	549	555
THIRD YEAR (353) SECTION -2	450	465	440	455	440	406	435	401
FINAL YEAR (341) SECTION -1	482	496	520	576	590	593	610	550
FINAL YEAR (341(A)) SECTION -2	471	425	502	416	435	418	397	356

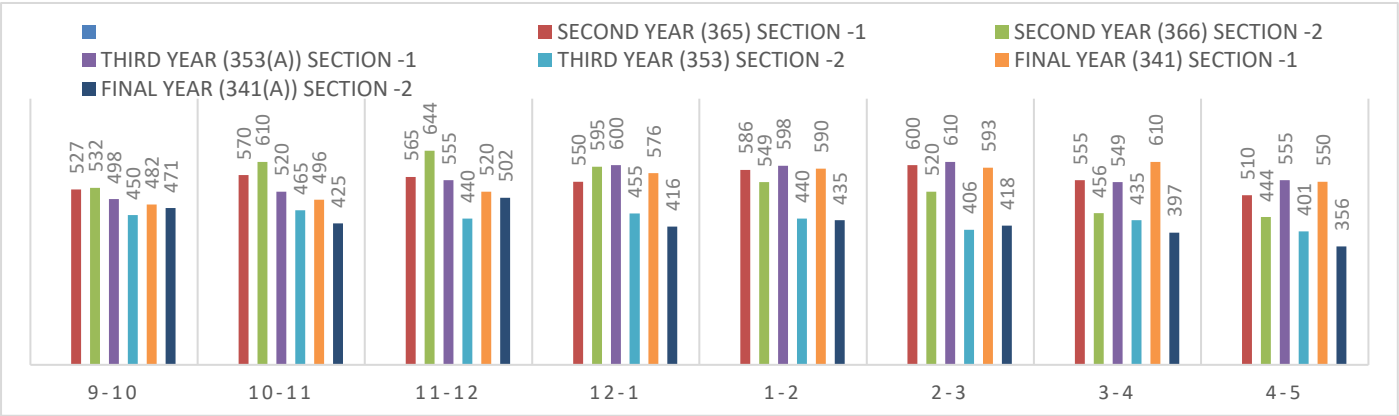

Fig176: CO2 in Class Rooms of ECE Dept

Table177: CO2 in Staff Rooms of ECE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(370)	490	440	450	477	500	489	477	420
ECE OFFICE (368)	443	456	471	500	540	490	462	450
LIBRARY(361)	800	743	560	593	600	615	600	590
STAFF ROOM -1 (358)	510	520	531	540	570	515	500	490
STAFF ROOM -2(340)	392	430	49	500	586	690	562	490
STAFF ROOM -3(254)	490	500	520	516	510	500	462	450
STAFF ROOM -4 (256)	484	492	500	566	610	583	573	590
E-CLASS ROOM (255(A))	561	592	653	689	700	810	1123	900
STAFF ROOM -5(363)	492	588	471	481	496	471	469	430
ECE HOD ROOM (369)	560	565	570	592	600	566	526	490
STAFF ROOM -6 (362)	450	440	501	590	504	490	483	453

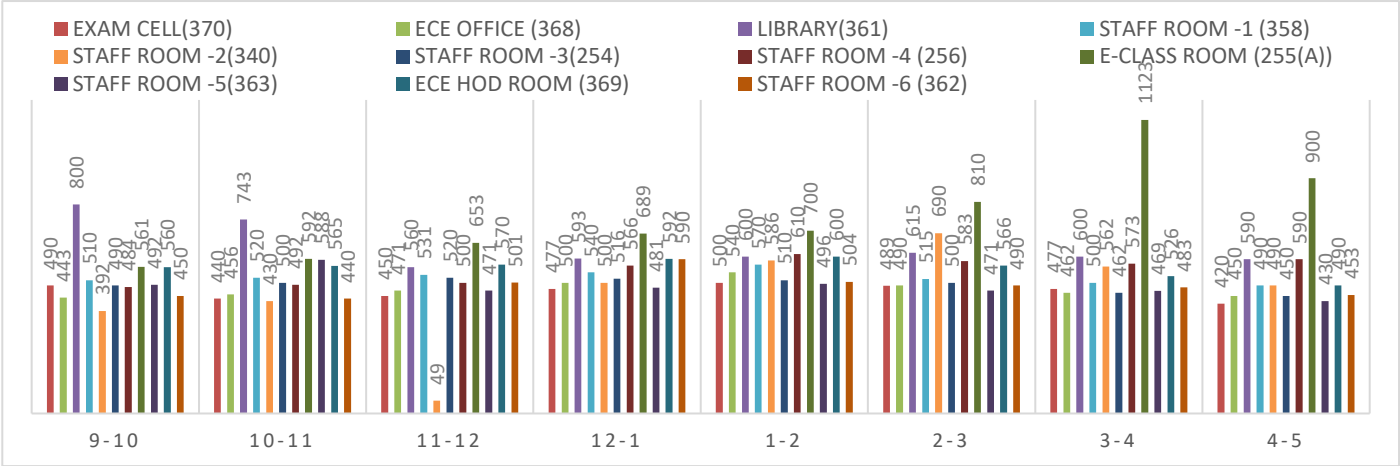

Fig177: CO2 in Staff Rooms of ECE Dept

Table178: CO2 in Class Laboratories of ECE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE R&D LAB(367)	530	555	590	615	645	670	599	545
VLSI LAB(364)	890	923	950	888	791	710	673	600
EMBEDED SYSTEM LAB (357)	750	717	700	680	700	890	710	609
RESEARCH DEVELOPMENT CELL(344)	414	500	544	590	590	600	560	500
ANALOG & DIGITAL LAB (253)	540	600	655	790	700	695	600	520
JC BOSE HALL (255)	637	658	691	777	832	1011	978	900
COMMUNICATION SYSTEM LAB (261)	584	590	593	600	610	575	540	467
MICROWAVE LAB (264)	393	466	505	599	654	644	623	607

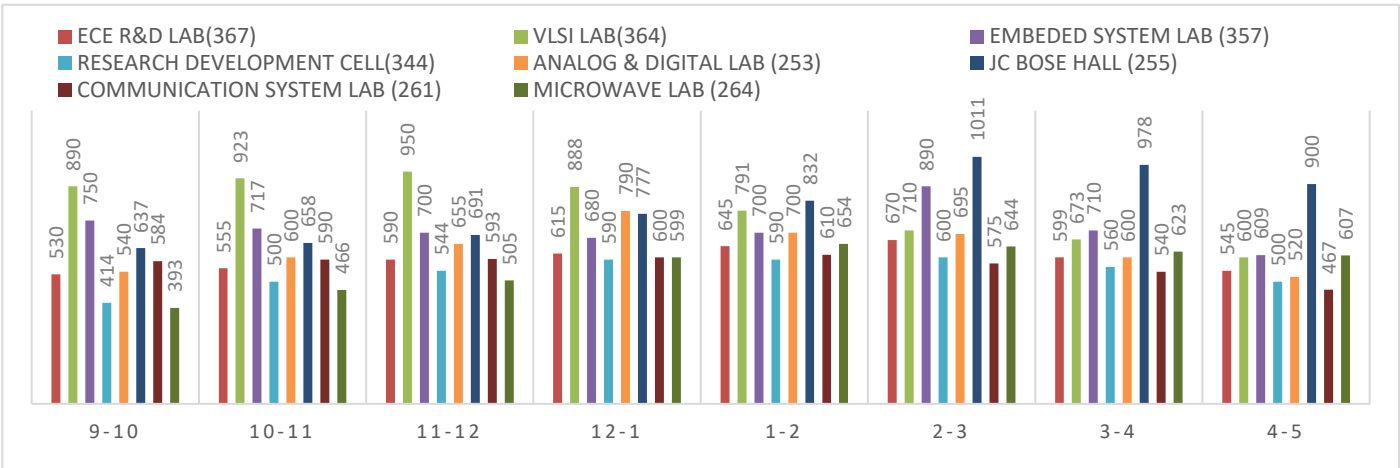

Fig178: CO2 in Class Laboratories of ECE Dept

Table179: Humidity in Class Rooms of ECE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (365) SECTION -1	71.3	71.5	71.1	70.6	70.4	70.1	65.3	67.2
SECOND YEAR (366) SECTION -2	69.9	68.8	68.1	68.1	69.9	71.1	71.0	69.1
THIRD YEAR (353(A)) SECTION -1	63.9	66.6	66.4	66.9	63.4	63.4	67.1	67.9
THIRD YEAR (353) SECTION -2	64.9	64.3	64.5	69.3	64.5	67.5	67.4	66.4
FINAL YEAR (341) SECTION -1	67.1	67.0	66.9	67.1	69.4	69.4	71.1	69.9
FINAL YEAR (341(A)) SECTION -2	70.1	66.1	66.9	66.9	66.7	67.9	67.8	67.2

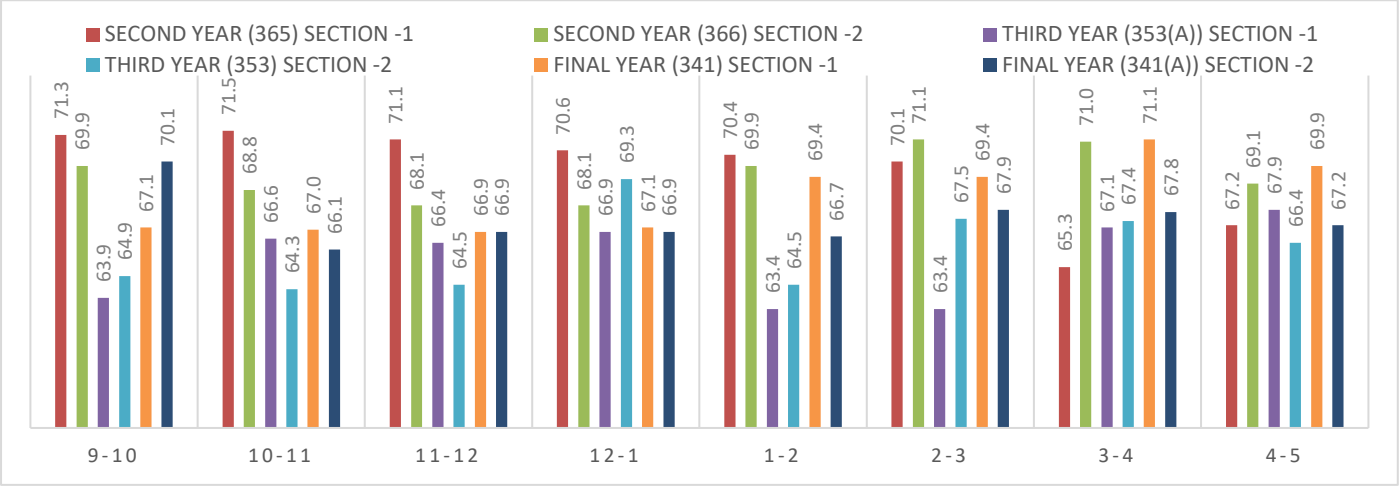

Fig179: Humidity in Class Rooms of ECE Dept

Table180: Humidity in Staff Rooms of ECE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(370)	71.1	68.3	67.2	67.1	67.1	68.3	69.7	70.0
ECE OFFICE (368)	70.6	68.2	65.1	65.3	65.3	66.6	68.9	69.2
LIBRARY(361)	67.1	66.3	66.9	66.4	66.9	67.0	67.9	69.5
STAFF ROOM -1 (358)	66.5	66.4	68.6	68.9	67.2	65.1	67.9	70.2
STAFF ROOM -2(340)	65.9	65.8	65.6	66.1	66.4	66.1	67.4	68.0
STAFF ROOM -3(254)	68.1	68.3	68.0	62.1	62.3	62.2	67.7	68.1
STAFF ROOM -4 (256)	71.2	71.1	70.1	67.1	65.3	63.2	66.3	67.2
E-CLASS ROOM (244(A))	70.6	70.9	70.1	69.7	71.3	72.8	70.2	68.1
STAFF ROOM -5(363)	68.3	68.1	97.9	68.9	69.2	69.1	70.1	69.1
ECE HOD ROOM (369)	67.3	67.3	67.6	67.7	69.5	66.0	65.9	65.7
STAFF ROOM -6 (362)	67.4	67.3	68.2	66.5	66.2	68.2	68.2	68.3

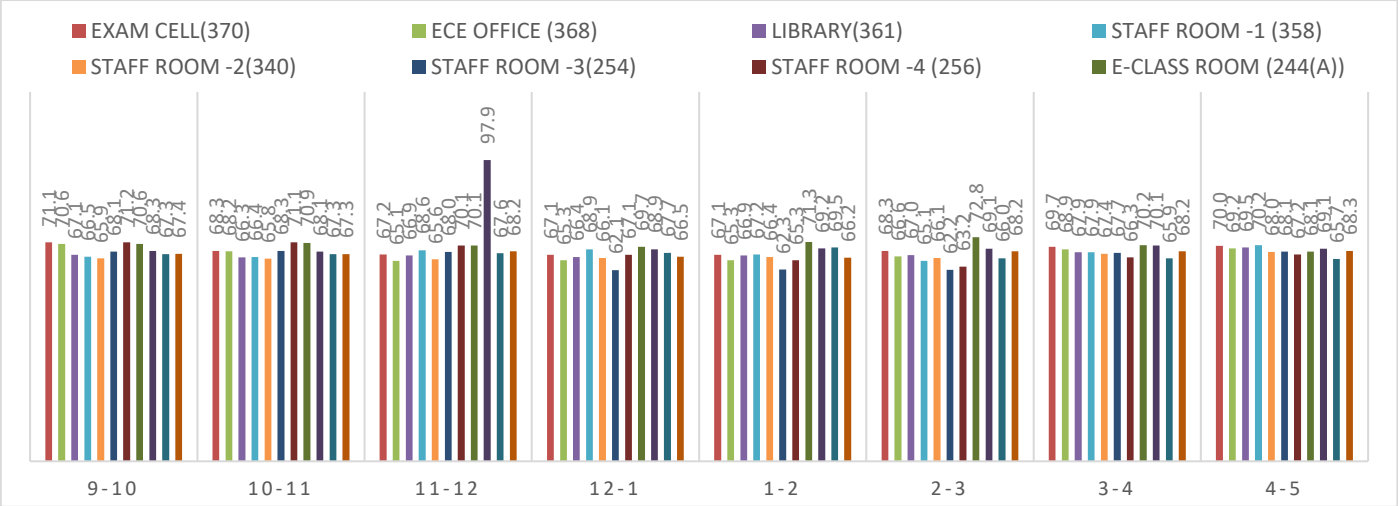

Fig180: Humidity in Staff Rooms of ECE Dept

Table181: Humidity in Laboratories of ECE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE R&D LAB(367)	70.1	71.3	71.5	71.9	71.4	71.4	71.2	71.1
VLSI LAB(364)	61.1	61.2	61.5	61.5	61.5	61.9	62.2	61.1
EMBEDED SYSTEM LAB (357)	66.5	66.9	66.9	66.4	69.3	69.6	65.4	70.1
RESEARCH DEVELOPMENT CELL(344)	69.6	68.9	67.7	67.9	68.4	70.1	69.3	69.8
ANALOG & DIGITAL LAB (253)	70.2	70.1	68.9	67.9	67.2	66.4	66.5	65.5
JC BOSE HALL (255)	69.2	68.2	67.2	67.1	66.1	62.3	62.1	66.1
COMMUNICATION SYSTEM LAB (261)	72.1	72.3	71.4	71.0	67.7	67.5	67.7	67.4
MICROWAVE LAB (264)	74.6	72.9	68.3	69.1	68.9	68.3	68.2	68.3

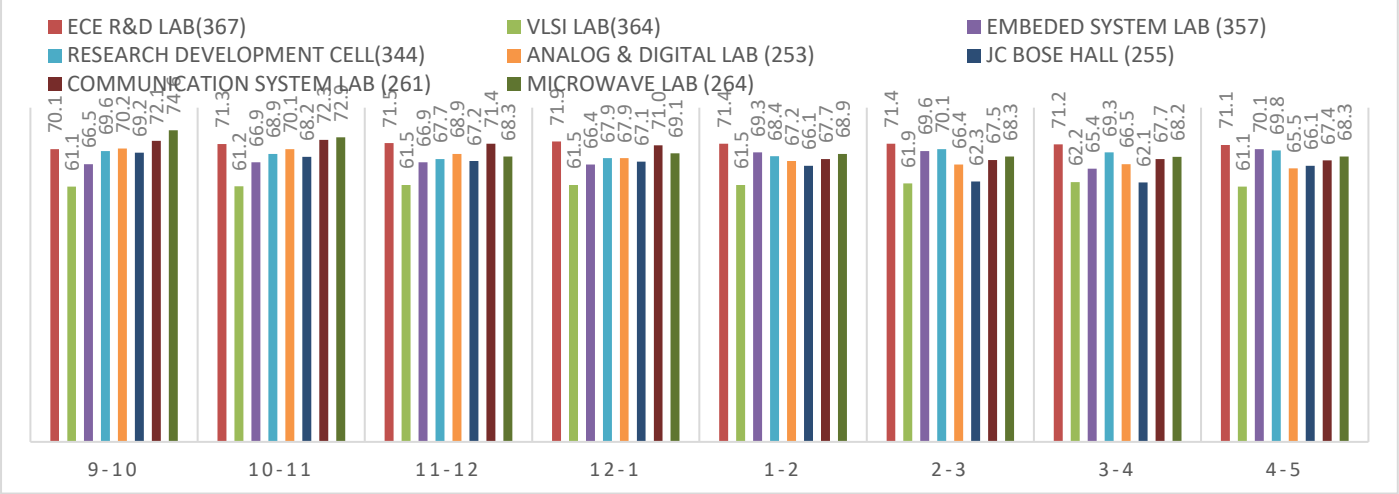

Fig181: Humidity in Laboratories of ECE Dept

Table182: Temperature in Class Rooms of ECE Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (365) SECTION -1	30.2	30.8	30.4	31.4	31	31.6	31.1	31.5
SECOND YEAR (366) SECTION -2	30.6	30.2	30.4	30.4	30.5	30.6	31.6	31.2
THIRD YEAR (353(A)) SECTION -1	31.2	31.6	31.3	31.6	31.7	30.6	31.3	31
THIRD YEAR (353) SECTION -2	30.4	30.5	30.6	31.6	31.2	30.1	31.2	31.5
FINAL YEAR (341) SECTION -1	32.1	32.6	31.2	31.0	30.9	30.9	31.1	31
FINAL YEAR (341(A)) SECTION -2	31.2	31.2	30.9	31.6	31.6	31.1	30.9	30.9

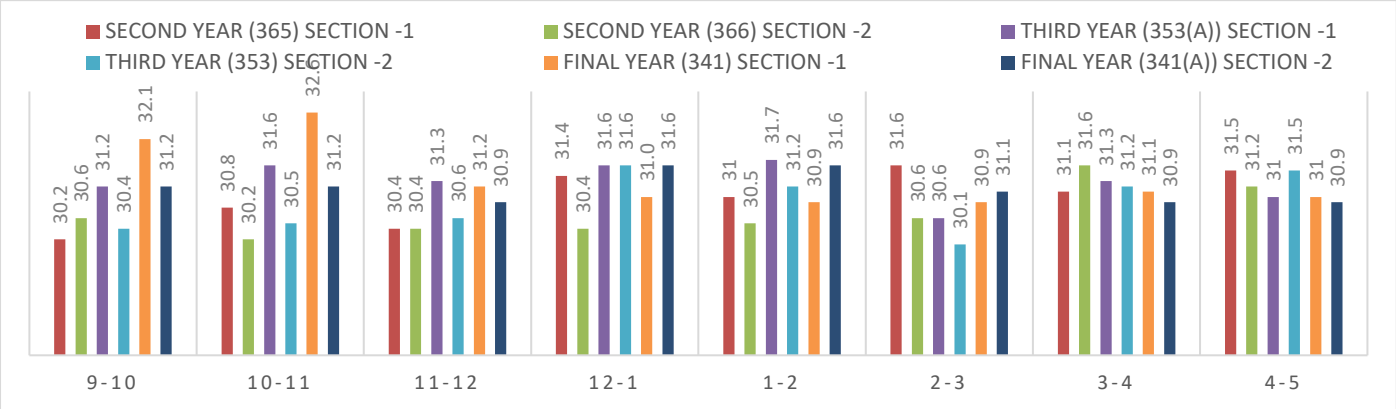

Fig182: Temperature in Class Rooms of ECE Dept

Table183: Temperature in Staff Rooms of ECE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EXAM CELL(370)	31.2	31.6	31.5	31.8	31.4	30.1	30.7	30.9
ECE OFFICE (368)	31.9	31.5	30.6	31.2	31.6	31.4	31.2	30.6
LIBRARY(361)	30.9	30.5	31.2	30.6	30.2	30.1	30.7	32.6
STAFF ROOM -1 (358)	30.5	30.6	30.7	30.9	31.0	31.6	31.2	31.2
STAFF ROOM -2(340)	30.6	30.2	30.4	30.4	30.5	30.6	31.6	31.4
STAFF ROOM -3(254)	30.8	31.2	31.8	31.5	31.9	31.6	31.2	30.2
STAFF ROOM -4 (256)	31.2	30.6	30.1	30.2	31.5	31.0	31.6	31.4
E-CLASS ROOM (244(A))	31.2	31.6	30.5	30.6	31.0	31.5	31.2	31.2
STAFF ROOM -5(363)	31.6	31.5	31.2	31.9	32.1	32.1	32.6	31.9
ECE HOD (369)	31.4	31.6	31.7	31.0	30.9	31.2	31.4	31.8
STAFF ROOM -6 (362)	30.8	31.9	31.5	31.6	31.5	31.9	31.7	31.8

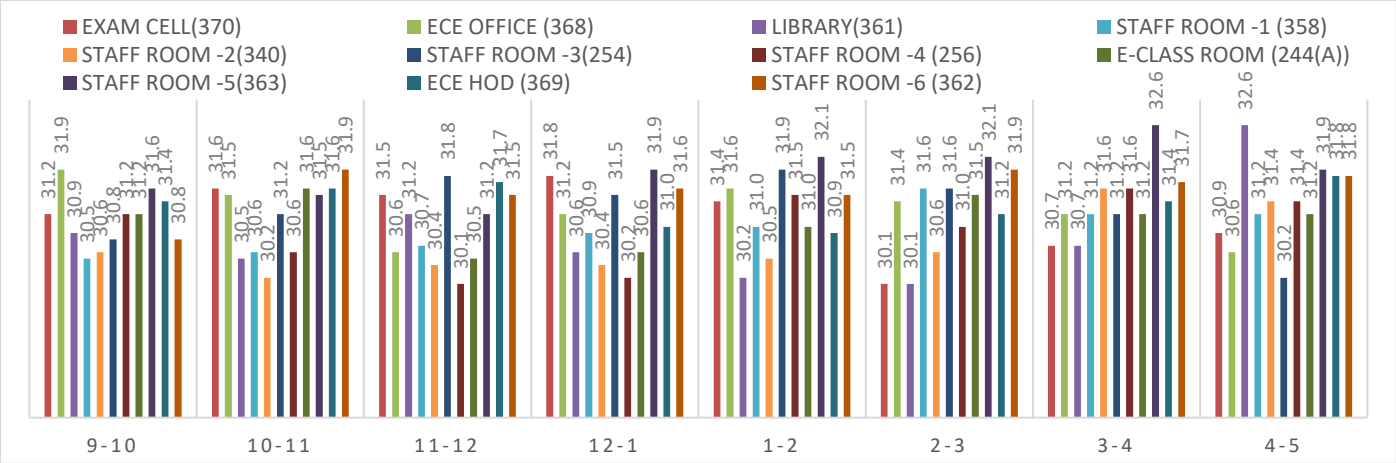

Fig183: Temperature in Staff Rooms of ECE Dept

Table184: Temperature in Laboratories of ECE Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE R&D LAB(367)	31.1	31.1	31.9	31.1	31.2	31.3	30.9	30.7
VLSI LAB(364)	30.7	30.8	31.2	31.4	31.4	31.1	30.9	30.9
EMBEDED SYSTEM LAB (357)	30.8	30.9	31.1	30.5	30.9	30.4	30.7	30.4
RESEARCH DEVELOPMENT CELL(344)	31.2	31.4	32.1	32.0	31.1	30.9	31.0	31.0
ANALOG & DIGITAL LAB (253)	31.3	31.1	32.2	32.1	31.6	31.0	31.1	31.2
JC BOSE HALL (255)	31.2	31.3	31.4	31.1	30.9	31.3	30.9	30.7
COMMUNICATION SYSTEM LAB (261)	31.2	31.3	31.4	31.1	30.9	31.3	30.9	30.7
MICROWAVE LAB (264)	30.2	30.2	31.2	31.6	31.9	31.9	31.2	31.2

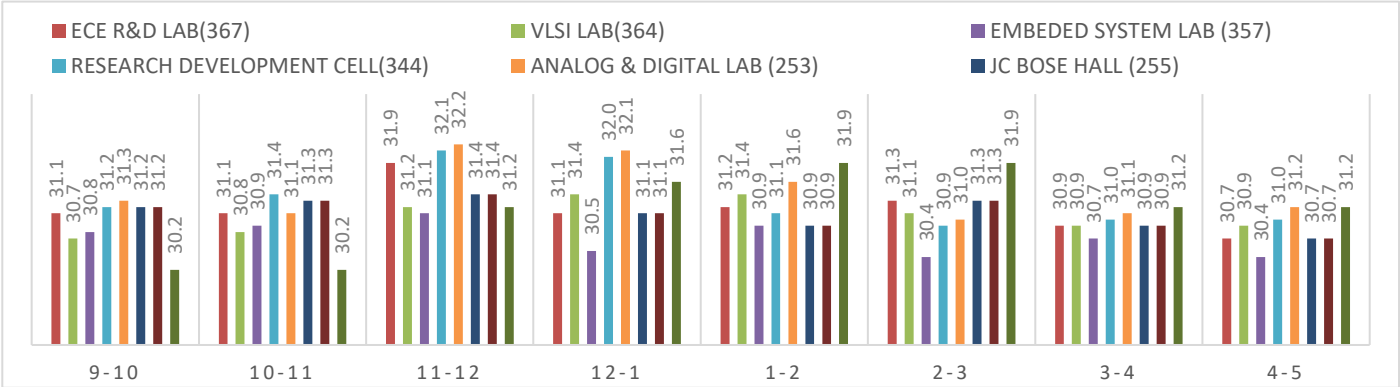

Fig184: Temperature in Laboratories of ECE Dept

ELECTRICAL AND ELECTRONICS ENGINEERING

Table185: CO2 in Class Rooms of EEE Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (242) SECTION -1	490	507	518	521	530	520	515	512
SECOND YEAR (242(A)) SECTION -2	592	610	590	577	550	530	550	505
THIRD YEAR (262) SECTION -1	425	488	458	470	468	482	421	393
THIRD YEAR (263) SECTION -2	430	450	490	500	509	521	519	505
FINAL YEAR (252) SECTION -1	522	536	561	590	598	566	532	500
FINAL YEAR (269) SECTION -2	525	577	595	600	588	565	561	551

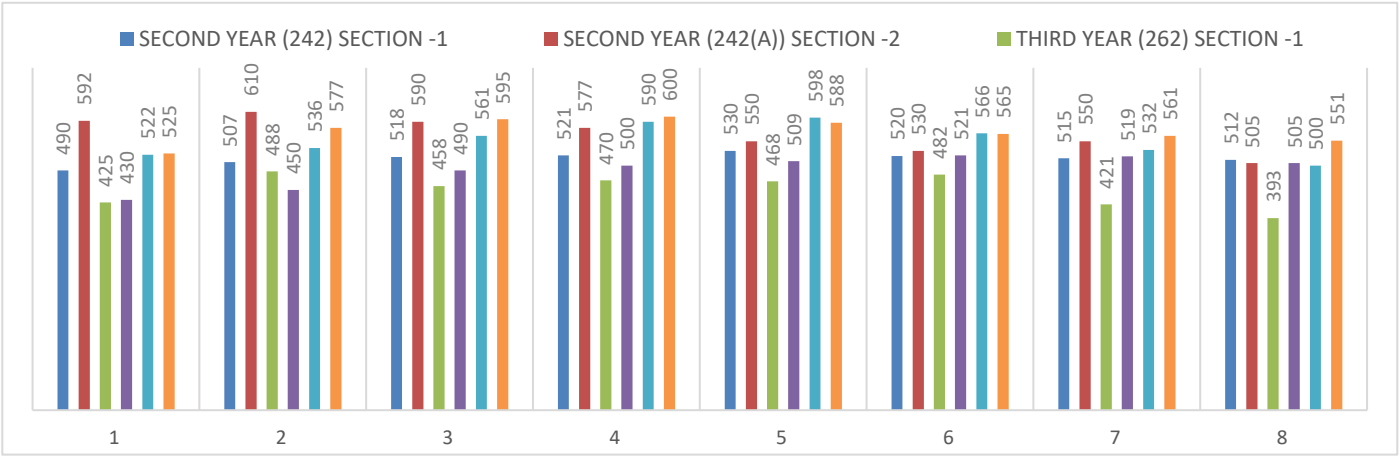

Fig185: CO2 in Class Rooms of EEE Dept

Table186: CO2 in Staff Rooms of EEE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
NETWORKS LAB (140)	445	564	587	610	620	636	625	590
ELECTROMECHANICS LAB (139)	503	577	628	658	630	603	586	555
ELECTRICAL MEASUREMENTS LAB (133)	425	524	559	566	530	513	503	496
SIMULATION OF ELECTRICAL SYSTEMS LAB (247)	490	550	721	900	850	739	690	666
CONTROL SYSTEMS LAB (243)	500	520	526	533	549	555	550	531
CONTROL SYSTEMS LAB ROOM (243(A))	549	560	570	577	580	588	573	550
POWER ELECTRONICS LAB (241)	600	650	710	777	643	610	590	578

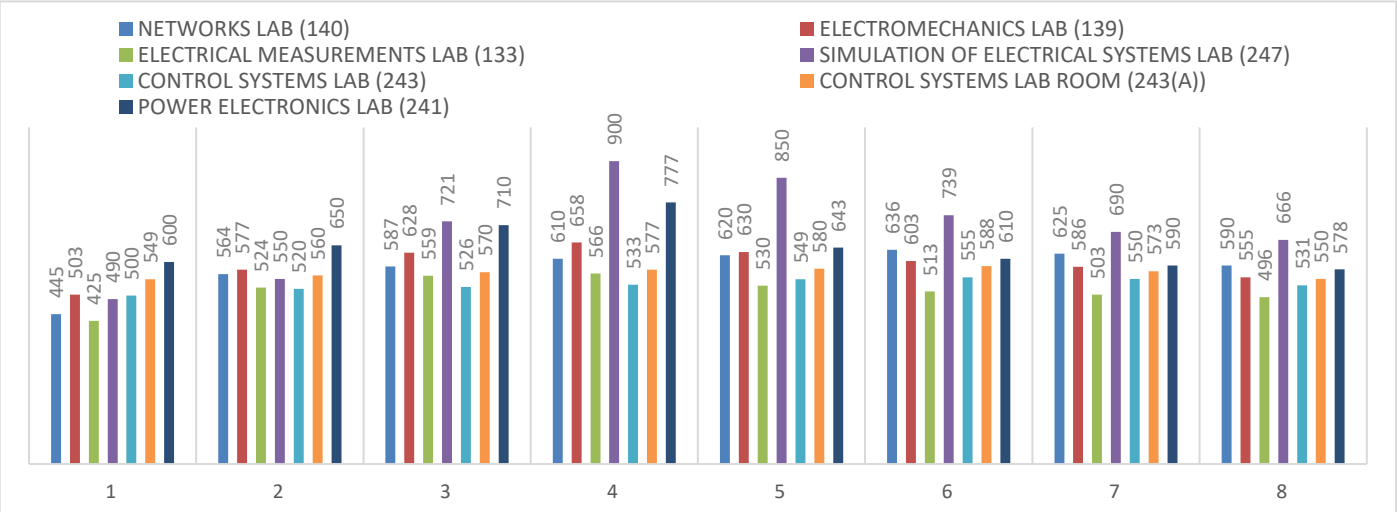

Fig187: CO2 in Staff Rooms of EEE Dept

Table188: CO2 in Class Laboratories of EEE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE OFFICE (132)	443	471	480	493	509	520	590	510
LIBRARY(245)	540	580	561	567	559	540	530	527
STAFF ROOM -1 (268)	438	459	468	454	440	449	428	406
STAFF ROOM -2(260)	530	544	554	569	578	580	571	560
STAFF ROOM -3(259)	505	520	555	600	590	566	536	510
STAFF ROOM -4 (244)	519	530	577	610	590	482	549	520
STAFF ROOM -5(239)	448	450	432	420	433	420	415	411
ECE HOD ROOM (131)	515	524	530	550	590	555	520	490
STAFF ROOM -6 (251)	489	523	585	566	531	500	490	481

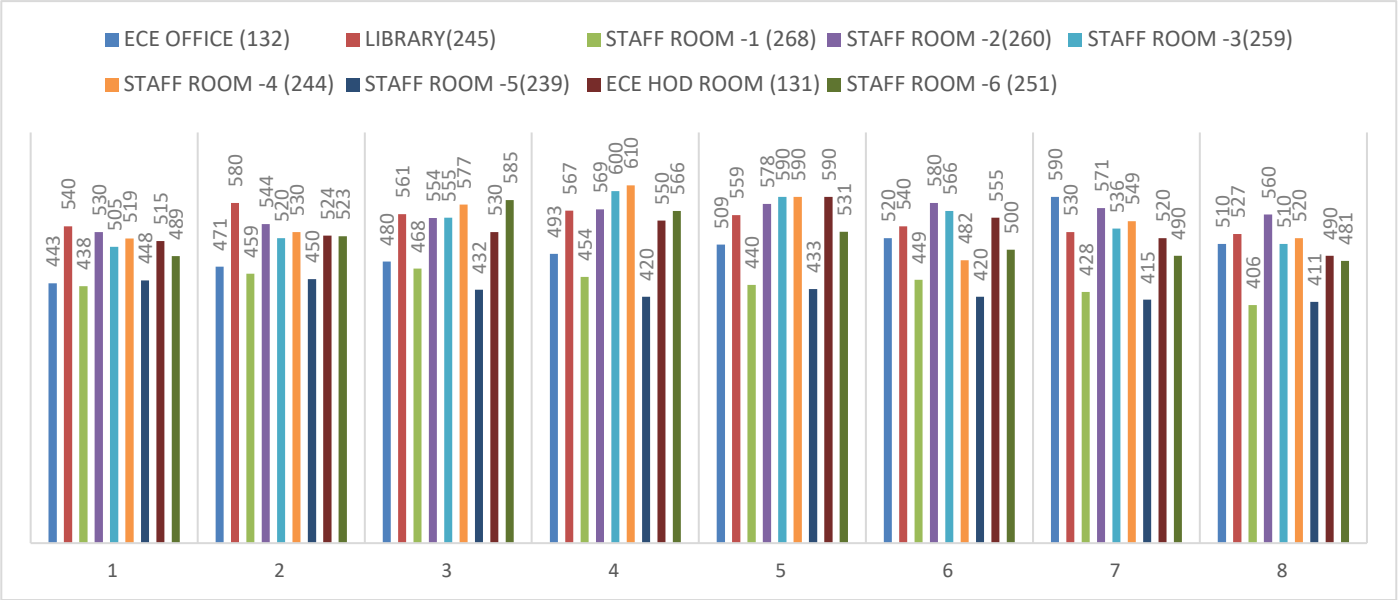

Fig188: CO2 in Class Laboratories of EEE Dept

Table189: Humidity in Class Rooms of EEE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (242) SECTION -1	70.9	70.5	70.3	69.9	71.8	72.2	68.6	66.4
SECOND YEAR (242(A)) SECTION -2	68.1	68.8	70.1	69.3	69.1	68.6	68.9	68.9
THIRD YEAR (262) SECTION -1	70.1	70.4	70.7	67.7	66.3	65.4	69.2	62.3
THIRD YEAR (263) SECTION -2	67.9	66.3	61.3	62.1	64.3	66.0	65.9	65.7
FINAL YEAR (252) SECTION -1	67.4	67.3	68.2	66.5	66.2	66.1	66.9	66.3
FINAL YEAR (269) SECTION -2	70.1	71.2	71.1	66.9	65.5	65.4	65.9	65.3

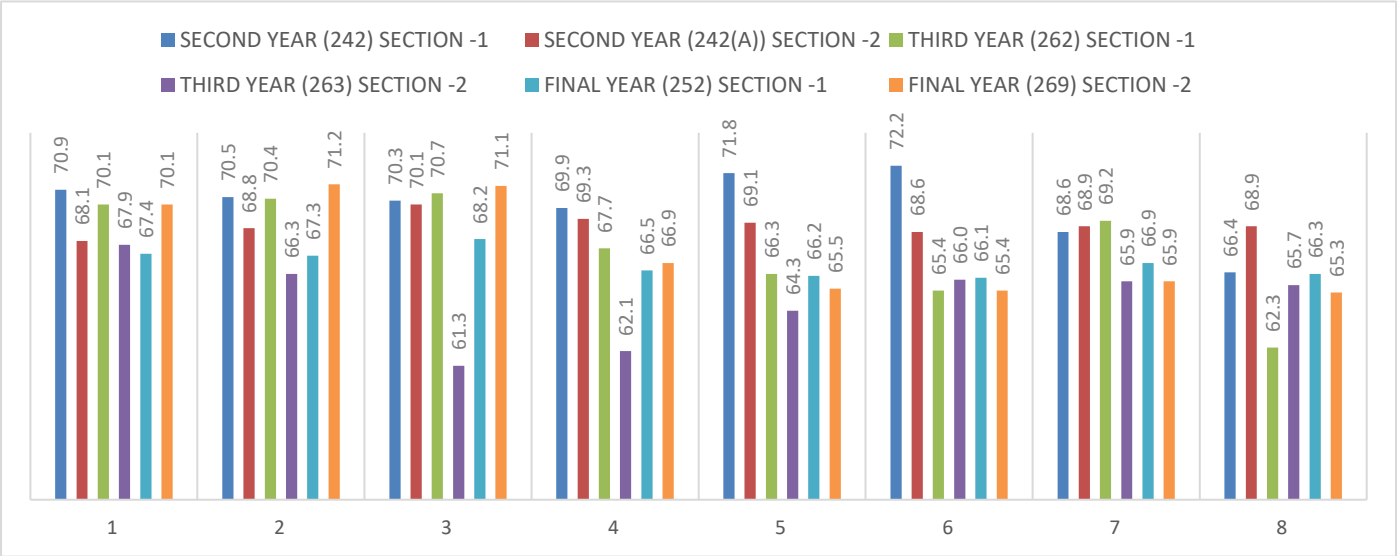

Fig189: Humidity in Class Rooms of EEE Dept

Table190: Humidity in Laboratories of EEE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
NETWORKS LAB (140)	69.9	68.8	68.5	70.9	70.1	71.8	71.5	71.9
ELECTROMECHANICS LAB (139)	70.2	70.9	71.2	69.8	68.9	70.1	70.9	71.2
ELECTRICAL MEASUREMENTS LAB (133)	68.7	68.1	67.1	66.5	65.5	66.0	68.2	69.2
SIMULATION OF ELECTRICAL SYSTEMS LAB (247)	66.8	56.7	64.3	69.2	60.8	60.1	60.5	60.0
CONTROL SYSTEMS LAB (243)	67.8	67.9	68.8	68.9	68.4	67.1	67.3	67.2
CONTROL SYSTEMS LAB ROOM (243(A))	66.8	66.9	68.1	66.2	67.9	68.9	69.3	69.1
POWER ELECTRONICS LAB (241)	66.6	66.8	67.0	67.1	66.9	68.5	69.1	68.7

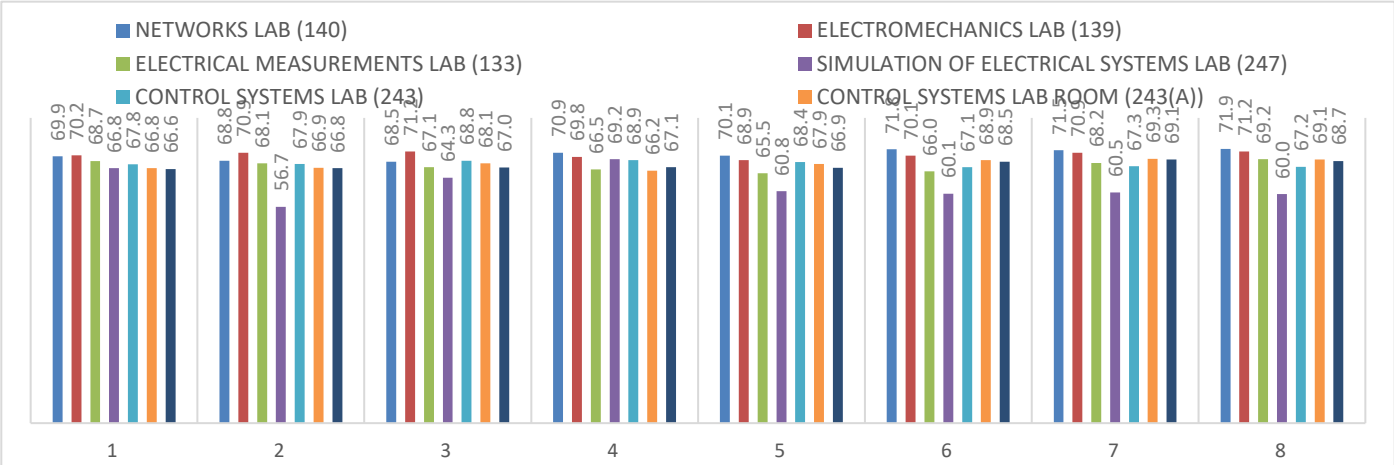

Fig190: Humidity in Laboratories of EEE Dept

Table191: Humidity in Staff Rooms of EEE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
ECE OFFICE (132)	67.1	68.2	68.0	67.9	67.4	67.1	69.2	68.6
LIBRARY(245)	68.5	68.4	68.2	68.3	68.5	68.6	68.9	70.1
STAFF ROOM -1 (268)	76.9	71.2	67.1	66.9	66.5	65.5	69.9	69.1
STAFF ROOM -2(260)	66.8	66.1	65.2	65.1	63.2	63.7	66.8	66.4
STAFF ROOM -3(259)	66.9	66.7	67.0	67.3	67.2	66.1	65.3	65.5
STAFF ROOM -4 (244)	67.2	68.1	67.9	69.8	68.5	67.2	67.3	67.0
STAFF ROOM -5(239)	66.3	66.7	67.0	66.8	67.2	68.1	68.9	69.1
ECE HOD ROOM (131)	67.2	67.8	68.3	68.6	69.4	69.5	69.9	69.1
STAFF ROOM -6 (251)	67.3	67.4	67.4	63.5	63.9	67.1	68.2	68.1

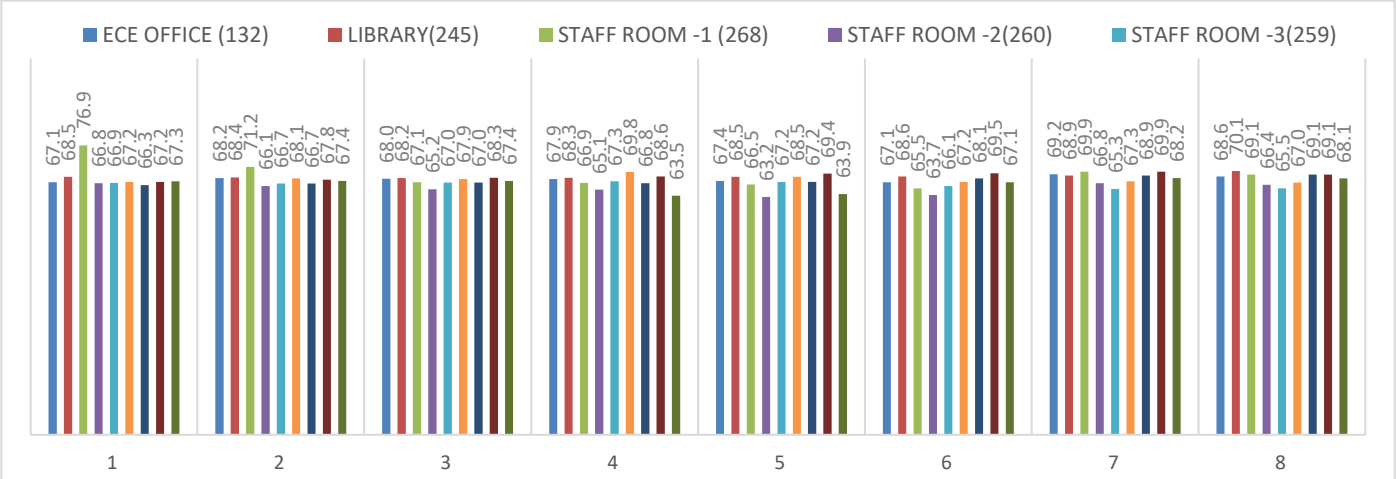

Fig191: Humidity in Staff Rooms of EEE Dept

Table192: Temperature in Class Rooms of EEE Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
SECOND YEAR (242) SECTION -1	30.8	30.8	30.9	31.0	31.2	31.2	31.1	31.0
SECOND YEAR (242(A)) SECTION -2	31.6	31.7	31.5	31.4	31.4	31.3	31.5	31.4
THIRD YEAR (262) SECTION -1	31.4	31.6	31.8	31.8	31.8	31.0	31.1	31.1
THIRD YEAR (263) SECTION -2	31.1	31.3	31.5	31.5	31.2	31.6	31.5	31.8
FINAL YEAR (252) SECTION -1	31.5	31.8	31.2	31.2	31.4	31.5	31.9	31.8
FINAL YEAR (269) SECTION -2	31.1	31.6	31.2	31.0	31.1	31.5	31.8	31.5

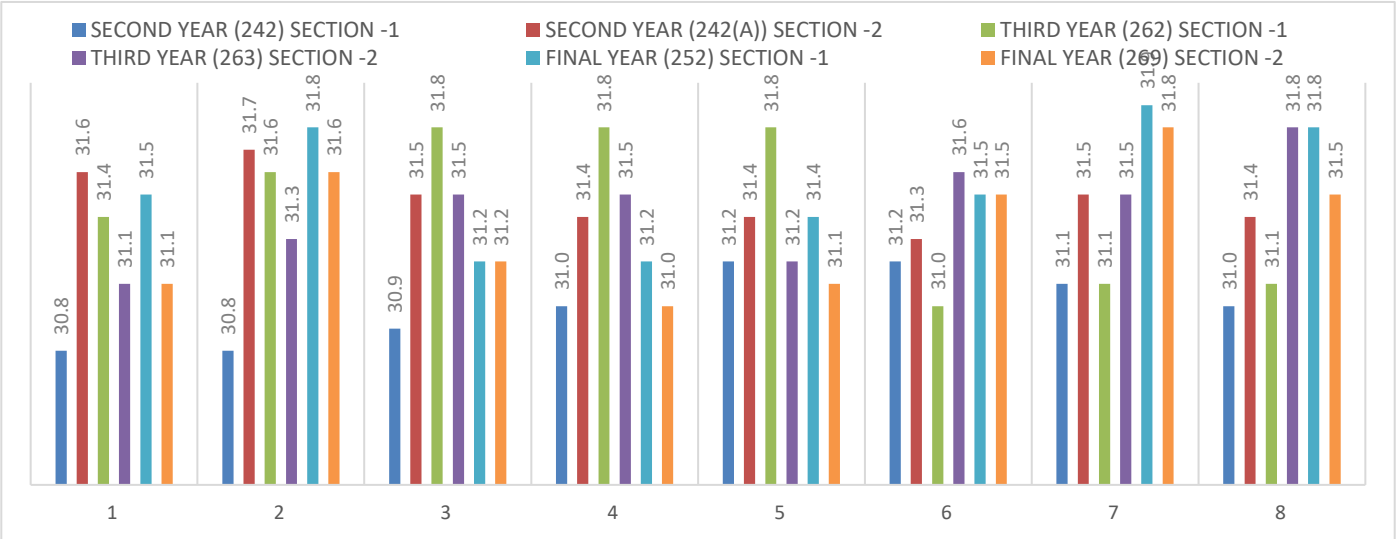

Fig192: Temperature in Class Rooms of EEE Dept

Table193: Temperature in Laboratories of EEE Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
NETWORKS LAB (140)	31.0	31.1	31.2	31.2	30.6	30.7	30.4	30.9
ELECTROMECHANICS LAB (139)	31.1	31.4	31.5	31.0	31.3	31.5	31.2	30.8
ELECTRICAL MEASUREMENTS LAB (133)	31.1	31.1	31.5	31.5	31.2	31.2	31.1	31.0
SIMULATION OF ELECTRICAL SYSTEMS LAB (247)	31.2	31.3	31.6	31.4	31.7	31.2	31.9	31.7
CONTROL SYSTEMS LAB (243)	31.1	31.2	31.1	31.4	31.5	31.5	31.6	31.7
CONTROL SYSTEMS LAB ROOM (243(A))	31.7	31.7	31.7	32.1	31.7	31.8	31.8	31.9
POWER ELECTRONICS LAB (241)	31.8	31.7	31.6	31.6	31.7	31.7	31.7	31.8

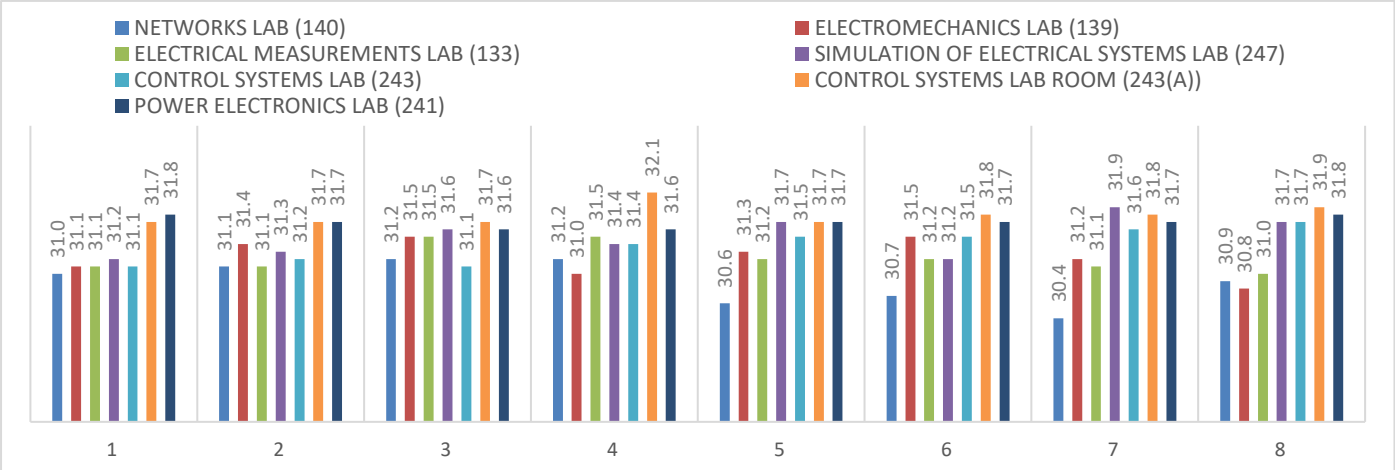

Fig193: Temperature in Laboratories of EEE Dept

Table194: Temperature in Staff Rooms of EEE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
EEE OFFICE (132)	31.5	31.3	31.6	31.9	31.8	31.7	31.3	31.0
LIBRARY(245)	31.3	31.6	31.5	31.7	31.6	31.5	31.7	31.7
STAFF ROOM -1 (268)	30.1	30.9	31.7	31.9	31.5	31.4	31.2	31.2
STAFF ROOM -2(260)	31.1	31.2	31.4	31.5	31.7	31.8	31.5	31.8
STAFF ROOM -3(259)	31.0	31.1	31.3	29.0	29.8	30.4	30.9	31.1
STAFF ROOM -4 (244)	31.4	31.7	31.5	31.2	31.6	31.4	31.5	31.8
STAFF ROOM -5(239)	31.6	31.7	31.7	31.3	31.7	31.5	31.9	31.5
EEE HOD ROOM (131)	31.6	31.7	31.9	31.7	31.5	31.4	31.2	31.3
STAFF ROOM -6 (251)	31.5	31.5	31.8	31.6	31.5	31.2	31.8	31.5

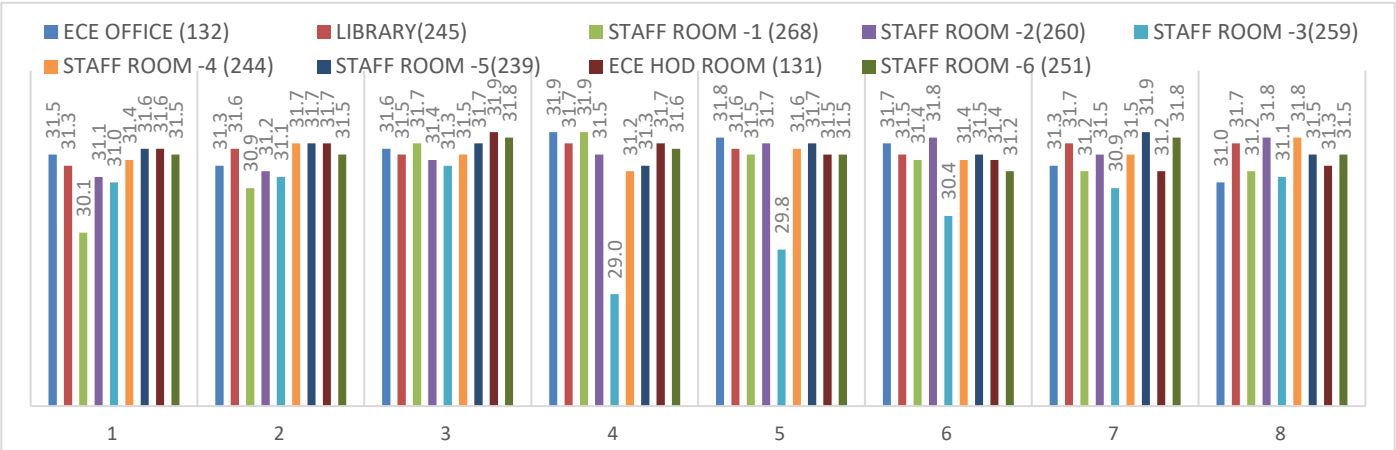

Fig194: Temperature in Staff Rooms of EEE Dept

FRESHMAN ENGINEERING

Table194: CO2 in Class Rooms of FE Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
IT FIRST YEAR (426) SECTION - 1	451	440	458	438	455	450	436	420
IT FIRST YEAR (427) SECTION - 2	475	489	510	500	490	500	501	496
CIVIL FIRST YEAR (422) SECTION -1	486	477	432	471	480	460	455	443
COMPUTER SCIENCE AND DATA SCIENCES (420)	569	571	575	582	561	540	523	490
COMPUTER SCIENCE AND MACHINE LEARNING (419)	537	540	566	587	555	539	515	500
CSE FIRST YEAR (417) SECTION - 3	560	533	512	523	525	529	522	500
CSE FIRST YEAR (411) SECTION - 2	471	483	502	489	466	428	410	401
CSE FIRST YEAR (410) SECTION - 1	441	492	564	491	483	480	470	445
MECH FIRST YEAR (408)	478	491	509	530	545	560	541	532
EEE FIRST YEAR (407)	510	520	530	545	561	540	501	490
ECE FIRST YEAR (436) SECTION - 1	490	515	539	553	551	550	529	500
ECE FIRST YEAR (437) SECTION - 2	465	451	439	461	485	455	449	438

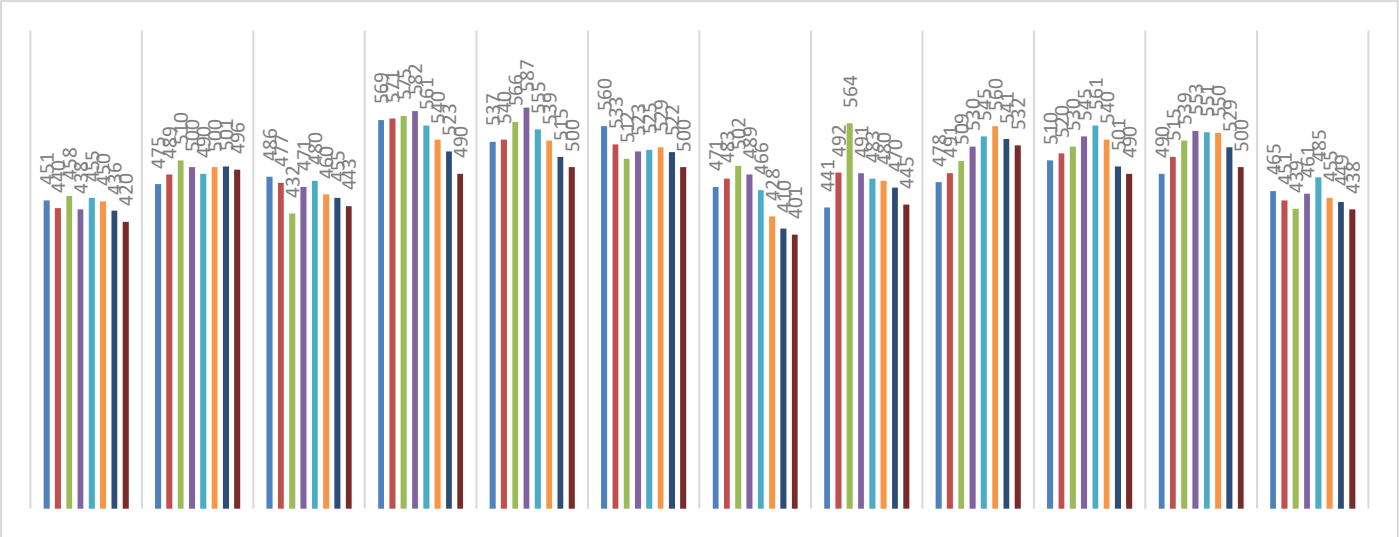

Fig194: CO2 in Class Rooms of FE Dept

Table195: CO2 in Staff Rooms of FE Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
FED OFFICE (418)	514	536	569	550	539	520	480	450
FED HOD ROOM (418(A))	600	596	580	585	590	577	569	540
STAFF ROOM - 1 (416)	425	476	500	465	435	440	415	400
EXAM CELL (413)	414	455	475	450	449	428	420	400
STAFF ROOM - 2 (409)	425	436	449	471	460	437	410	400
STAFF ROOM - 3 (433)	434	449	461	470	455	439	420	401
STAFF ROOM - 4 (434)	450	455	461	470	455	449	439	430
STAFF ROOM - 5 (439)	405	419	429	449	475	456	449	445
STAFF ROOM - 6 (446)	425	439	461	470	490	465	460	455
STAFF ROOM - 7 (415)	505	524	539	550	539	525	515	510
STAFFROOM - 8 (428(A))	421	432	438	449	450	459	429	410

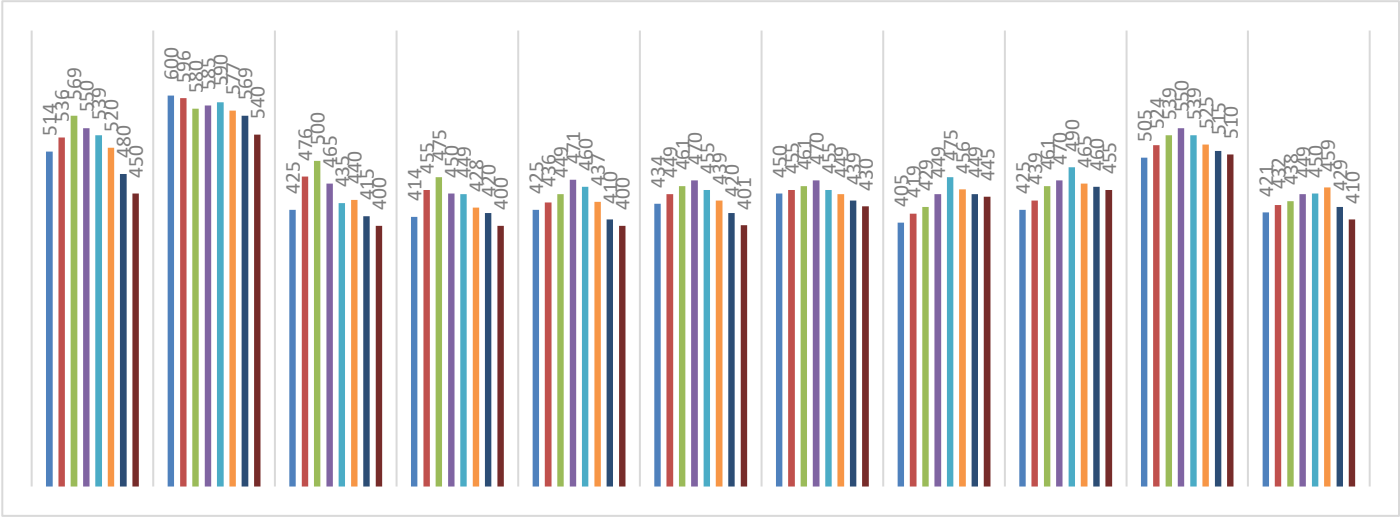

Fig195: CO2 in Staff Rooms of FE Dept

Table196: CO2 in Laboratories of FE Dept

CO2 VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
DRAWING HALL - 1 (428)	451	460	466	453	460	483	485	470
CHEMISTRY LAB (425)	421	445	465	432	420	450	439	431
PHYSICS LAB (424)	415	420	430	463	469	473	465	459
PROBLEM SOLVING AND PROGRAMMING LAB (414)	463	480	498	480	485	475	470	451
LIFE SCIENCES LAB (438)	459	460	467	482	496	490	485	481
DESIGN THINKING AND PRODUCT INNOVATION LAB (459)	410	459	470	475	490	475	469	460
ENGISH LAB (462)	1238	1459	1569	1671	1587	1209	1111	103
DRAWING HALL - 2 (422)	484	481	475	470	459	451	447	440

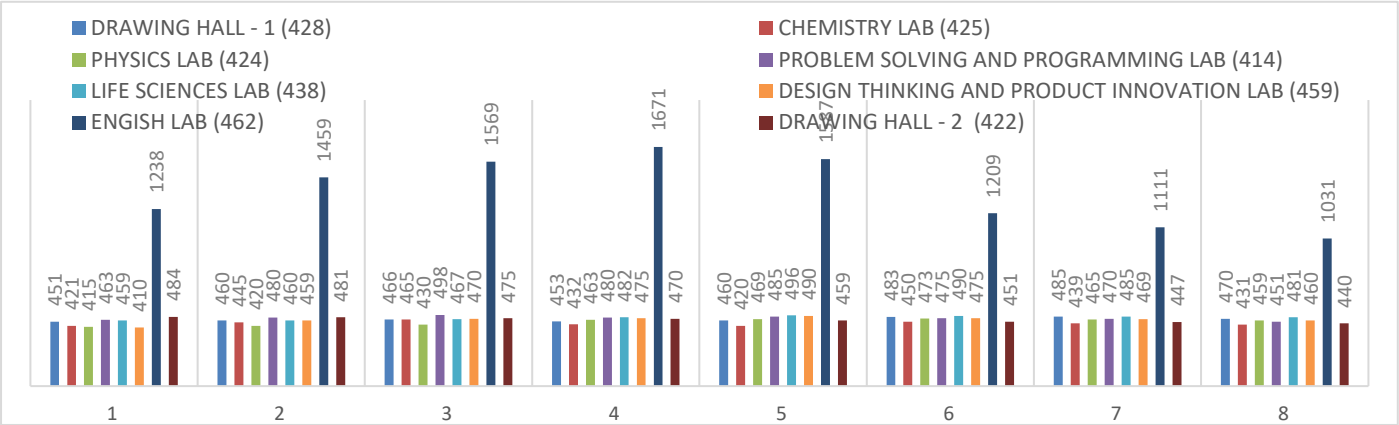

Fig196: CO2 in Laboratories of FE Dept

Table197: Humidity in Class Rooms of FE Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
IT FIRST YEAR (426) SECTION - 1	74.5	74.1	73.9	73.4	72.9	72.1	71.6	71.3
IT FIRST YEAR (427) SECTION - 2	73.9	72.6	71.2	70.9	71.2	71.2	71.1	71.3
CIVIL FIRST YEAR (422) SECTION -1	71.5	71.5	71.3	71.7	71.5	71.1	70.9	70.1
COMPUTER SCIENCE AND DATA SCIENCES (420)	70.2	70.9	71.1	71.1	68.9	70.2	71.0	71.1
COMPUTER SCIENCE AND MACHINE LEARNING (419)	71.5	71.3	71.3	71.3	71.6	71.5	70.9	70.1
CSE FIRST YEAR (417) SECTION - 3	72.8	71.9	71.5	71.9	72.3	72.1	72.6	72.5
CSE FIRST YEAR (411) SECTION - 2	65.5	66.1	67.8	68.1	69.2	69.9	70.1	70.1
CSE FIRST YEAR (410) SECTION - 1	70.0	70.6	70.9	71.1	71.0	71.1	71.3	71.1
MECH FIRST YEAR (408)	72.1	72.6	72.8	73.0	72.5	72.0	71.1	71.2
EEE FIRST YEAR (407)	68.2	65.7	66.3	65.4	71.7	71.2	71.1	71.0
ECE FIRST YEAR (436) SECTION - 1	71.3	71.1	71.9	72.1	72.0	72.1	72.1	72.0
ECE FIRST YEAR (437) SECTION - 2	68.6	68.6	68.0	68.7	68.5	68.4	68.1	68.0

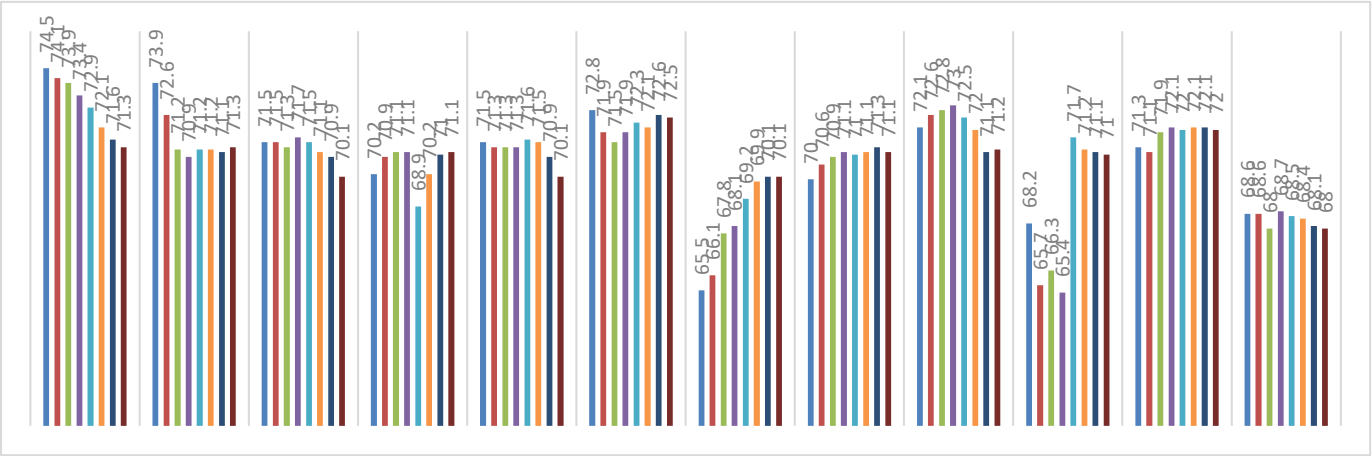

Fig197: Humidity in Class Rooms of FE Dept

Table198: Humidity in Staff Rooms of FE Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
FED OFFICE (418)	70.1	70.5	70.9	71.1	71.2	68.1	68.0	68.1
FED HOD ROOM (418(A))	70.2	70.9	71.2	71.1	71.2	71.3	71.1	71.0
STAFF ROOM - 1 (416)	70.2	70.6	70.7	70.9	71.2	71.2	71.4	71.1
EXAM CELL (413)	70.7	70.9	71.0	71.2	71.3	71.4	71.2	71.1
STAFF ROOM - 2 (409)	69.7	69.8	69.1	69.8	69.4	69.5	69.5	69.4
STAFF ROOM - 3 (433)	71.0	71.6	71.9	72.1	72.1	72.3	72.1	70.1
STAFF ROOM - 4 (434)	68.5	68.2	67.8	66.5	66.4	65.1	68.3	68.2
STAFF ROOM - 5 (439)	68.7	68.1	68.7	68.8	70.1	70.0	69.9	69.1
STAFF ROOM - 6 (446)	68.7	68.7	68.9	70.1	70.4	70.4	70.7	70.4
STAFF ROOM - 7 (415)	70.1	70.2	70.2	70.9	70.8	71.2	69.4	69.8
STAFF ROOM - 8 (428(A))	73.3	73.1	72.8	72.7	71.2	70.2	71.6	72.1

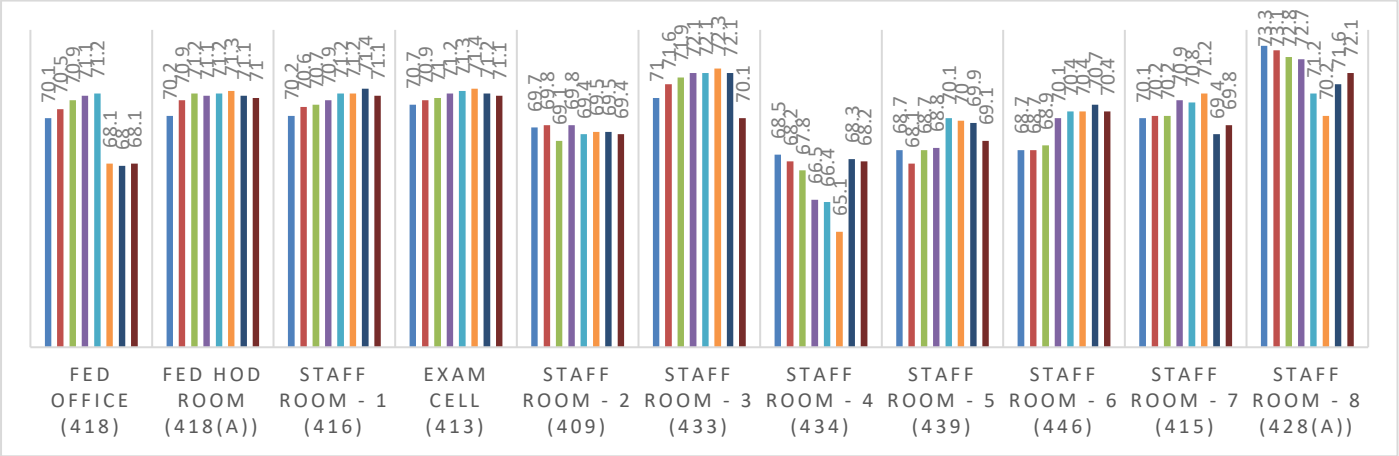

Fig198: Humidity in Staff Rooms of FE Dept

Table199: Humidity in Laboratories of FE Dept

HUMIDITY VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
DRAWING HALL - 1 (428)	73.1	73.1	72.9	72.5	72.1	72.0	72.5	73.2
CHEMISTRY LAB (425)	73.3	73.1	74.1	73.9	73.6	73.1	74.0	73.9
PHYSICS LAB (424)	71.4	71.6	72.2	72.3	72.3	72.5	72.1	72.1
PROBLEM SOLVING AND PROGRAMMING LAB (414)	71.4	71.5	71.9	72.1	72.0	72.1	71.6	71.2
LIFE SCIENCES LAB (438)	70.8	71.2	71.1	68.5	68.4	68.2	68.2	68.1
DESIGN THINKING AND PRODUCT INNOVATION LAB (459)	70.3	70.6	70.7	71.2	71.6	71.7	71.9	70.2
ENGISH LAB (462)	56.7	56.1	56.7	56.7	51.1	51.3	52.3	52.6
DRAWING HALL - 2 (422)	68.1	68.3	68.2	68.2	67.9	67.7	68.1	68.9

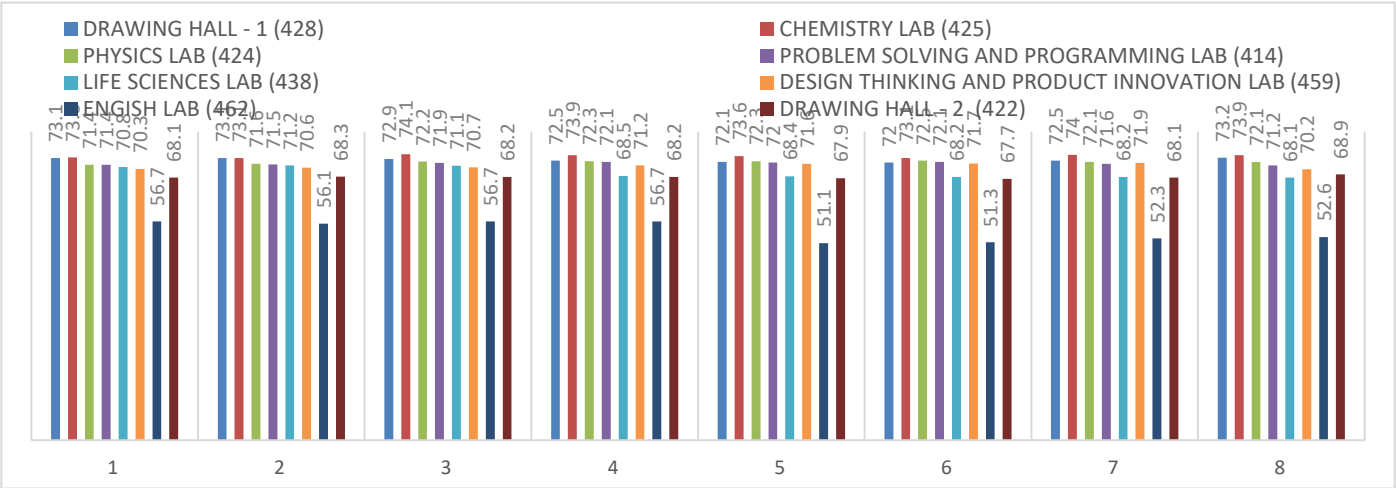

Fig199: Humidity in Laboratories of FE Dept

Table200: Temperature in Class Rooms of FE Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
IT FIRST YEAR (426) SECTION - 1	31.2	31.1	30.6	30.4	30.1	30.0	30.5	31.1
IT FIRST YEAR (427) SECTION - 2	29.6	30.1	30.2	30.6	30.9	31.1	31.1	31.4
CIVIL FIRST YEAR (422) SECTION -1	30.9	30.9	30.7	30.6	30.8	30.8	30.1	30.6
COMPUTER SCIENCE AND DATA SCIENCES (420)	31.4	31.6	31.5	32.0	30.9	30.7	31.0	31.1
COMPUTER SCIENCE AND MACHINE LEARNING (419)	31.7	31.6	31.6	31.9	32.5	32.4	32.1	32.0
CSE FIRST YEAR (417) SECTION - 3	28.6	29.1	29.5	29.8	30.7	30.7	30.1	30.5
CSE FIRST YEAR (411) SECTION - 2	31.5	31.6	31.9	32.1	32.1	31.7	31.5	31.9
CSE FIRST YEAR (410) SECTION - 1	30.3	30.5	30.4	31.9	30.5	30.5	30.9	30.5
MECH FIRST YEAR (408)	31.2	30.6	30.4	30.5	30.5	30.9	31.1	31.2
EEE FIRST YEAR (407)	31.2	31.2	31.5	31.4	31.0	30.9	30.7	30.6
ECE FIRST YEAR (436) SECTION - 1	30.2	30.3	30.1	30.1	30.9	31.2	31.2	31.5
ECE FIRST YEAR (437) SECTION - 2	29.2	29.1	29.5	29.6	29.8	30.0	30.1	30.1

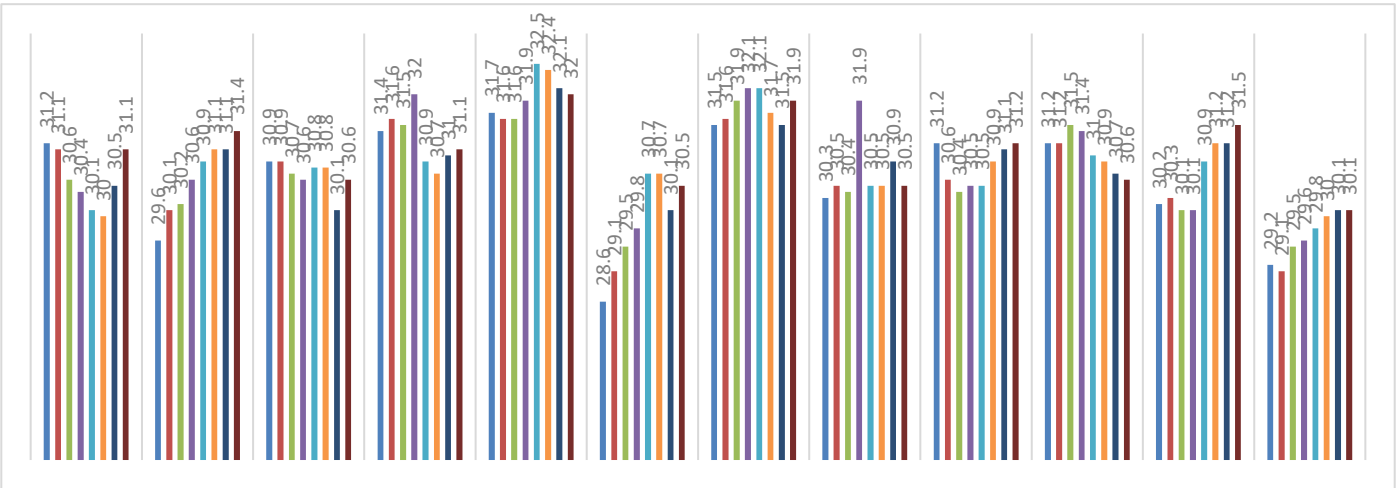

Fig200: Temperature in Class Rooms of FE Dept

Table201: Temperature in Staff Rooms of FE Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
FED OFFICE (418)	29.7	29.8	28.7	30.1	30.2	30.2	30.9	31.2
FED HOD ROOM (418(A))	31.2	31.2	31.1	31.5	31.4	30.7	30.9	30.7
STAFF ROOM - 1 (416)	31.2	31.3	31.5	30.7	30.7	30.8	30.8	30.9
EXAM CELL (413)	31.3	31.5	31.9	32.1	32.1	32.3	31.2	31.1
STAFF ROOM - 2 (409)	30.3	30.4	30.3	30.7	30.7	30.9	31.1	31.3
STAFF ROOM - 3 (433)	31.3	31.3	31.4	31.5	31.1	30.9	30.1	30.1
STAFF ROOM - 4 (434)	30.0	30.4	30.4	31.1	31.2	30.6	31.1	30.8
STAFF ROOM - 5 (439)	30.2	30.2	30.3	30.5	30.7	31.2	30.9	31.0
STAFF ROOM - 6 (446)	30.2	30.1	30.2	30.1	30.5	30.5	31.2	31.0
STAFF ROOM - 7 (415)	31.5	31.6	31.6	31.8	31.7	31.1	30.5	30.0
STAFFROOM - 8 (428(A))	29.2	29.9	30.5	30.5	30.6	31.2	31.6	30.3

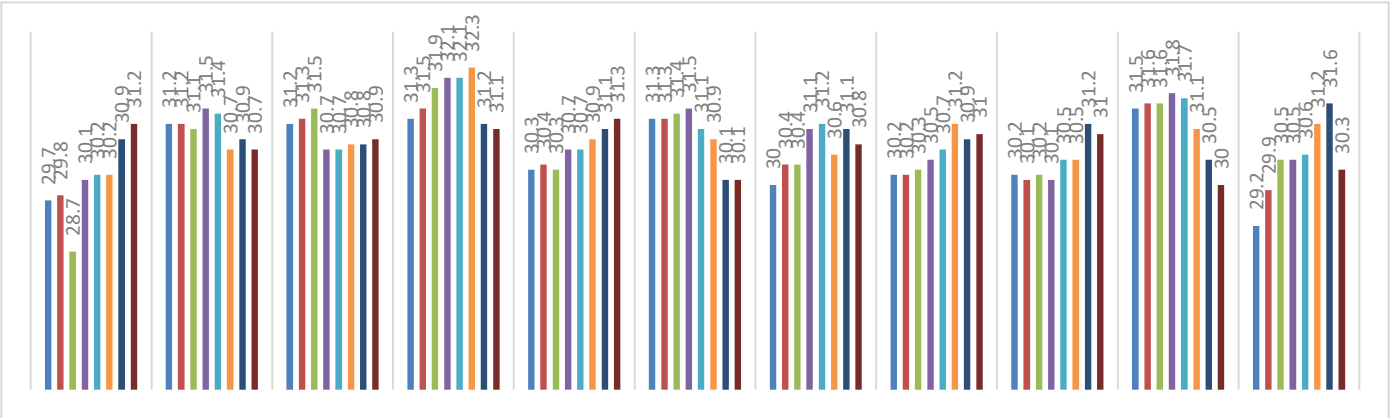

Fig201: Temperature in Staff Rooms of FE Dept

Table202: Temperature in Laboratories of FE Dept

TEMPERATURE VALUES								
TIME SLOT								
LABS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
DRAWING HALL - 1 (428)	29.3	29.1	28.3	28.1	28.2	28.6	29.4	29.1
CHEMISTRY LAB (425)	31.8	31.2	30.7	30.5	30.5	30.1	30.1	30.2
PHYSICS LAB (424)	30.9	30.6	30.5	30.4	30.4	30.4	30.1	30.2
PROBLEM SOLVING AND PROGRAMMING LAB (414)	30.7	30.1	31.3	31.2	31.3	31.4	30.6	30.9
LIFE SCIENCES LAB (438)	30.1	30.1	30.2	30.6	30.9	31.2	31.1	30.2
DESIGN THINKING AND PRODUCT INNOVATION LAB (459)	30.2	30.3	30.6	30.8	30.9	30.1	30.2	30.8
ENGISH LAB (462)	29.9	31.1	31.2	31.1	31.0	31.2	31.1	31.1
DRAWING HALL - 2 (422)	30.6	30.5	29.8	30.3	30.3	30.2	30.1	30.5

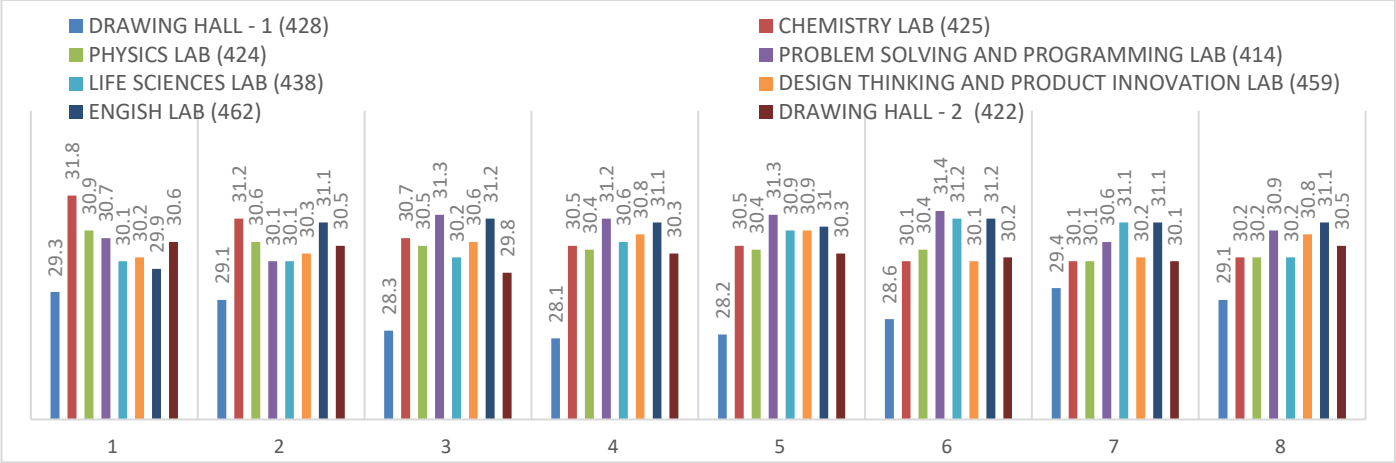

Fig202: Temperature in Laboratories of FE Dept

MASTER OF BUSINESS ADMINISTRATION

Table203: CO2 in Class Rooms of MBA Dept

CO2 VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA FIRST YEAR (460)	468	470	475	450	453	460	444	431
MBA SECOND YEAR (466)	459	465	481	490	491	496	485	479
MBA HR (461)	440	466	480	488	461	450	455	430

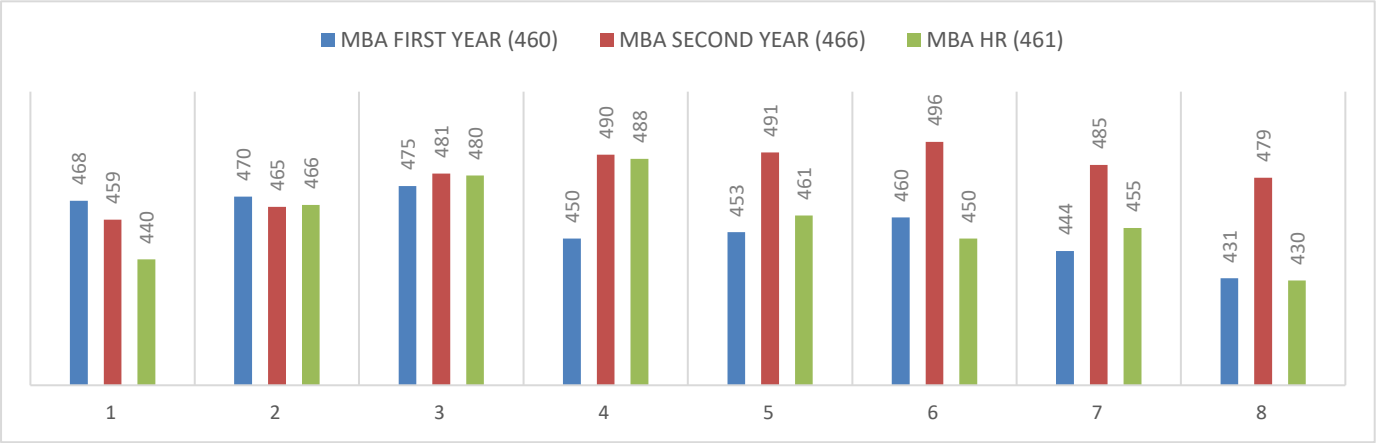

Fig203: CO2 in Class Rooms of MBA Dept

Table204: CO2 in Staff Rooms of MBA Dept

CO2 VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA HOD ROOM (464)	505	570	575	560	599	588	580	525
MBA OFFICE (463)	499	510	540	535	531	525	523	501
STAFF ROOM - 1 (451)	439	466	473	492	501	488	468	433
STAFF ROOM - 2 (453)	480	489	496	503	515	500	488	461

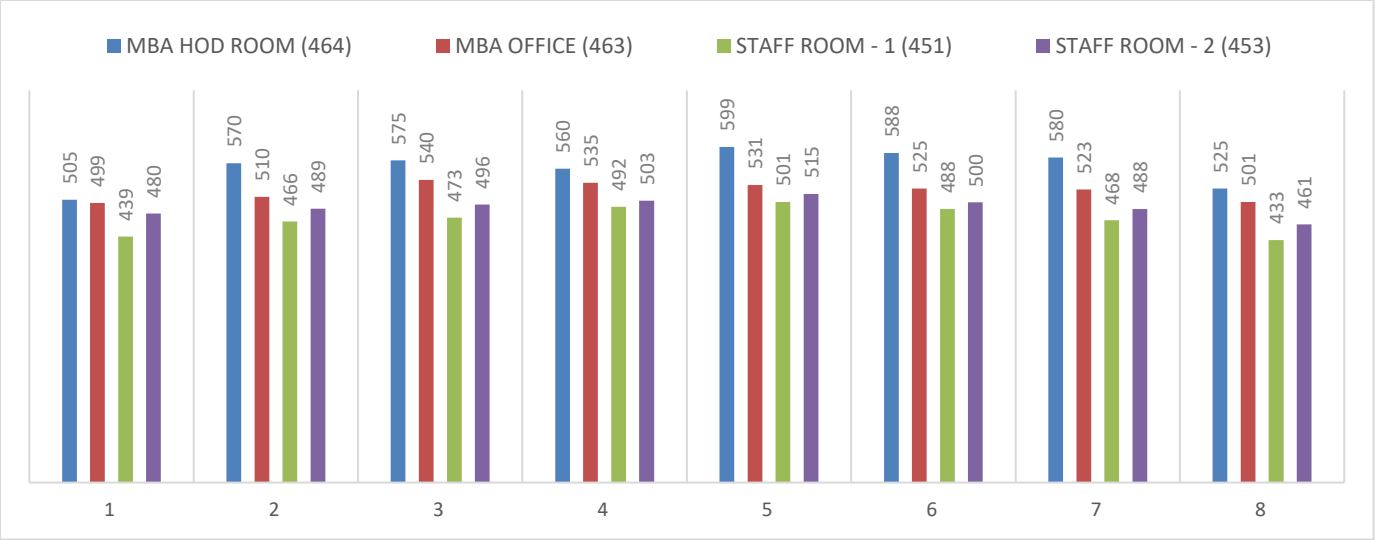

Fig204: CO2 in Staff Rooms of MBA Dept

Table205: Humidity in Class Rooms of MBA Dept

HUMIDITY VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA FIRST YEAR (460)	71.3	71.1	71.4	70.9	70.1	70.1	70.2	70.6
MBA SECOND YEAR (466)	70.8	71.1	71.2	71.1	67.6	68.3	69.6	70.1
MBA HR (461)	71.9	71.6	71.3	71.3	71.4	71.6	71.2	71.0

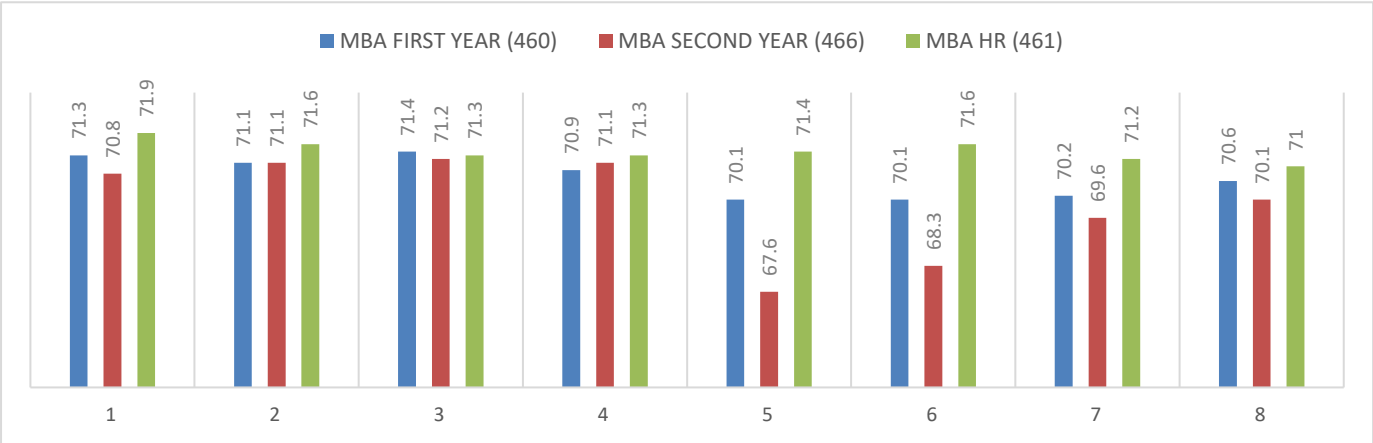

Fig205: Humidity in Class Rooms of MBA Dept

Table206: Humidity in Staff Rooms of MBA Dept

HUMIDITY VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA HOD ROOM (464)	71.9	71.5	71.4	71.1	70.8	68.2	68.5	69.2
MBA OFFICE (463)	69.8	69.5	69.1	69.1	70.1	70.2	69.7	69.9
STAFF ROOM - 1 (451)	70.2	70.6	70.5	70.9	71.2	68.2	68.9	69.3
STAFF ROOM - 2 (453)	71.2	69.8	69.8	69.4	69.1	70.2	70.4	71.2

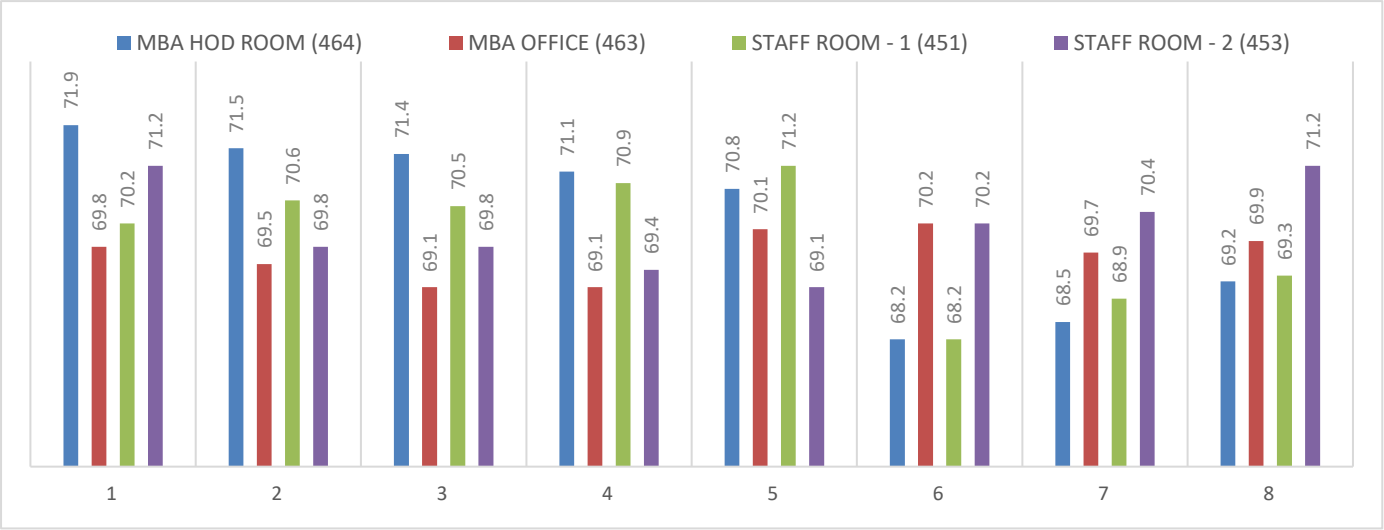

Fig206: Humidity in Staff Rooms of MBA Dept

Table207: Temperature in Class Rooms of MBA Dept

TEMPERATURE VALUES								
TIME SLOT								
CLASS ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA FIRST YEAR (460)	29.1	29.6	30.1	30.8	30.1	30.1	29.6	29.7
MBA SECOND YEAR (466)	30.1	30.9	30.4	30.5	31.1	31.2	30.7	30.2
MBA HR (461)	29.6	30.1	30.2	30.1	30.5	31.2	30.9	30.1

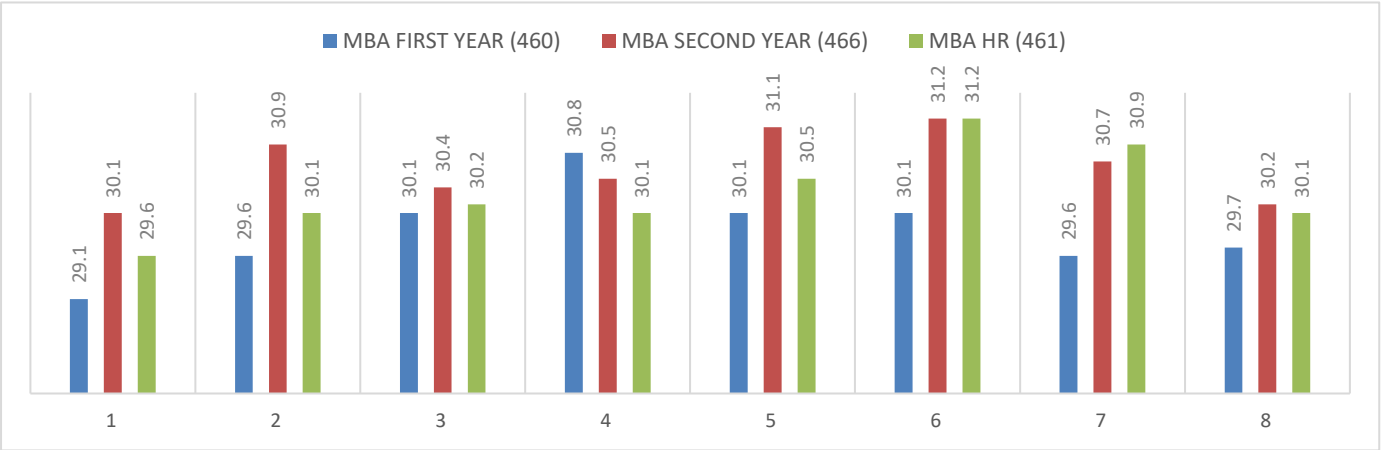

Fig207: Temperature in Class Rooms of MBA Dept

Table208: Temperature in Staff Rooms of MBA Dept

TEMPERATURE VALUES								
TIME SLOT								
STAFF ROOMS	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
MBA HOD ROOM (464)	29.1	29.5	29.5	30.1	30.5	30.6	31.2	30.9
MBA OFFICE (463)	30.1	30.2	30.4	30.9	31.2	30.5	30.2	29.9
STAFF ROOM - 1 (451)	31.1	31.2	30.9	30.6	30.6	30.9	30.2	30.5
STAFF ROOM - 2 (453)	30.6	31.2	30.9	30.9	30.7	30.8	30.8	30.1

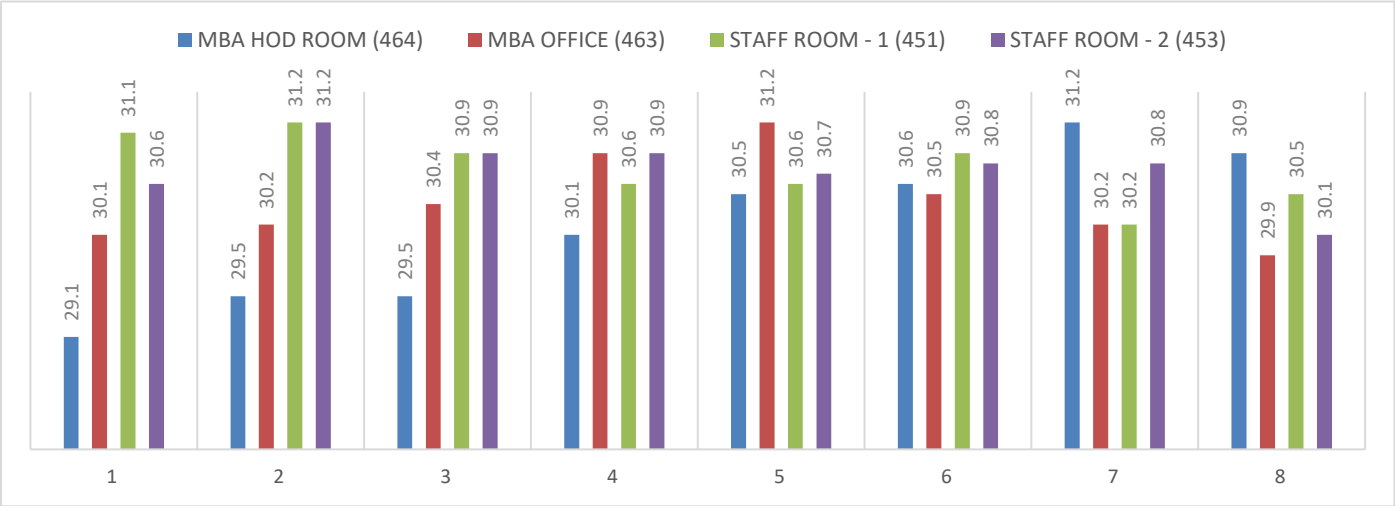

Fig208: Temperature in Staff Rooms of MBA Dept

6.DISCUSSION

Table209: CO2 in Final Year Class Room of CE Dept

Name of the Season	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
Rainy Season	1623	1596	1459	1390	1325	1293	1235	1193
Winter Season	1432	1356	1248	1123	1036	922	862	798
Summer Season	1391	1307	1201	1110	947	800	762	654

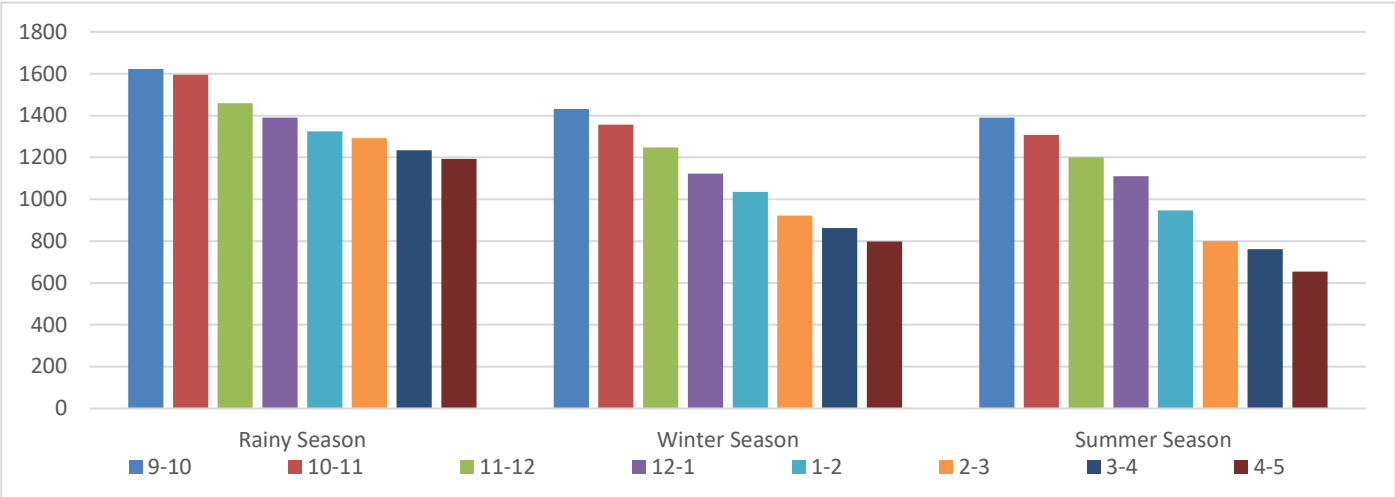

Fig209: CO2 in Final Year Class Room of CE Dept

Table210: Temperature in Final Year Class Room of CE Dept

Name Of The Season	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
Rainy Season	30.9	31.0	31.2	30.7	30.5	30.3	30.8	31.0
Winter Season	31.3	30.9	30.8	30.7	30.5	31.3	30.8	31
Summer Season	31.1	31.2	31.1	31.6	31.5	31.9	31.7	31.2

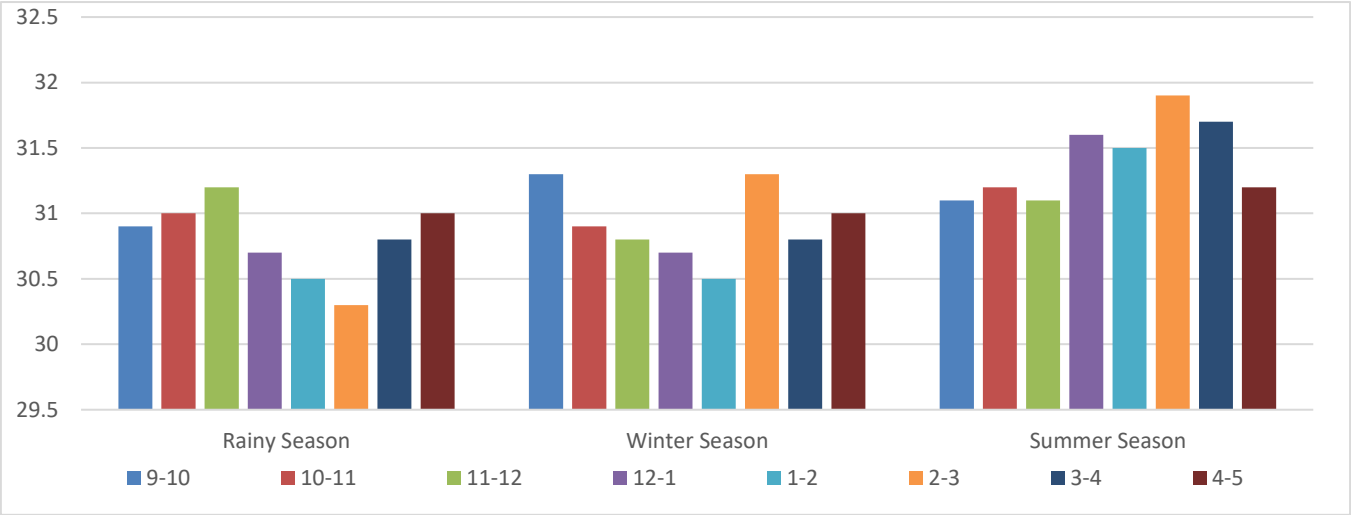

Fig210: Temperature in Final Year Class Room of CE Dept

Table211: Humidity in Final Year Class Room of CE Dept

Name Of The Season	9-10	10-11	11-12	12-1	1-2	2-3	3-4	4-5
Rainy Season	62.9	61.2	60.2	59.6	64.3	66.0	65.9	65.7
Winter Season	61.3	59.9	59.8	65.3	66.8	66	66.3	65.2
Summer Season	72.9	72.8	71.3	70.2	71.1	71.9	71.1	71.2

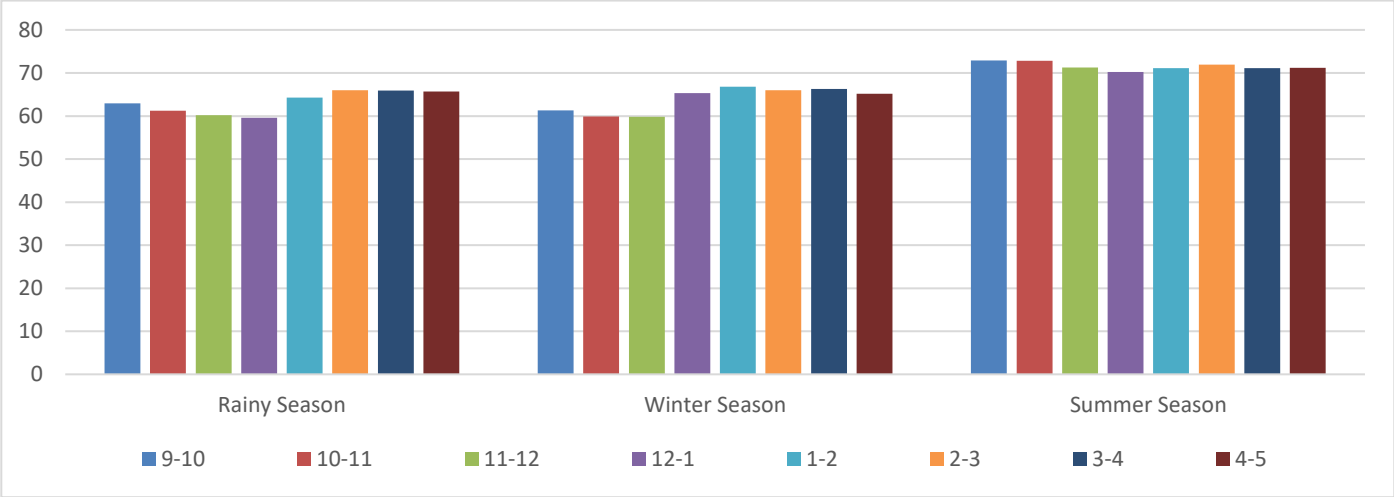

Fig211: Humidity in Final Year Class Room of CE Dept

Accurate and precise measurement of IAQ is done in PVPSIT. We have collected the indoor air quality parameters such as CO2, Temperature and Humidity in around 167 locations (48 Class Rooms, 68 Staff Rooms & 51 Laboratories) all over the campus. We prospectively measured in three seasons i.e., Rainy Season, Winter Season and Summer Season in 8 time slots between 9 AM to 5 PM.

In order to conduct this descriptive-analytical study, gas pollutants affecting indoor air quality were determined using portable analysis systems. Indoor Air Quality Toolkit was used in order to study the Indoor air quality.

We have compared final year class room of civil department in three seasons to make our descriptive-analytical study more effective.

We have compared CO2, Temperature and Humidity in three seasons individually. When the CO2 value is more, then we must face some consequences based upon the value. For example, if the CO2 value is in between 1000-2000ppm then it leads to the complaints of drowsiness and poor air. If the value is >40000ppm then the exposure may lead to serious oxygen deprivation resulting in permanent brain damage, coma, even death. When come to the final year class room, the highest CO2 value recorded 1623ppm which is in the range of 1000-2000ppm. So, there may be high chances for Headaches, sleepiness, and stagnant. The main reason for that massive recorded value is there was no ventilators and the windows are remains closed due to the AC.

And mainly the highest recorded value is in the time slot 9-10 during three seasons. Because there might be high strength at that time. So, when the strength is more there should be high amount of co2 and vice versa.

At the same time the highest recorded Temperature value is 31.9°C and for the humidity is 72.9%RH. In addition, with a change in relative humidity from 28% to 30%, change in CO2 values (6.26% to 9.39%) were observed while temperature kept at 25 ^{0}C. Results show that temperature, and relative humidity have a significant effect on the output of CO2 concentration. So, there is a connection in between the temperature, CO2, and Humidity.

Cold air cannot hold as much water vapor as warm air can. Thus, as temperature falls, with no change in the amount of water in the air, the relative humidity rises. As temperature rises, with no change in the amount of water in the air, relative humidity falls.

Especially, the humidity should be in between 40-60%RH. But we got 72.9%RH in the final year class room. High levels of humidity can cause people to feels uncomfortable and even unwell. So, the humidity should be in the ideal level or optimum condition.

An increase in temperature of 20 o C can lead to a typical drop in humidity of around 60%RH (relative humidity). This means that humid air entering a building at 80%rH would decrease to just 20%RH when heated.

And in most of the software laboratories, the CO2 might be in >2000ppm which is slightly harmful for human health. The main reason is there are no ventilators and at the same time the windows are remains closed. So, there should be provided some outlets.

The lowest recorded value for CO2 is 390ppm which is <400ppm. It is in optimum condition and it leads to normal background concentration in outdoor ambient air.

7.SURVEY ON INDOOR AIR QUALITY

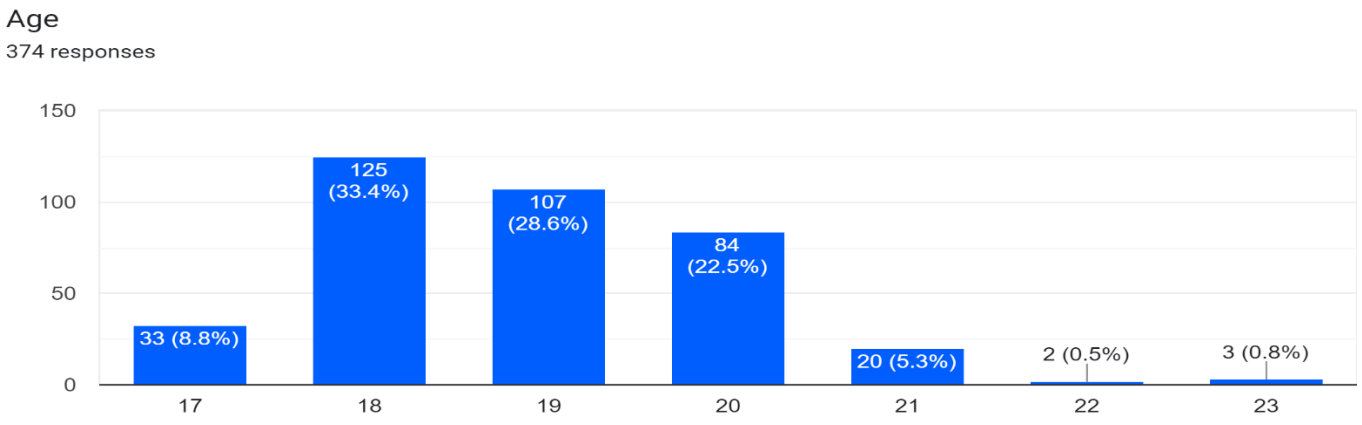

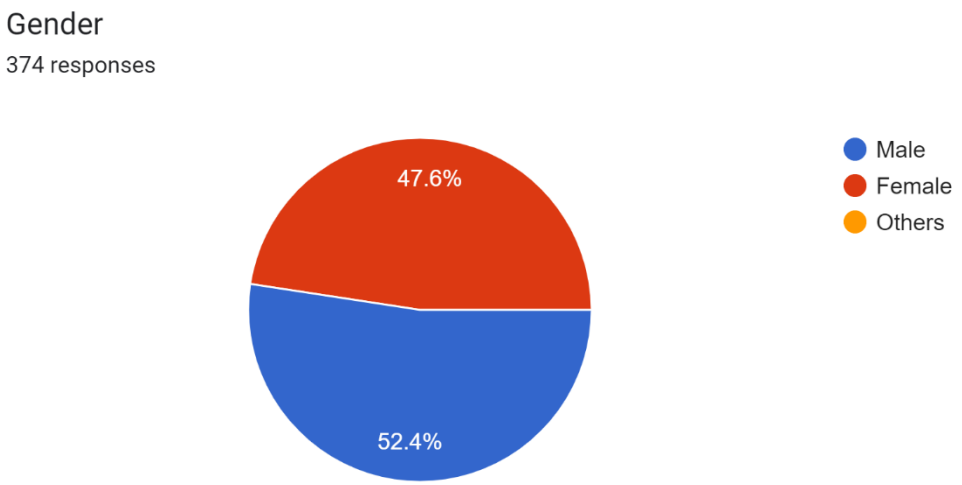

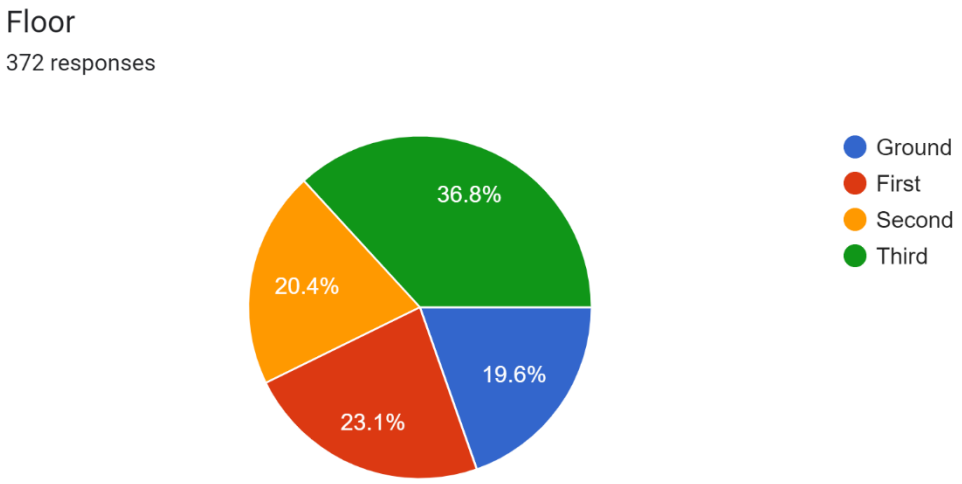

Department

374 responses

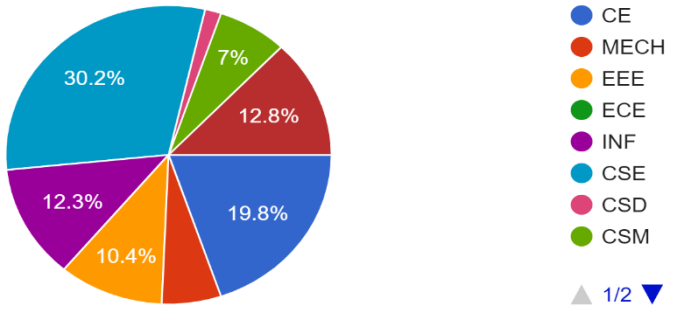

1. How do you find the classroom now?

374 responses

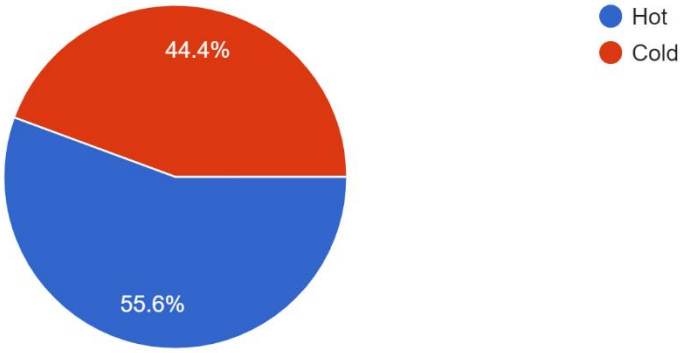

2. In general, during winter how is the classroom ?

374 responses

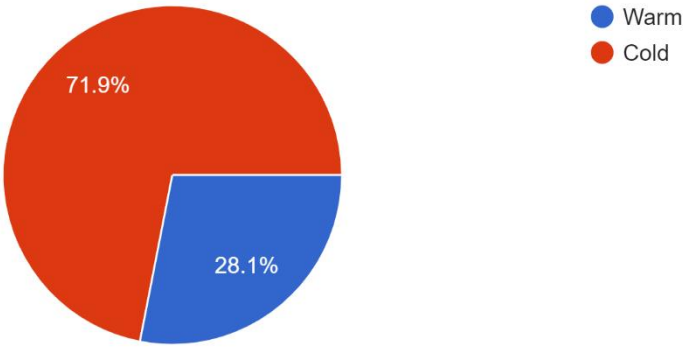

3. How is your state of health?

374 responses

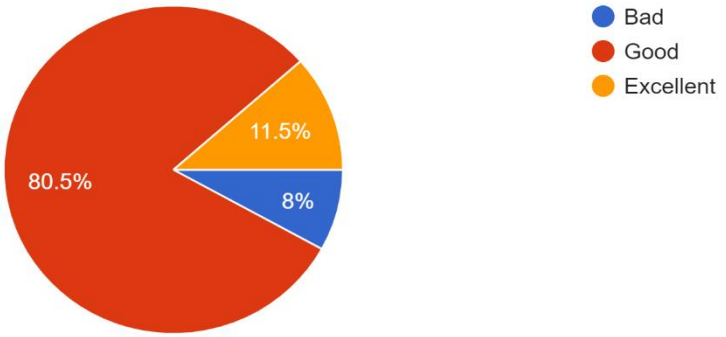

4. Last two weeks, do you have any respiratory illness ?

374 responses

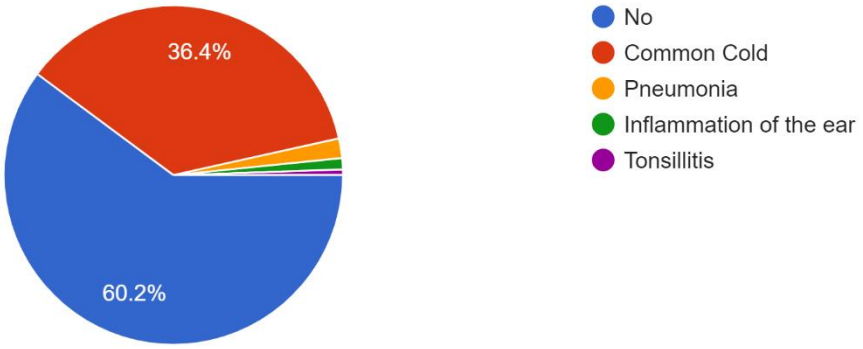

5. Did the poor indoor air quality bother you during last hour?

374 responses

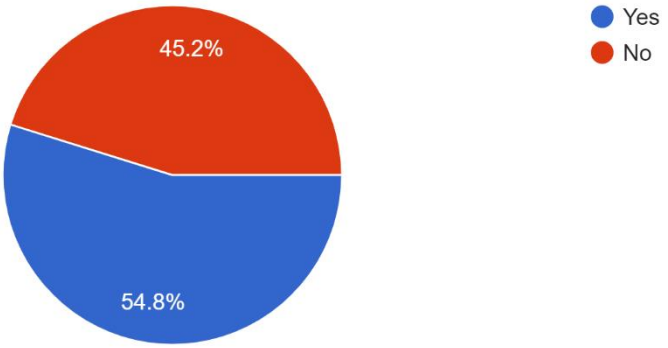

6. What bothered?

374 responses

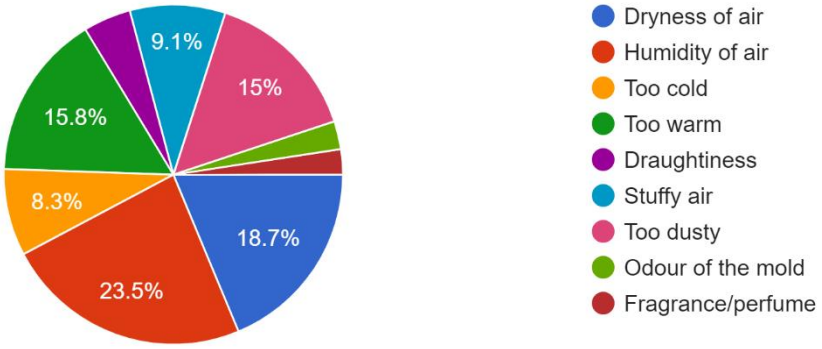

7. If you have any respiratory illness, does it decrease when you are not at college?

374 responses

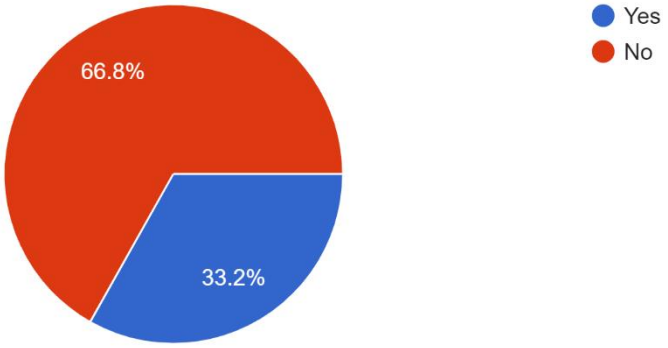

8. Are there any signs of mold in the room?

374 responses

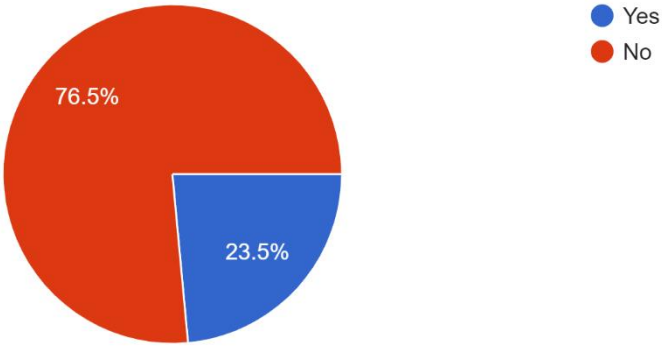

9. Are there any signs of humidity in the room?

374 responses

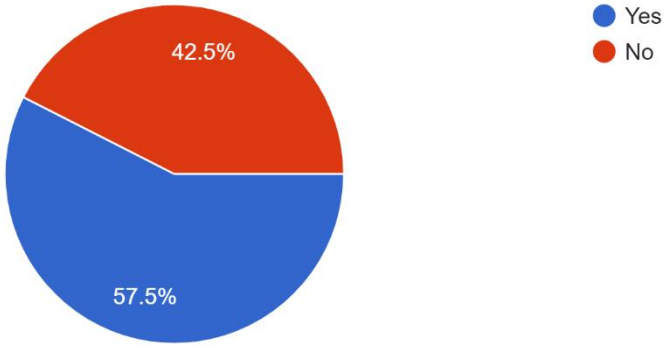

10. Has condensation been observed on window interiors?

374 responses

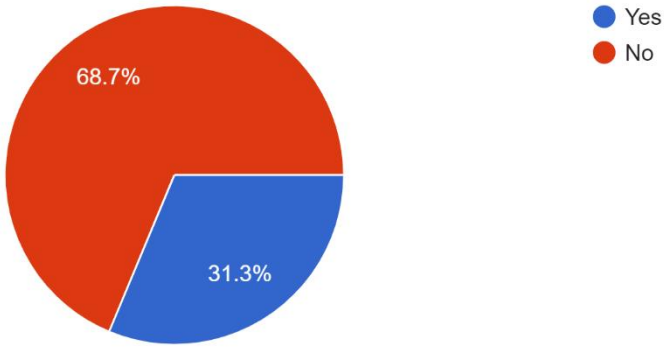

11. Air quality

374 responses

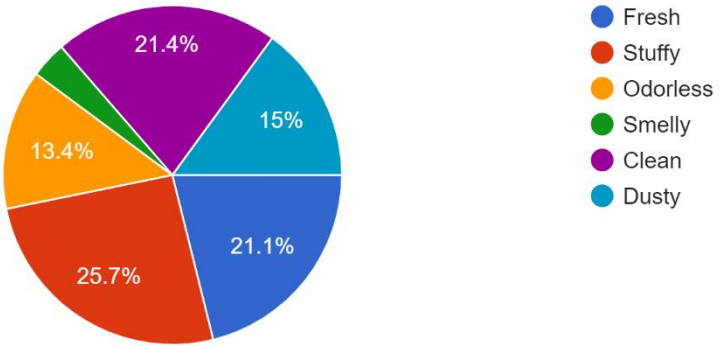

12. Satisfaction with indoor air quality

374 responses

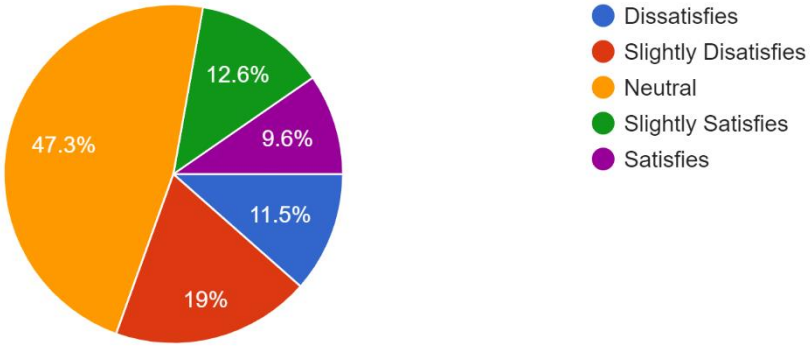

13. Impact of indoor air quality on work productivity

374 responses

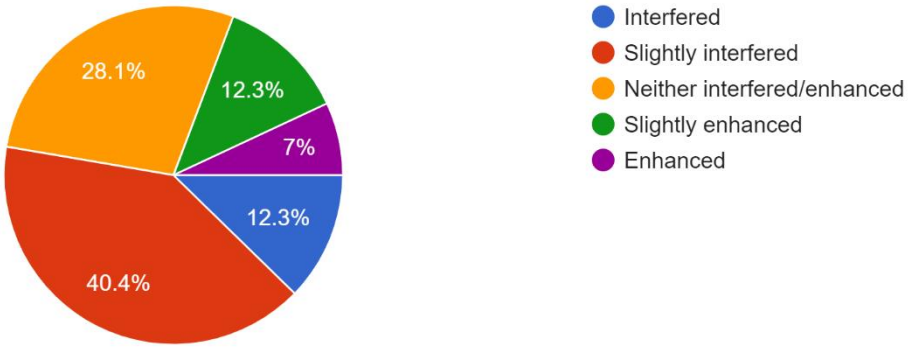

14. Self-reported health impacts

374 responses

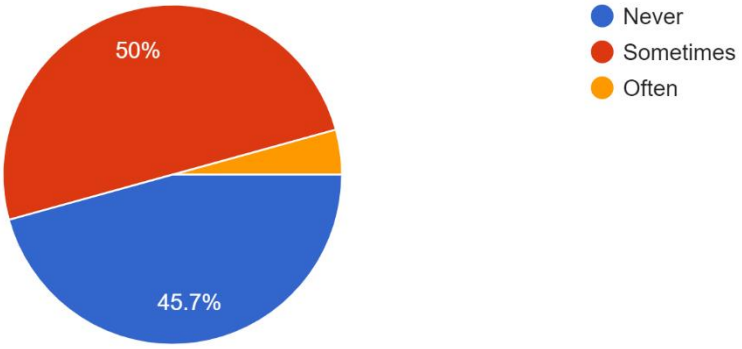

15. Would you have preferred that the windows were opened?

374 responses

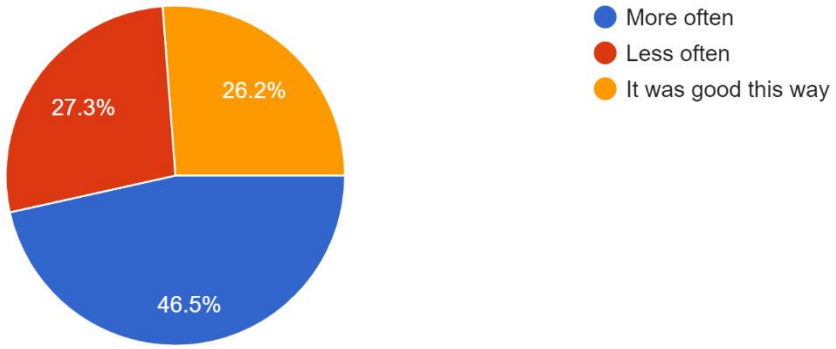

16. would you have preferred that the windows were kept opened ?

374 responses

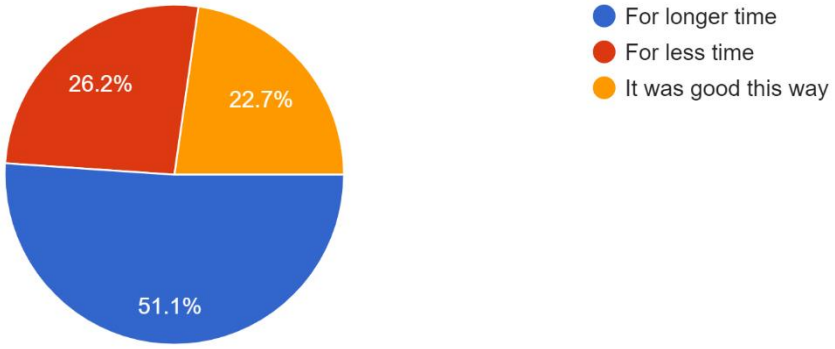

8.Discussion On Survey On IAQ

We have conducted a survey on Indoor Air Quality in PVPSIT to make our analytical-descriptive study more effective. There was a huge response from the students and faculty members of the PVPSIT.

We have received around 400 responses from the campus. Mainly, 55.6% of the students are found that their room is hot and 44.4% of students as cold. When they feel hot in the room there might be high amount of CO_2. In general, 28.1% of the students feel that the room is warm and when come to the state of health of the students, 80.5% as Good, 11.5% as Excellent and 8% as Bad and some of the students responded that they are having illness.

Students bothered due to: Dryness of air-18.7%

Humidity of air-23.5%

Too cold-8.3%

Too warm-15.8%, etc...,

Students got bothered due to high amount of CO_2 in their room. Because, when there is a high amount of CO_2 then obviously there will be some consequences to be face. At the same time the amount of humidity is also more as well as temperature. The laboratories of CSE & IT departments having huge amount of CO_2 with lack of proper ventilation.

According to the survey, if the students have any respiratory illness, then it decreases when they are not at college. So, the management to improve the Indoor Air Quality in PVPSIT. And due to the mold in the room they are feeling that slightly uncomfortable.

And around 57.5% of the students were responded that they are having humidity in the rooms. Due to high amount of humidity, there will be some problems like suffocation, illness, etc..., Air Quality in their rooms is:

Fresh-21.1%

Stuffy-25.7%

Odorless-13.4%

Smelly-3.5%

Clean-21.4%

Dusty-15%

So, most of the students feel that the air quality in their room is stuffy. Then it leads to decrease the work productivity. That is why we preferred that the windows were kept opened for longer time. In survey also many of the students (51.4%) are preferred that the windows were kept opened for longer time.

9.MEASURES TO IMPROVE IAQ

- By placing mini plants
- Air Purifiers
- Don’t cover up odors
- Vacuum often
- Use exhaust fans
- Ban smoking
- Open windows
- Kept ventilators open
- Try to kept the room dry
- Store chemicals safely

10.CONCLUSION

Accurate and precise measurement of IAQ is done in PVPSIT. This Indoor Air Quality monitoring study of an educational institution (PVPSIT) provides the data set parameters such as Temperature, CO2, and Humidity during the three seasons (Rainy, Winter and Summer) in 8 time slots with a gap of one hour time period on a day.

Indoor Air Quality Toolkit was used in order to study the Indoor air quality. We have evaluated the IAQ parameters in 167 locations (48 Class Rooms, 68 Staff Rooms & 51 Laboratories) of PVPSIT. CO2 showed the widest range of concentrations from 390ppm to 3000 ppm, Temperature from 25-35 degrees Celsius and humidity from 50-75%RH. The highest concentrations were measured in the Laboratories of CSE & IT departments due to the lack of ventilation. And at the same time the lowest concentrations were recorded in a staff room of ECE department. Because they are maintaining miny plants in their room as well as they were preferred to open the windows for a longer time.

In parallel with this study, we have conducted a survey on IAQ in PVPSIT, we have received the responses from 400 students all over the campus. This was made our analytical-descriptive study more effective.

To a lesser extent of our analytical-descriptive study, we will incorporate Internet Of Things (IOT) in our project to monitor the parameters round the clock.

11.REFERENCES

1. Alemany, S., Vilor-Tejedor, N., García-Esteban, R., Bustamante, M., Dadvand, P., Esnaola, M., et al., 2018. Traffic-related air pollution, apoεε4 status, and neurodevelopmental outcomes among school children enrolled in the breathe project (catalonia, Spain). Environ. Health Persp. 126, 087001.

2. Annesi-Maesano, I., Baiz, N., Banerjee, S., Rudnai, P., Rive, S., Group, S., 2013. Indoor air quality and sources in schools and related health effects. J. Toxicol. Environ. Health B Crit. Rev. 16, 491–550.

3. Arcega-Cabrera, F., Fargher, L., Quesadas-Rojas, M., Moo-Puc, R., Oceguera-Vargas, I., Norena-Barroso, ˜ E., et al., 2018. Environmental exposure of children to toxic trace elements (hg, cr, as) in an urban area of yucatan, Mexico: water, blood, and urine levels. Bull. Environ. Contam. Toxicol. 100, 620–626.

4. Basagana, ˜ X., Esnaola, M., Rivas, I., Amato, F., Alvarez-Pedrerol, M., Forns, J., et al., 2016. Neurodevelopmental deceleration by urban fine particles from different emission sources: a longitudinal observational study. Environ. Health Perspect. 124, 1630–1636. 5. 5.Baxi, S.N., Sheehan, W.J., Sordillo, J.E., Muilenberg, M.L., Rogers, C.A., Gaffin, J.M., et al., 2019. Association between fungal spore exposure in inner-city schools and asthma morbidity. Ann. Allergy Asthma Immunol. 122, 610–615 e611.

6. Berman, J.D., McCormack, M.C., Koehler, K.A., Connolly, F., Clemons-Erby, D., Davis, M. F., et al., 2018. School environmental conditions and links to academic performance and absenteeism in urban, mid-atlantic public schools. Int. J. Hyg Environ. Health 221, 800–808.

7. Braun, J.M., 2017. Early-life exposure to edcs: role in childhood obesity and neurodevelopment. Nat. Rev. Endocrinol. 13, 161–173.

8. Cavaleiro Rufo, J., Madureira, J., Paciˆencia, I., Aguiar, L., Pereira, C., Silva, D., et al., 2017. Indoor fungal diversity in primary schools may differently influence allergic sensitization and asthma in children. Pediatr. Allergy Immunol. 28, 332–339.

9. Che, W., Li, A.T.Y., Frey, H.C., Tang, K.T.J., Sun, L., Wei, P., et al., 2021. Factors affecting variability in gaseous and particle microenvironmental air pollutant concentrations in Hong Kong primary and secondary schools. Indoor Air 31, 170–187.

10. Dong, W., Liu, S., Chu, M., Zhao, B., Yang, D., Chen, C., et al., 2019. Different cardiorespiratory effects of indoor air pollution intervention with ionization air 28 purifier: findings from a randomized, double-blind crossover study among school children in beijing.

Environ. Pollut. 254, 113054.

11. Ferguson, A., Solo-Gabriele, H., 2016. Children's exposure to environmental contaminants: an editorial reflection of articles in the ijerph special issue entitled, "children's exposure to environmental contaminants". Int. J. Environ. Res. Publ. Health 13.

12. Fu, X., Norb¨ ack, D., Yuan, Q., Li, Y., Zhu, X., Hashim, J.H., et al., 2021. Association between indoor microbiome exposure and sick building syndrome (sbs) in junior high schools of johor bahru, Malaysia. Sci. Total Environ. 753, 141904.

13. Gaihre, S., Semple, S., Miller, J., Fielding, S., Turner, S., 2014. Classroom carbon dioxide concentration, school attendance, and educational attainment. J. Sch. Health 84, 569–574.

14. Gauderman, W.J., Vora, H., McConnell, R., Berhane, K., Gilliland, F., Thomas, D., et al., 2007. Effect of exposure to traffic on lung development from 10 to 18 years of age: a cohort study. Lancet (London, England) 369, 571–577.

15. Grineski, S.E., Collins, T.W., Adkins, D.E., 2020. Hazardous air pollutants are associated with worse performance in reading, math, and science among us primary schoolchildren. Environ. Res. 181, 108925.

16. Haverinen-Shaughnessy, U., Moschandreas, D.J., Shaughnessy, R.J., 2011. Association between substandard classroom ventilation rates and students' academic achievement. Indoor Air 21, 121–131.

17. Hoek, G., Pattenden, S., Willers, S., Antova, T., Fabianova, E., Braun-Fahrl¨ ander, C., et al., 2012. Pm10, and children's respiratory symptoms and lung function in the paty study. Eur. Respir. J. 40, 538–547.

18. Iglesias-Gonz´ alez, A., Hardy, E.M., Appenzeller, B.M.R., 2020. Cumulative exposure to organic pollutants of French children assessed by hair analysis. Environ. Int. 134, 105332.

19. Kalimeri, K.K., Bartzis, J.G., Sakellaris, I.A., de Oliveira Fernandes, E., 2019. Investigation of the pm(2.5), no(2) and o(3) i/o ratios for office and school microenvironments. Environ. Res. 179, 108791.

20. Landrigan, P.J., Fuller, R., Acosta, N.J.R., Adeyi, O., Arnold, R., Basu, N.N., et al., 2018. The lancet commission on pollution and health. Lancet (London, England) 391, 462–512. 29

21. Li, L., Liu, H., Wang, Y., Han, X., Ge, T., Pan, L., 2020. Construction of a nomogram for predicting the risk of allergic rhinitis among employees of long-distance bus stations in China. Indoor Air 30, 1178–1188.

22. Liu, Y., Dong, J., Xu, X., Jiang, Y., 2020. Pm(2.5) mass concentration variation in urban residential buildings during heating season in severe cold region of China: a case study in harbin. Sci. Total Environ. 722, 137945.

23. Madureira, J., Alvim-Ferraz, M., Rodrigues, S., Gonçalves, C., Azevedo, M., Pinto, E., et al., 2009. Indoor air quality in schools and health symptoms among Portuguese teachers. Hum. Ecol. Risk Assess. 15, 159–169.

24. Madureira, J., Paciˆencia, I., Pereira, C., Teixeira, J.P., Fernandes Ede, O., 2016. Indoor air quality in Portuguese schools: levels and sources of pollutants. Indoor Air 26, 526– 537.

25. Marchetti, S., Longhin, E., Bengalli, R., Avino, P., Stabile, L., Buonanno, G., et al., 2019. In vitro lung toxicity of indoor pm10 from a stove fueled with different biomasses. Sci. Total Environ. 649, 1422–1433.

26. Meng, J., Barnes, C.S., Rosenwasser, L.J., 2012. Identity of the fungal species present in the homes of asthmatic children. Clin. Exp. Allergy 42, 1448–1458.

27. Norback, D., Li, T., Bai, X., Li, C., Zhao, Z., Zhang, X., 2019. Onset and remission of rhinitis among students in relation to the home and school environment-a cohort study from northern China. Indoor Air 29, 527–538.

28. Pacitto, A., Amato, F., Moreno, T., Pandolfi, M., Fonseca, A., Mazaheri, M., et al., 2020. Effect of ventilation strategies and air purifiers on the children's exposure to airborne particles and gaseous pollutants in school gyms. Sci. Total Environ. 712, 135673.

29. Rosbach, J., Krop, E., Vonk, M., van Ginkel, J., Meliefste, C., de Wind, S., et al., 2016. Classroom ventilation and indoor air quality-results from the fresh intervention study. Indoor Air 26, 538–545.

30. Rosner, B., 2015. Fundamentals of Biostatistics. Nelson Education. Rovelli, S., Cattaneo, A., Nuzzi, C.P., Spinazz`e, A., Piazza, S., Carrer, P., et al., 2014. Airborne particulate matter in school classrooms of northern Italy. Int. J. Environ. Res. Publ. Health 11, 1398–1421.

31. Chan WR, Parthasarathy S, Fisk WJ, McKone TE. Estimated effect of ventilation and filtration on chronic health risks in U.S. offices, schools, and retail stores. Indoor Air. 2016;26:331-343.

32. Kwon JW, Park HW, Kim WJ, Kim MG, Lee SJ. Exposure to volatile organic compounds and airway inflammation. Environ Health. 2018;17:65.

33. Viegi G, Simoni M, Scognamiglio A, et al. Indoor air pollution and airway disease. Int J Tuberc Lung Dis. 2004;8:1401-1415.

34. Loh MM, Houseman EA, Gray GM, Levy JI, Spengler JD, Bennett DH. Measured concentrations of VOCs in several non-residential microenvironments in the United States. Environ Sci Technol. 2006;40:6903-6911.

35. Eklund BM, Burkes S, Morris P, Mosconi L. Spatial and temporal variability in VOC levels within a commercial retail building. Indoor Air. 2008;25:365-374.

36. Nirlo E, Crain N, Corsi R, Siegel J. Volatile organic compounds in fourteen U.S. retail stores. Indoor Air. 2014;24:484-494.

37. Wu X, Apte MG, Maddalena R, Bennett DH. Volatile organic compounds in small- and medium-sized commercial buildings in California. Environ Sci Technol. 2011;45:9075-9083.

38. Chan WR, Cohn S, Sidheswaran M, Sullivan DP, Fisk WJ. Contaminant levels, source strengths, and ventilation in California retail stores. Indoor Air. 2015;25:381-392. 39. Jia C, Cao K, Valaulikar R, Fu X, Sorin AB. Variability of Total Volatile Organic Compounds (TVOC) in the indoor air of retail stores. Int J Environ Res Public Health. 2019;16:4622.

40. Tang J, Chan CY, Wang X, Chan LY, Sheng G, Fu J. Volatile organic compounds in a multi-storey shopping mall in Guangzhou, South China. Atmospheric Environ. 2005;39:7374-7383.

12.GALLERY

2022/09/21 09:36

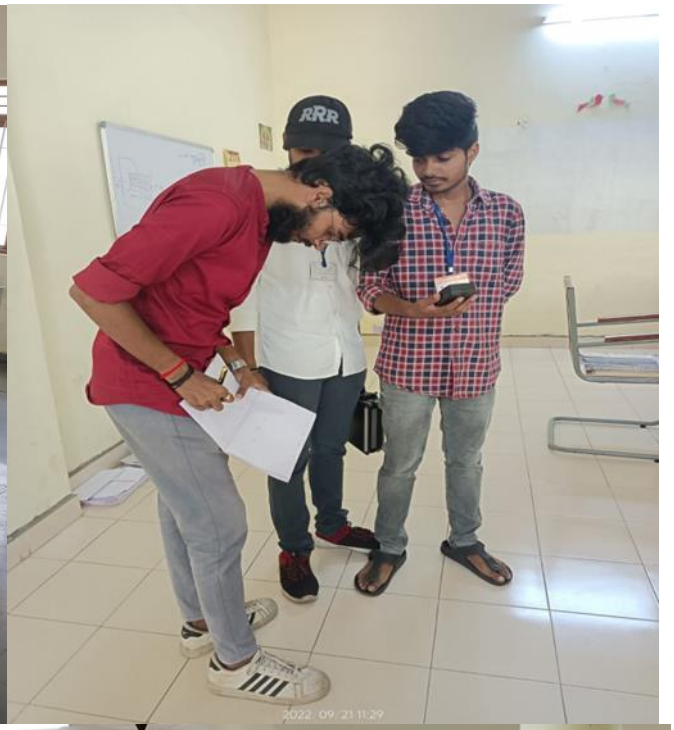

FIRST AID
BOX

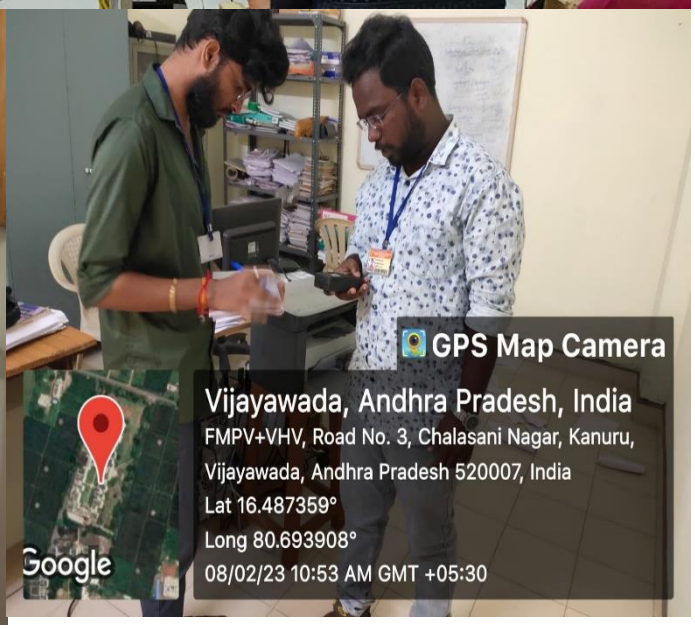
GPS Map Camera
Vijayawada, Andhra Pradesh, India
FMPV+VHV, Road No. 3, Chalasani Nagar, Kanuru,
Vijayawada, Andhra Pradesh 520007, India
Lat 16.487359°
Long 80.693908°
08/02/23 10:53 AM GMT +05:30
Google