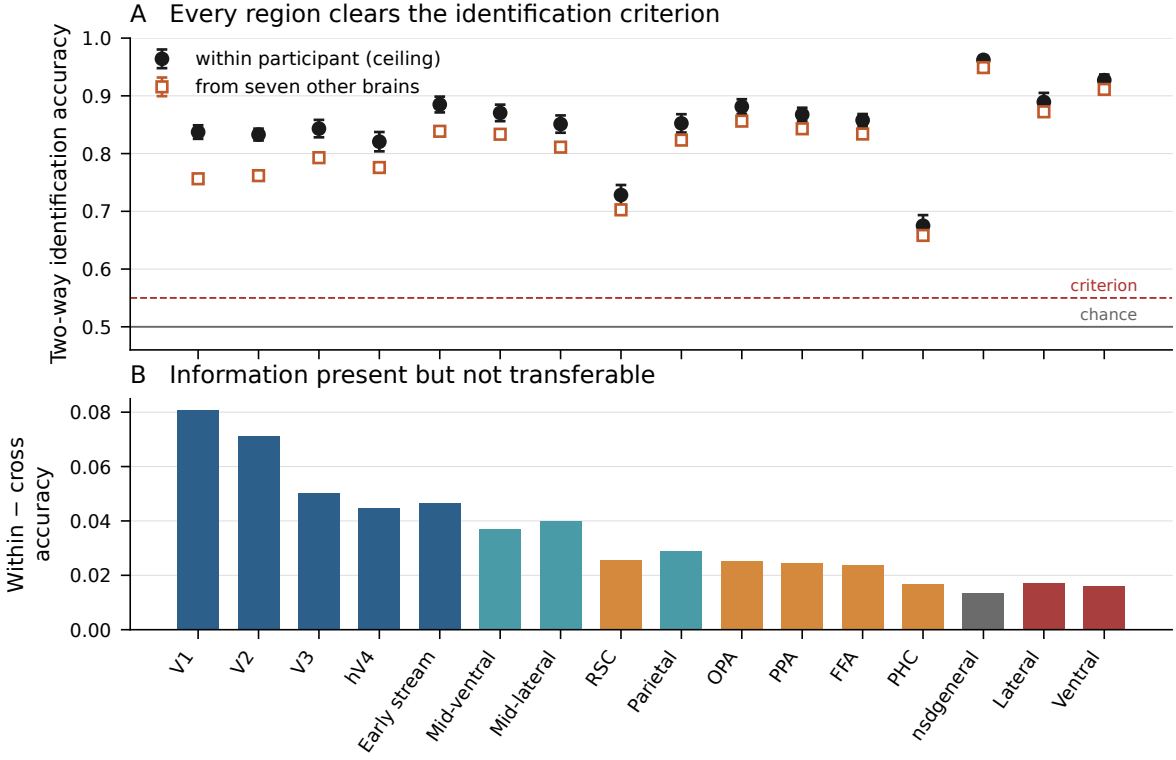
A Every region clears the identification criterion
within participant (ceiling)
from seven other brains
Two-way identification accuracy
1.0
0.9
0.8
0.7
0.6
0.5
criterion
chance
B Information present but not transferable
Within − cross accuracy
0.08
0.06
0.04
0.02
0.00
V1
V2
V3
hV4
Early stream
Mid-ventral
Mid-lateral
RSC
Parietal
OPA
PPA
FFA
PHC
nsdgeneral
Lateral
Ventral