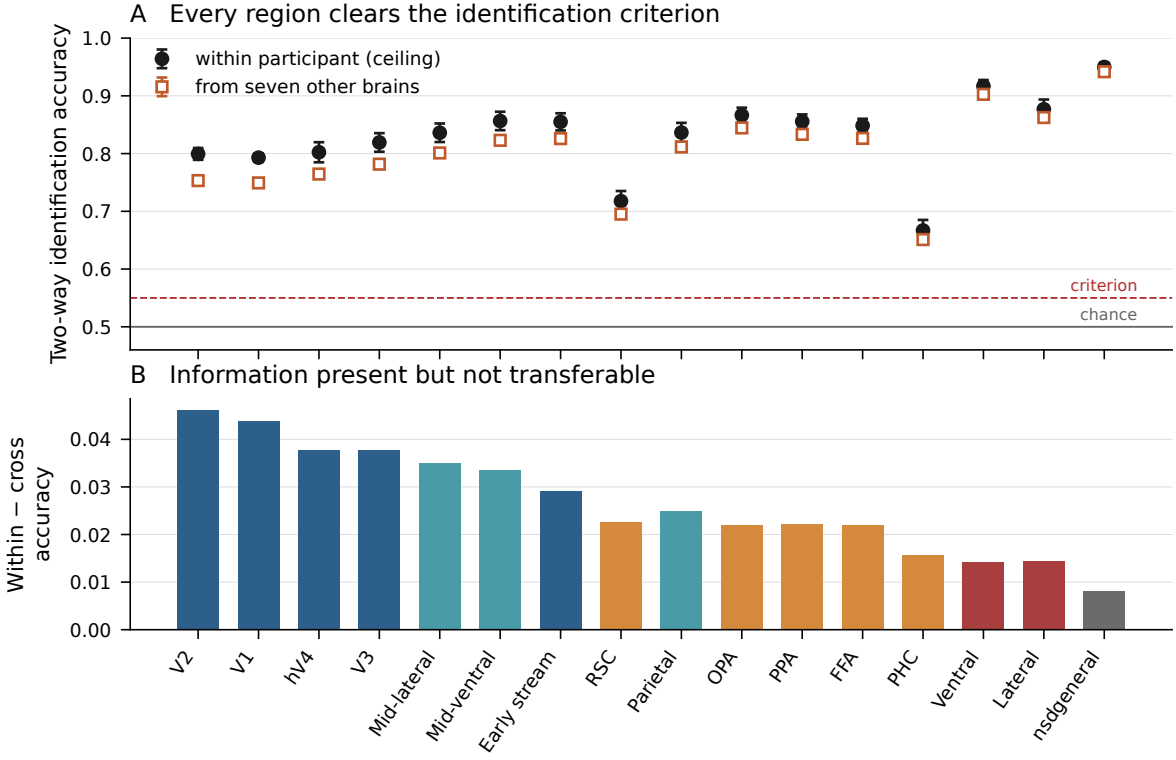
A Every region clears the identification criterion
within participant (ceiling)
from seven other brains
Two-way identification accuracy
1.0
0.9
0.8
0.7
0.6
0.5
criterion
chance
B Information present but not transferable
Within − cross accuracy
0.04
0.03
0.02
0.01
0.00
V2
V1
hV4
V3
Mid-lateral
Mid-ventral
Early stream
RSC
Parietal
OPA
PPA
FFA
PHC
Ventral
Lateral
nsdgeneral