




COMMUNITY HALL (TH-01)

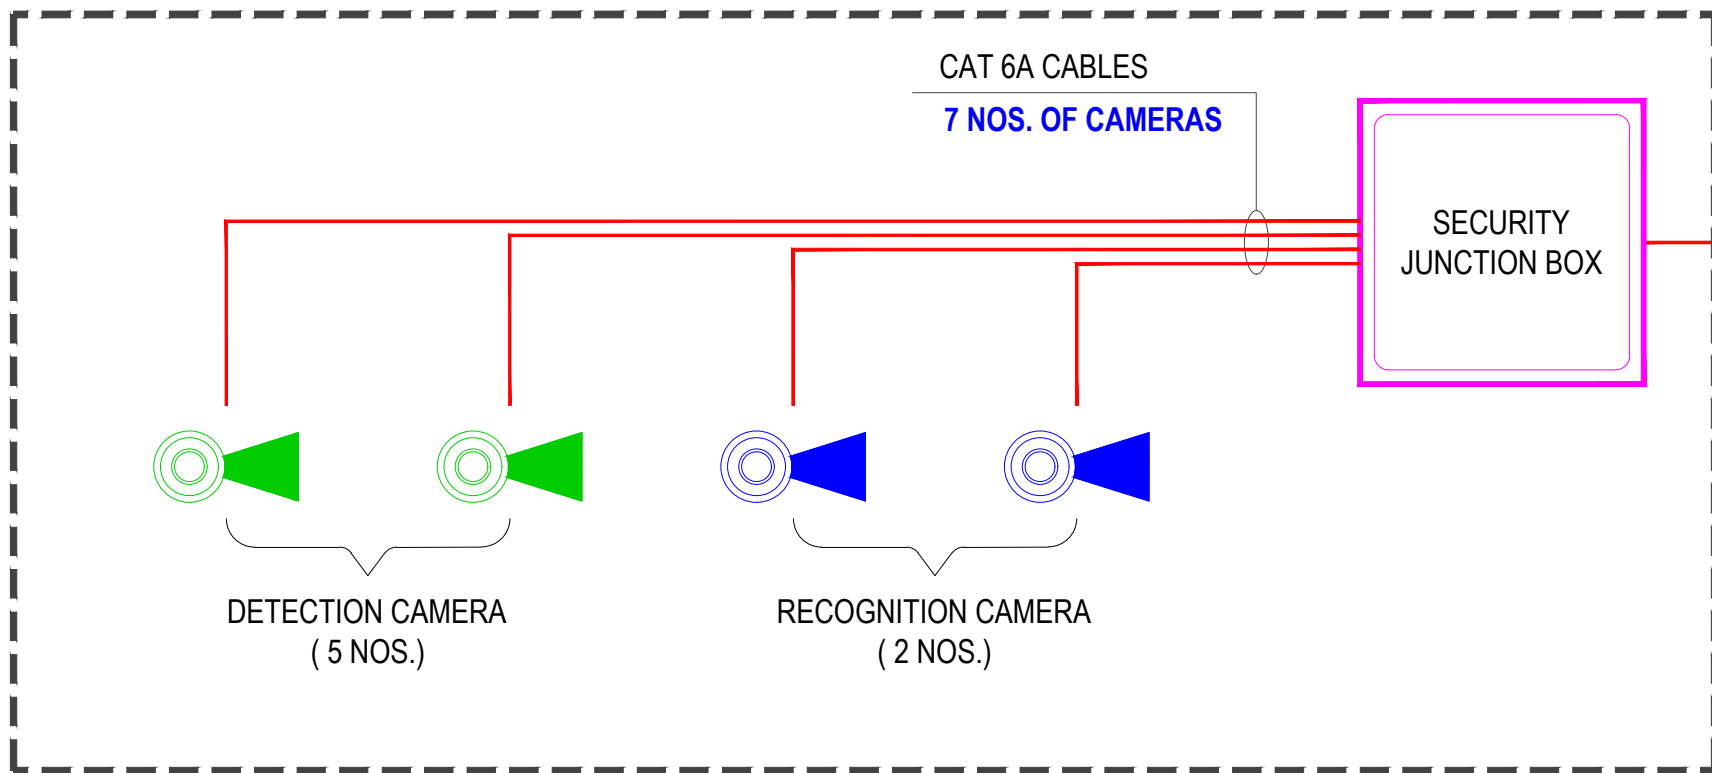


GYM (TH-01)

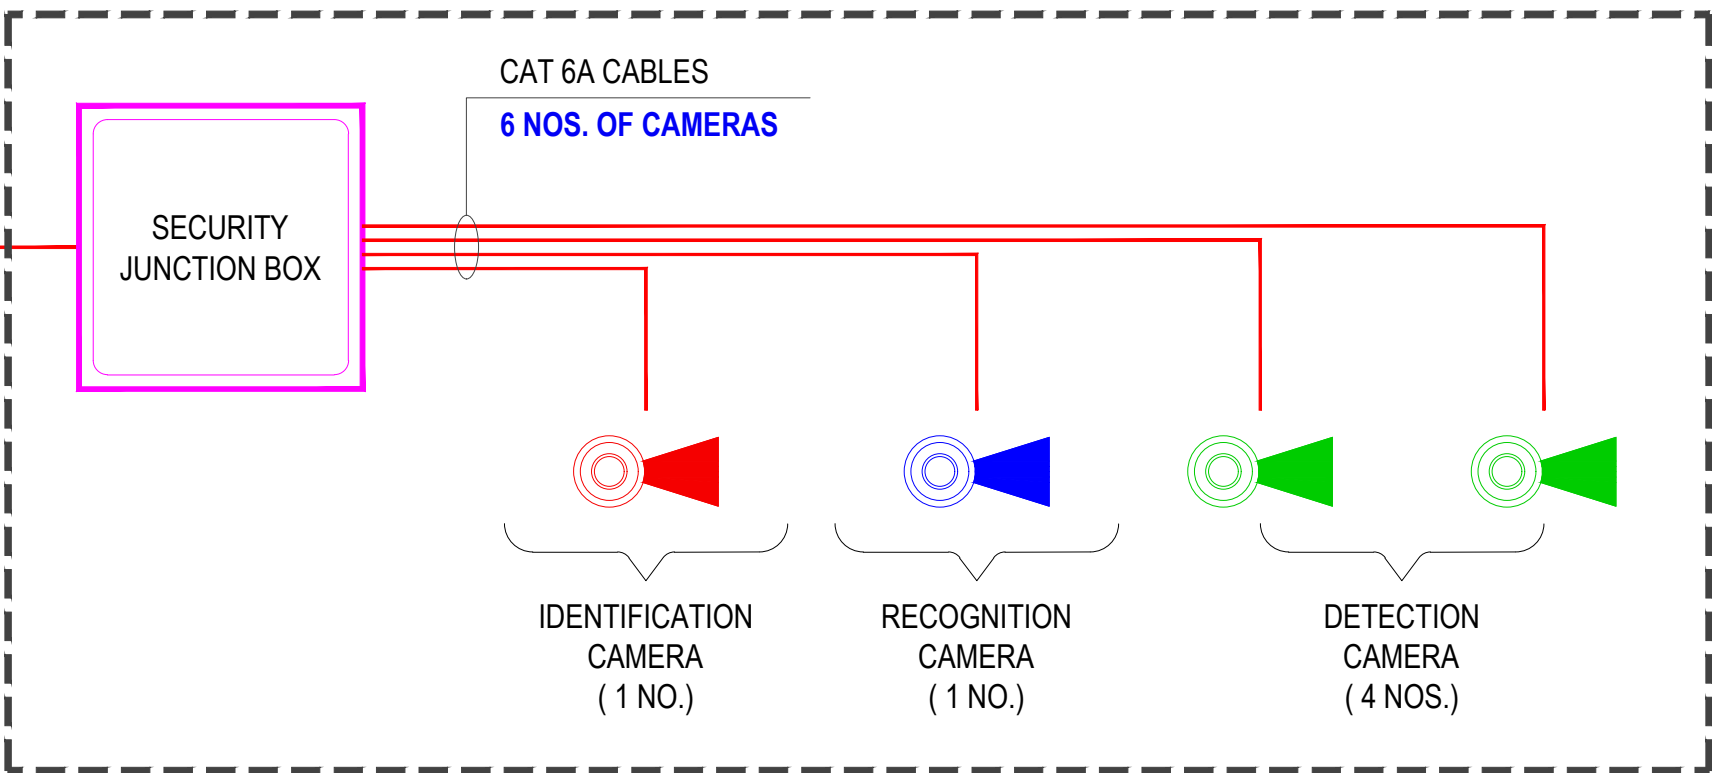


SERVICE BLOCK (TH-01)

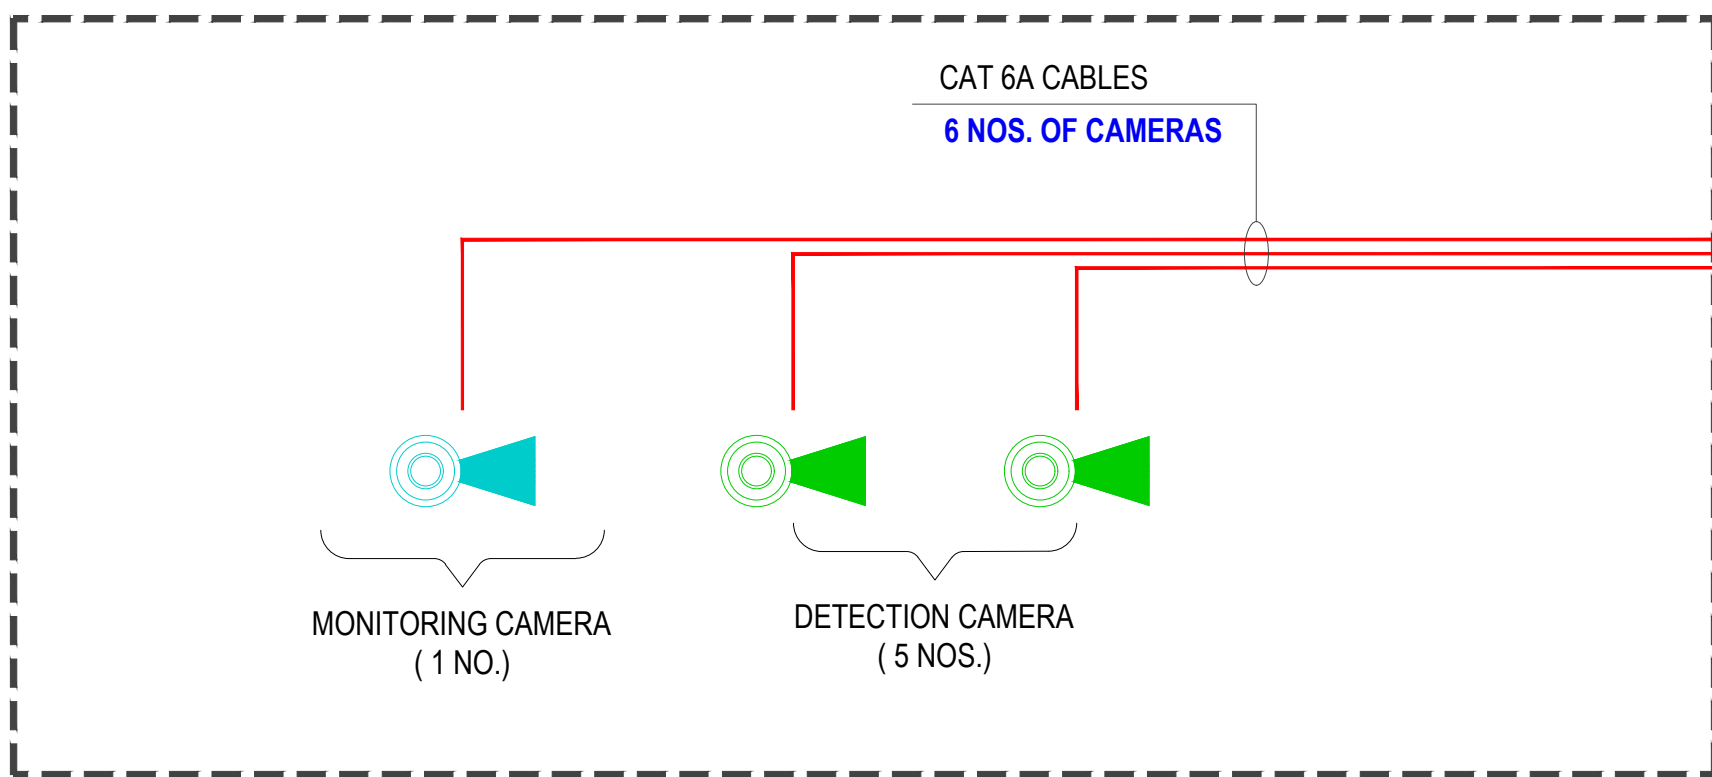

YOGA (TH-01)

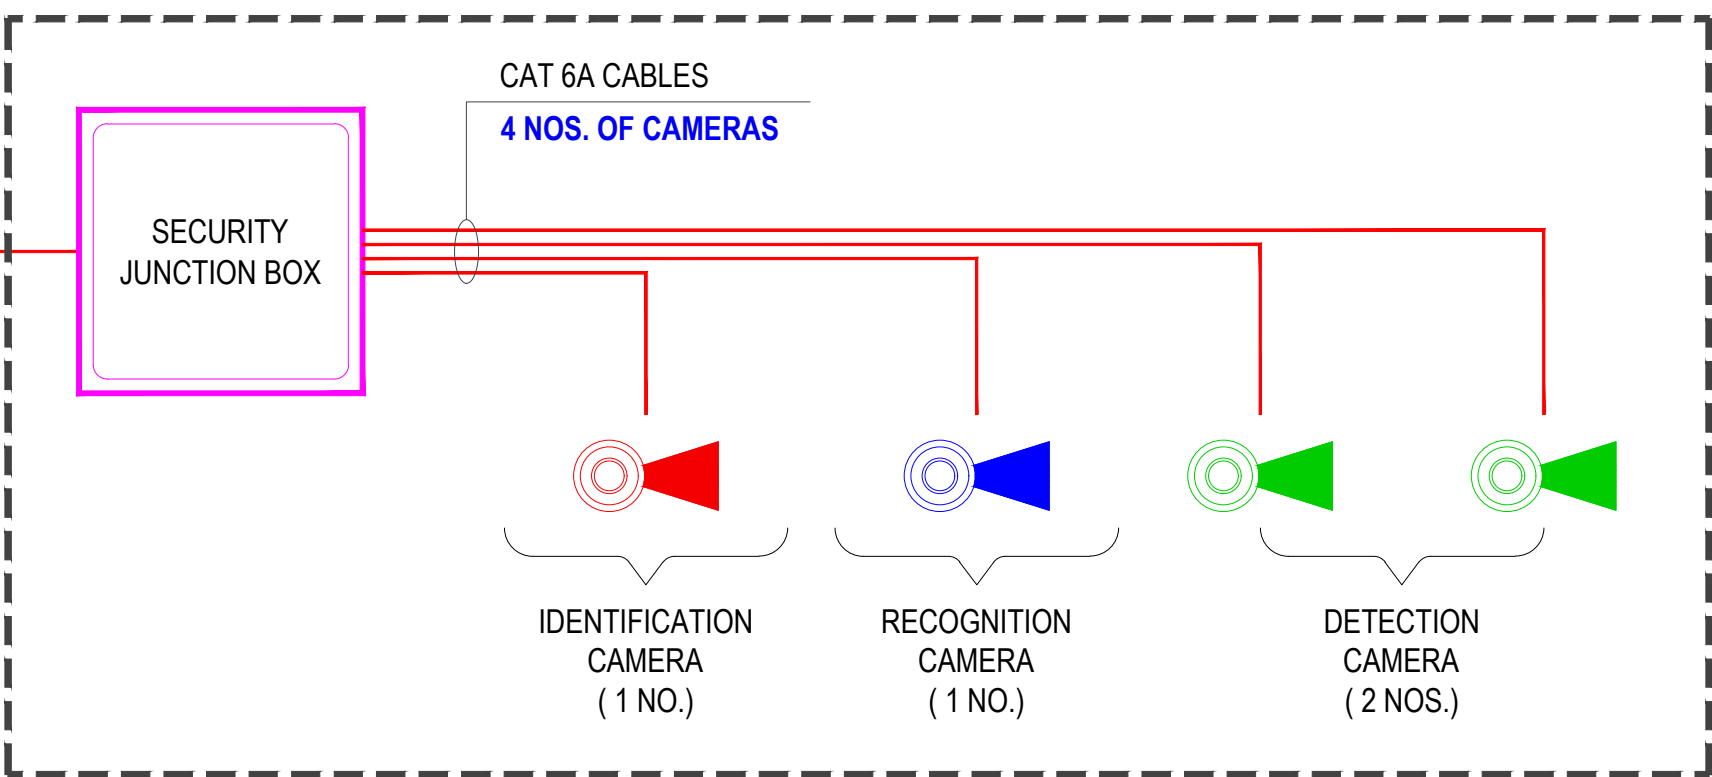

OUTDOOR AMENITIES (TH-01)

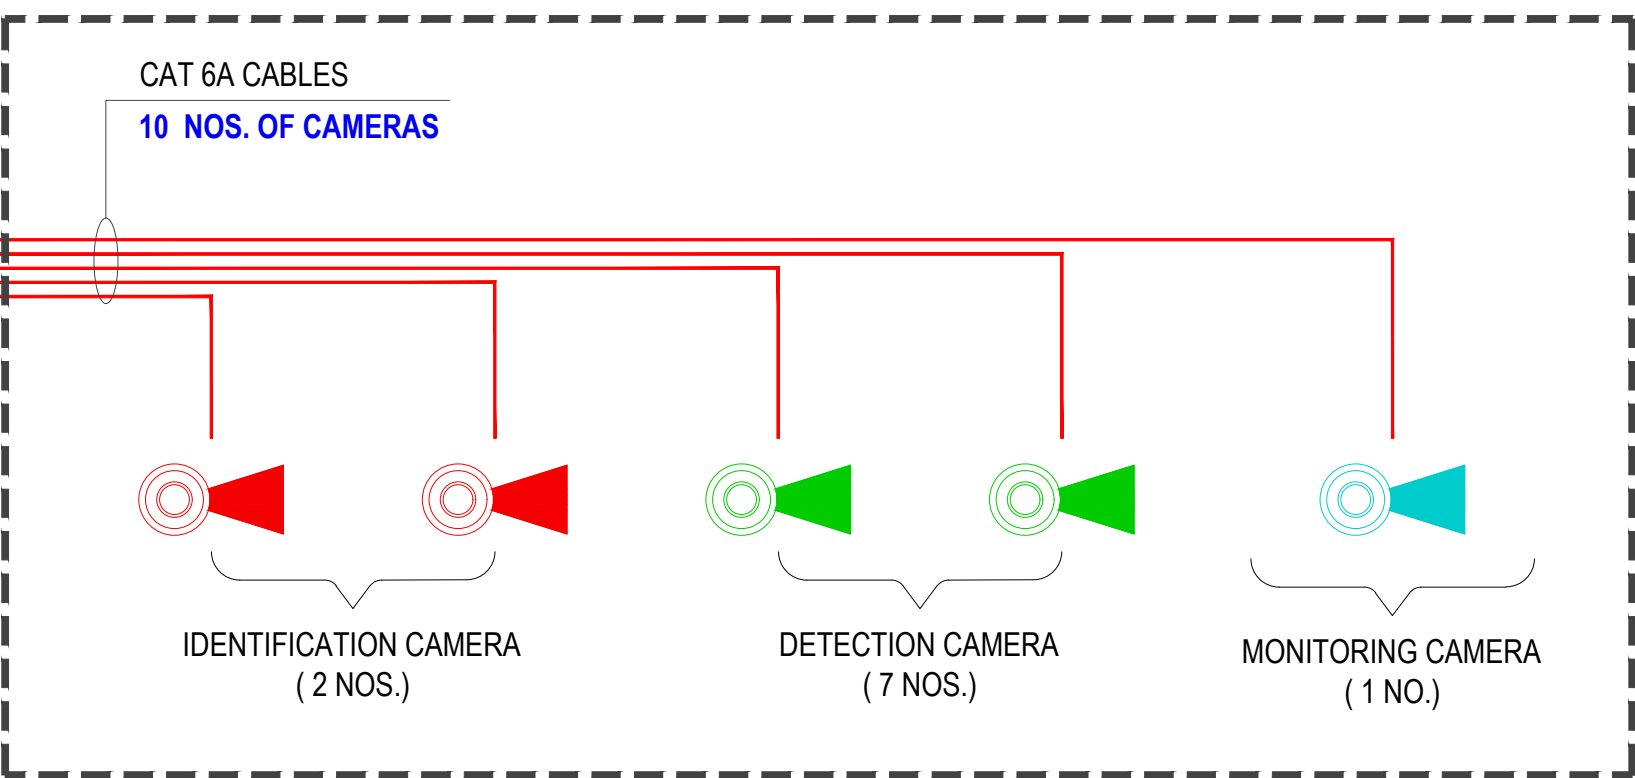

IDF (15U SECURITY RACK)
TOTAL CAM. (33 NOS.)
IN IT ROOM
@ SERVICE BLOCK - TH01

15	FIBER PATCH PANEL	15
14	CABLE MANAGER	14
13		13
12	CAT 6A PATCH PANEL	12
11	CABLE MANAGER	11
10	24 PORT POE SWITCH	10
9	CABLE MANAGER	9
8	CAT 6A PATCH PANEL	8
7	CABLE MANAGER	7
6	24 PORT POE SWITCH	6
5	CABLE MANAGER	5
4		4
3		3
2	UPS - 2 KVA	2
1		1

2x 8 CORE OS2 SINGLE MODE FIBER OPTIC CABLE (ARMORED)
CONNECTING TO MDF

2x 8 CORE OS2 SINGLE MODE FIBER OPTIC CABLE (ARMORED)
CONNECTED FROM GUARD HOUSE IDF


IES NOTE: CCTV + INTRUSION + ACCESS CONTROL

- THE LOCATIONS OF CCTV, ALARM, AND ACS COMPONENTS ARE INDICATED APPROXIMATELY ON THE DRAWINGS AND ARE SUBJECT TO ON-SITE VERIFICATION.
- EXACT LOCATIONS AND HEIGHTS OF COMPONENTS WILL BE FINALIZED IN COORDINATION WITH THE CONTRACTOR ON-SITE, CONSIDERING BUILDING LAYOUT, INTERIOR DESIGN, DECORATION, AND ANY OTHER RELEVANT SERVICES OR COMPONENTS.
- ON-SITE, COORDINATION WITH THE CONTRACTOR IS ESSENTIAL TO ADDRESS ANY POTENTIAL OBSTRUCTIONS TO THE CAMERA'S FIELD OF VIEW, IN COMPLIANCE WITH DUBAI LAW 12/2016, AS WELL AS TO MITIGATE ELECTROMAGNETIC INTERFERENCE (EMI) IMPACTING ELECTRONIC SECURITY COMPONENTS.
- THIS DESIGN WILL BECOME INVALID IF THERE ARE ANY MODIFICATIONS TO THE ARCHITECTURAL PLANS OR CHANGES IN LEGAL REQUIREMENTS.
- LOW-LIGHT AREAS SHOULD BE EQUIPPED WITH INFRARED (IR) OR NIGHT VISION CAMERAS TO ENSURE PROPER COVERAGE AND VISIBILITY.

SECURITY CAMERA SCHEDULE				
SYMBOL	DESCRIPTION	CAM. QTY.	NO. OF FLOOR	TOTAL NO. OF CAM.
	120% IDENTIFICATION CAMERA	4	1	4
	50% RECOGNITION CAMERA	4	1	4
	25% OBSERVATION CAMERA	0	1	0
	10% DETECTION CAMERA	23	1	23
	5% MONITORING CAMERA	2	1	2
	20% ANPR CAMERA	0	1	0
OVERALL TOTAL CAMERA				33

LEGEND		
SYMBOL	DESCRIPTION	TOTAL NO.
	JUNCTION BOX FOR SECURITY (300mm x 150mm x 150mm)	3
	15U SECURITY RACK (WALL MOUNTED)	1

Key Plan

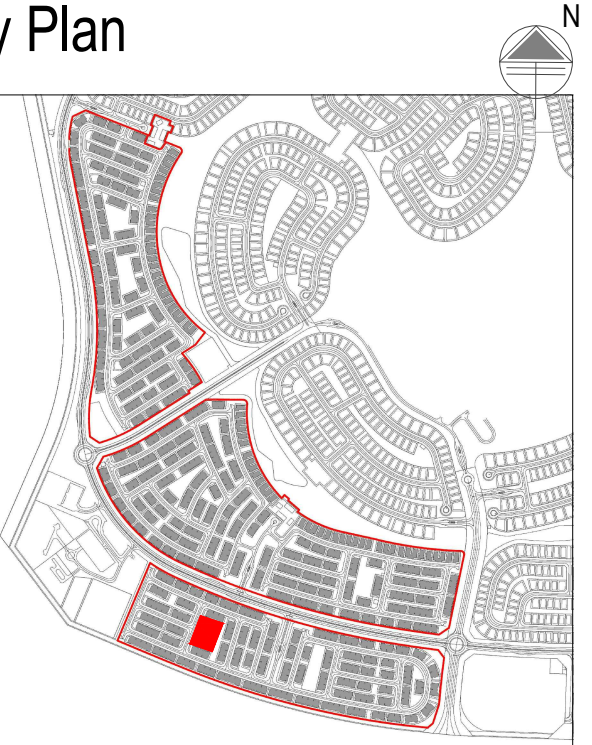

General Notes

- Do not Scale The Drawings. Follow (The MM) Written Dimensions Unless Otherwise Mentioned.
- Each Drawing Shall be Read in Conjunction With all Other Drawings, Specification & the General Standard Details. In Case of Any Discrepancies Bring it to the Knowledge of Engineer and Same to be Resolved Prior to Execution of Work.
- Dimensions Shown on These Drawings are Structural Dimensions. Unless Noted Otherwise.
- All Levels Indicated On These Drawings are Levels as per the Survey Datum, Same Should be Verified at Site Prior to Execution of Work.
- All Levels Indicated On These Drawings are Based On Design Level, Which is Equivalent to Datum Level and Same Should be Verified at Site Prior to Execution of Work.



09	10/03/2026	JP	TENDER SUBMISSION
No.	Date	Initials	Description

REVISIONS / ISSUE

THIS DRAWING MUST NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR APPROVAL OF ARIF & BINTOAK

TENDER SUBMISSION



Project Title:
Proposed Residential Townhouses and Standalone Villas TH-1, TH-2, and TH-3 at Grand Polo Club & Resort, Dubai, UAE

SECURITY

Architectural Engineer	Electrical Engineer	Structural Engineer
MUSTAFA ABID	MARWAN MOHD.	RIHAM RAMADAN
Registration # 5847	Registration # 80102	Registration # 105082
Scale(s):	Date drawn: 10/03/2026	Project no: 1857
Drawn by: JP	Checked: MM	Approved: JR
Drawing Number: GPCR-TH01-IES-CC1-SLD-SEC-VSS-2000-00		