



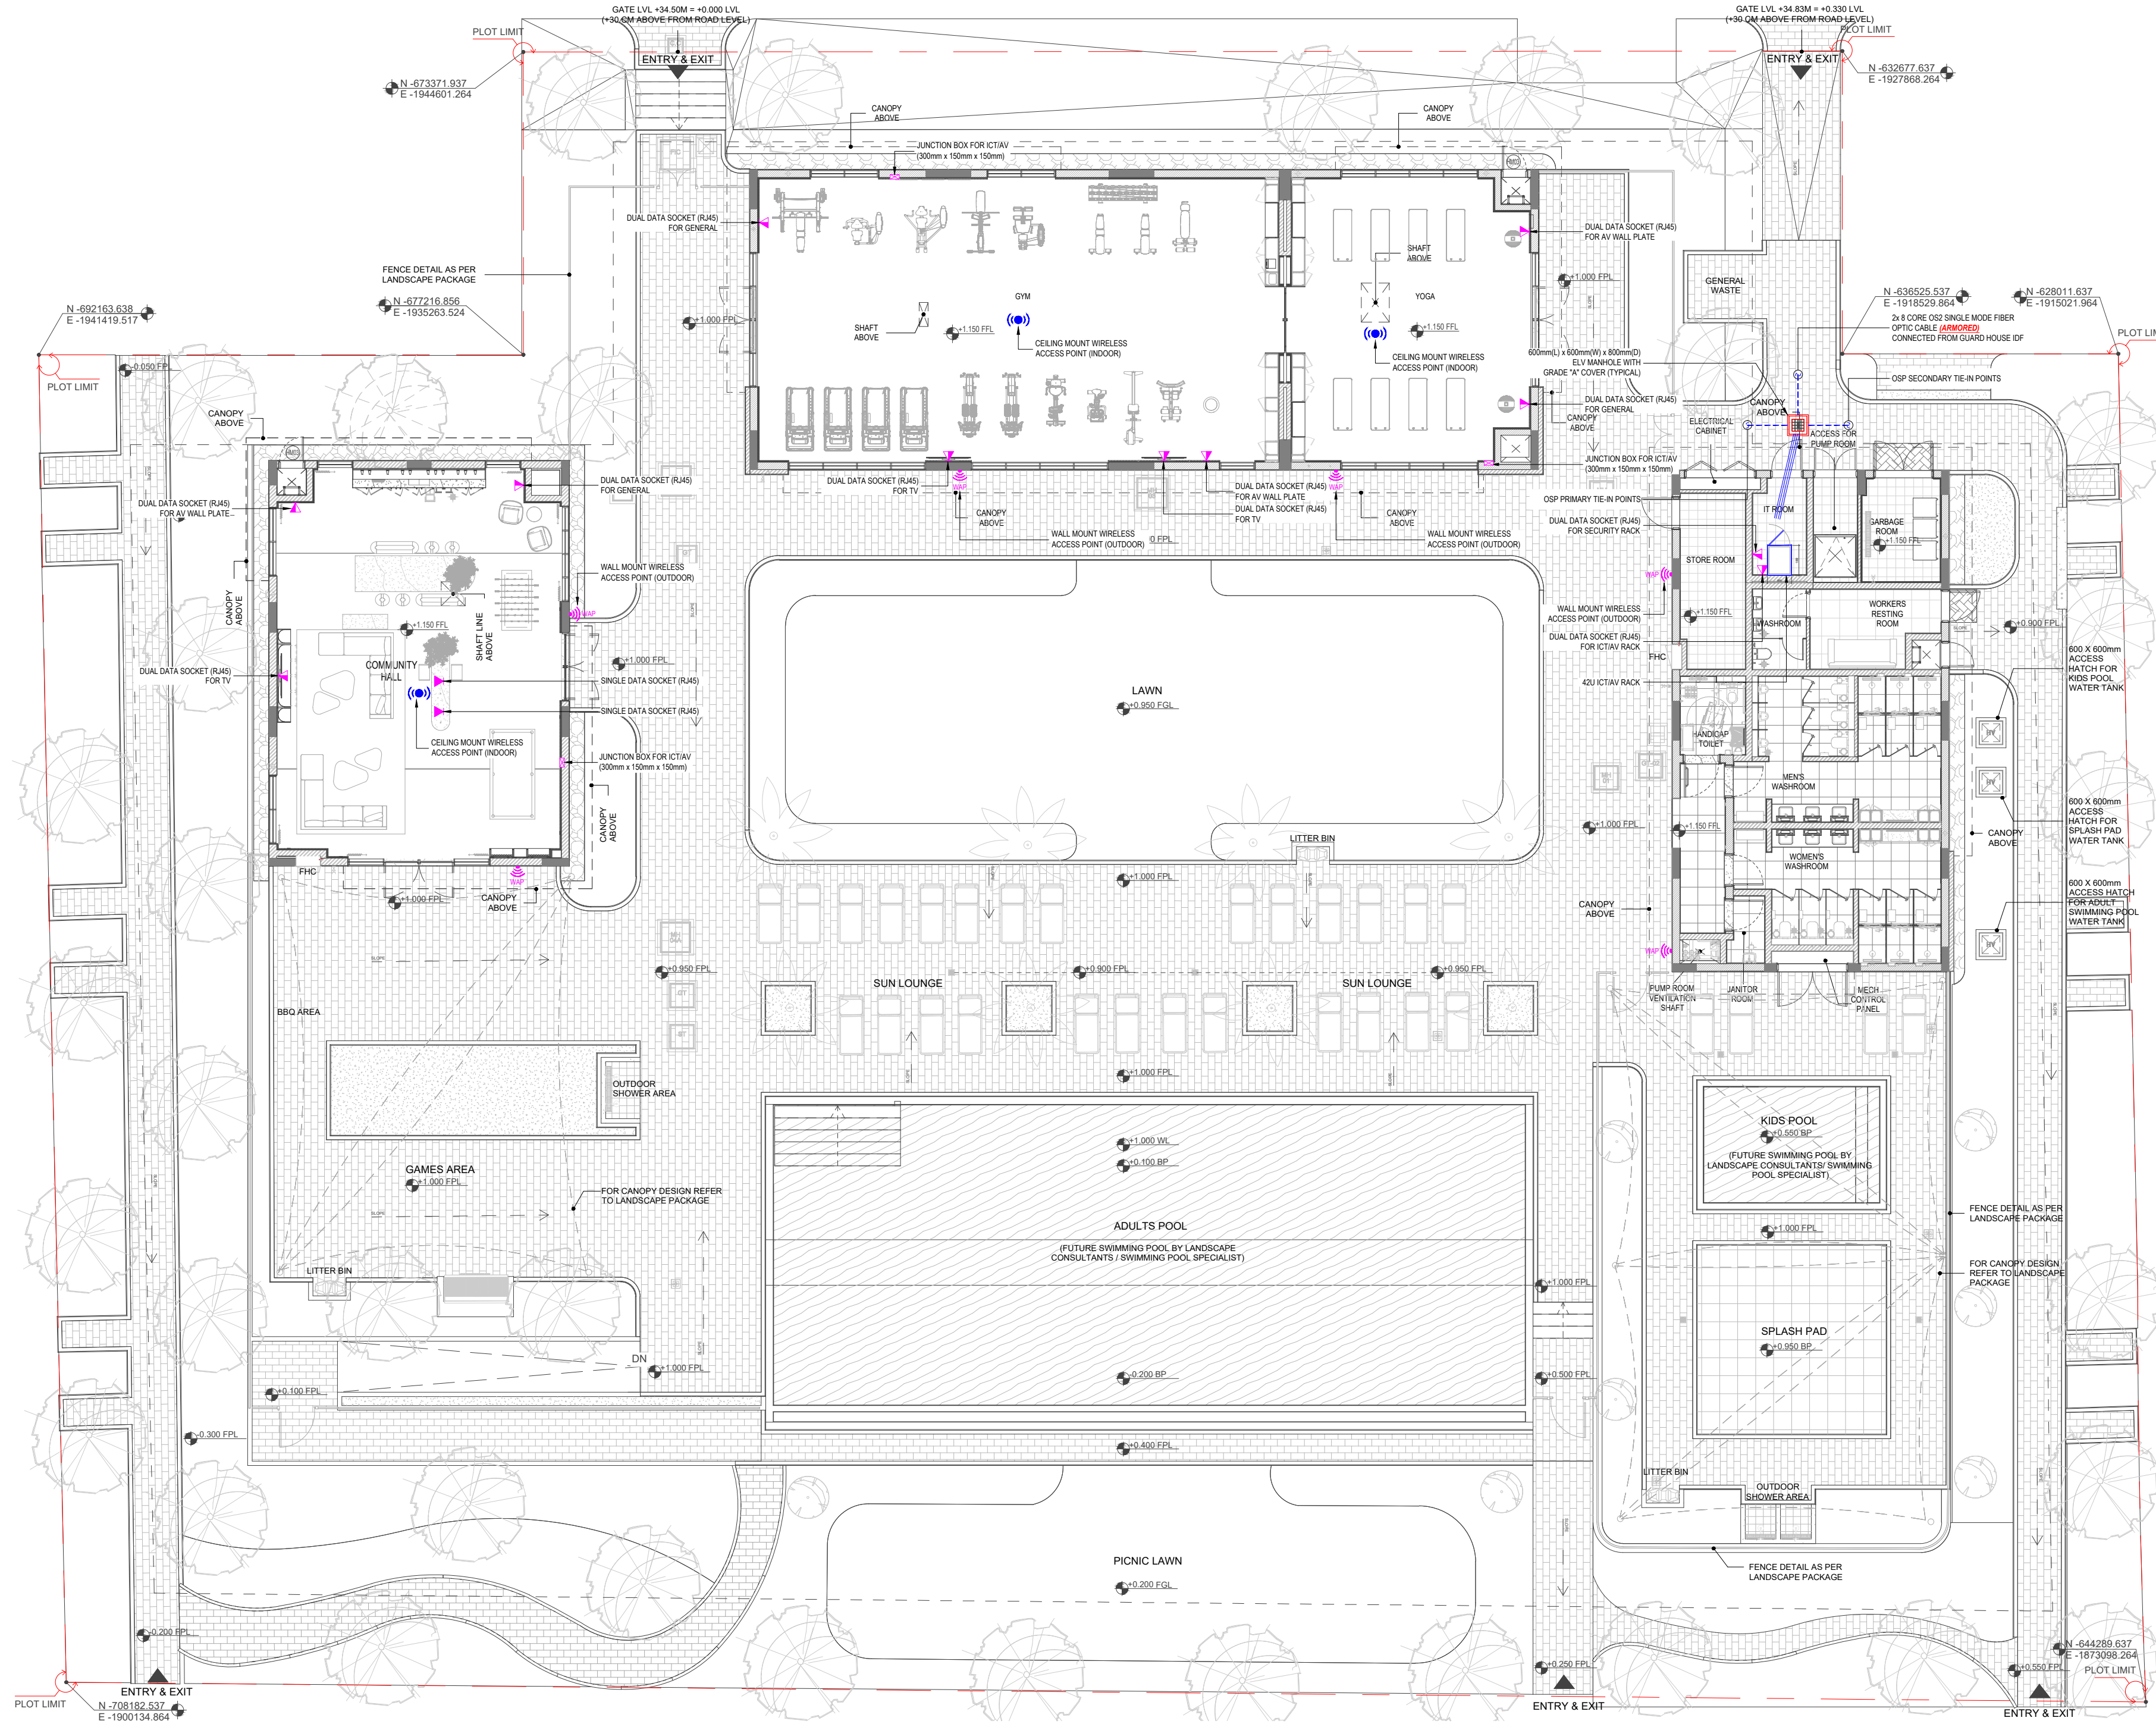

- NOTE: ICT DATA POINTS AND WIRELESS ACCESS POINT (WAPs)**
- ALL ICT DATA POINTS AND WAP LOCATIONS SHALL BE VERIFIED ON-SITE AND PRIOR TO INSTALLATION.
 - ALL ICT DATA POINTS SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST STANDARDS FOR STRUCTURED CABLING (e.g., ANSI/TIA-568, ISO/IEC 11801).
 - DATA OUTLETS SHALL BE RJ45 TYPE, CAT 6A, AND HOUSED IN STANDARD WALL-MOUNT OR FLOOR-BOX FACEPLATES AS PER PROJECT SPECIFICATIONS.
 - ALL WIRELESS ACCESS POINTS (WAPs) SHALL BE INSTALLED AS PER MANUFACTURER SPECIFICATIONS TO ENSURE OPTIMAL WIRELESS COVERAGE AND PERFORMANCE.
 - CONDUITS AND CABLE TRAYS USED FOR ICT CABLING SHALL BE SEPARATE FROM ELECTRICAL POWER CONDUITS TO AVOID INTERFERENCE.
 - DATA OUTLET AND WAPs FINAL LOCATIONS SHALL BE COORDINATED WITH ARCHITECTURAL LAYOUTS TO ENSURE ACCESSIBILITY AND AVOID CONFLICTS WITH OTHER FIXTURES OR FINISHES.
 - LABEL ALL DATA OUTLETS CLEARLY AND CONSISTENTLY AS PER THE APPROVED ICT NUMBERING SYSTEM.
 - ENSURE ALL CABLING IS TESTED AND CERTIFIED AFTER INSTALLATION. TEST REPORTS MUST BE SUBMITTED FOR APPROVAL BEFORE COMMISSIONING.

ICT SYSTEM SCHEDULE				
SYMBOL	DESCRIPTION	AV QTY.	NO. OF FLOOR	TOTAL NO. OF AV.
	SINGLE DATA SOCKET (RJ45)	2	1	2
	DUAL DATA SOCKET (RJ45)	11	1	11
	CEILING MOUNT (WAP)	3	1	3
	WIRELESS ACCESS POINT	6	1	6

LEGEND		
SYMBOL	DESCRIPTION	TOTAL NO.
	JUNCTION BOX FOR ICT/AV (300mm x 150mm x 150mm)	3
	42U ICT / AV RACK (FREE STANDING)	1

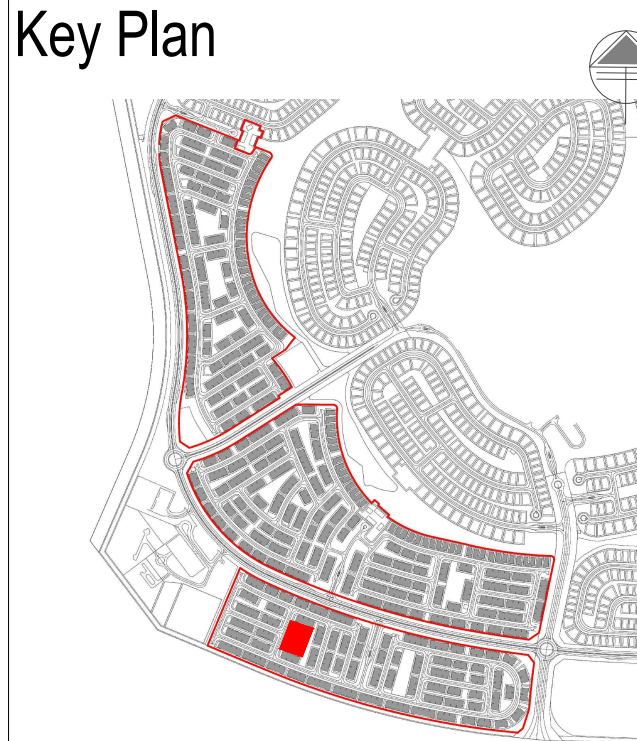

- General Notes**
- Do not Scale The Drawings. Follow (The MM) Written Dimensions Unless Otherwise Mentioned.
 - Each Drawing Shall be Read in Conjunction With all Other Drawings, Specification & the General Standard Details. In Case of Any Discrepancies Bring it to the Knowledge of Engineer and Same to be Resolved Prior to Execution of Work.
 - Dimensions Shown on These Drawings are Structural Dimensions, Unless Noted Otherwise.
 - All Levels Indicated On These Drawings are Levels as per the the Survey Datum, Same Should be Verified at Site Prior to Execution of Work.
 - All Levels Indicated On These Drawings are Based On Design Level, Which is Equivalent to Datum Level and Same Should be Verified at Site Prior to Execution of Work.

No.	09	Date	10/03/2026	Initials	JP	Description	TENDER SUBMISSION
REVISIONS / ISSUE							
THIS DRAWING MUST NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR APPROVAL OF ARIF & BINTOAK							
Status	TENDER SUBMISSION						
Client							
Lead Consultant							
Security Consultant							

Proposed Residential Townhouses and Standalone Villas TH-1, TH-2, and TH-3 at Grand Polo Club & Resort, Dubai, UAE

Discipline :	ICT	
Drawing title:	OVERALL GROUND FLOOR PLAN ICT SYSTEM LAYOUT COMMUNITY CENTER - TH-01	
Architectural Engineer	Electrical Engineer	Structural Engineer
MUSTAFA ABID	MARWAN MOHD.	RIHAM RAMADAN
Registration # 5847	Registration # 80102	Registration # 105092
Scale(s):	Date drawn: 10/03/2026	Project no: 1857
1 : 150		
Drawn by: JP	Checked: MM	Approved: JR
Drawing Number :	GPCR-TH01-IES-PL-CC-1-ICT-IT-0001-00	