

For community centres, BMS is considered as a “Standalone BACnet IP DDC controller with integrated I/O module for future connection to Emaar IT network for remote monitoring”. for remote monitoring”. BACnet points should be discoverable from the DDC for future integration on any IOT platform.

1. Swimming Pool:
- 1.1 Common fault / Alarm
- 1.2 Temperature
- 1.3 PH Level
- 1.4 Chlorine level.
2. Fire Alarm:
- 2.1 Common fault / alarm
- 2.2 Fire Alarm
3. CBS/Self-contained emergency lighting monitoring:
- 3.1 Common fault / alarm
4. Booster Pump: (As Applicable):
- 4.1 Common fault / alarm monitoring
5. General Exhaust fan: (As Applicable):
- 5.1 Common fault / alarm monitoring
6. ERV:
- 6.1 Common fault / alarm monitoring
7. WaterTank:
- 7.1 Common fault / alarm monitoring
8. Leak sensor:
- 8.1 Common alarm monitoring

Any other project specific provision if any other pumps/fan-common fault / Alarm monitoring only. I/O module either integrated or separate based on the number of points in the community centre.

- SWIMMING POOL
- COMM FAULT / ALARM
- TEMPERATURE
- PH LEVEL
- CHLORINE LEVEL
- FIRE ALARM
- COMMON FAULT / ALARM
- CMS (CENTRAL MONITORING SYSTEM) FOR SELF CONTAINED LIGHTS
- COMMON FAULT / ALARM
- BOOSTER PUMP
- COMMON FAULT / ALARM
- GENERAL EXHUAUST FAN
- COMMON FAULT / ALARM MONITORING
- WATER TANK
- COMMON FAULT / ALARM MONITORING
- LEAK SENSOR
- COMMON ALARM MONITORING



LEGEND

DDC	DIRECT DIGITAL CONTROL
-----	------------------------

NOTES:-

1. THE SCHEMATIC IS TO SHOW THE DESIGN INTENT. THE CONTRACTOR SHALL EMPLOY THE SERVICES OF A SPECIALIST SUPPLIER IN ORDER TO ENSURE A COMPLETE & PROPERLY FUNCTIONING SYSTEM IN FULL COMPLIANCE WITH THE APPLICABLE CODES & STANDARDS. DRAWING TO BE SUBMITTED BY THE CONTRACTOR/SPECIALIST FOR APPROVAL.
- 2.NETWORK COMMUNICATION PROTOCOL IS TO BE FOLLOWED AS PER SPECIFICATION AND AS PER APPROVED TECHNICAL SUBMITTAL.

CONNECTED TO EMAAR IT NETWORK FOR REMOTE MONITORING

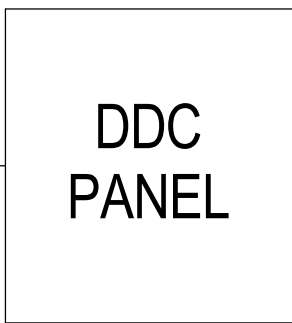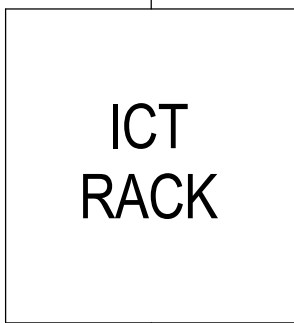

12U CABINET LOC:(TELE ROOM)

COMMUNICATION CABLE AS PER SYSTEM REQUIREMENT
CAT 6 CABLE (TCP/IP NETWORK BY BMS SPECIALIST)

ALL DDC CONTROLLRE WITH BACENT OVER IP PROTOCOL WITH INBUILT I/O MODULES & IOT ENABLED DEVICES


SYSTEM ARCHITECTURE - STANDALONE BMS SYSTEM)

Key Plan



General Notes :

01. Do not Scale The Drawings. Follow (The MM) Written Dimensions Unless Otherwise Mentioned.
02. Each Drawing Shall be Read in Conjunction With all Other Drawings.Specification & the General Standard Details. In Case of Any Discrepancies Bring it to the Knowledge of Engineer and Same to be Resolved Prior to Execution of Work.
03. Dimensions Shown on These Drawings are Structural Dimensions Unless Noted Otherwise.
04. All Levels Indicated On These Drawings are Levels as per the the Survey Datum, Same Should be Verified at Site Prior to Execution of Work.
05. All Levels Indicated On These Drawings are Based On Design Level, Which is Equivalent to Datum Level and Same Should be Verified at Site Prior to Execution of Work.

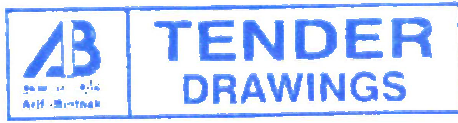

00	10/03/2026	VPA	TENDER SUBMISSION
No.	Date	Initials	Description

REVISIONS / ISSUE
THIS DRAWING MUST NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR APPROVAL OF ARIF & BINTOAK
Status
TENDER SUBMISSION



Project Title:

COMMUNITY CENTER -TH01
GRANDPOLP CLUB & RESORT, UAE

Discipline :	ELECTRICAL
--------------	------------

Drawing title:	COMMUNITY CENTER BMS SMART BUILDING MANAGEMENT SYSTEM SINGLE LINE DIAGRAM
----------------	---

Architectural Engineer	Electrical Engineer	Structural Engineer
MUSTAFA ABID	MARWAN MOHD.	RIHAM RAMADAN
Registration # 5847	Registration # 80102	Registration # 105092
Scale(s): 1 : 35	Date drawn: 10/03/2026	Project no: 1857
Drawn by: VPA	Checked: HAE	Approved: MRM

Drawing Number :	GPCR-TH01-AB-DRG-ZZZ-ELE-BM-3026-00
------------------	-------------------------------------