




GYM (TH-02)

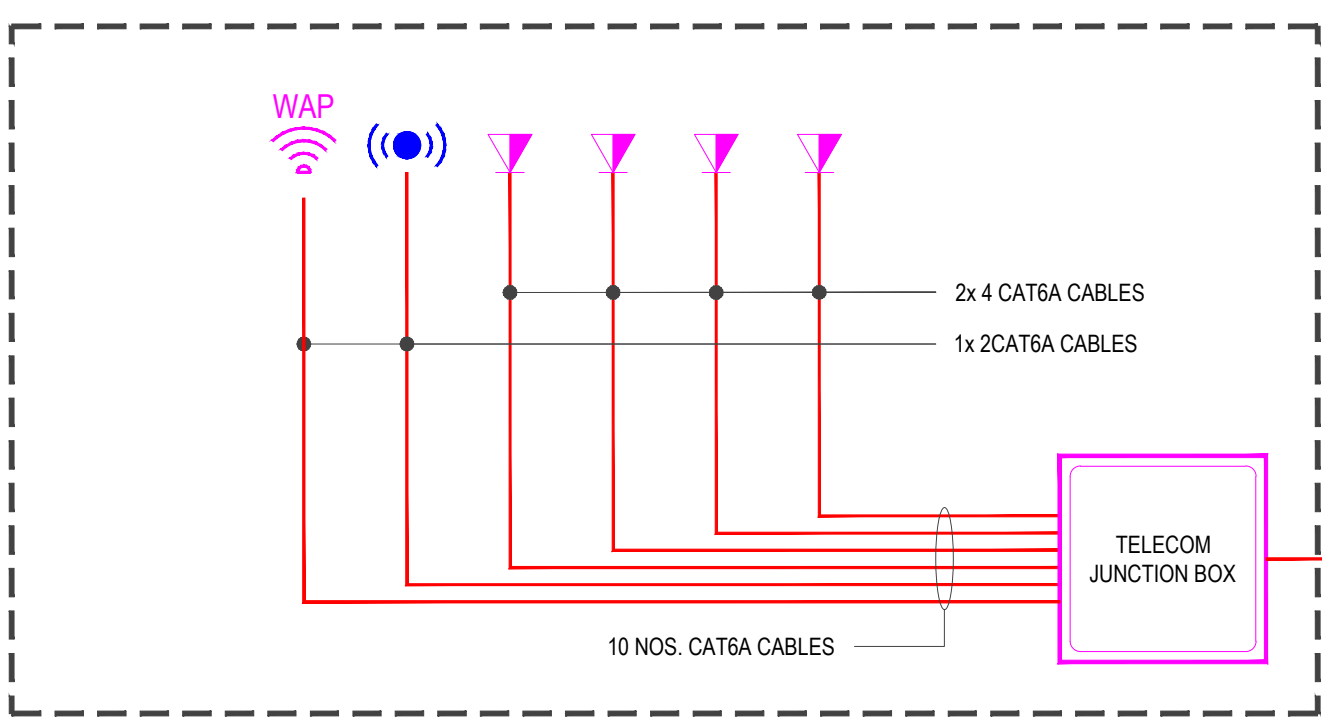


YOGA (TH-02)

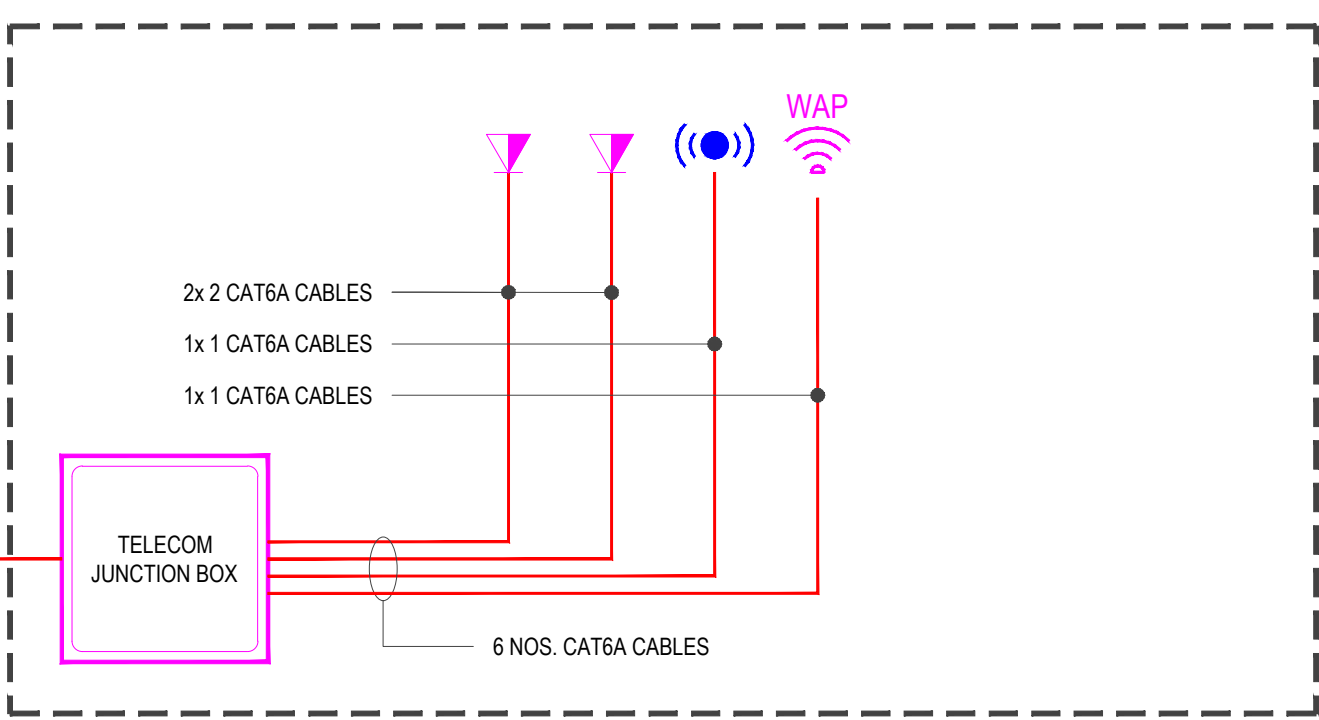


COMMUNITY HALL (TH-02)

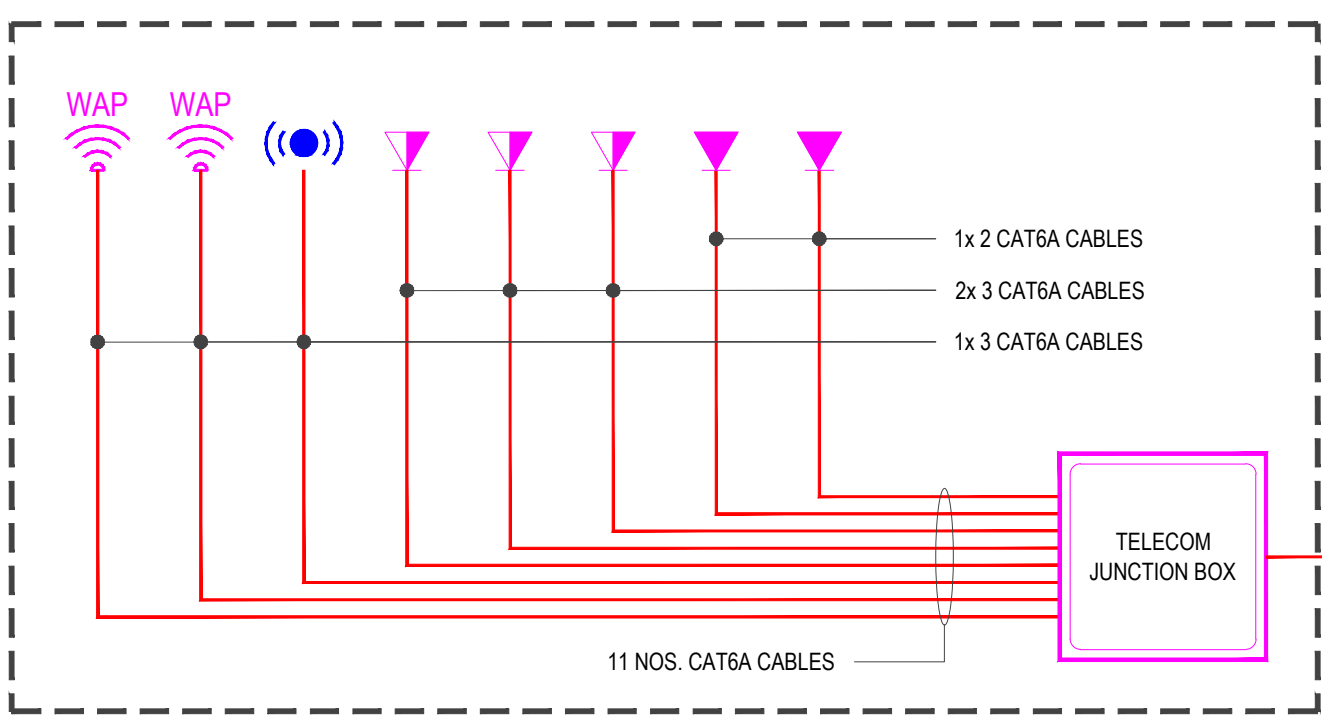

SERVICE BLOCK (TH-02)

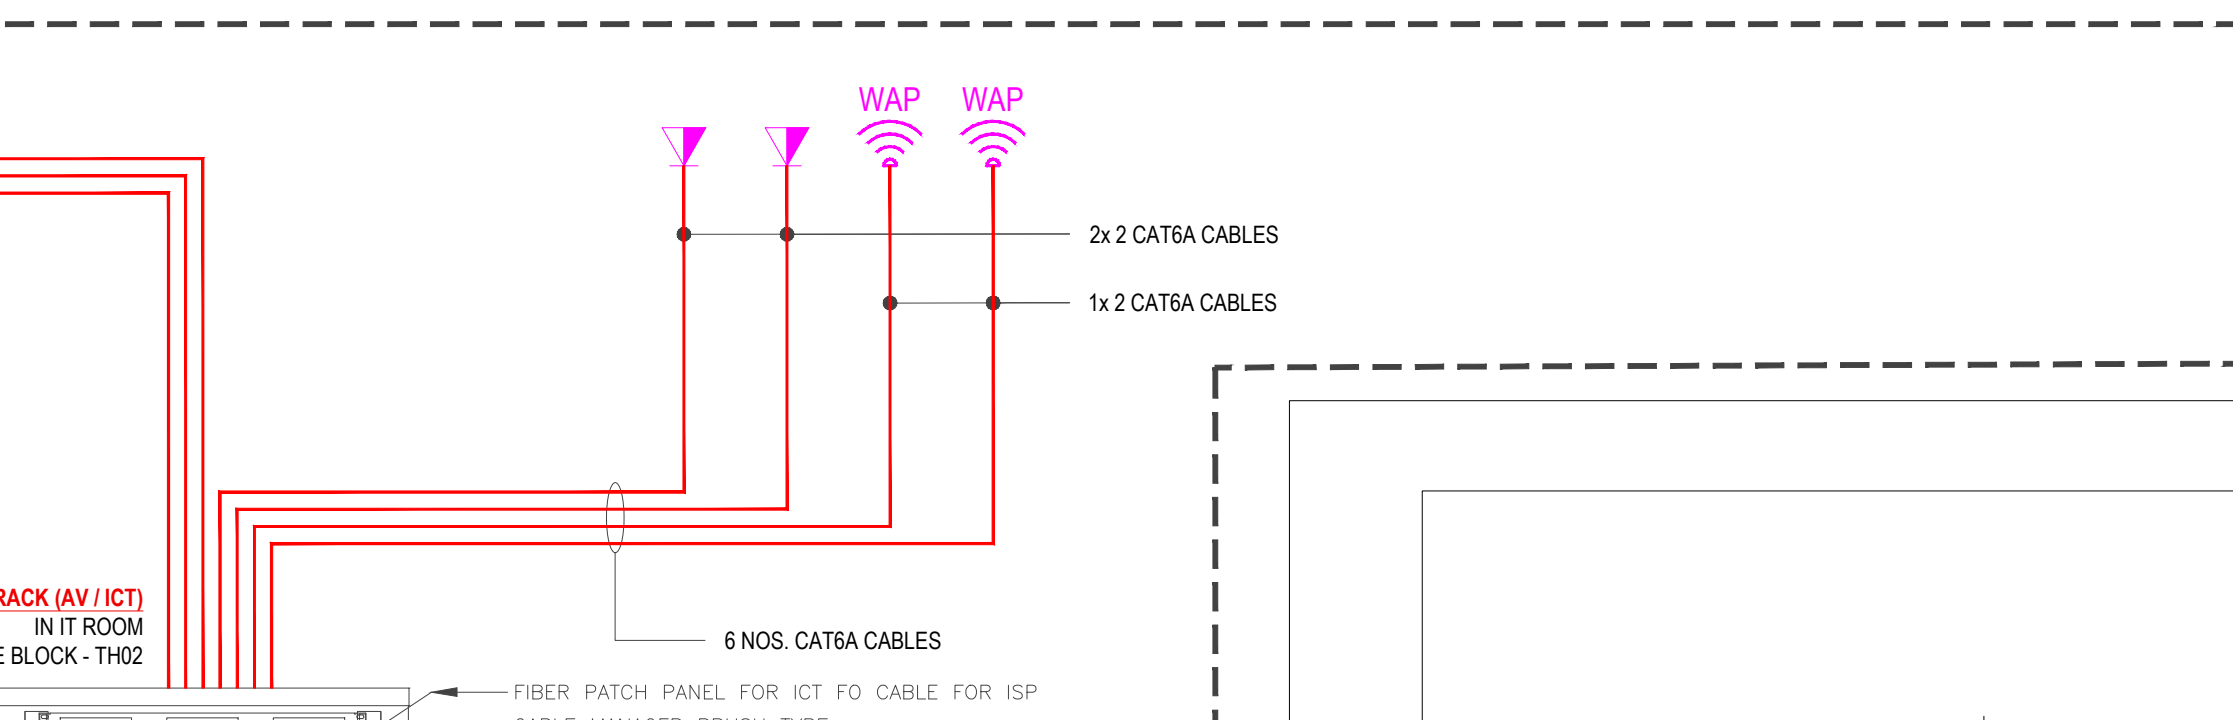

42U IDF RACK (AV / ICT)
IN IT ROOM
@ SERVICE BLOCK - TH-02

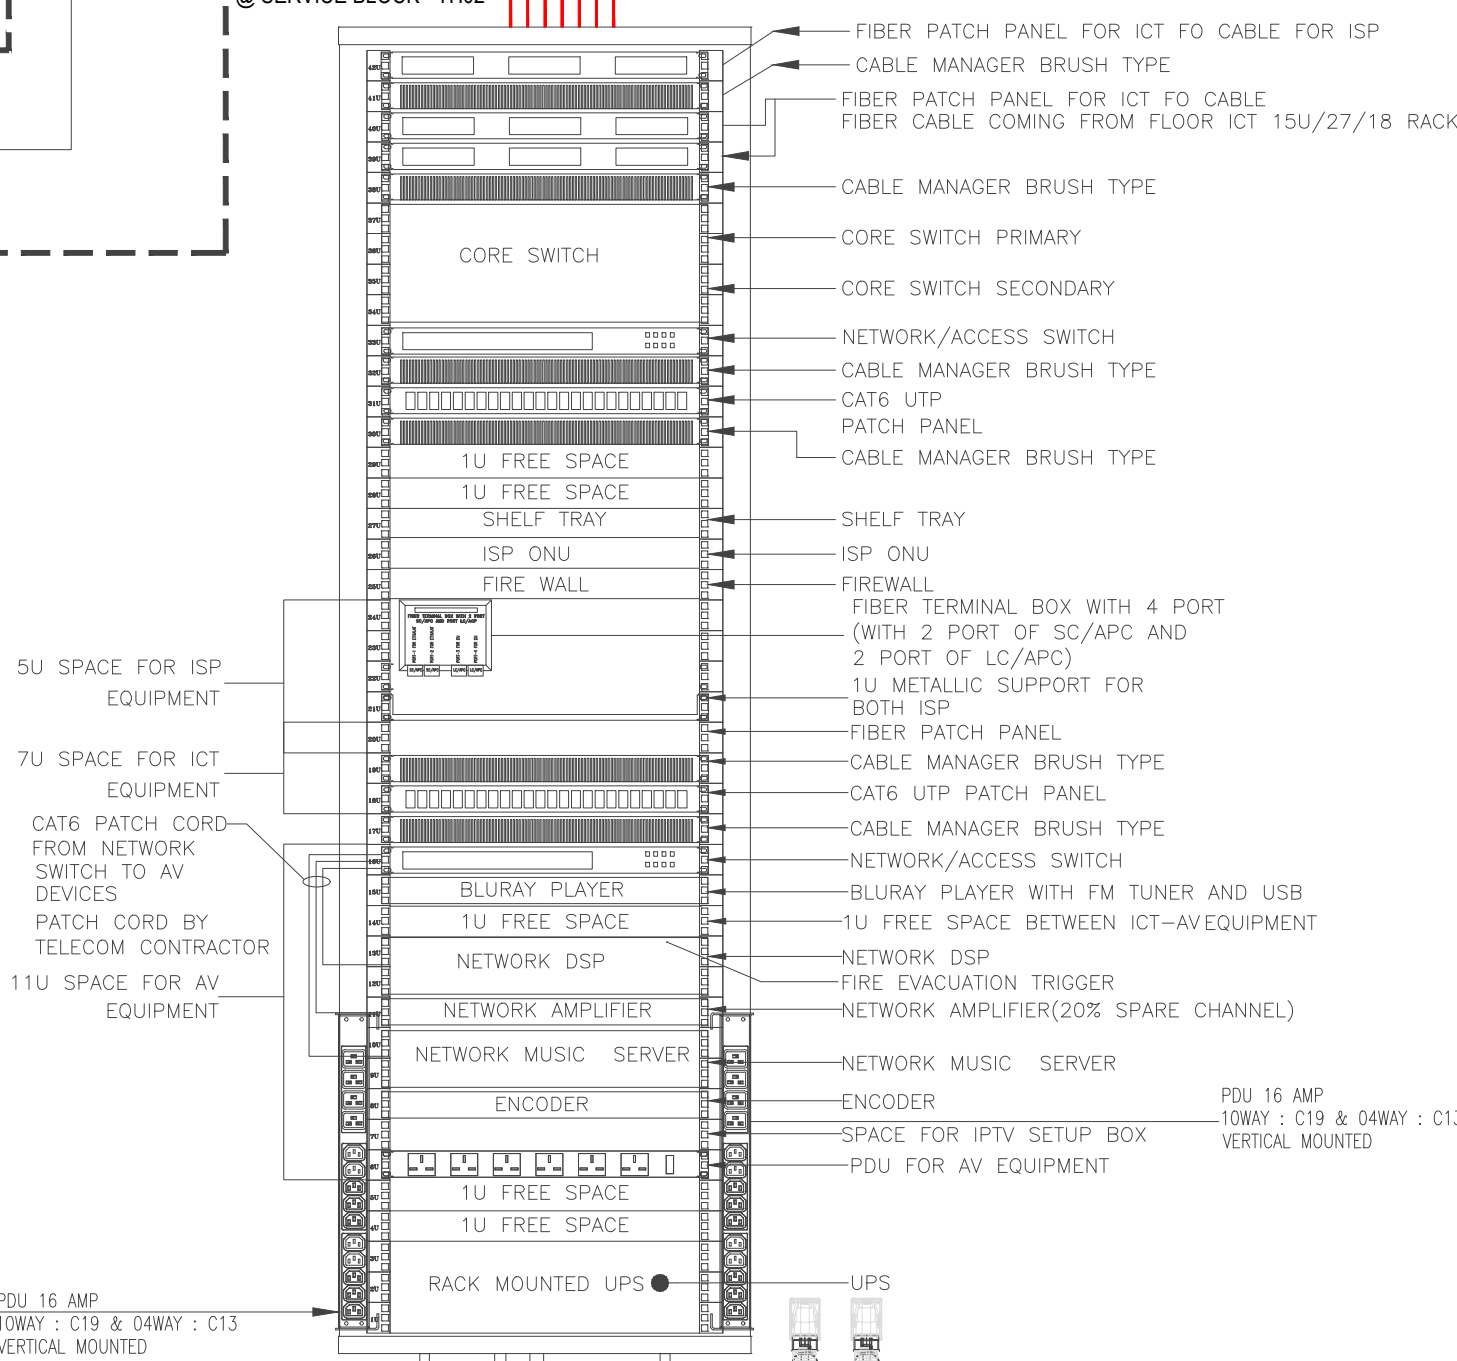

NOTE:-
CNS/FIREWALL COMPONENTS
UNDER CONTRACTOR
SCOPE. QUANTITY SHOWN ON
SCHEMATIC DIAGRAM ARE
INDICATIVE ONLY.

2xD54 (100mm) UPVC DUCT
AT 800 mm DEPTH FOR
FIBRE OPTIC CABLE INTAKE

ENTRY BOX
600(L)X600(W)X800(D)mm

PRIMARY ENTRY FROM
SERVICE NETWORK

2x8 CORE 0S2 SINGLE MODE FIBER OPTIC CABLE
(ARMORED) CONNECTING TO GUARD HOUSE

LOC: IT ROOM
ICT & AV RACK
42U 800(W)X1000(D)

EARTH PIT FOR
LOW CURRENT

SECONDARY ENTRY
FROM SERVICE NETWORK

ENTRY BOX
600(L)X600(W)X800(D)mm

2xD54 (100mm) UPVC DUCT
AT 800 mm DEPTH FOR
FIBRE OPTIC CABLE INTAKE

GROUND FLOOR

CNS- SCHEMATIC

NOTE: ICT DATA POINTS AND WIRELESS ACCESS
POINT (WAPs)

- ALL ICT DATA POINTS AND WAP LOCATIONS SHALL BE VERIFIED ON-SITE AND PRIOR TO INSTALLATION.
- ALL ICT DATA POINTS SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST STANDARDS FOR STRUCTURED CABLEING (e.g., ANSI/TIA-568, ISO/IEC 11801).
- DATA OUTLETS SHALL BE RJ45 TYPE, CAT 6A, AND HOUSED IN STANDARD WALL-MOUNT OR FLOOR-BOX FACEPLATES AS PER PROJECT SPECIFICATIONS.
- ALL WIRELESS ACCESS POINTS (WAPs) SHALL BE INSTALLED AS PER MANUFACTURER SPECIFICATIONS TO ENSURE OPTIMAL WIRELESS COVERAGE AND PERFORMANCE.
- CONDUITS AND CABLE TRAYS USED FOR ICT CABLEING SHALL BE SEPARATE FROM ELECTRICAL POWER CONDUITS TO AVOID INTERFERENCE.
- DATA OUTLET AND WAPs FINAL LOCATIONS SHALL BE COORDINATED WITH ARCHITECTURAL LAYOUTS TO ENSURE ACCESSIBILITY AND AVOID CONFLICTS WITH OTHER FIXTURES OR FINISHES.
- LABEL ALL DATA OUTLETS CLEARLY AND CONSISTENTLY AS PER THE APPROVED ICT NUMBERING SYSTEM.
- ENSURE ALL CABLEING IS TESTED AND CERTIFIED AFTER INSTALLATION. TEST REPORTS MUST BE SUBMITTED FOR APPROVAL BEFORE COMMISSIONING.


ICT SYSTEM SCHEDULE

SYMBOL	DESCRIPTION	AV QTY.	NO. OF FLOOR	TOTAL NO. OF AV
	SINGLE DATA SOCKET (RJ45)	2	1	2
	DUAL DATA SOCKET (RJ45)	11	1	11
	CEILING MOUNT (WAP) WIRELESS ACCESS POINT	3	1	3
	WALL MOUNT WAP (WEATHERPROOF)	6	1	6

LEGEND

SYMBOL	DESCRIPTION	TOTAL NO.
	JUNCTION BOX FOR ICT/AV (300mm x 150mm x 150mm)	3
	42U ICT / AV RACK (FREE STANDING)	1

Key Plan

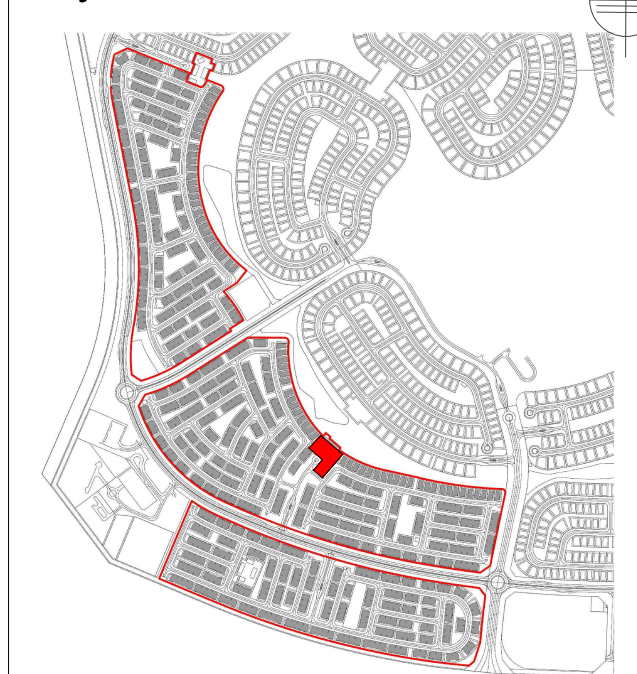

General Notes :

- Do not Scale The Drawings. Follow (The MM) Written Dimensions Unless Otherwise Mentioned.
- Each Drawing Shall be Read in Conjunction With all Other Drawings, Specification & the General Standard Details. In Case of Any Discrepancies Bring it to the Knowledge of Engineer and Same to be Resolved Prior to Execution of Work.
- Dimensions Shown on These Drawings are Structural Dimensions. Unless Noted Otherwise.
- All Levels Indicated On These Drawings are Levels as per the the Survey Datum, Same Should be Verified at Site Prior to Execution of Work.
- All Levels Indicated On These Drawings are Based On Design Level, Which is Equivalent to Datum Level and Same Should be Verified at Site Prior to Execution of Work.



No.	Date	Initials	Description
01	18.02.2026	JP	TENDER SUBMISSION

REVISIONS / ISSUE

THIS DRAWING MUST NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR APPROVAL OF ARIF & BINTOAK

Status
TENDER SUBMISSION

Client

EMAAR

Lead Consultant

عارف وبن طوق
Arif&Bintoak
consulting architects & engineers
POST BOX 3676 DUBAI U.A.E TEL: 84-372288 FAX: 84-372932
POST BOX 42981 ABU DHABI U.A.E TEL: 02-434659 -arfoak@emirates.net.ae

Security Consultant

INTERNATIONAL ELECTRONIC SECURITY
TEL: 04 397 0757, FAX: 04 397 0754
P.O. BOX 12734 DUBAI - U.A.E
ENQUIRIES@IESCONSULTING.AE
AUDIT@IESCONSULTING.AE
WWW.IESCONSULTING.AE

Project Title:

Proposed Residential Townhouses and
Standalone Villas TH-1, TH-2, and TH-3
at Grand Polo Club & Resort, Dubai,
UAE

Discipline :
ICT

Drawing title:
ICT SYSTEM
SINGLE LINE DIAGRAM
COMMUNITY CENTER - TH-02

Architectural Engineer	Electrical Engineer	Structural Engineer
MUSTAFA ABID	MARWAN MOHD.	RIHAM RAMADAN
Registration # 5847	Registration # 80102	Registration # 105092
Scale(s): NTS	Date drawn: 16-02-2026	Project no: 1857
Drawn by: JP	Checked: MM	Approved: JR

Drawing Number : GPCR-TH02-IES-CC2-SLD-ICT-IT-2000-00