


For community centres, BMS is considered as a “Standalone BACnet IP DDC controller with integrated I/O module for future connection to Emaar IT network for remote monitoring”. for remote monitoring”. BACnet points should be discoverable from the DDC for future integration on any IOT platform.

1. Swimming Pool:
- 1.1 Common fault / Alarm
- 1.2 Temperature
- 1.3 PH Level
- 1.4 Chlorine level.
2. Fire Alarm:
- 2.1 Common fault / alarm
- 2.2 Fire Alarm
3. CBS/Self-contained emergency lighting monitoring:
- 3.1 Common fault / alarm
4. Booster Pump: (As Applicable):
- 4.1 Common fault / alarm monitoring
5. General Exhaust fan: (As Applicable):
- 5.1 Common fault / alarm monitoring
6. ERV:
- 6.1 Common fault / alarm monitoring
7. WaterTank:
- 7.1 Common fault / alarm monitoring
8. Leak sensor:
- 8.1 Common alarm monitoring

Any other project specific provision if any other pumps/fan-common fault / Alarm monitoring only. I/O module either integrated or separate based on the number of points in the community centre.

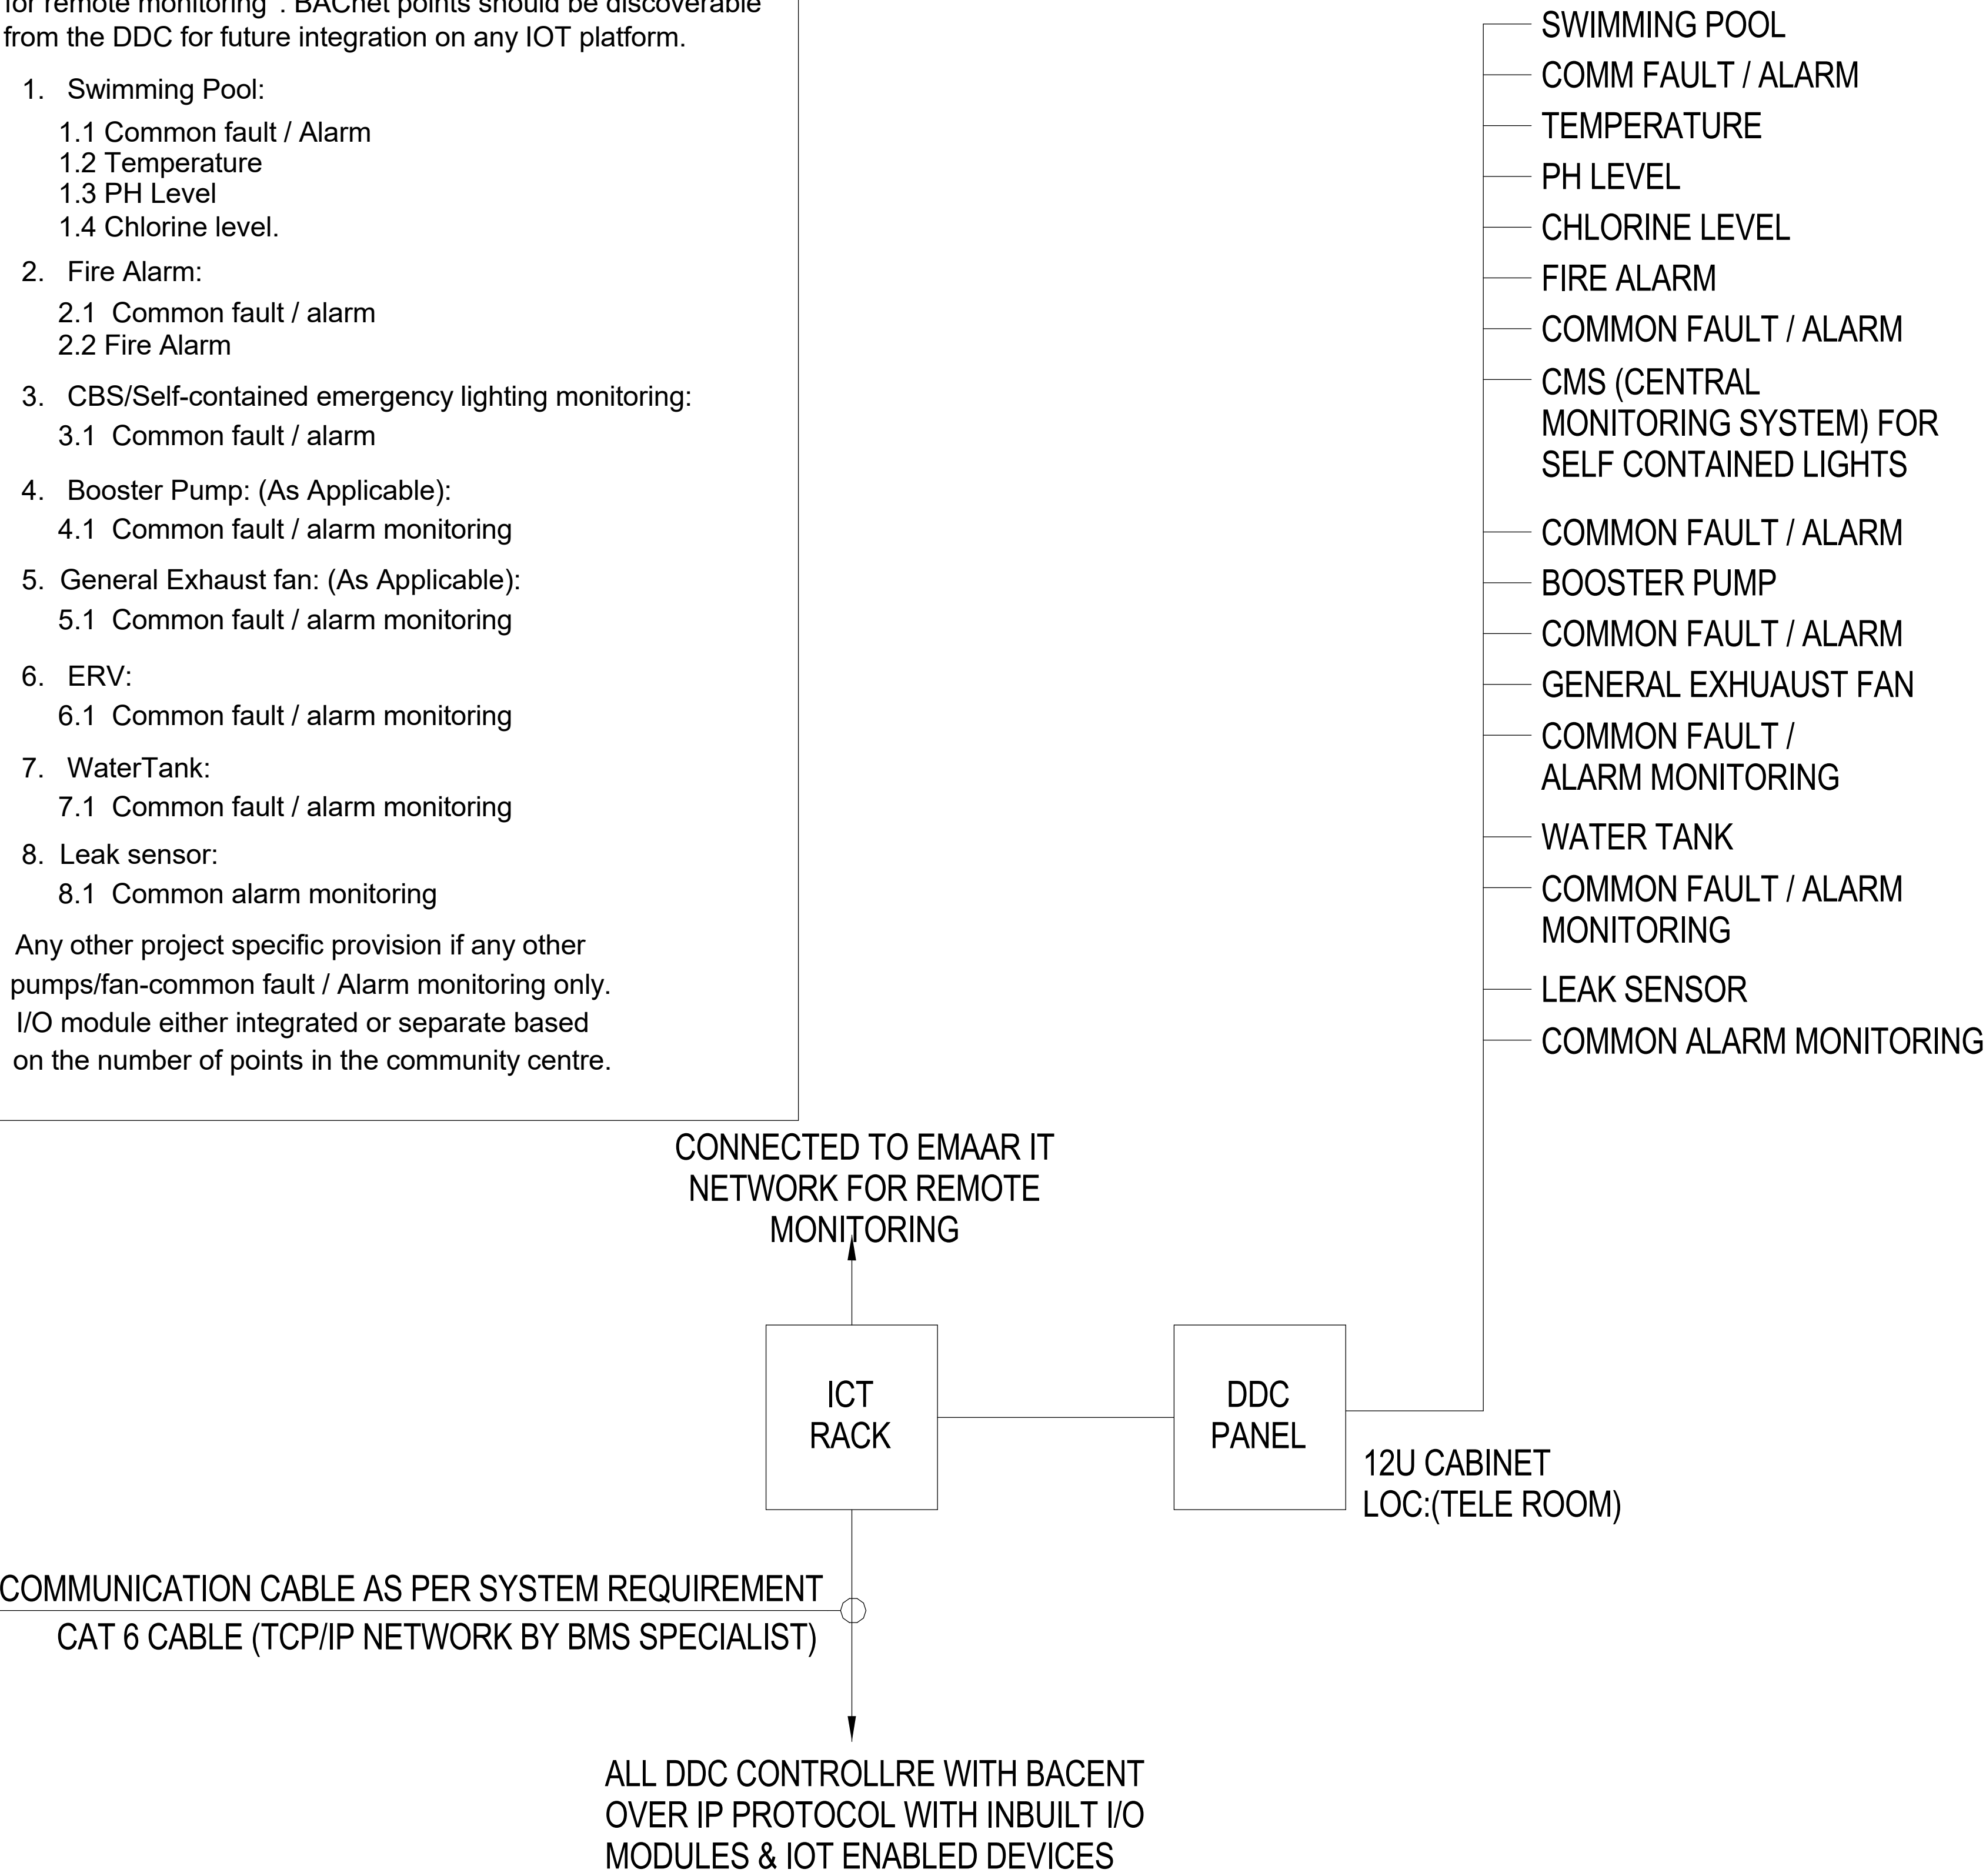


SYSTEM ARCHITECTURE - STANDALONE BMS SYSTEM)

LEGEND


DDC	DIRECT DIGITAL CONTROL
-----	------------------------

NOTES:-

1. THE SCHEMATIC IS TO SHOW THE DESIGN INTENT. THE CONTRACTOR SHALL EMPLOY THE SERVICES OF A SPECIALIST SUPPLIER IN ORDER TO ENSURE A COMPLETE & PROPERLY FUNCTIONING SYSTEM IN FULL COMPLIANCE WITH THE APPLICABLE CODES & STANDARDS. DRAWING TO BE SUBMITTED BY THE CONTRACTOR/SPECIALIST FOR APPROVAL.
- 2.NETWORK COMMUNICATION PROTOCOL IS TO BE FOLLOWED AS PER SPECIFICATION AND AS PER APPROVED TECHNICAL SUBMITTAL.

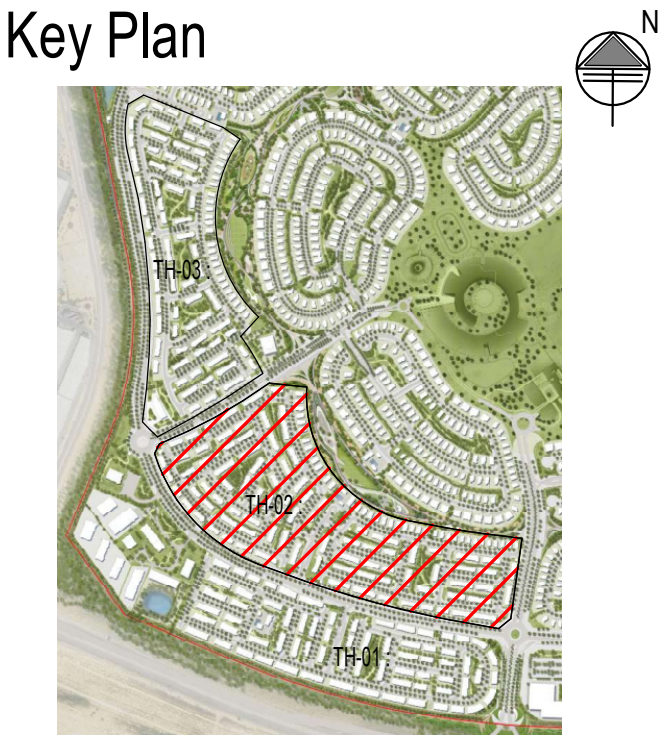

- General Notes :
01. Do not Scale The Drawings. Follow (The MM) Written Dimensions Unless Otherwise Mentioned.
02. Each Drawing Shall be Read in Conjunction With all Other Drawings, Specification & the General Standard Details. In Case of Any Discrepancies Bring it to the Knowledge of Engineer and Same to be Resolved Prior to Execution of Work.
03. Dimensions Shown on These Drawings are Structural Dimensions Unless Noted Otherwise.
04. All Levels Indicated On These Drawings are Levels as per the Survey Datum, Same Should be Verified at Site Prior to Execution of Work.
05. All Levels Indicated On These Drawings are Based On Design Level, Which is Equivalent to Datum Level and Same Should be Verified at Site Prior to Execution of Work.



00	10/03/2026	VPA	TENDER SUBMISSION
No.	Date	Initials	Description
REVISIONS / ISSUE			
THIS DRAWING MUST NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR APPROVAL OF ARIF & BINTOAK			
Status	TENDER SUBMISSION		
Client	EMAAR		
Lead Consultant	Arif & BintOak consulting architects & engineers		
Project Title:	COMMUNITY CENTER - TH02 GRANDPOLP CLUB & RESORT, UAE		
Discipline :	ELECTRICAL		
Drawing title:	COMMUNITY CENTER BMS SMART BUILDING MANAGEMENT SYSTEM SINGLE LINE DIAGRAM		
Architectural Engineer	Electrical Engineer	Structural Engineer	
MUSTAFA ABID	MARWAN MOHD.	RIHAM RAMADAN	
Registration # 5847	Registration # 80102	Registration # 105092	
Scale(s): 1 : 35	Date drawn: 10/03/2026	Project no: 1857	
Drawn by: VPA	Checked: HAE	Approved: MRM	
Drawing Number :	GPCR-TH02-AB-DRG-ZZZ-ELE-BM-3026-00		