



DX Unit (GHs)													
Unit Ref.	Space	Unit Type	Area	NRT	TCL	SCL	Flow	Density	Density	FA	On Coil DB/WB	Off Coil DB/WB	Estimated Electrical Load
			m²	RT	kW	kW	L/s	W/m²	m²/TR	L/s	°C	°C	kW
GH-GF-01	GUARDHOUSE	DECORATIVE	9.90	1.93	6.80	5.90	371	686.87	5.12	25	23.6 / 17.2	12.9 / 12.3	3.08
1. ALL AIR CONDITIONING UNITS SHALL HAVE ACTUAL CAPACITY AS GIVEN ABOVE AT AMBIENT TEMPERATURE: 46DB °C 2. ALL DX A/C EQUIPMENT SHALL BE WITH REFRIGERANT R407C OR R410A. 3 - EXTERNAL STATIC PRESSURE FOR ALL FANS SHALL BE CALCULATED BY THE CONTRACTOR AND SUBMITTED FOR ENGINEER'S APPROVAL 4 - CONTRACTOR TO CHECK SIZE OF REFRIGERANT PIPES AGAINST THE TOTAL PIPE LENGTH/ELEVATION DIFFERENCE AND MANUFACTURER RECOMMENDATION. 5 - AIR COOLED CONDENSING UNITS TO BE SUITABLE FOR OUTDOOR INSTALLATION. 6 - HVAC UNITS SHALL BE SELECTED ACCORDING TO DM GREEN BUILDING REGULATIONS AND DBC. 7 - ELECTRICAL POWER SUPPLY: 400 /220V ,3PH/1PH & 50Hz. 8 - AC CONDENSATE DRAIN SHALL BE INSULATED. 9 - ACOUSTIC LINED SHALL BE PROVIDED WHERE IS REQUIRED TO ACHIEVE THE NC LEVEL IN EACH SPACE. 10 - THE SELECTED UNITS LISTED IN THE ABOVE SCHEDULE PROVIDED TO ESTIMATE THE ACTUAL POWER CONSUMPTION ONLY, THE CONTRACTOR SHALL RESPONSIBLE TO PROVIDE ACTUAL SELECTION BASED ON THE CALCULATED VALUE 11 - HVAC DESIGN LAYOUT BASED ON THE CALCULATED UNIT AIR FLOW RATE, CONTRACTOR SHALL BE RESPONSIBLE TO REVISE DUCT SIZE, AIR DISTRIBUTION AND AIR OUTLET DIFFUSER ACCORDING TO ACTUAL AC UNIT SELECTION WITHOUT COST IMPACT. 12 - COIL ENTERING/LEAVING TEMPERATURE SHOWN IN THE SCHEDULE BASED ON THE COOLING LOAD CALCULATION/HAP SOFTWARE, THE CONTRACTOR SHALL RESPONSIBLE TO PROVIDE UNIT SELECTION TO ACHIEVE THE REQUIRED INDOOR TEMPERATURE (23°). 13 - UNTREATED/DIRECT FRESH AIR HAVE BEEN PROVIDED TO SAME OF AC INDOOR UNITS IN ORDER TO PROVIDE THE MINIMUM FRESH AIR IN THE BUILDING.CONTRACTOR SHALL TAKE THE SAME INTO CONSIDERATION DURING THE UNIT SELECTION.													


SCHEDULE OF FAN GHs								
REF NO.	LOCATION	SERVICE	TYPE	QTY	FAN		ELECTRICAL	
					CAPACITY L/s	ESP Pa	ESTIMATED... Watts	DETAILS V / PH / HZ
GH-EAF-01	WASHROOM	Centrifugal Box	Centrifugal Box Type	1	25	100	100	220 / 1 / 50
Notes: FANS SHALL BE CENTRIFUGAL BOX TYPE WITH TIMER AND SPEED CONTROLLER ESTIMATED ESP IS APPROXIMATE CONTRACTORS TO CALCULATE EXACT ESP FOR EACH TYPE OF								

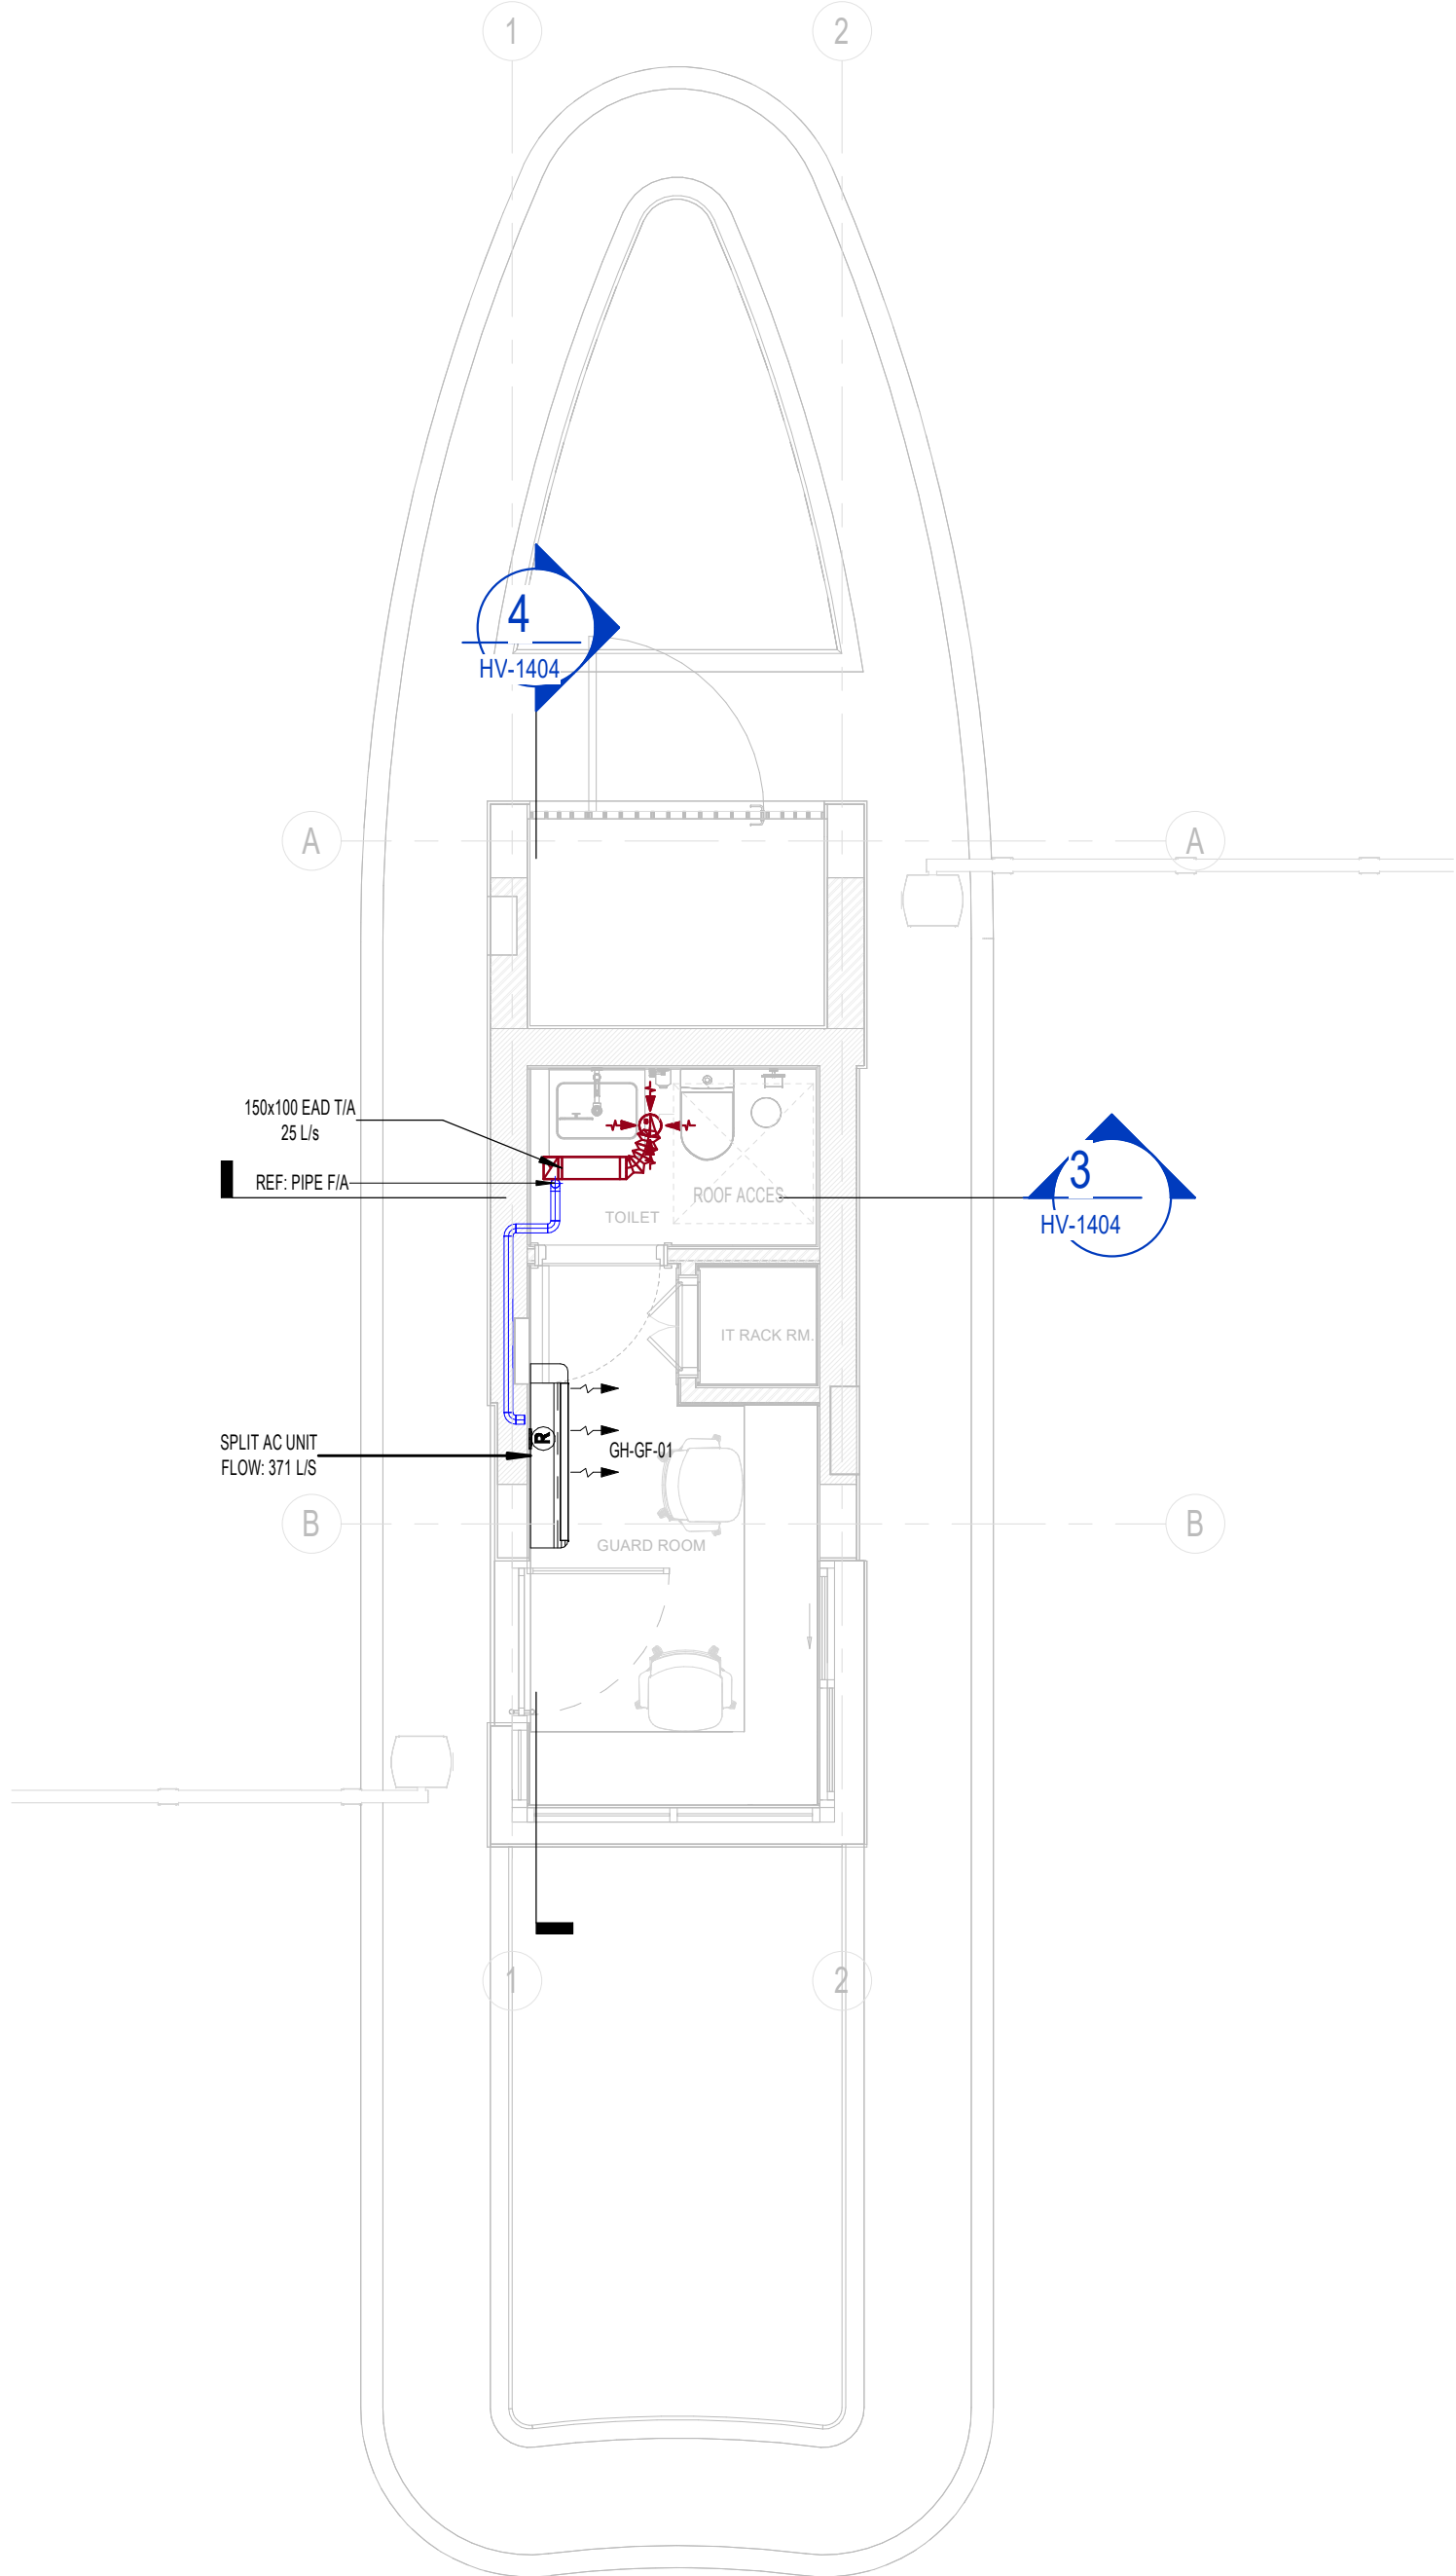


1 GROND FLOOR PLAN AC LAYOUT
1 : 50

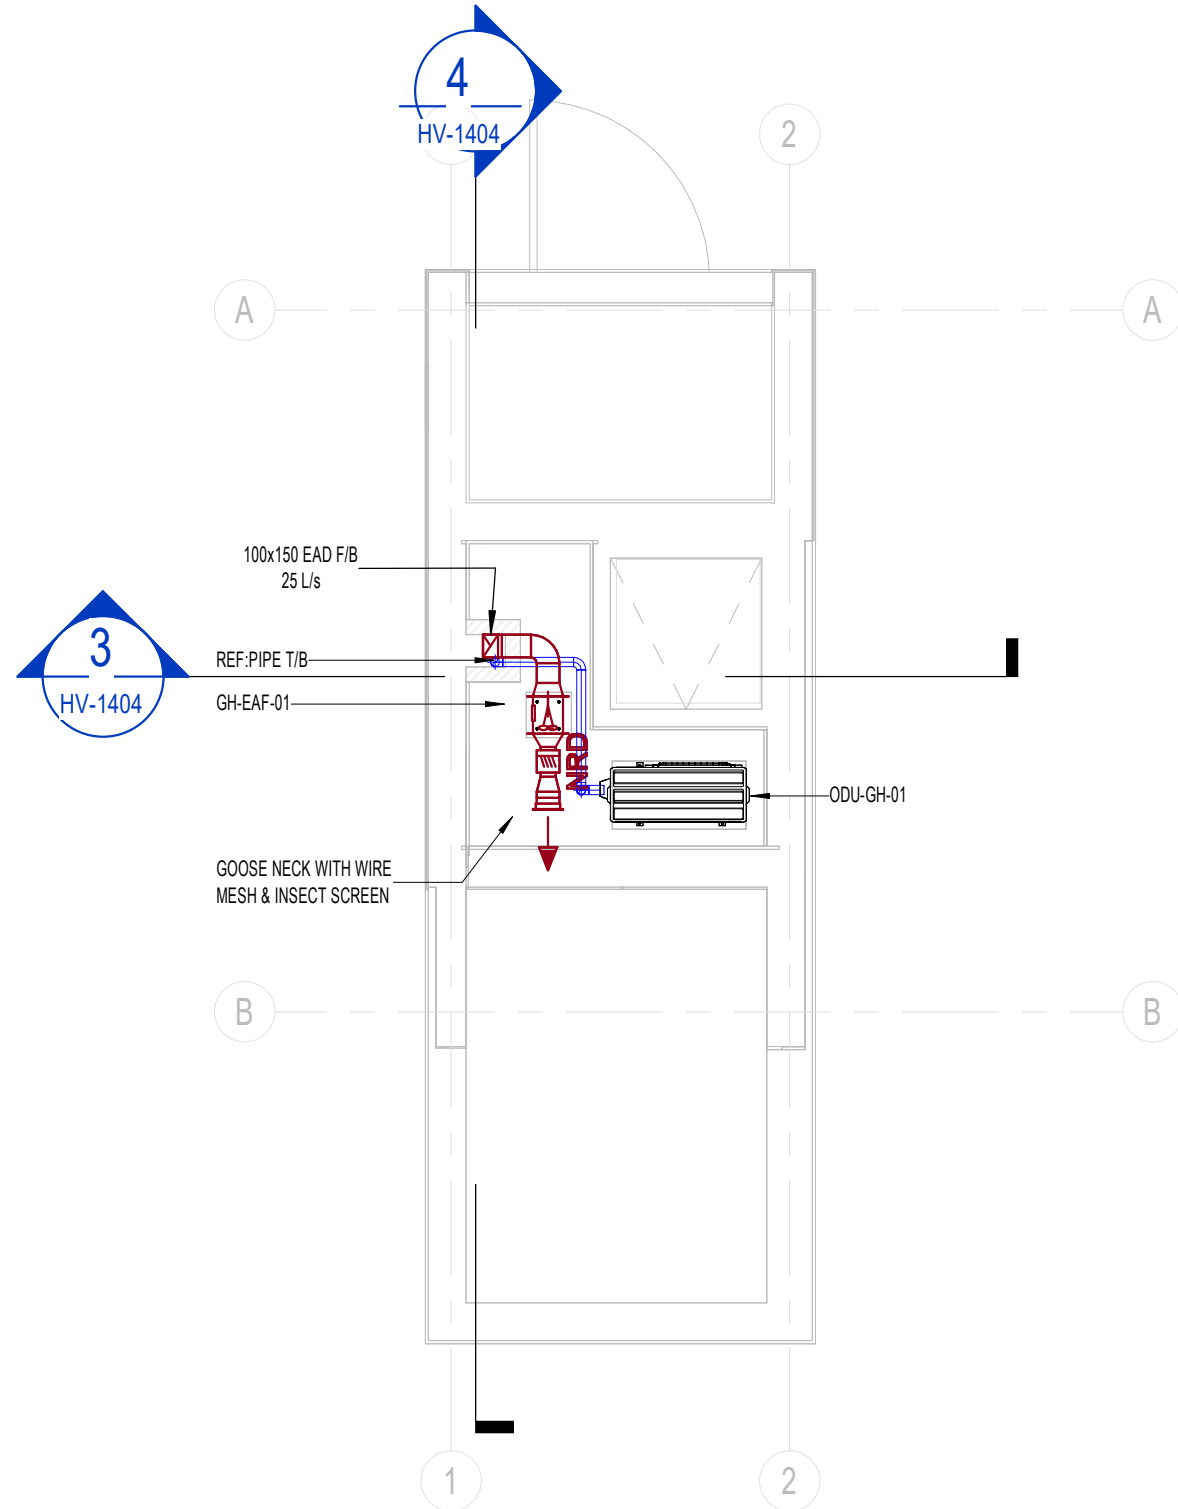


2 ROOF FLOOR PLAN AC LAYOUT
1 : 50

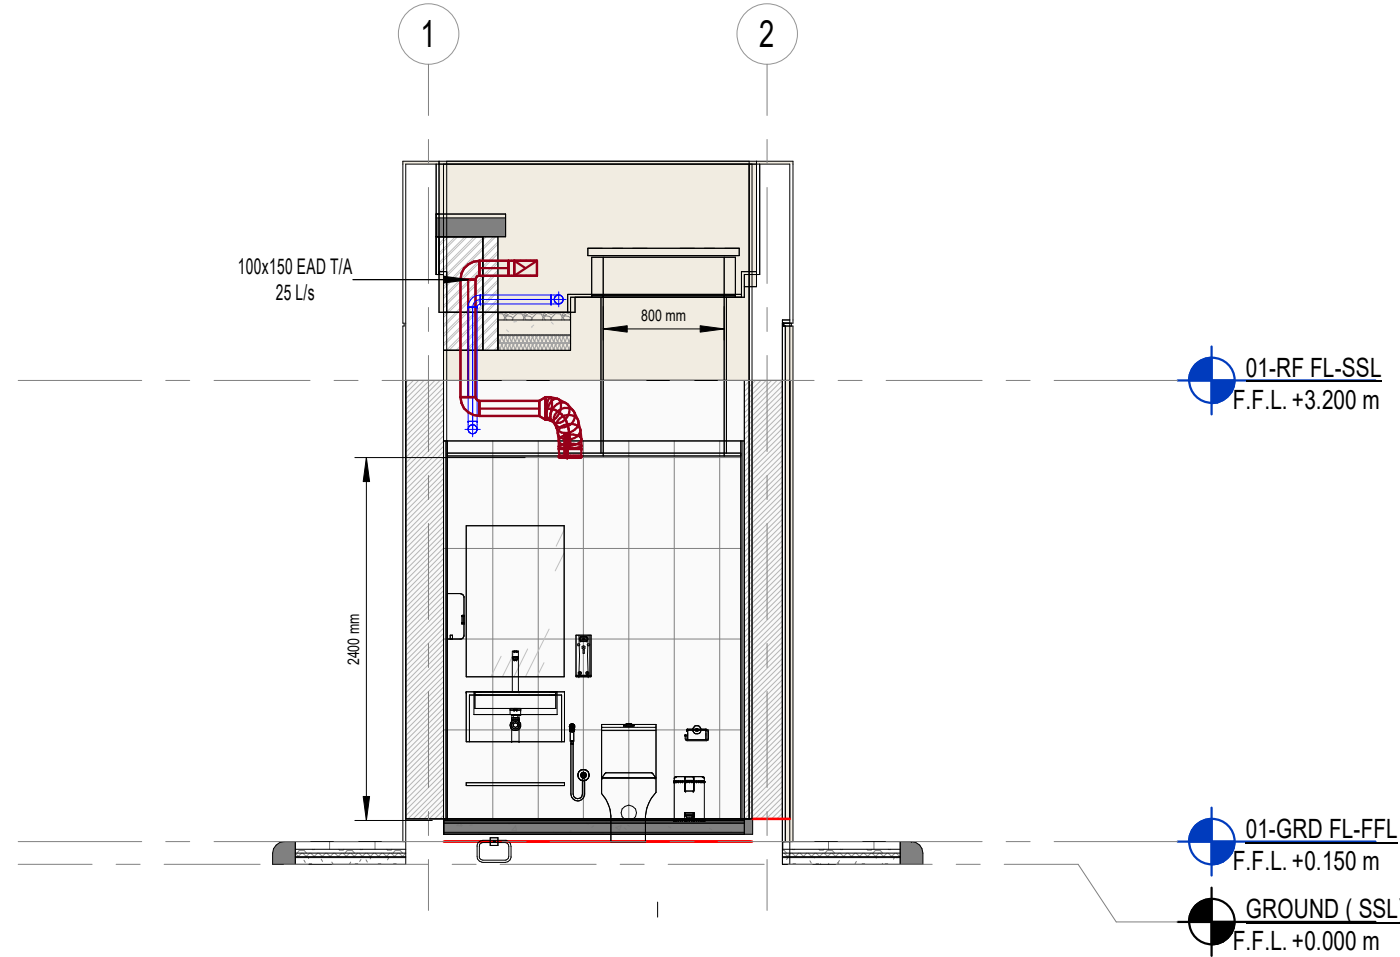

3 HVAC SECTION 1
1 : 50

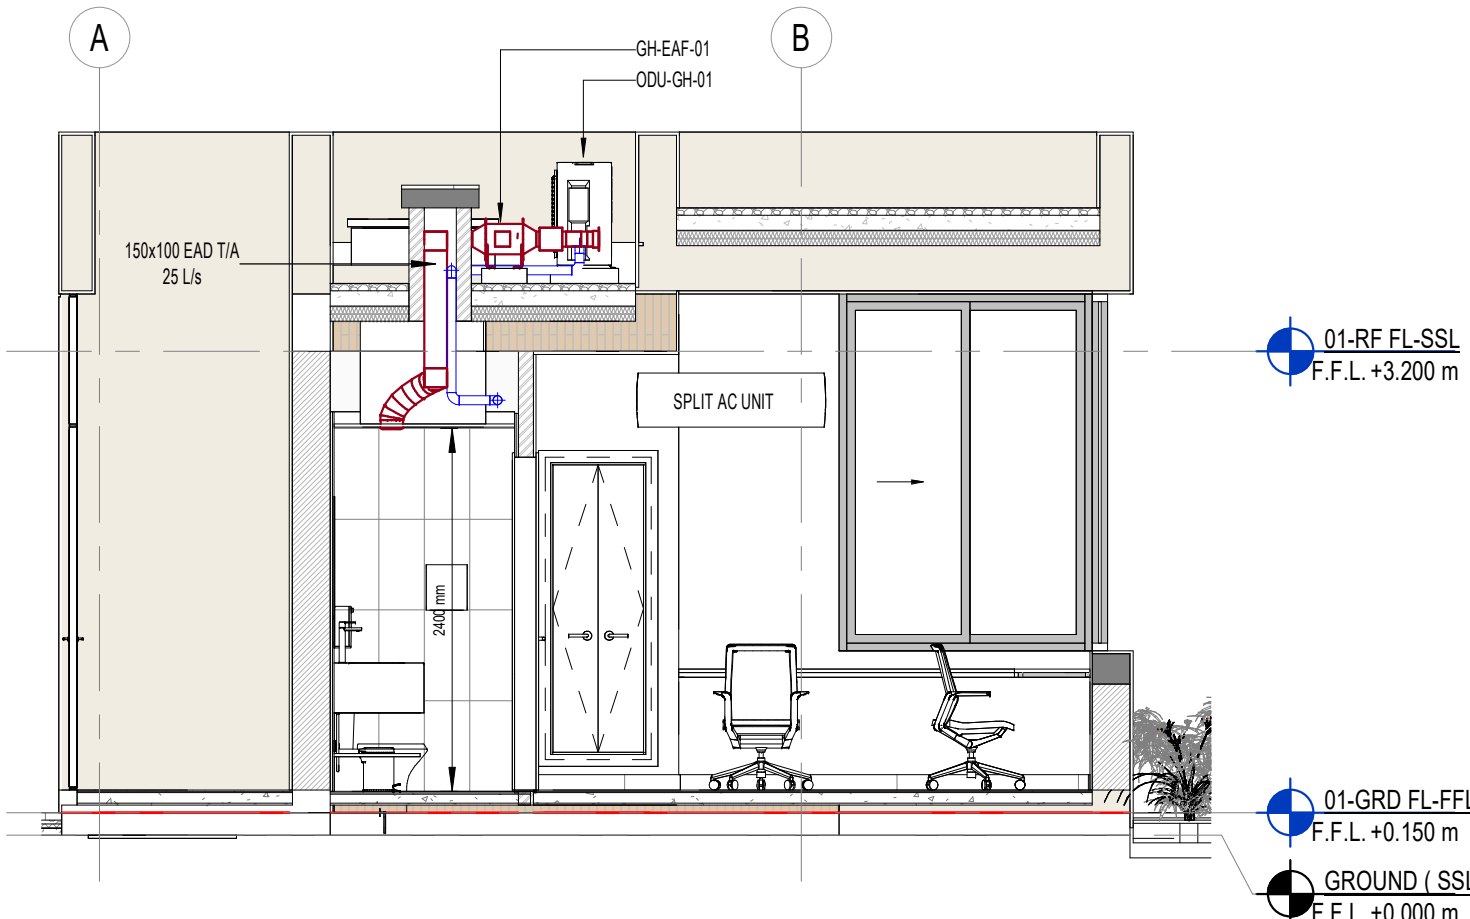

4 HVAC SECTION 2
1 : 50

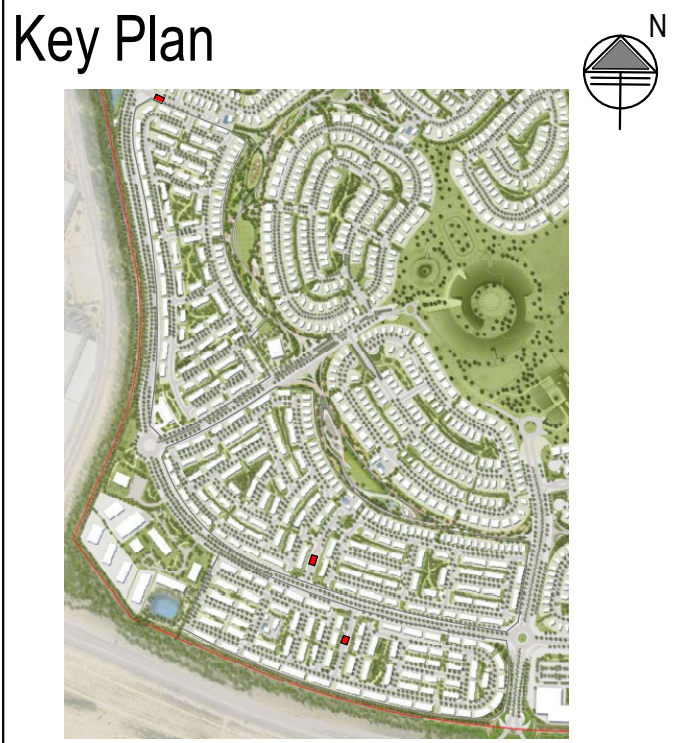

- General Notes :**
01. Do not Scale The Drawings. Follow (The MM) Written Dimensions Unless Otherwise Mentioned.
 02. Each Drawing Shall be Read in Conjunction With all Other Drawings, Specification & the General Standard Details. In Case of Any Discrepancies Bring it to the Knowledge of Engineer and Same to be Resolved Prior to Execution of Work.
 03. Dimensions Shown on These Drawings are Structural Dimensions. Unless Noted Otherwise.
 04. All Levels Indicated On These Drawings are Levels as per the Survey Datum, Same Should be Verified at Site Prior to Execution of Work.
 05. All Levels Indicated On These Drawings are Based On Design Level, Which is Equivalent to Datum Level and Same Should be Verified at Site Prior to Execution of Work.



00	10/03/2026	LSG	TENDER SUBMISSION
00	16/01/2026	LSG	DETAILED DESIGN SUBMISSION
00	31/10/2025	LSG	SCHEMATIC DESIGN SUBMISSION
00	15/10/2025	IMS	SCHEMATIC SUBMISSION-50%
00	01/09/2025	LSG	CONCEPT DESIGN SUBMISSION

No.	Date	Initials	Description
REVISIONS / ISSUE			
THIS DRAWING MUST NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR APPROVAL OF ARIF & BINTOAK			

Status
TENDER SUBMISSION

Client
EMAAR

Lead Consultant
المستشارون:
عارف وبن طوق
Arif & Bintook
consulting architects & engineers
POST BOX 5070 DUBAI, UAE TEL: 04-3372886 FAX: 04-3373332
POST BOX 50591 ABU DHABI, UAE TEL: 02-656655 arif@arifbintook.net.ae

Project Title:
Proposed Residential Townhouses
and Standalone Villas
TH-1, TH-2, and TH-3 at Grand Polo
Club & Resort, Dubai, UAE

Discipline :
MECHANICAL

Drawing title:
GUARD HOUSE HVAC
LAYOUT

Architectural Engineer	Electrical Engineer	Structural Engineer
MUSTAFA ABID	MARWAN MOHD.	RIHAM RAMADAN
Registration # 5847	Registration # 80102	Registration # 105892
Scale(s): 1 : 50	Date: 10/03/2026	Project no: 1830
Drawn by: LSG	Checked: MAV	Approved: MRM
Drawing Number : GPCR-TH02-AB-DRG-ZZZ-MEC-HV-1404-00		