


# Compressed Air Analytics

*prepared for*




*sponsored by*

**EVERSOURCE**  
ENERGY

*prepared by*



*Vendor Neutral, Energy Biased*





# New ES Dash Board

## Summary of System

# of Compressors in System	3
Combined System Capacity at Full Load (SCFM)	2824
Average Measured Flow (SCFM) <sup>1</sup>	1155
Non-Productive Measured Flow (SCFM) <sup>2</sup>	830
Cost of Non-Productive Demand (\$/Year) <sup>3</sup>	\$ 204,868.91
Combined System Power at Full Load (kW)	440.0
Average Measured Power (kW) <sup>4</sup>	217.0
Total kWh Consumption (kWh Annually) <sup>5</sup>	1,900,770




<sup>1</sup> See Power, Flow & Pressure Graph on Data Summary Page

<sup>2</sup> See Air System Information Page

830 X 246,830 = 1,900,770


<sup>3</sup> See Power, Flow & Pressure Graph on Data Summary Page

216,832 X 246,830 = 51,603,408

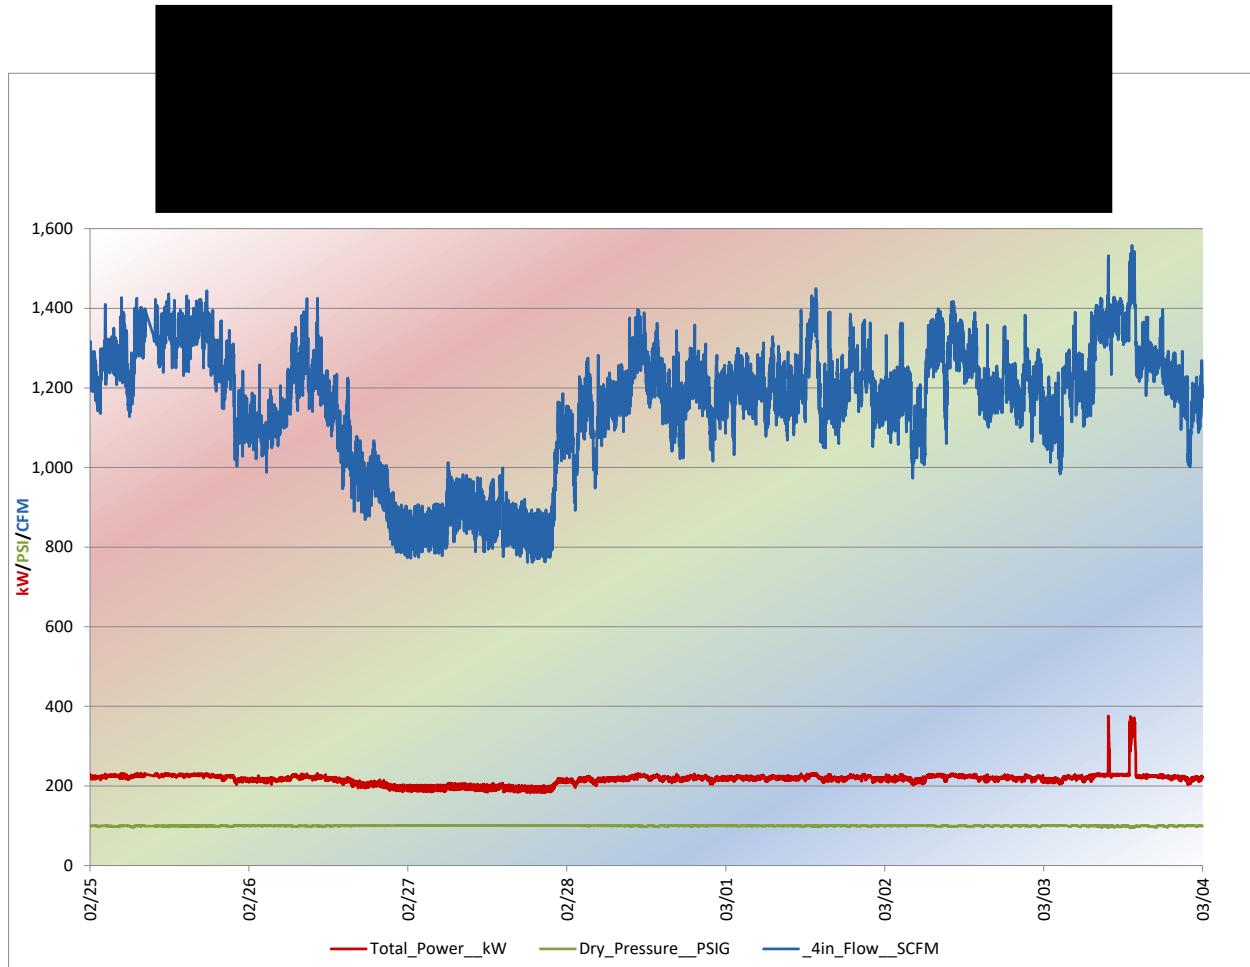


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow:Power Ratio**  
**Feb 25, 2022 to Mar 04, 2022**

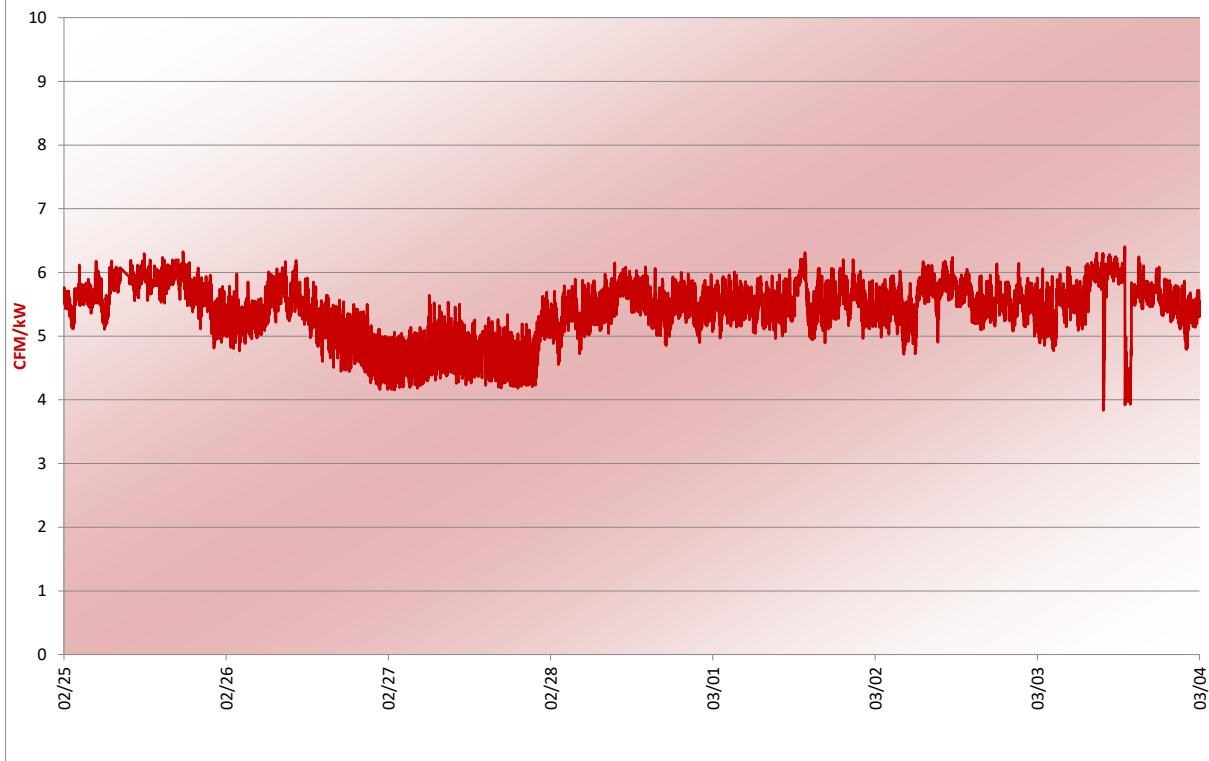


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor and Flow**  
**Feb 25, 2022 to Mar 04, 2022**

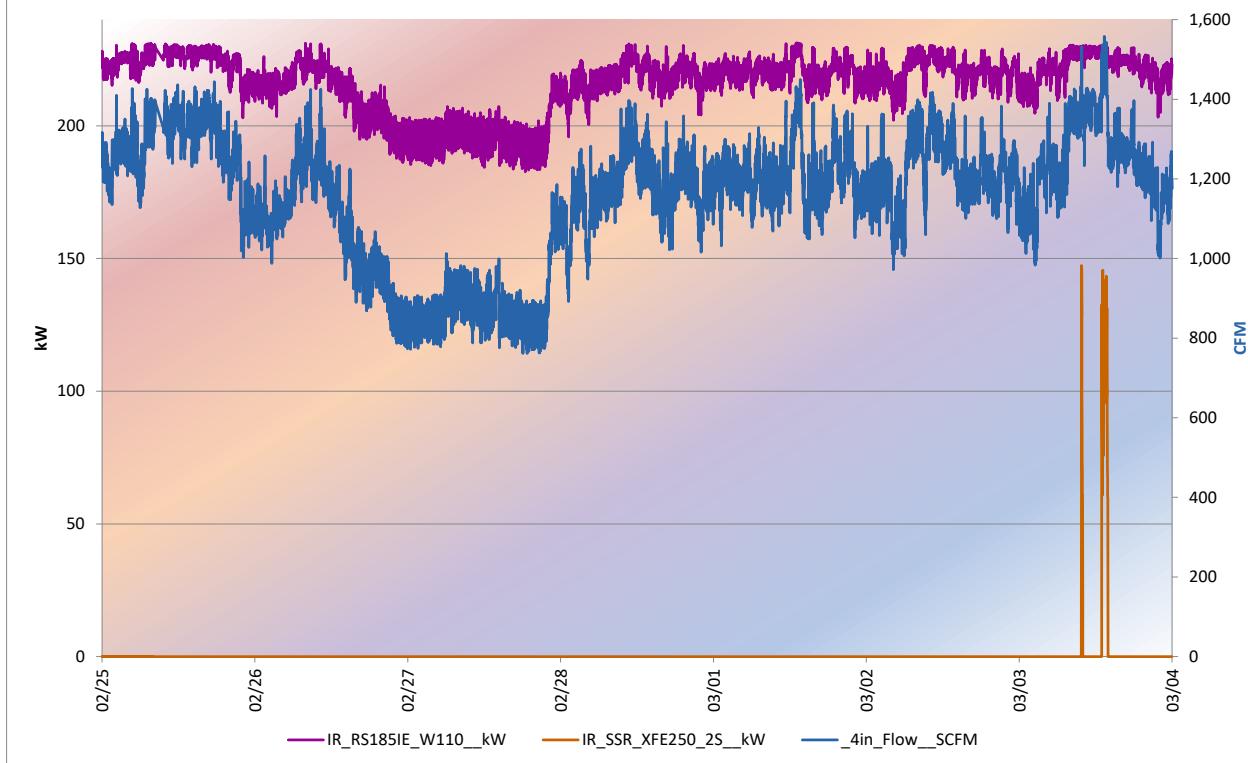


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor**  
**Feb 25, 2022 to Mar 04, 2022**

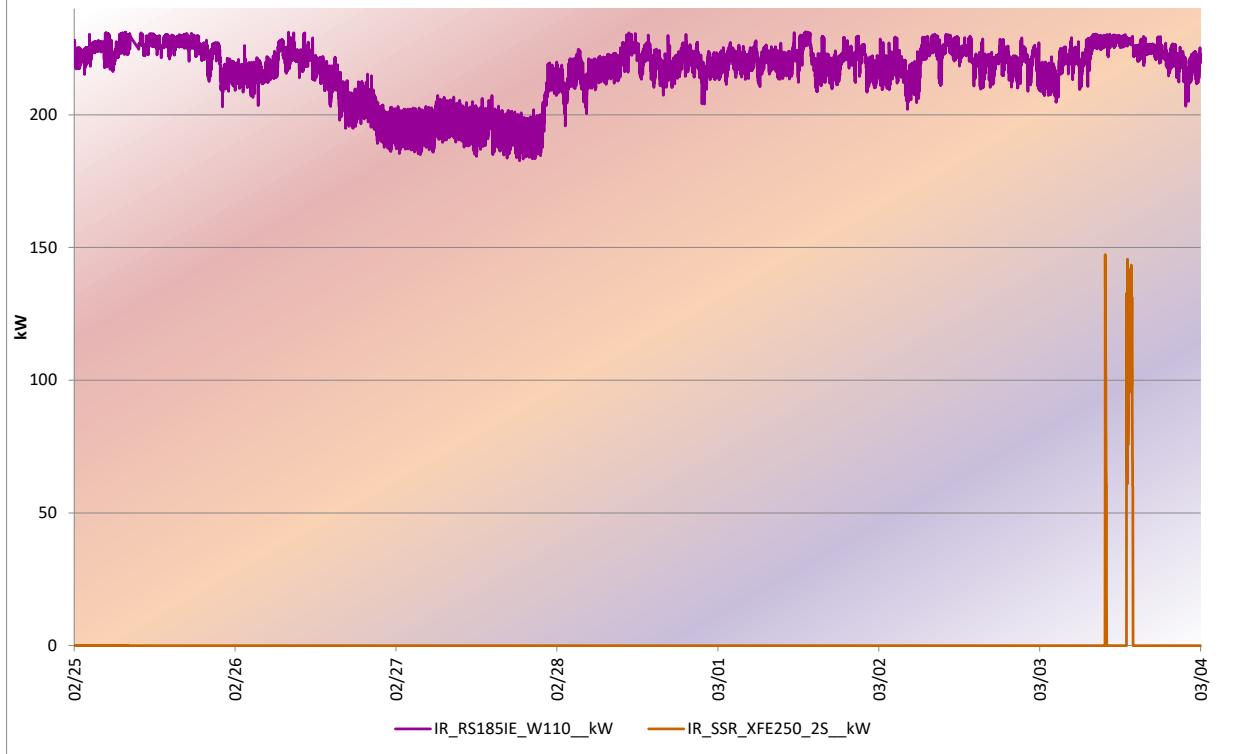


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow & Pressure**  
**Feb 25, 2022 to Mar 04, 2022**

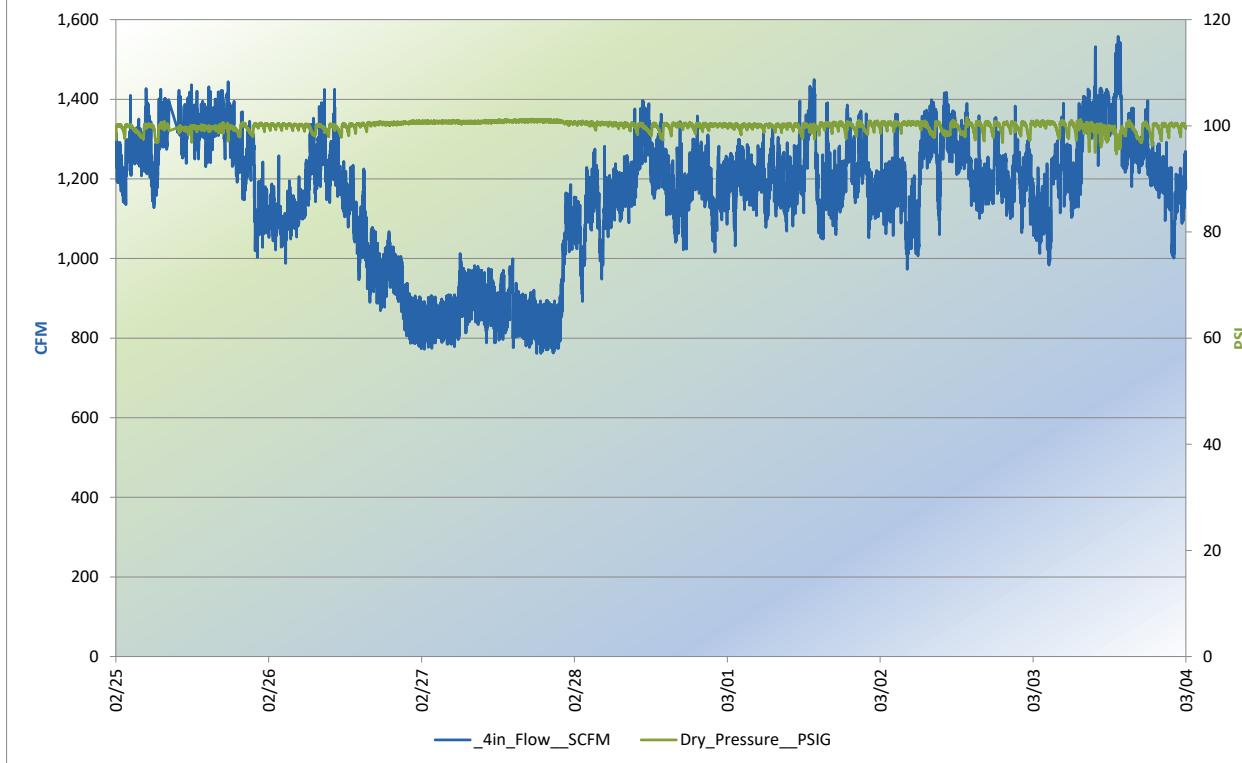

**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Pressure by Location**  
**Feb 25, 2022 to Mar 04, 2022**

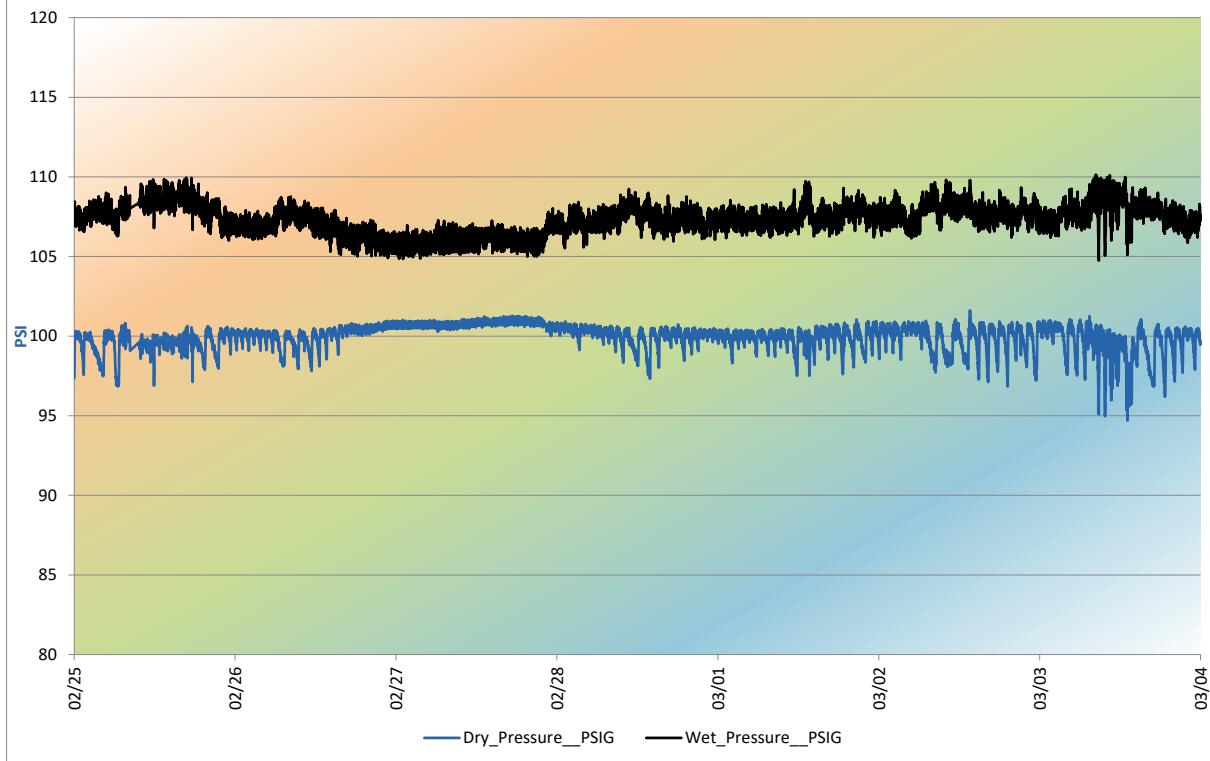


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

Full Deck: 2/25/2022 to 3/3/2022 - 1-Minute Averages								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	761.39	3.83	94.70	182.65	0.00	182.65	104.75	
Avg	1,155.11	5.40	99.93	216.22	0.76	216.98	107.34	
Max	1,557.77	6.40	101.62	231.34	147.30	375.52	110.13	
Friday, 2/25/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	1,002.67	4.81	96.85	203.01	0.00	203.01	106.00	
Avg	1,278.61	5.71	99.52	224.10	0.01	224.11	108.03	
Max	1,444.26	6.32	100.81	231.13	0.04	231.14	109.96	
Saturday, 2/26/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	773.36	4.16	97.81	186.14	0.00	186.14	104.91	
Avg	1,079.09	5.22	100.03	212.12	0.00	212.12	106.81	
Max	1,425.49	6.19	100.97	231.13	0.00	231.13	108.76	
Sunday, 2/27/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	761.39	4.15	100.01	182.65	0.00	182.65	104.84	
Avg	883.06	4.74	100.79	196.95	0.00	196.95	106.11	
Max	1,185.66	5.69	101.28	219.93	0.00	219.93	108.03	
Monday, 2/28/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	891.83	4.55	97.33	195.80	0.00	195.80	105.52	
Avg	1,175.43	5.47	100.00	218.07	0.00	218.07	107.35	
Max	1,397.17	6.15	100.93	230.85	0.00	230.85	109.23	
Tuesday, 3/1/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	1,032.09	4.90	97.51	208.50	0.00	208.50	106.15	
Avg	1,209.19	5.55	99.85	220.48	0.00	220.48	107.51	
Max	1,449.38	6.31	101.05	231.34	0.00	231.34	109.73	
Wednesday, 3/2/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	972.68	4.71	96.84	202.12	0.00	202.12	106.14	
Avg	1,217.68	5.58	99.81	220.31	0.00	220.31	107.80	
Max	1,417.92	6.23	101.62	230.37	0.00	230.37	109.81	
Thursday, 3/3/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	983.24	3.83	94.70	203.22	0.00	203.22	104.75	
Avg	1,249.48	5.57	99.48	221.97	5.26	227.24	107.79	
Max	1,557.77	6.40	101.26	230.39	147.30	375.52	110.13	

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power, Flow & Pressure**  
**Friday, Feb 25, 2022**

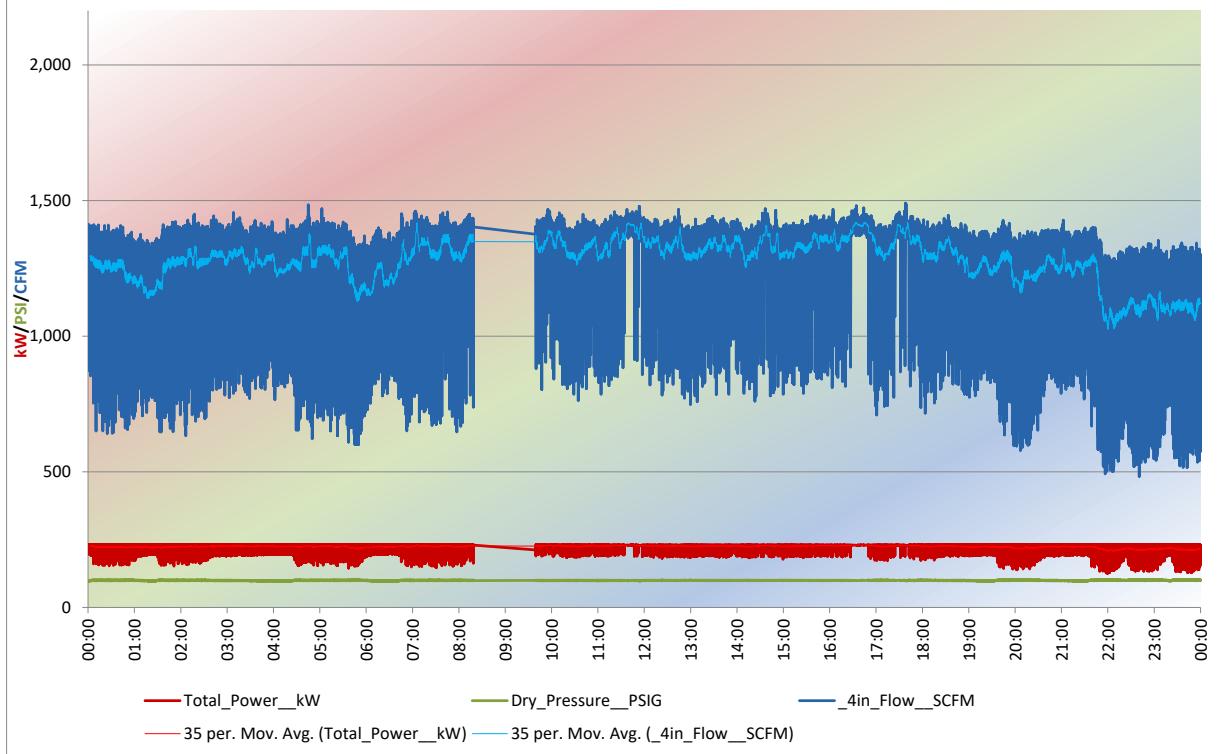

Friday, 2/25/2022									
First (1st) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,230.64	5.52	96.89	220.97	0.00	220.97	106.79		
Avg	1,334.88	5.90	99.53	226.74	0.00	226.74	108.60		
Max	1,436.27	6.29	100.37	230.92	0.03	230.92	109.85		
Second (2nd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,002.67	4.81	97.13	203.01	0.00	203.01	106.00		
Avg	1,243.75	5.65	99.63	221.92	0.00	221.92	107.87		
Max	1,444.26	6.32	100.63	230.77	0.00	230.77	109.96		
Third (3rd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,127.45	5.11	96.85	215.23	0.00	215.25	106.27		
Avg	1,266.47	5.62	99.38	224.07	0.02	224.09	107.70		
Max	1,427.09	6.18	100.81	231.13	0.04	231.14	109.36		


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow:Power Ratio**  
**Friday, Feb 25, 2022**

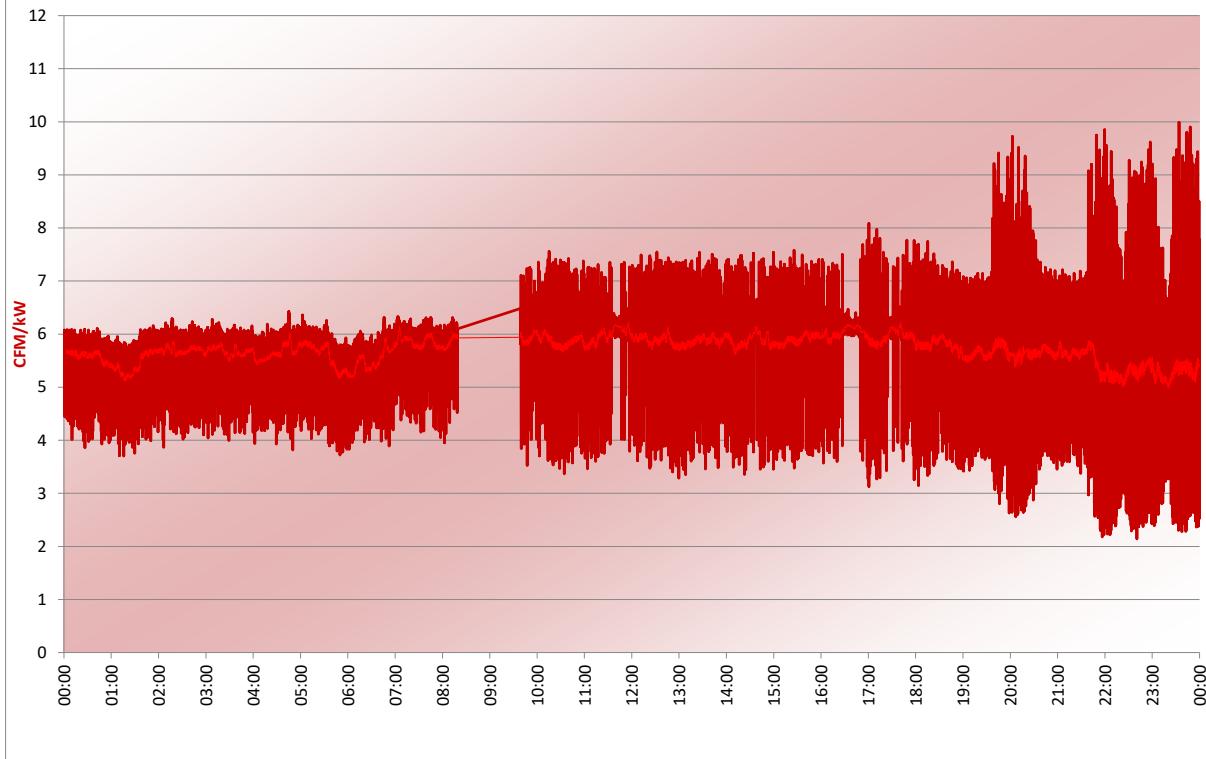


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor and Flow**  
**Friday, Feb 25, 2022**

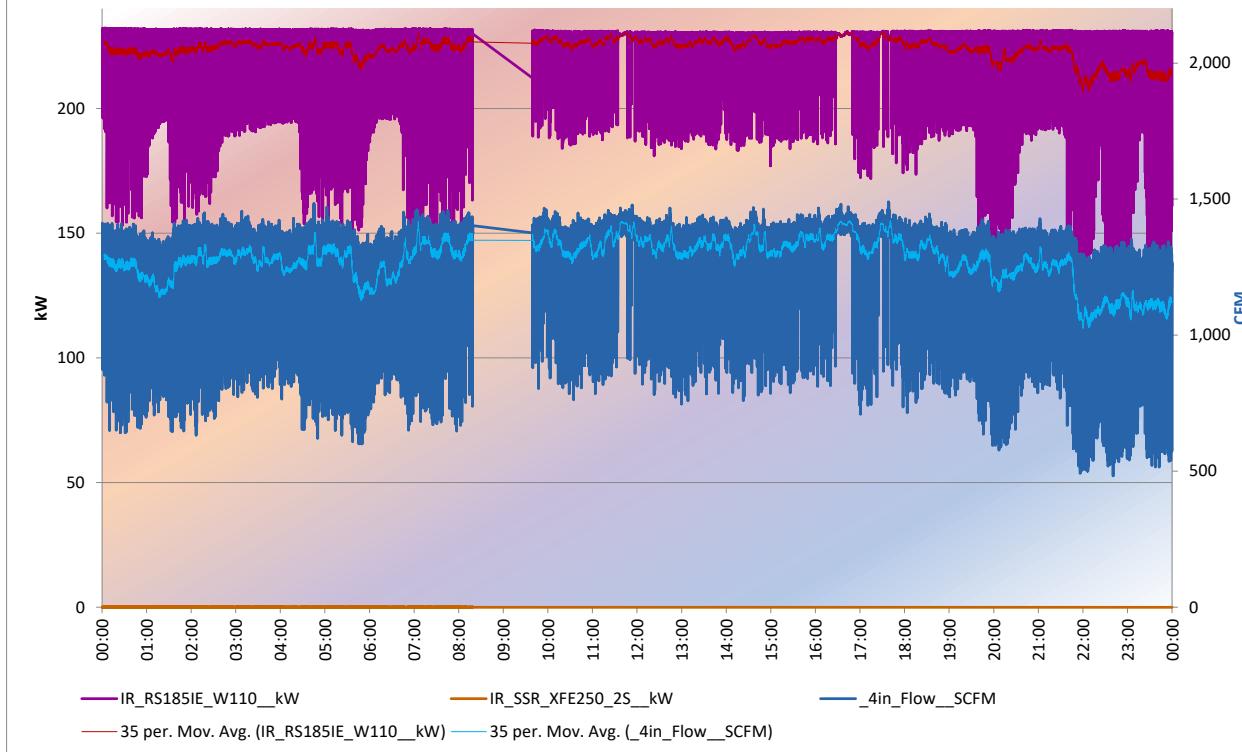


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor**  
**Friday, Feb 25, 2022**

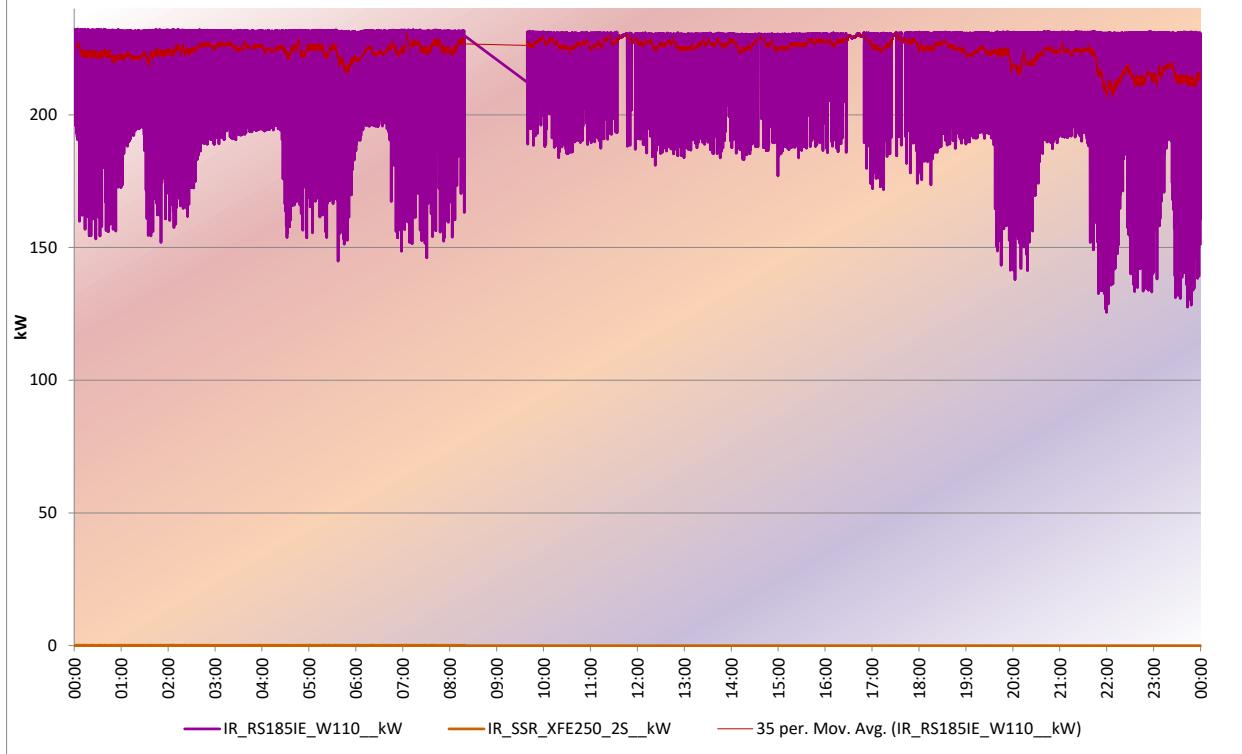


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow & Pressure**  
**Friday, Feb 25, 2022**

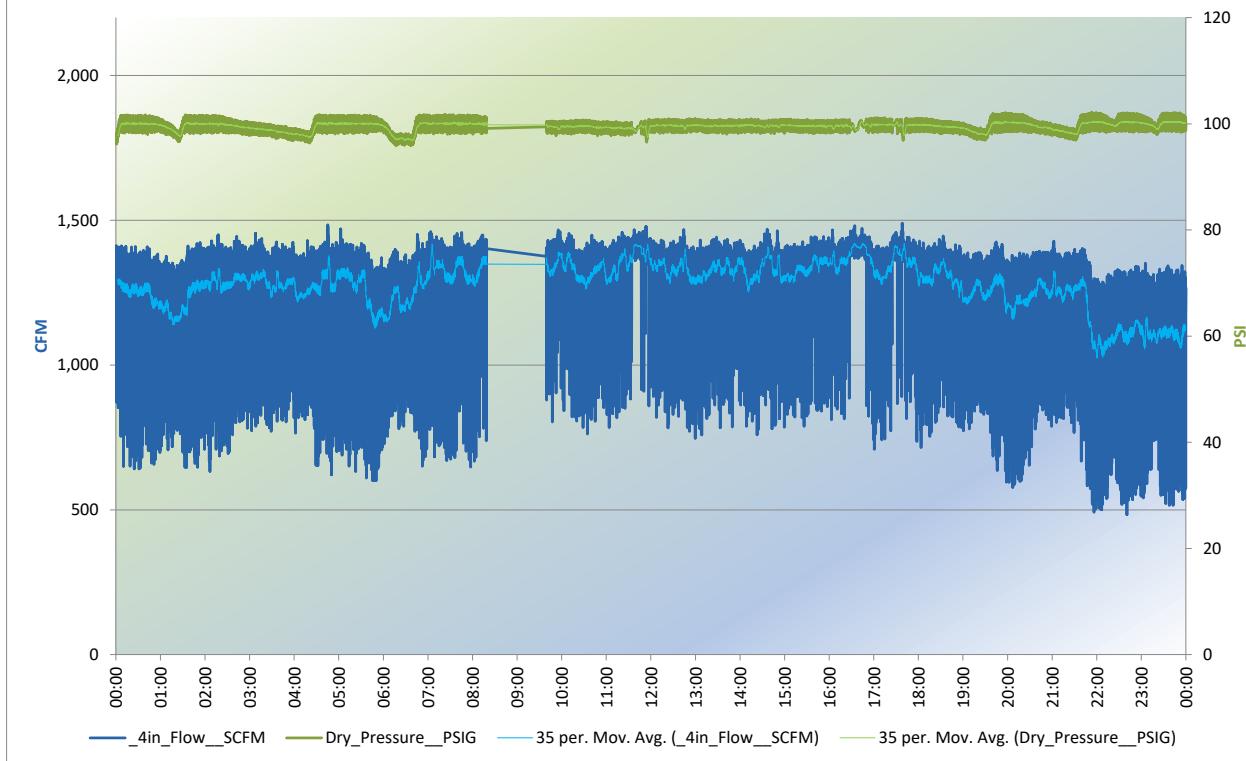


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Pressure by Location**  
**Friday, Feb 25, 2022**

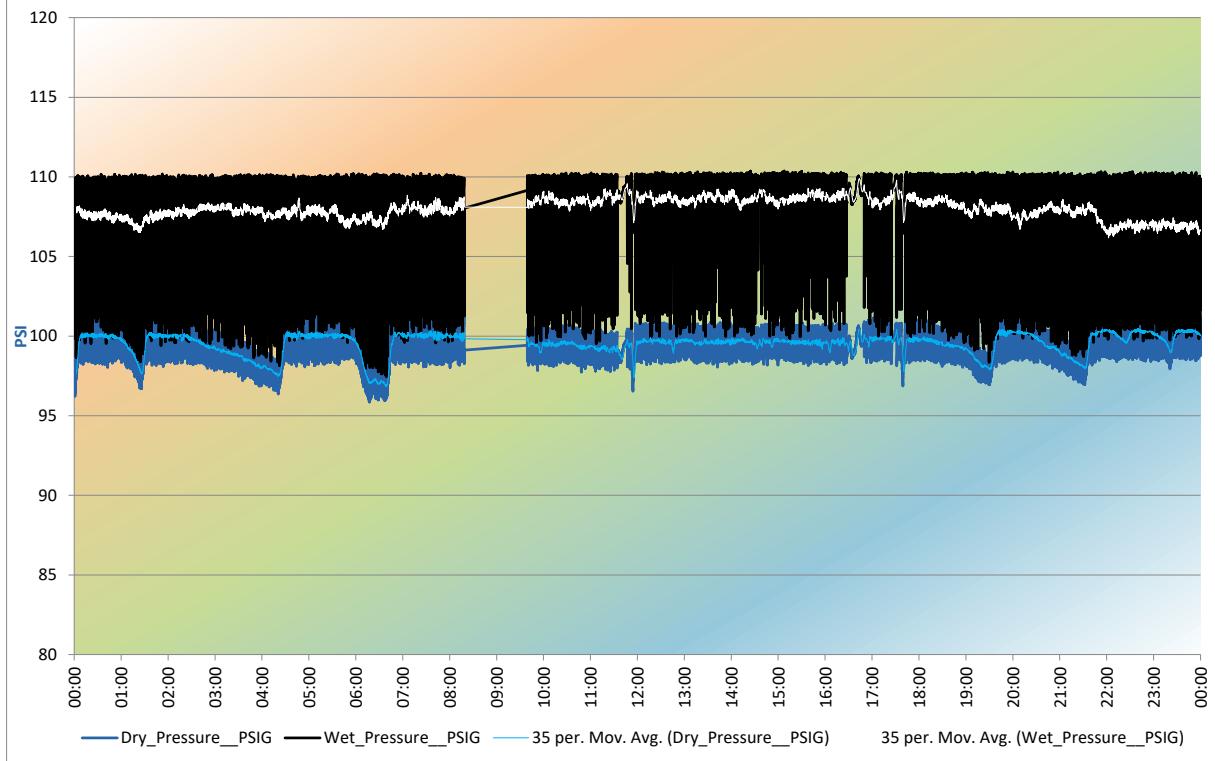

**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power, Flow & Pressure**  
**Saturday, Feb 26, 2022**

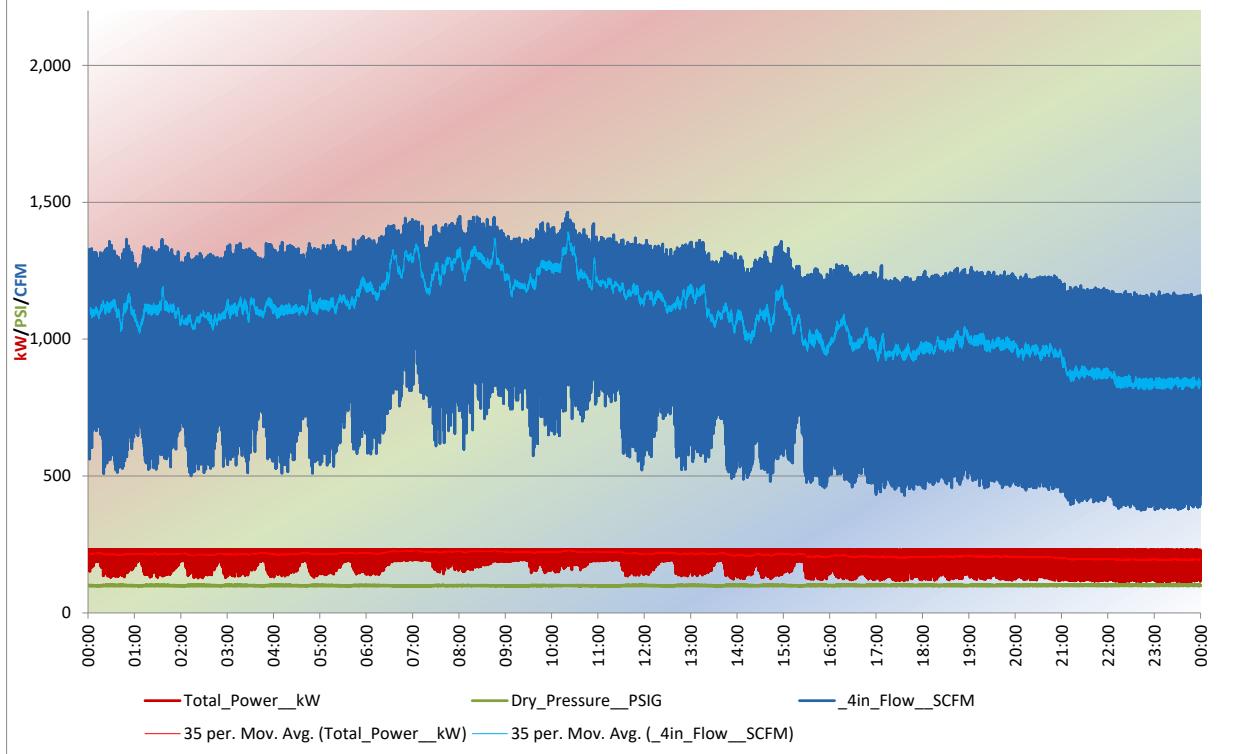


Saturday, 2/26/2022										
First (1st) Shift										
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSI	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSI			
Min	890.07	4.51	97.81	197.98	0.00	197.98	105.11			
Avg	1,163.26	5.43	99.75	217.87	0.00	217.87	107.20			
Max	1,425.49	6.19	100.70	230.92	0.00	230.92	108.76			
Second (2nd) Shift										
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSI	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSI			
Min	773.36	4.16	99.88	186.14	0.00	186.14	104.91			
Avg	930.56	4.86	100.50	201.45	0.00	201.45	106.13			
Max	1,078.81	5.57	100.97	215.35	0.00	215.35	107.41			
Third (3rd) Shift										
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSI	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSI			
Min	987.62	4.77	98.09	203.49	0.00	203.49	106.07			
Avg	1,143.45	5.37	99.84	217.03	0.00	217.03	107.09			
Max	1,381.98	6.06	100.48	231.13	0.00	231.13	108.73			

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow:Power Ratio**  
**Saturday, Feb 26, 2022**

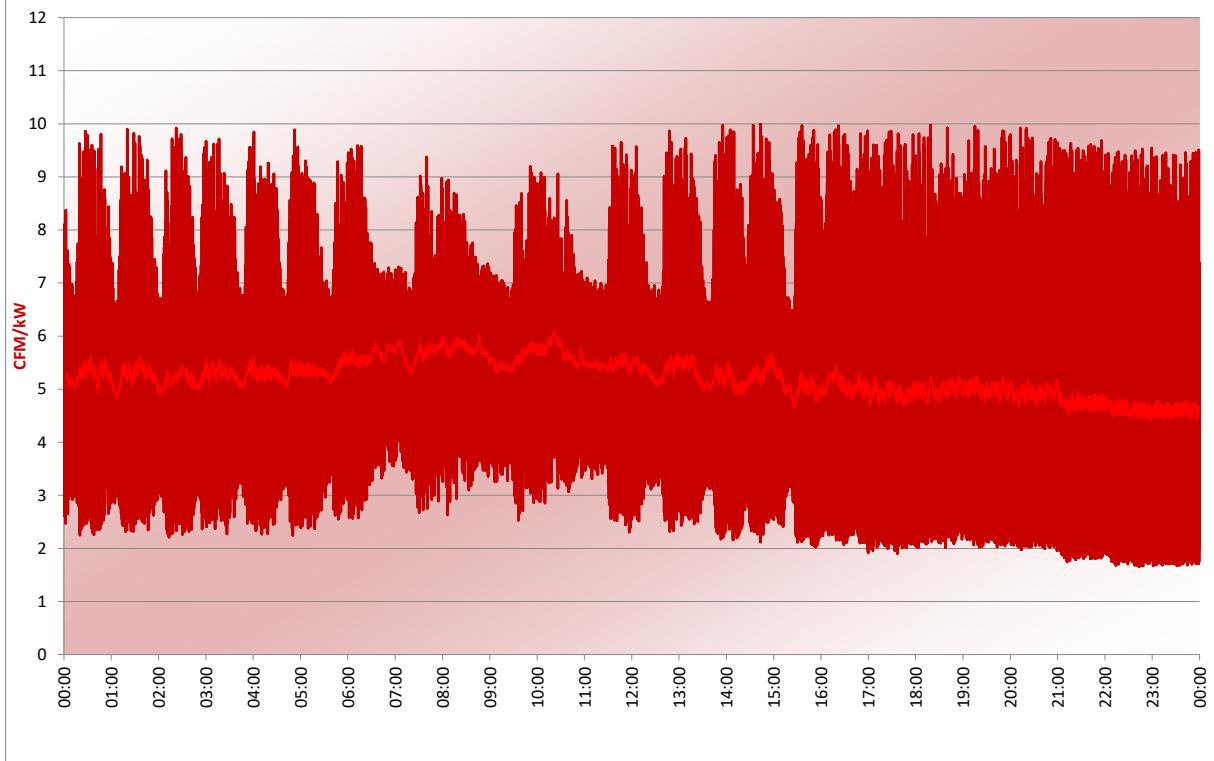


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor and Flow**  
**Saturday, Feb 26, 2022**

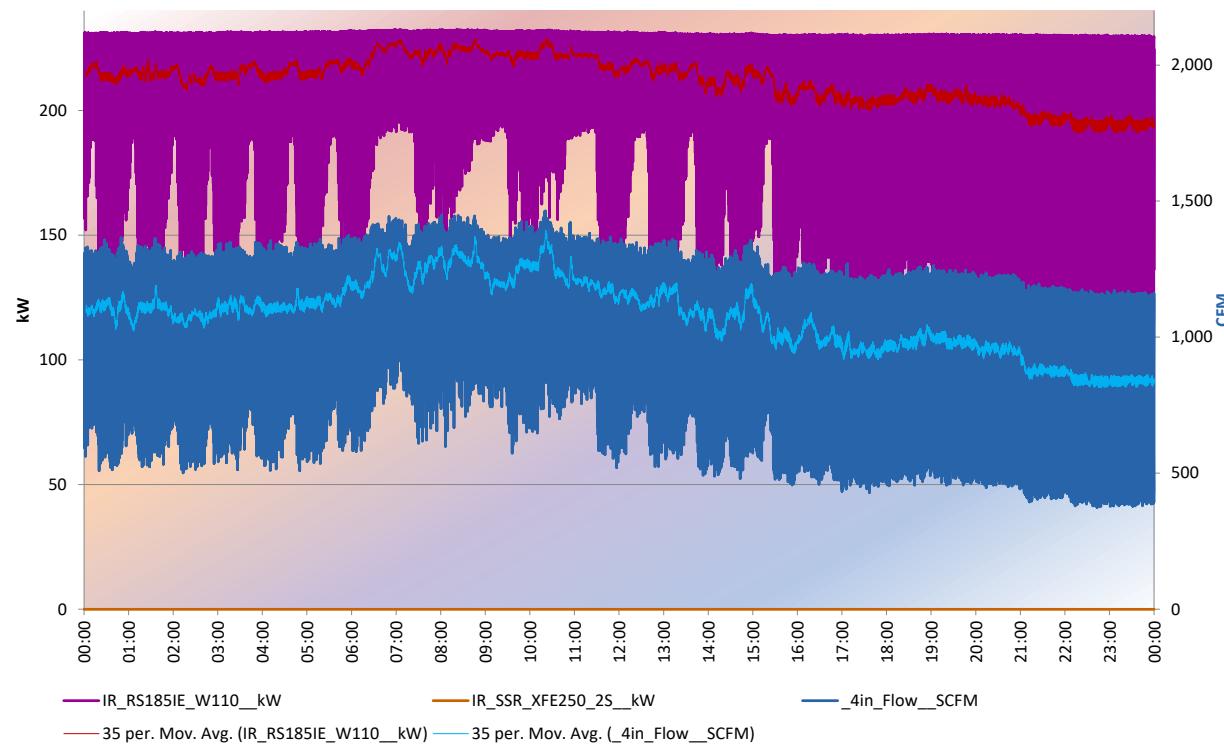


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor**  
**Saturday, Feb 26, 2022**

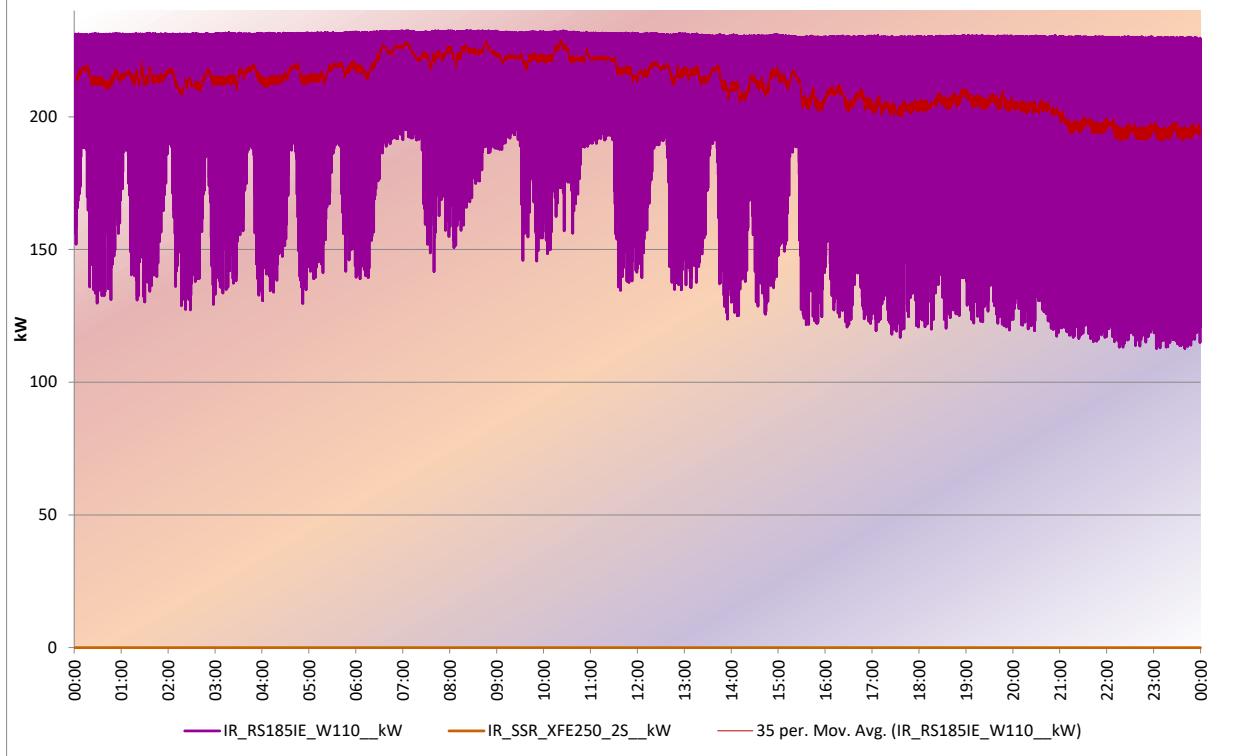


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow & Pressure**  
**Saturday, Feb 26, 2022**

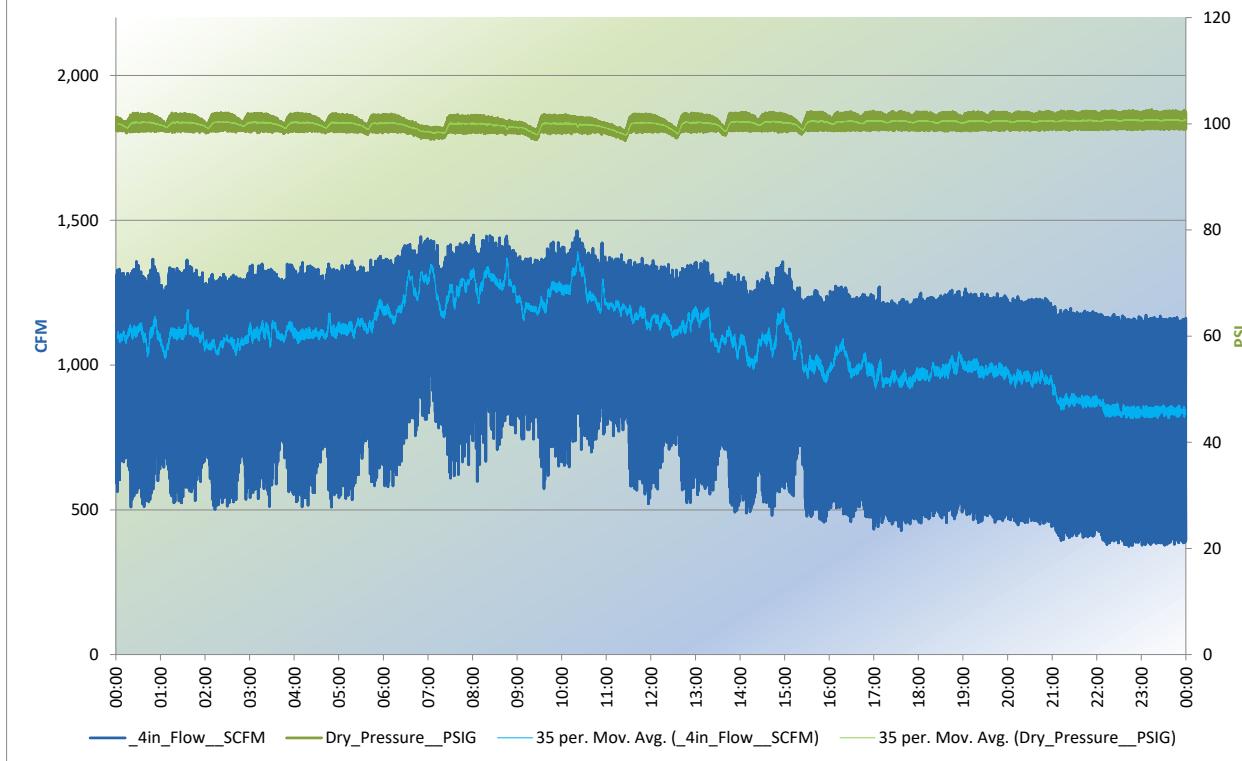


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Pressure by Location**  
**Saturday, Feb 26, 2022**

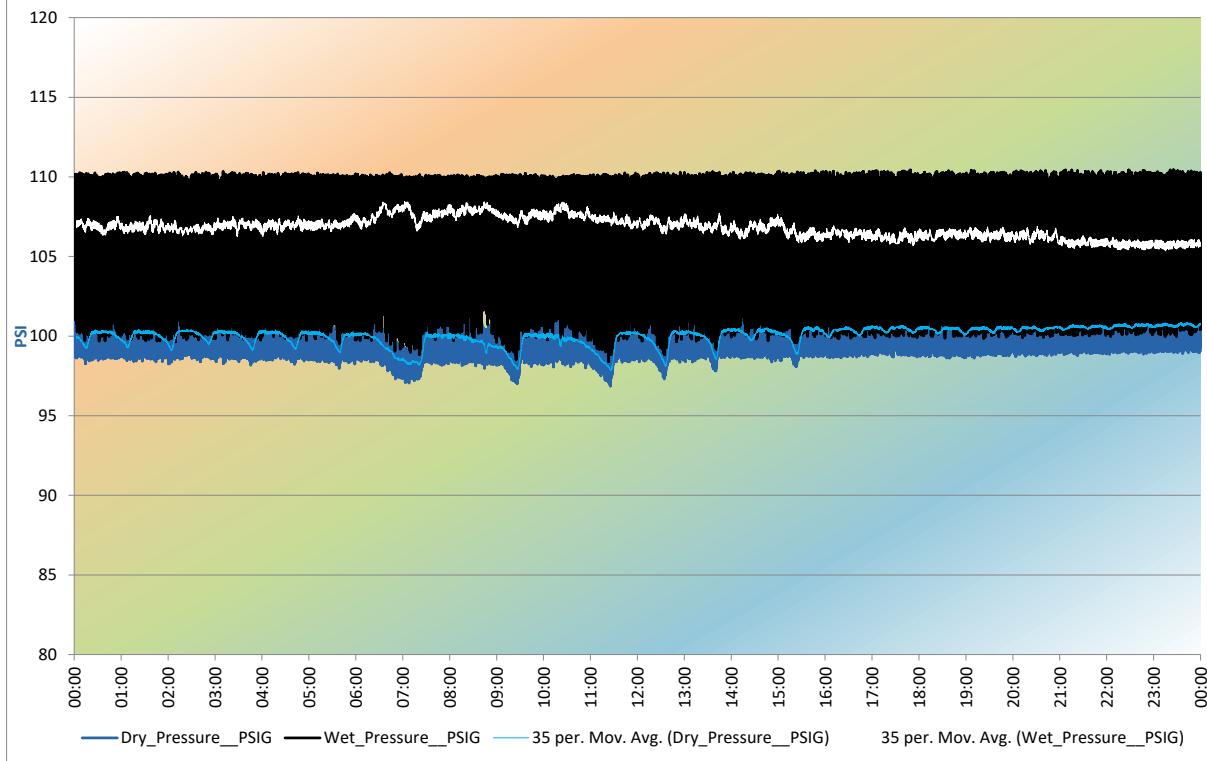

**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power, Flow & Pressure**  
**Sunday, Feb 27, 2022**

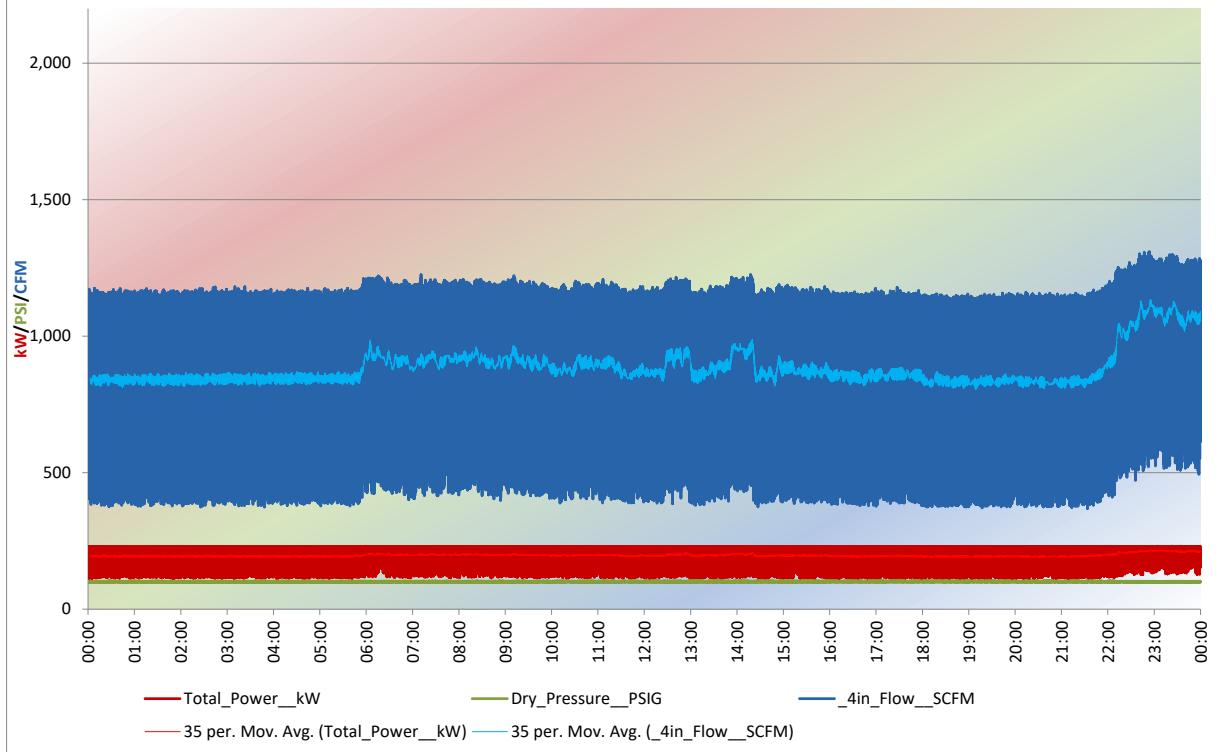

Sunday, 2/27/2022									
First (1st) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	775.69	4.23	100.38	184.35	0.00	184.35	105.13		
Avg	892.19	4.77	100.83	197.52	0.00	197.52	106.20		
Max	999.56	5.54	101.22	207.28	0.00	207.28	107.25		
Second (2nd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	761.39	4.18	100.01	182.65	0.00	182.65	105.00		
Avg	895.34	4.75	100.84	197.75	0.00	197.75	106.22		
Max	1,185.66	5.69	101.28	219.93	0.00	219.93	108.03		
Third (3rd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	772.14	4.15	100.29	184.99	0.00	184.99	104.84		
Avg	861.65	4.69	100.70	195.57	0.00	195.57	105.91		
Max	1,012.67	5.64	101.00	207.32	0.00	207.32	107.28		


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow:Power Ratio**  
**Sunday, Feb 27, 2022**

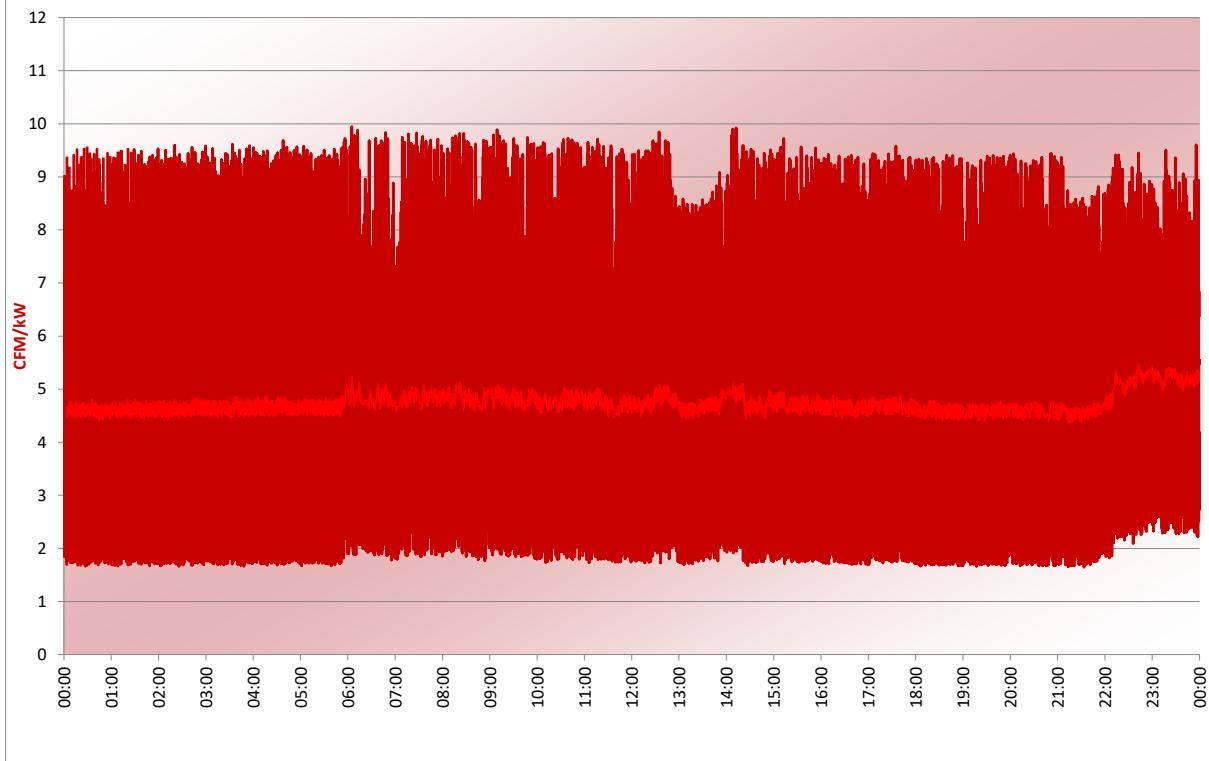


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor and Flow**  
**Sunday, Feb 27, 2022**

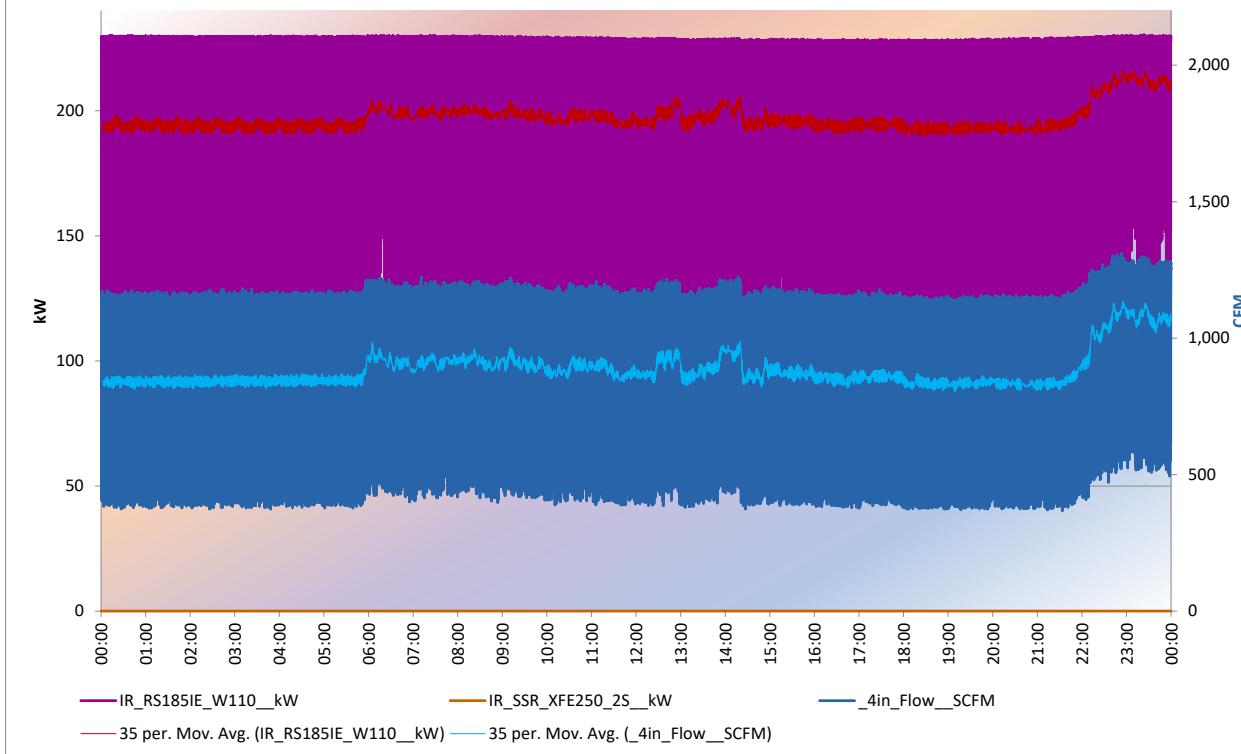


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor**  
**Sunday, Feb 27, 2022**

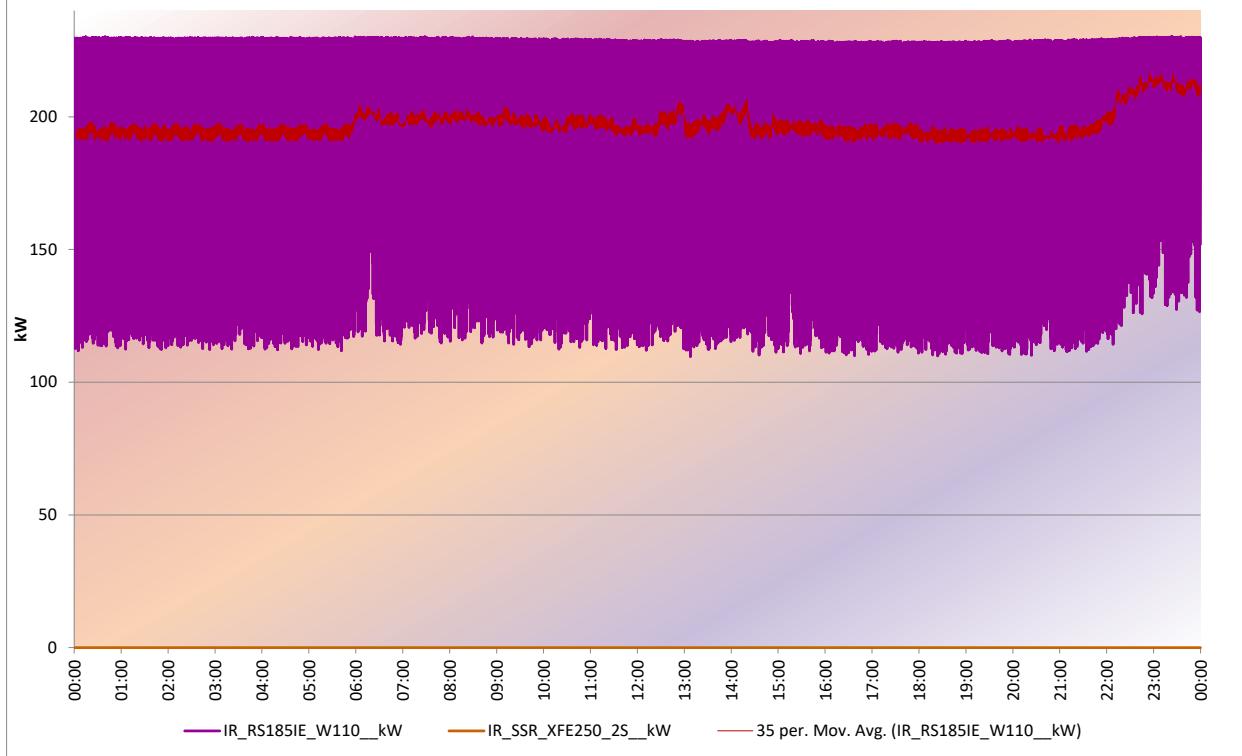


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow & Pressure**  
**Sunday, Feb 27, 2022**

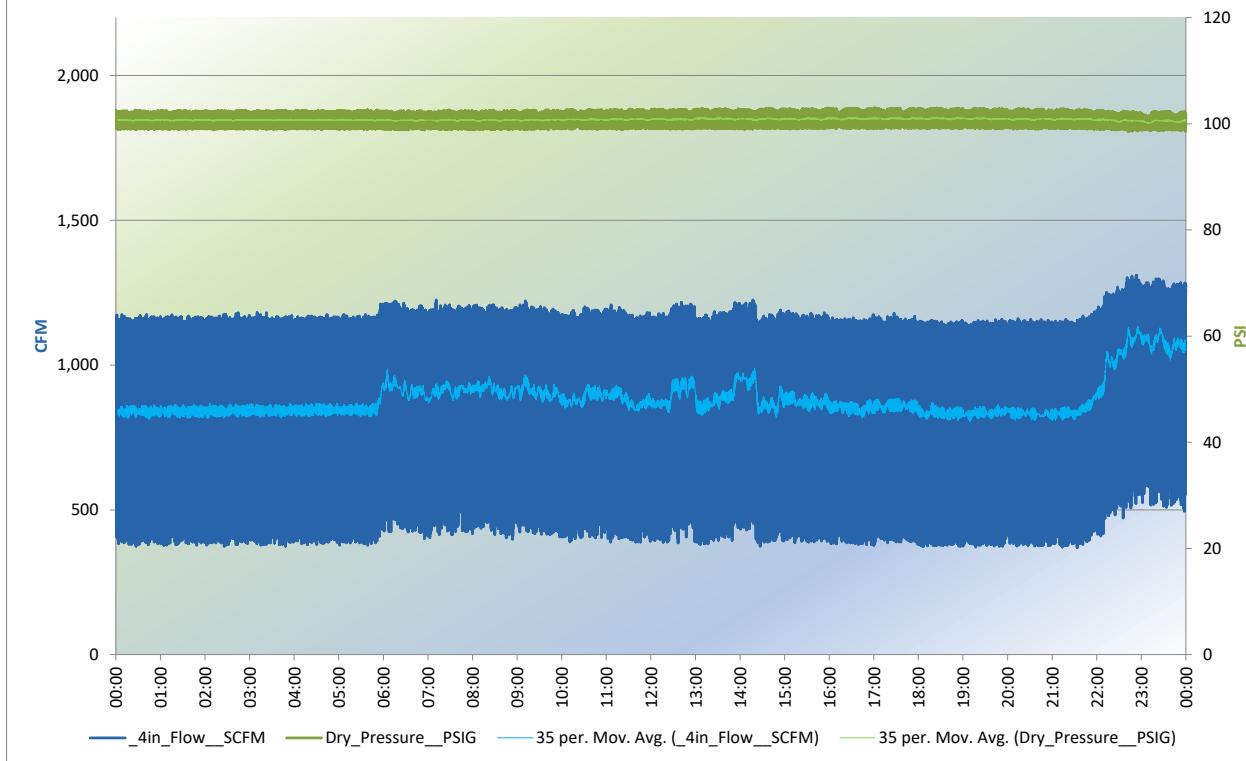


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Pressure by Location**  
**Sunday, Feb 27, 2022**

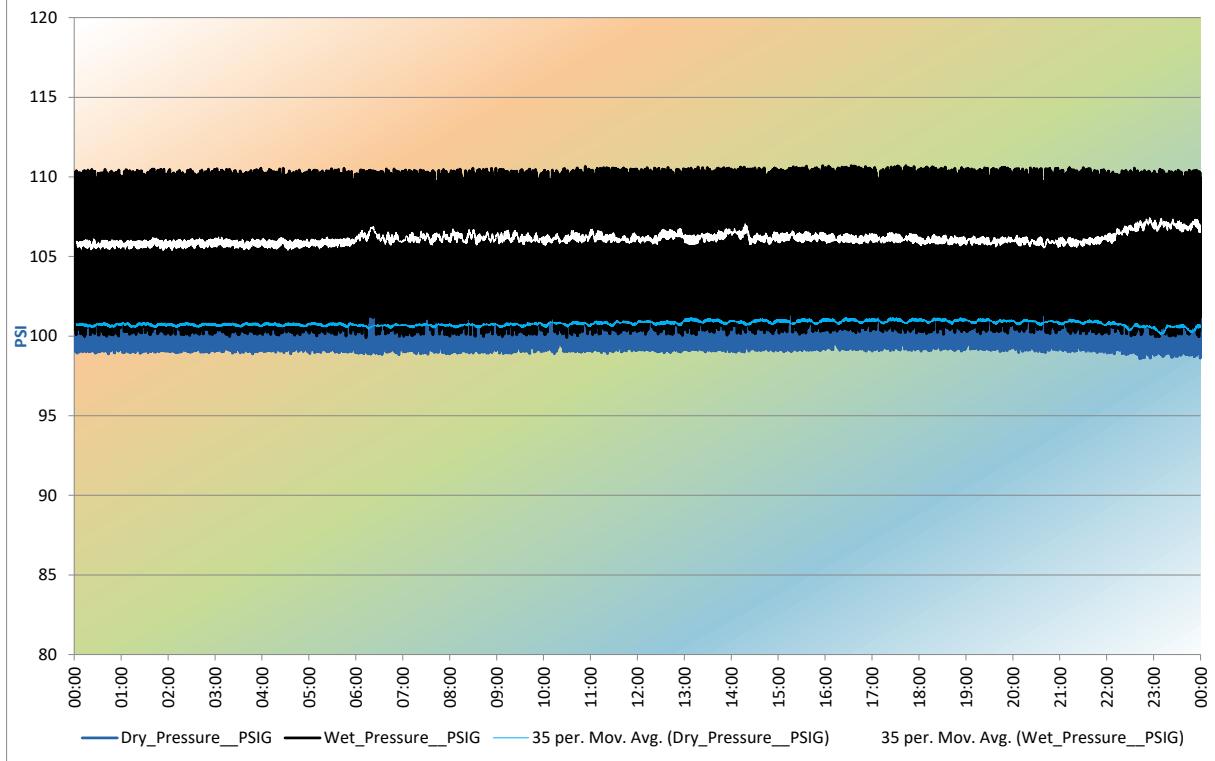

**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power, Flow & Pressure**  
**Monday, Feb 28, 2022**

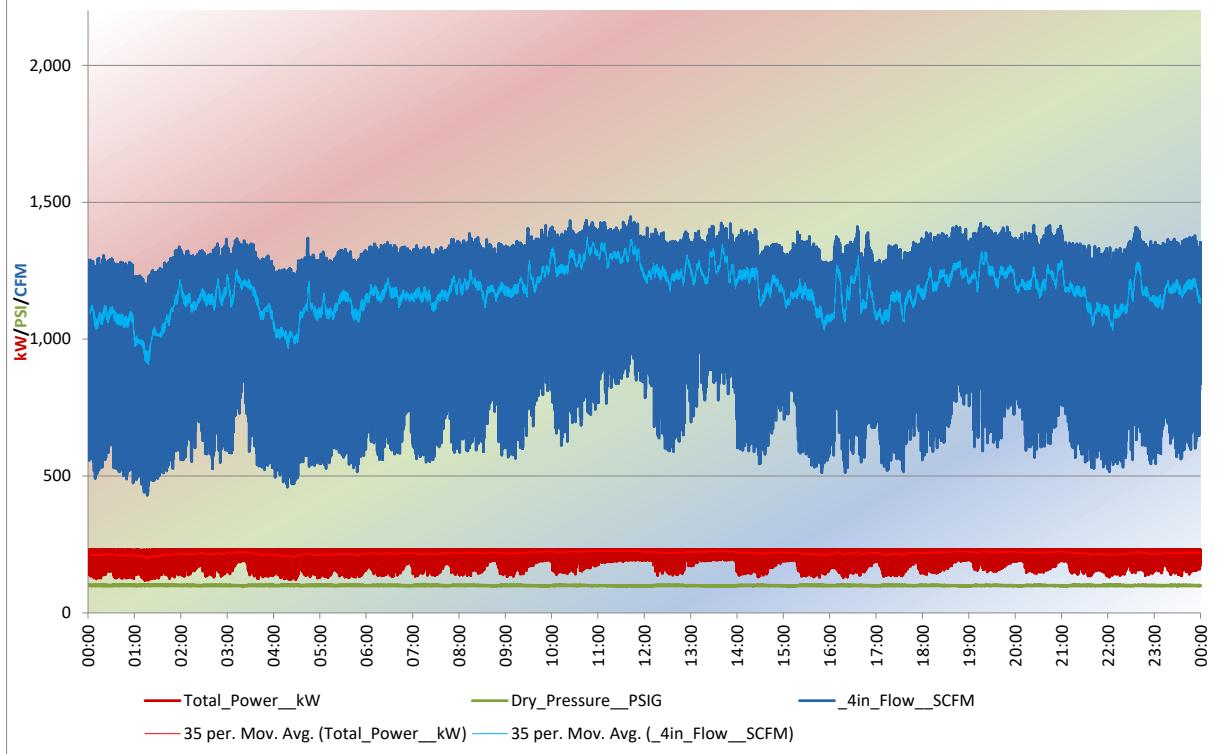


Monday, 2/28/2022									
First (1st) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,040.87	5.01	97.33	207.35	0.00	207.35	106.08		
Avg	1,228.93	5.62	99.66	221.17	0.00	221.17	107.66		
Max	1,397.17	6.15	100.65	230.85	0.00	230.85	109.23		
Second (2nd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,015.78	4.85	98.45	204.10	0.00	204.10	105.94		
Avg	1,180.51	5.47	100.01	218.82	0.00	218.82	107.28		
Max	1,358.09	6.00	100.73	230.34	0.00	230.34	108.82		
Third (3rd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	891.83	4.55	99.12	195.80	0.00	195.80	105.52		
Avg	1,116.84	5.33	100.32	214.22	0.00	214.22	107.13		
Max	1,282.14	5.89	100.93	224.71	0.00	224.71	108.43		

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow:Power Ratio**  
**Monday, Feb 28, 2022**

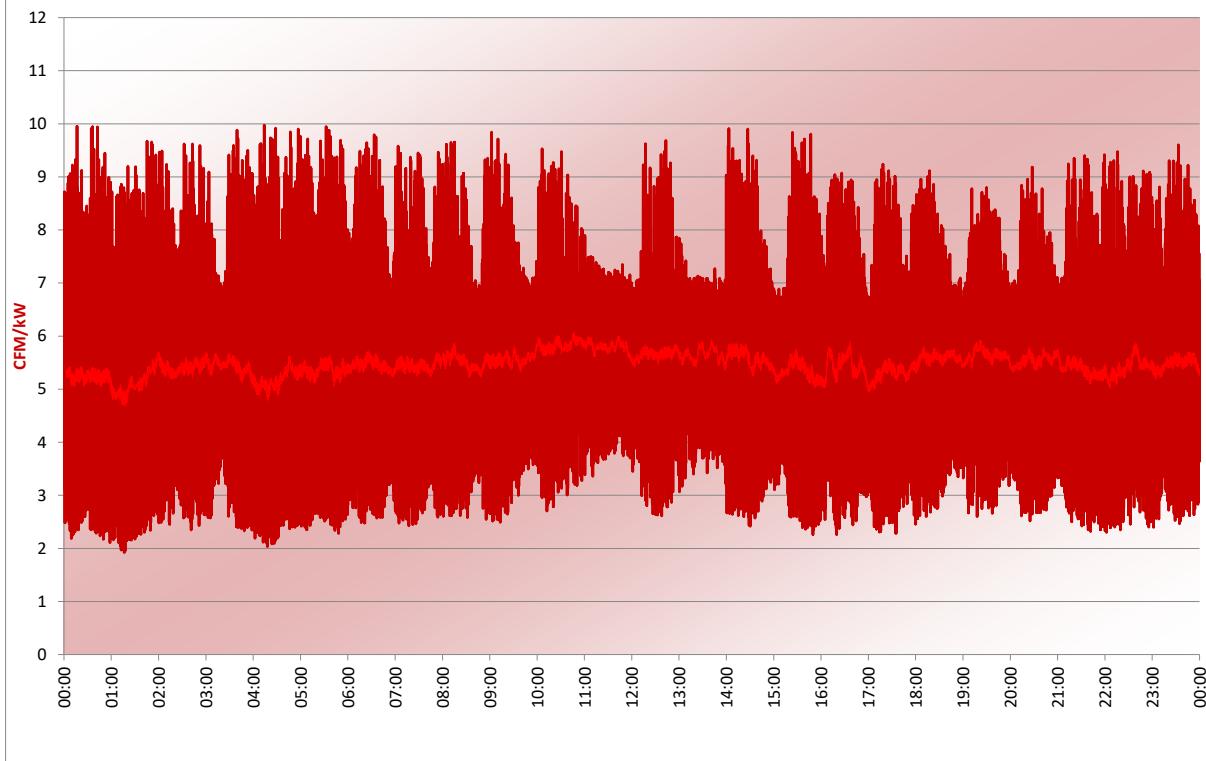

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor and Flow**  
**Monday, Feb 28, 2022**

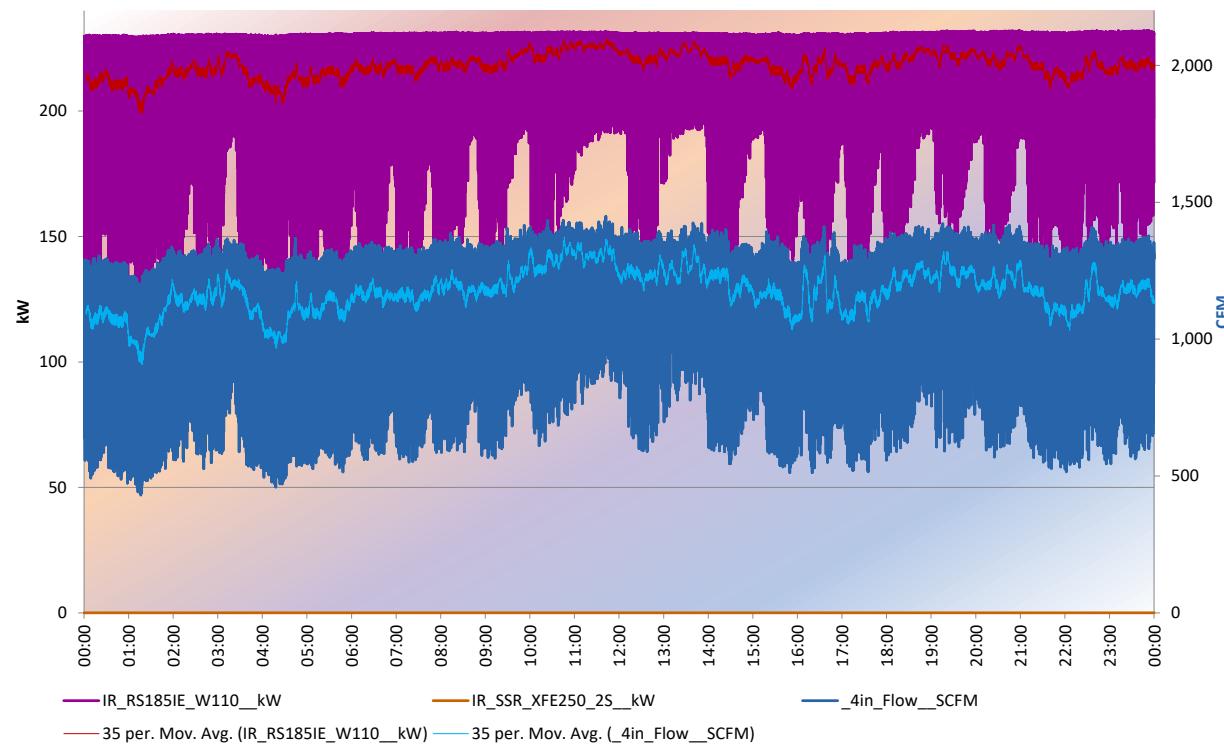


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor**  
**Monday, Feb 28, 2022**

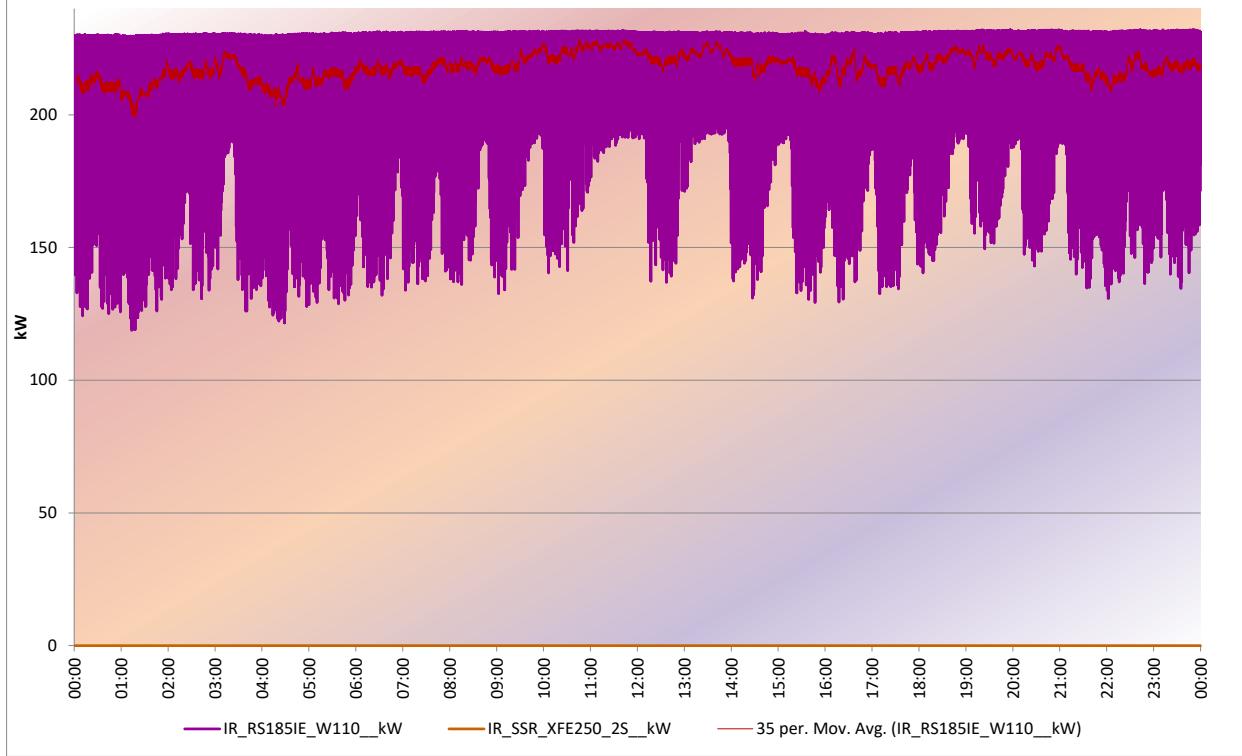


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow & Pressure**  
**Monday, Feb 28, 2022**

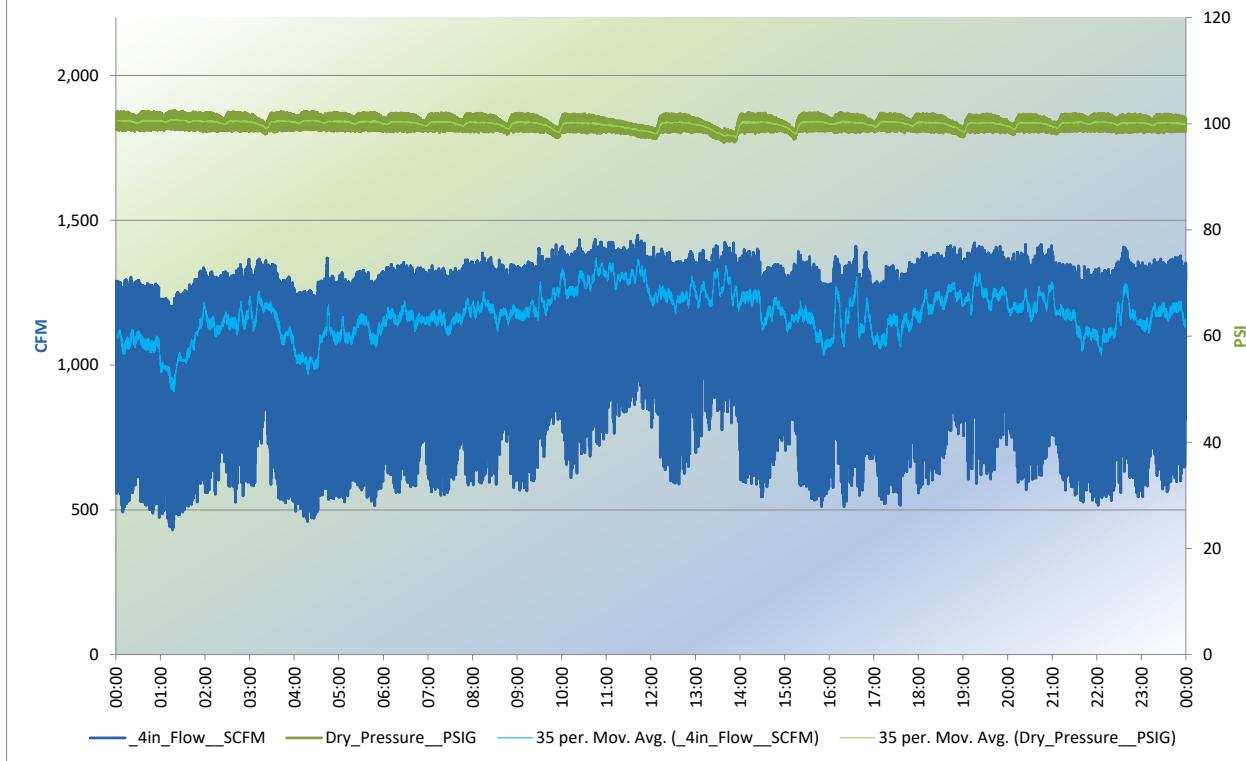


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Pressure by Location**  
**Monday, Feb 28, 2022**

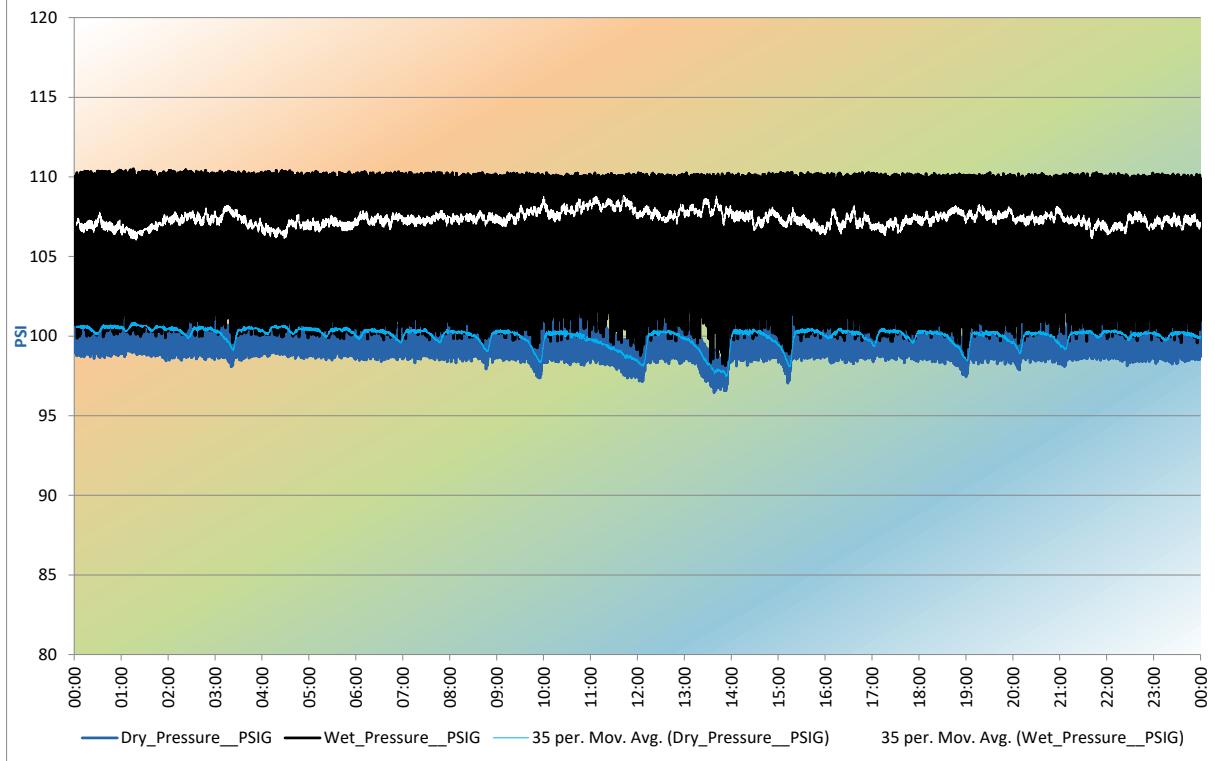

**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power, Flow & Pressure**  
**Tuesday, Mar 01, 2022**

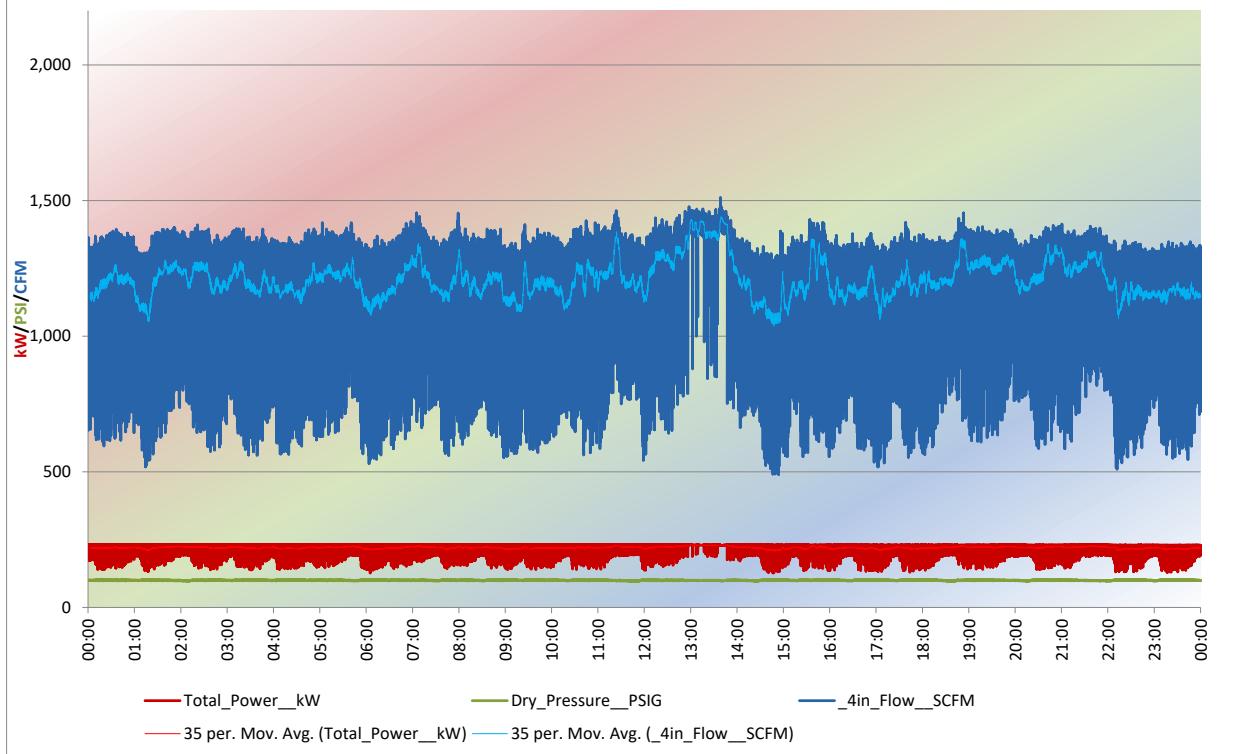


Tuesday, 3/1/2022									
First (1st) Shift									
Statistics	_4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	1,048.96	4.95	97.51	208.69	0.00	208.69	106.27		
Avg	1,222.67	5.58	99.78	221.30	0.00	221.30	107.54		
Max	1,449.38	6.31	100.66	231.34	0.00	231.34	109.73		
Second (2nd) Shift									
Statistics	_4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	1,052.08	4.90	97.61	208.50	0.00	208.50	106.19		
Avg	1,206.34	5.55	99.89	219.88	0.00	219.88	107.70		
Max	1,395.77	6.20	101.05	229.67	0.00	229.67	109.30		
Third (3rd) Shift									
Statistics	_4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	1,032.09	4.97	98.29	210.58	0.00	210.58	106.15		
Avg	1,198.58	5.51	99.89	220.27	0.00	220.27	107.31		
Max	1,328.91	6.01	100.46	227.89	0.00	227.89	108.54		

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow:Power Ratio**  
**Tuesday, Mar 01, 2022**

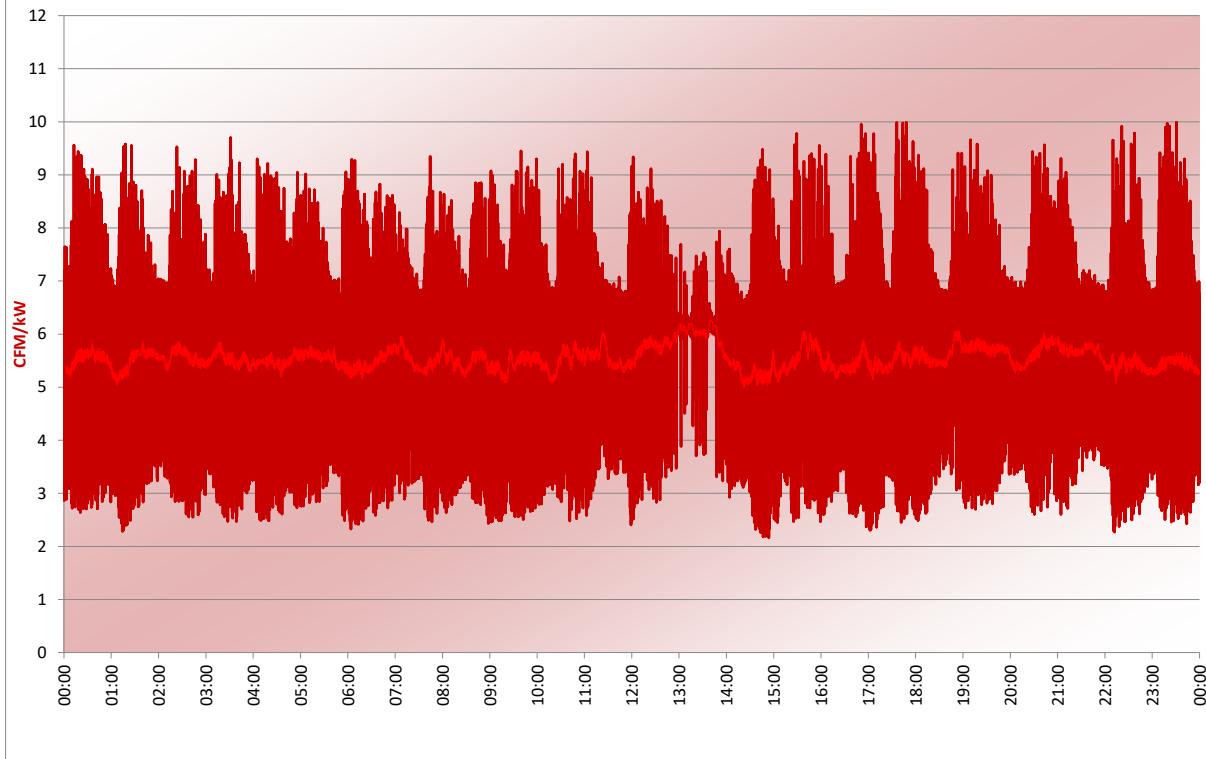

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor and Flow**  
**Tuesday, Mar 01, 2022**

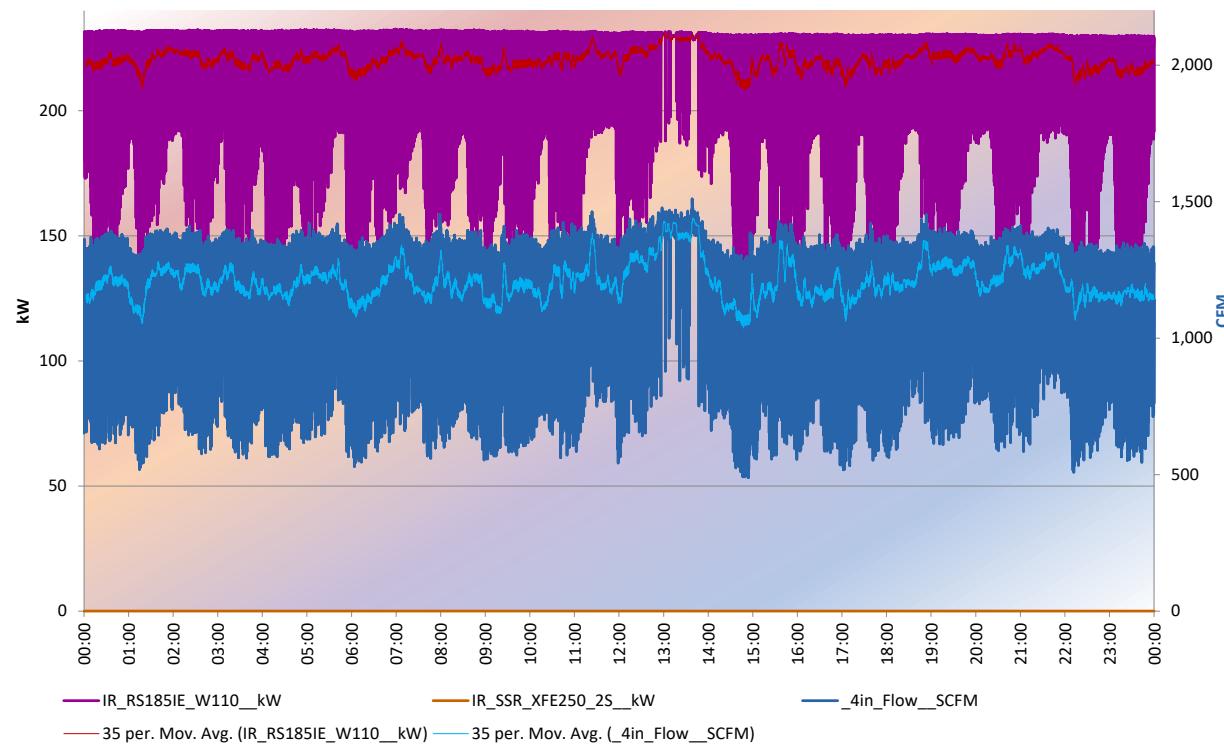


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor**  
**Tuesday, Mar 01, 2022**

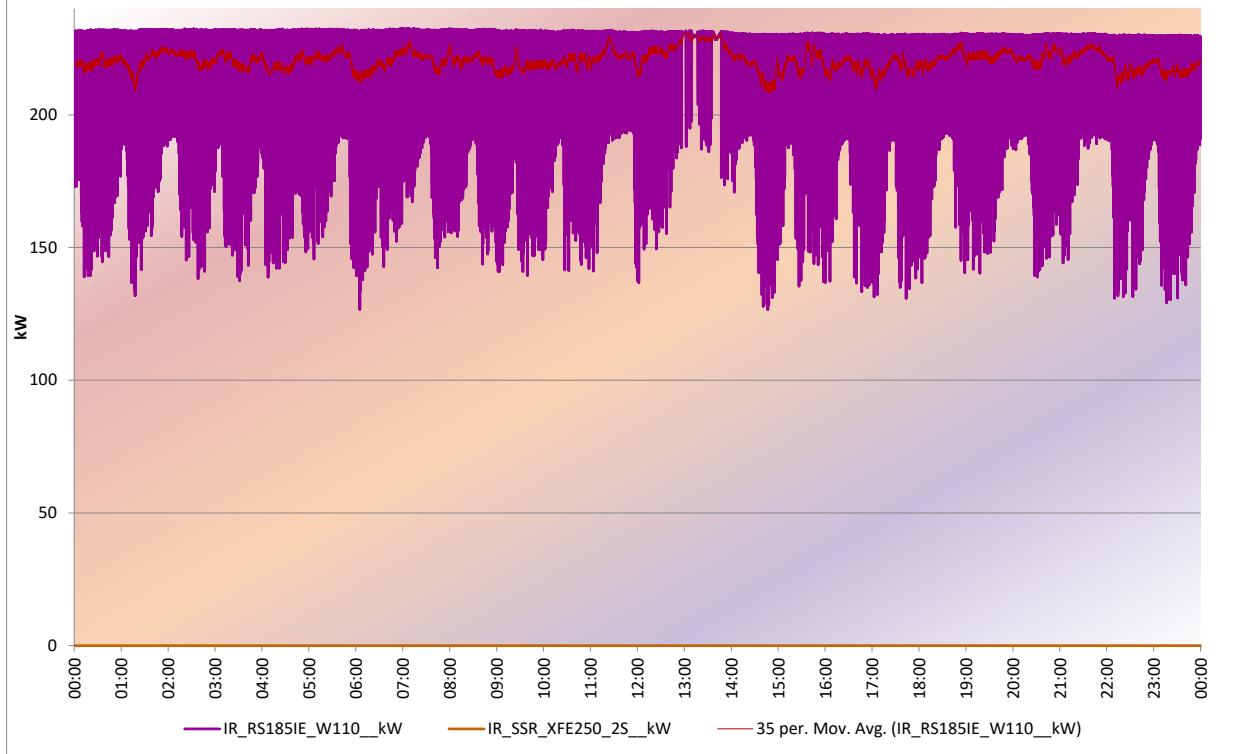


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow & Pressure**  
**Tuesday, Mar 01, 2022**

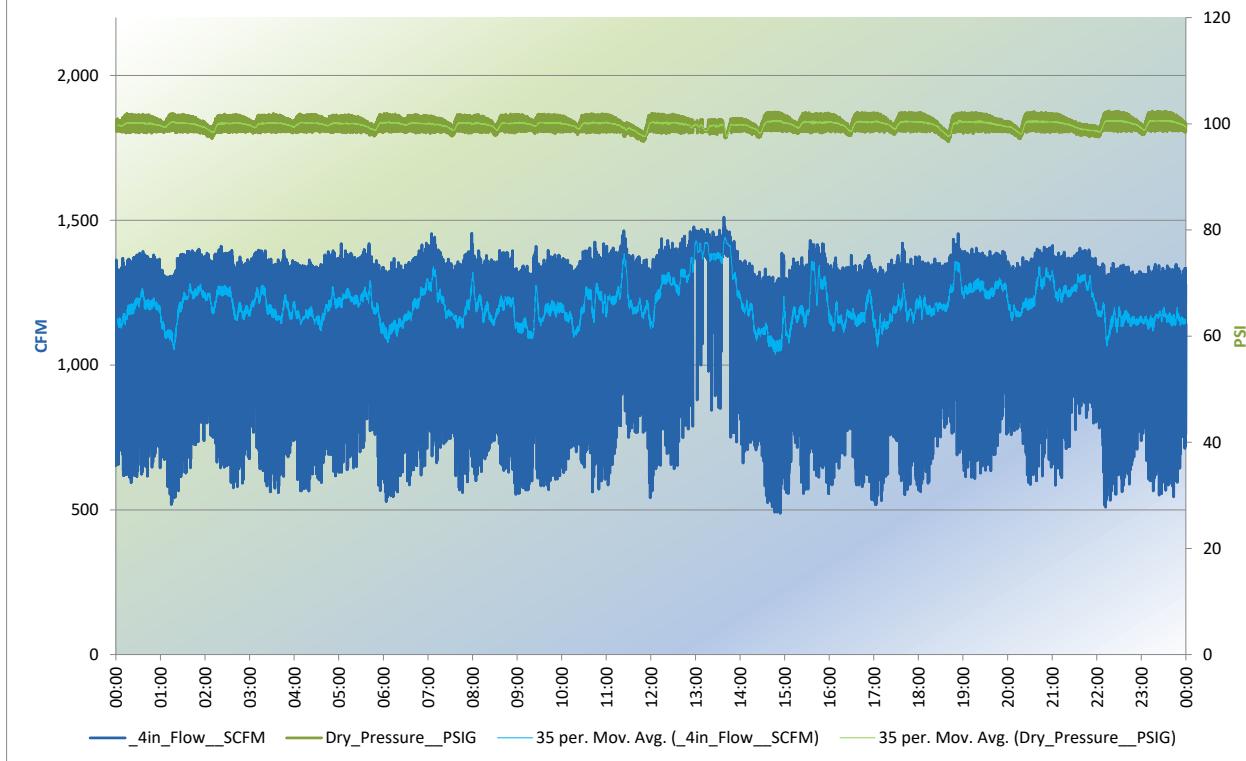


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Pressure by Location**  
**Tuesday, Mar 01, 2022**

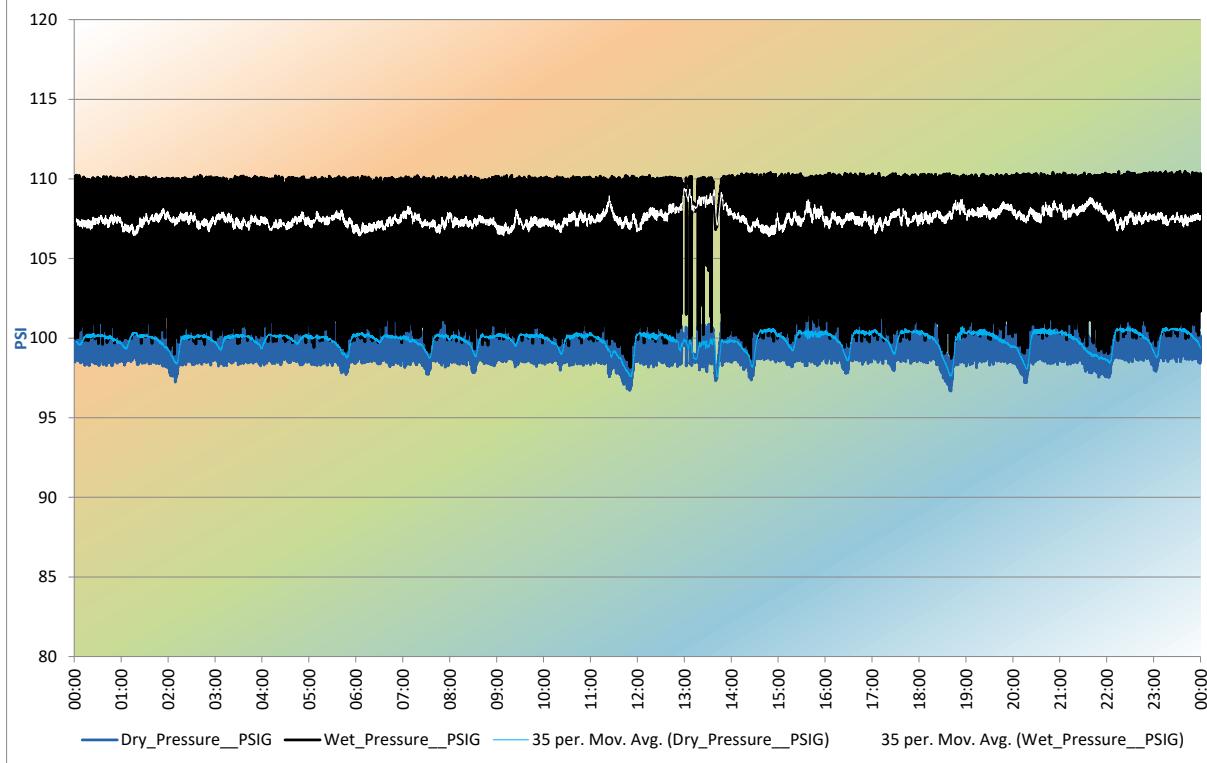

**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power, Flow & Pressure**  
**Wednesday, Mar 02, 2022**

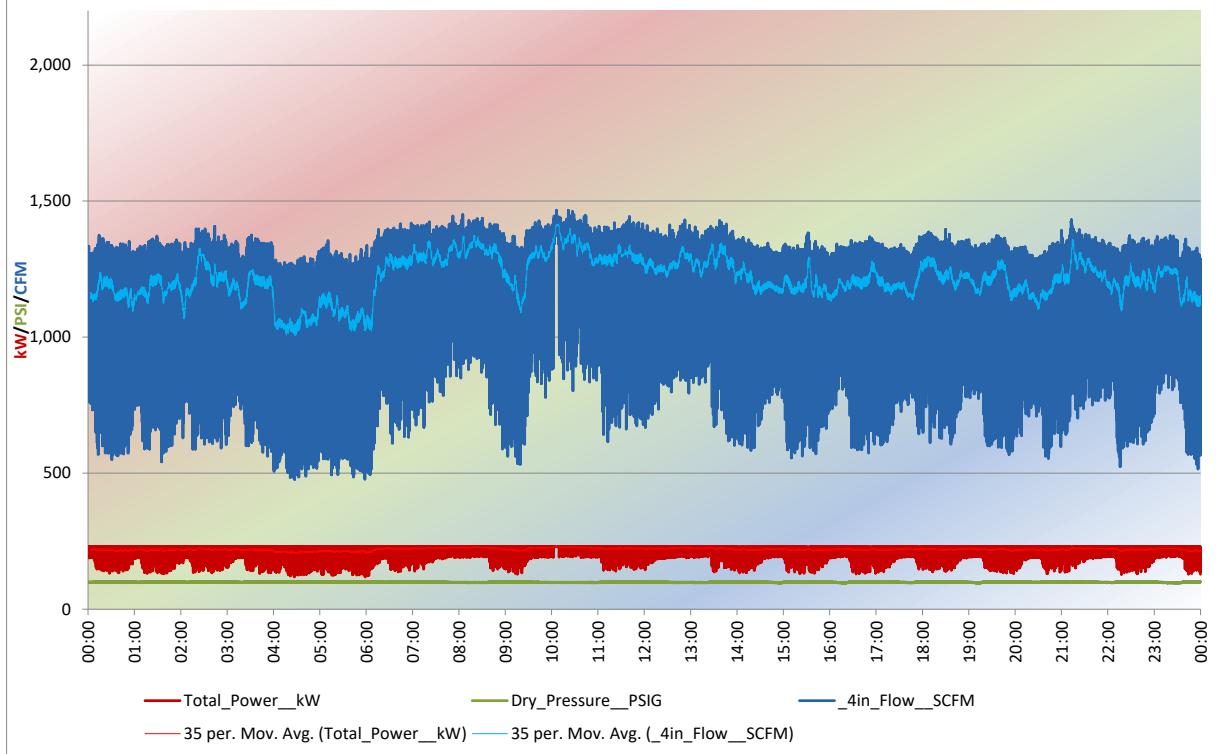

Wednesday, 3/2/2022									
First (1st) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	1,059.63	4.90	97.28	209.67	0.00	209.67	106.55		
Avg	1,265.89	5.71	99.54	222.96	0.00	222.96	108.12		
Max	1,417.92	6.23	101.62	230.37	0.00	230.37	109.81		
Second (2nd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	1,064.88	5.00	96.84	208.88	0.00	208.88	106.20		
Avg	1,207.02	5.54	99.70	220.09	0.00	220.09	107.68		
Max	1,393.02	6.14	100.93	228.97	0.00	228.97	109.33		
Third (3rd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	972.68	4.71	98.35	202.12	0.00	202.12	106.14		
Avg	1,180.12	5.49	100.20	217.89	0.00	217.89	107.61		
Max	1,383.65	6.17	100.96	229.65	0.00	229.65	109.54		


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow:Power Ratio**  
**Wednesday, Mar 02, 2022**

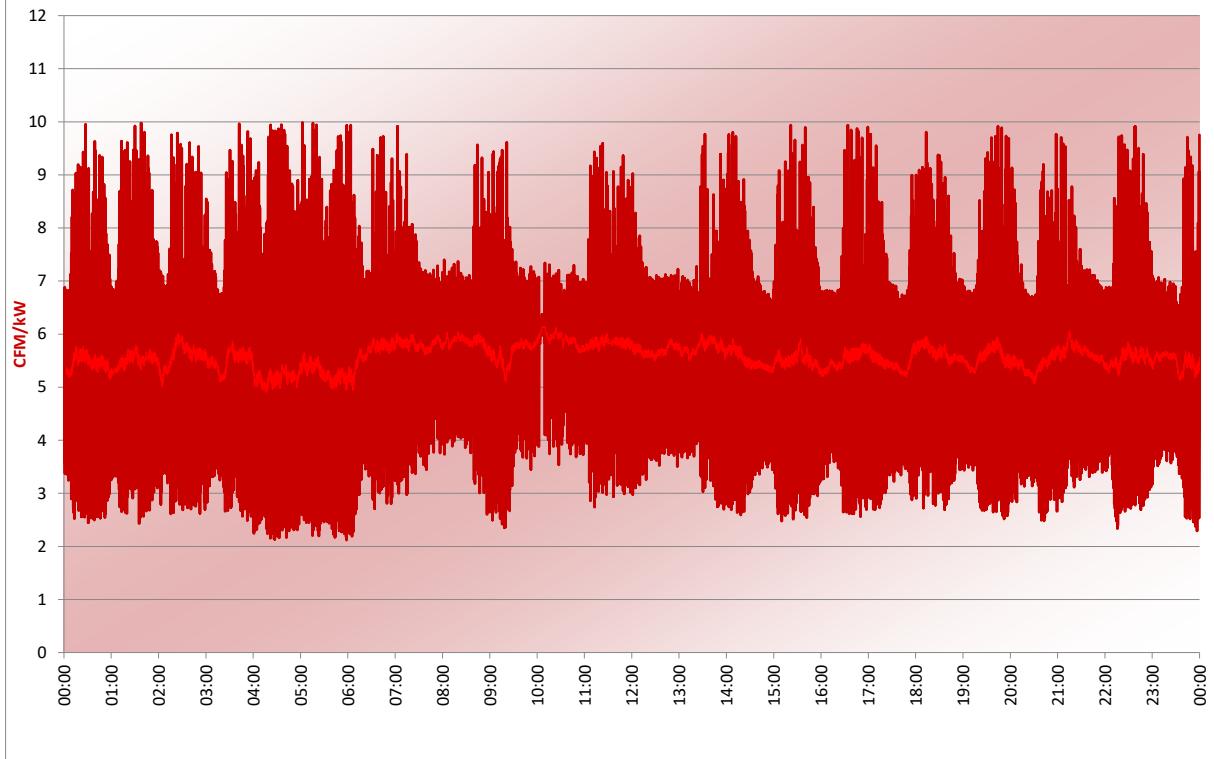


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor and Flow**  
**Wednesday, Mar 02, 2022**

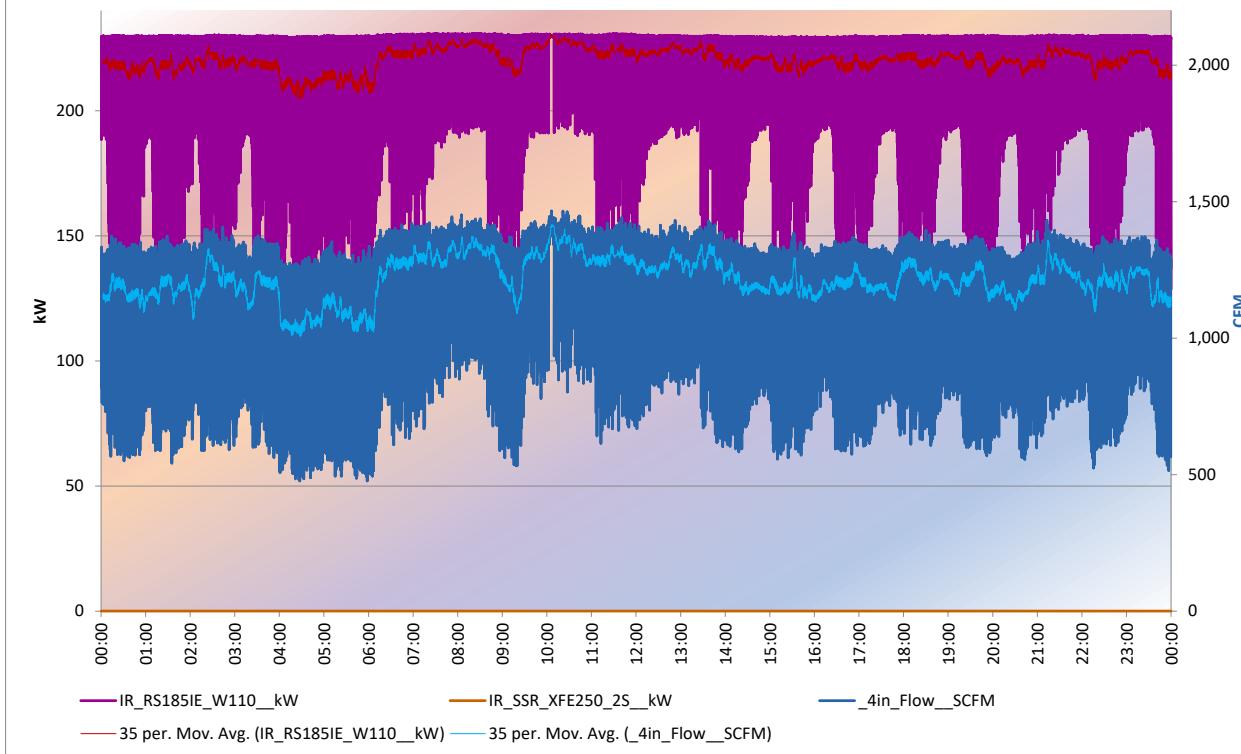


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor**  
**Wednesday, Mar 02, 2022**

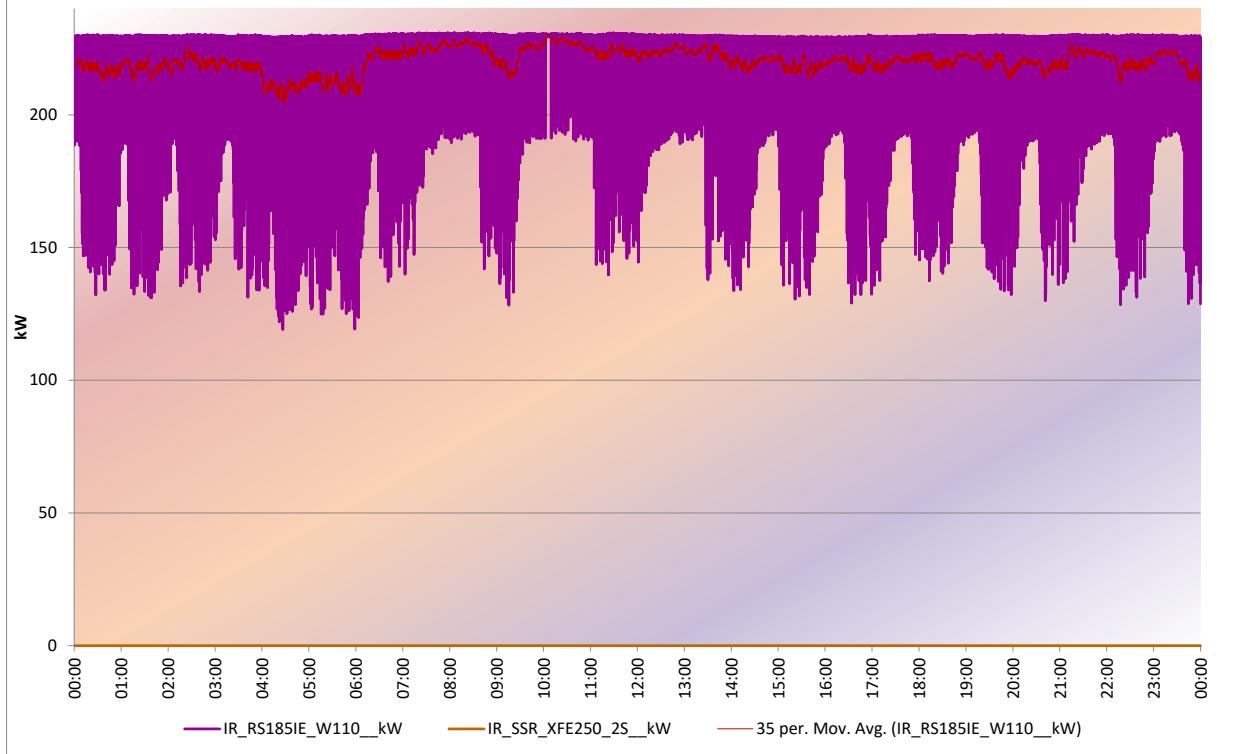


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow & Pressure**  
**Wednesday, Mar 02, 2022**

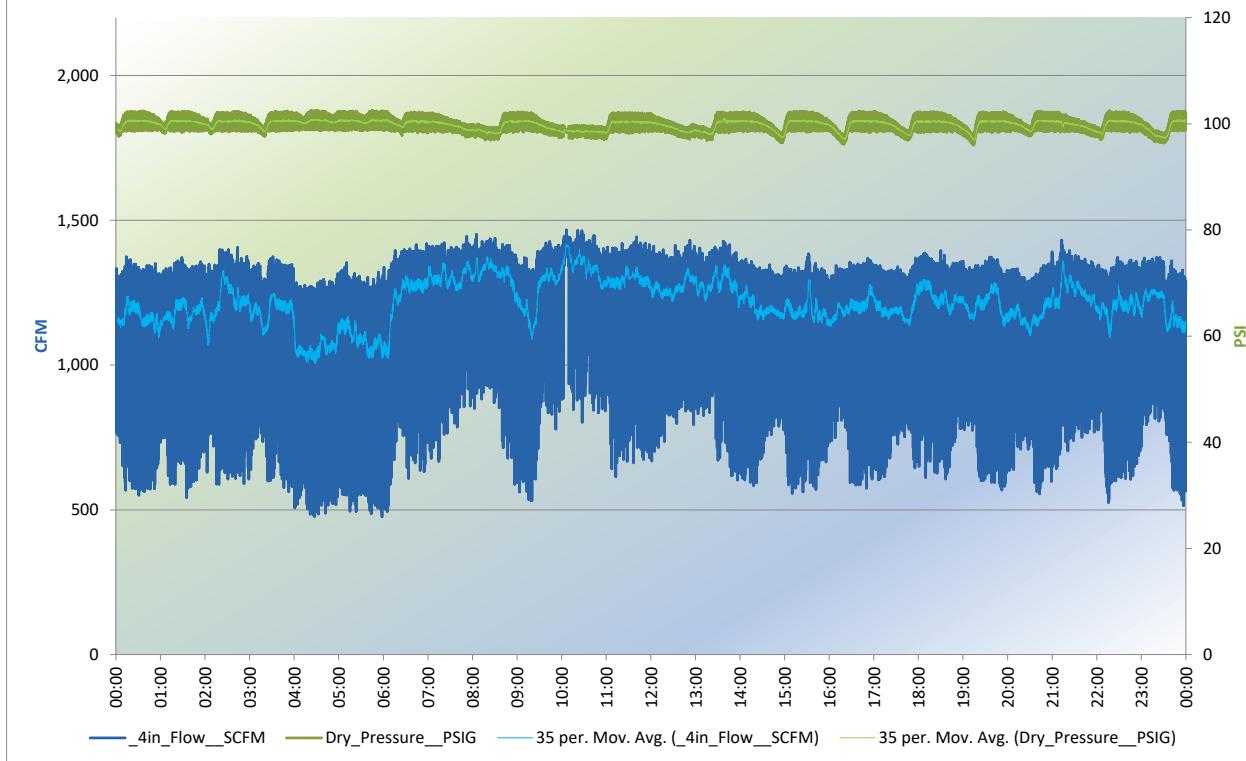


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Pressure by Location**  
**Wednesday, Mar 02, 2022**

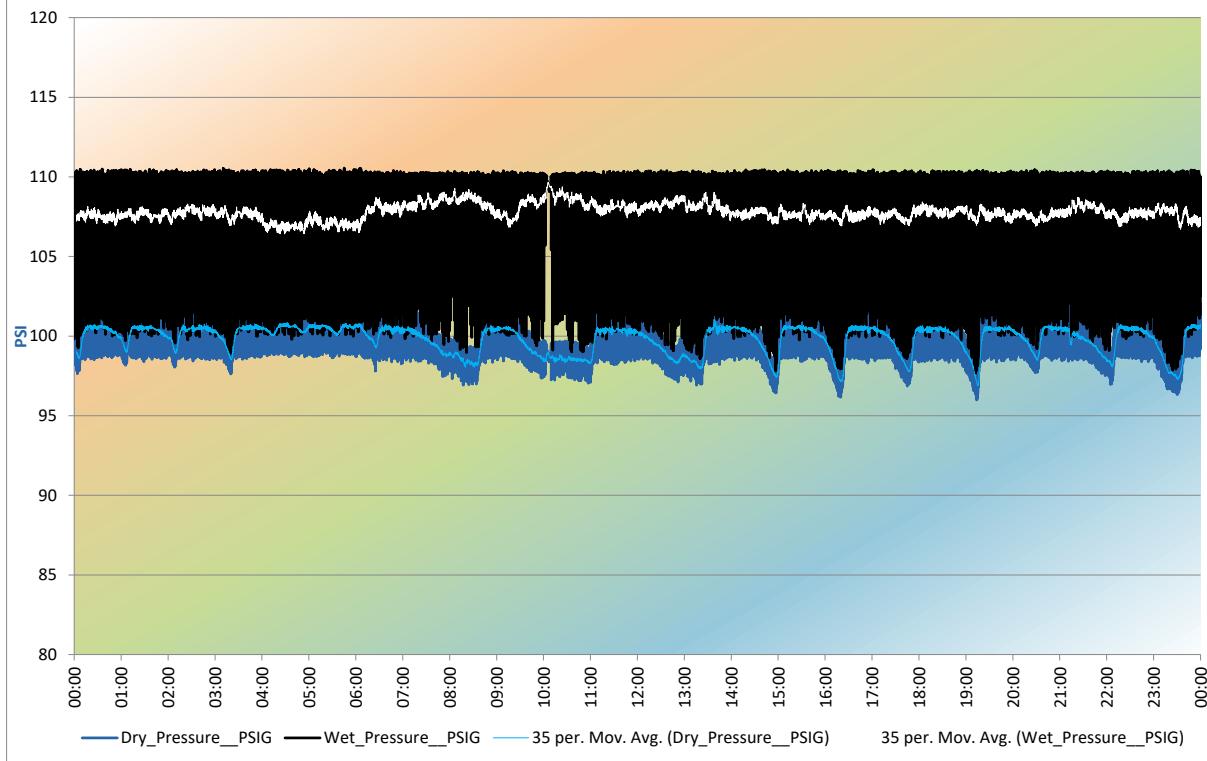

**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power, Flow & Pressure**  
**Thursday, Mar 03, 2022**

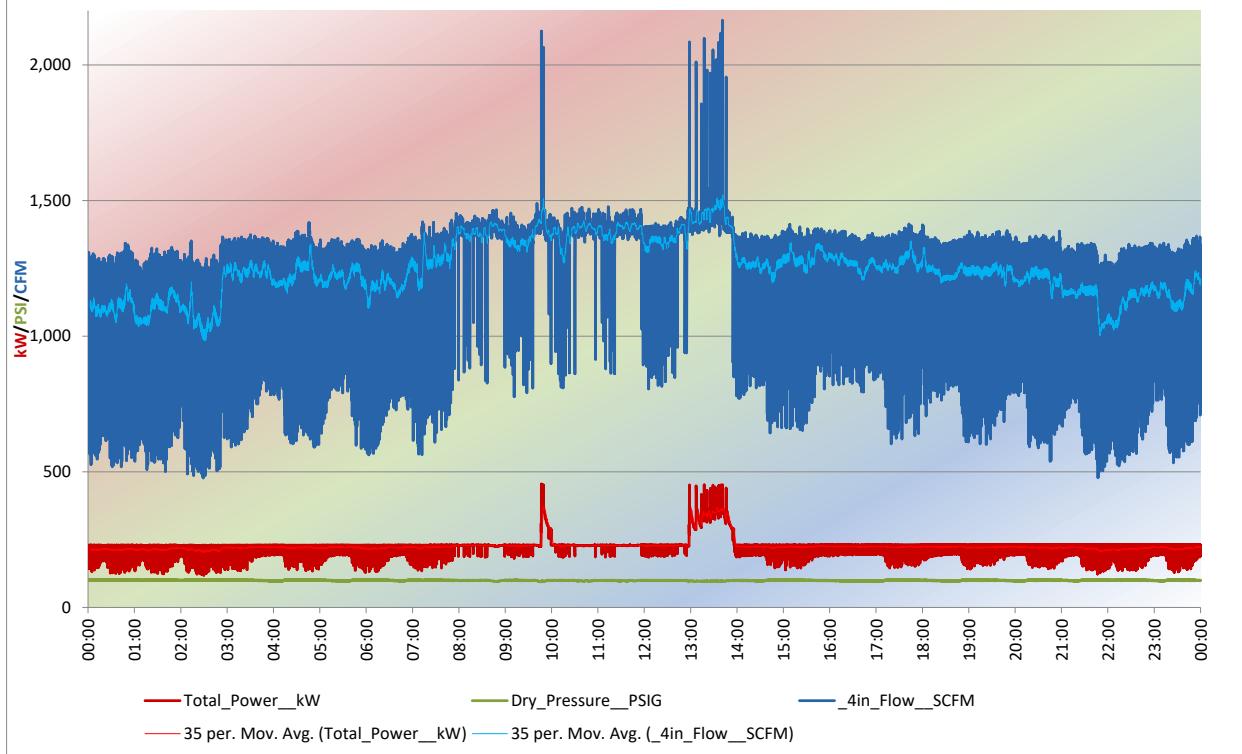


Thursday, 3/3/2022									
First (1st) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,180.38	3.83	94.70	218.48	0.00	218.48	104.75		
Avg	1,359.21	5.71	99.02	226.79	15.79	242.58	108.27		
Max	1,557.77	6.40	101.06	230.39	147.30	375.52	110.13		
Second (2nd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,001.11	4.79	96.19	203.22	0.00	203.22	105.86		
Avg	1,206.60	5.52	99.37	220.73	0.00	220.73	107.45		
Max	1,396.58	6.09	100.75	229.49	0.00	229.49	109.00		
Third (3rd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	983.24	4.77	97.26	204.77	0.00	204.77	106.18		
Avg	1,182.62	5.48	100.05	218.39	0.00	218.39	107.63		
Max	1,406.95	6.14	101.26	230.28	0.00	230.28	109.81		

**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow:Power Ratio**  
**Thursday, Mar 03, 2022**

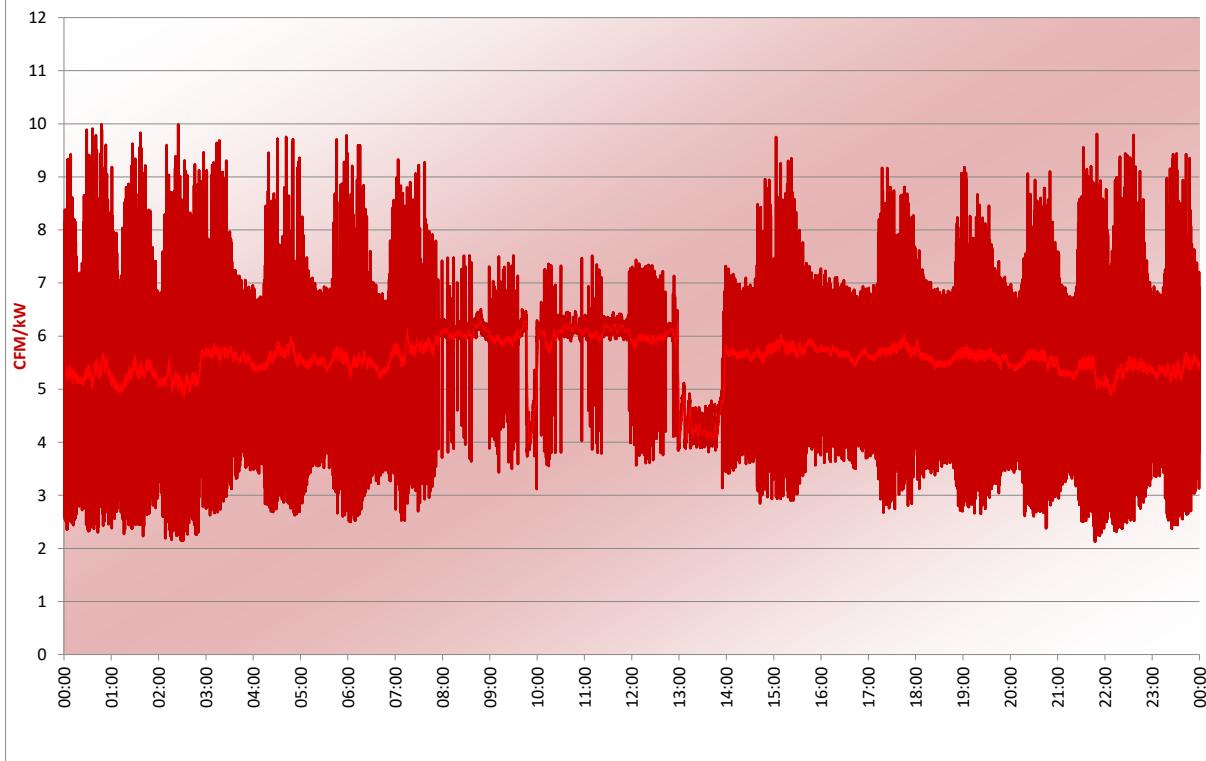

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor and Flow**  
**Thursday, Mar 03, 2022**

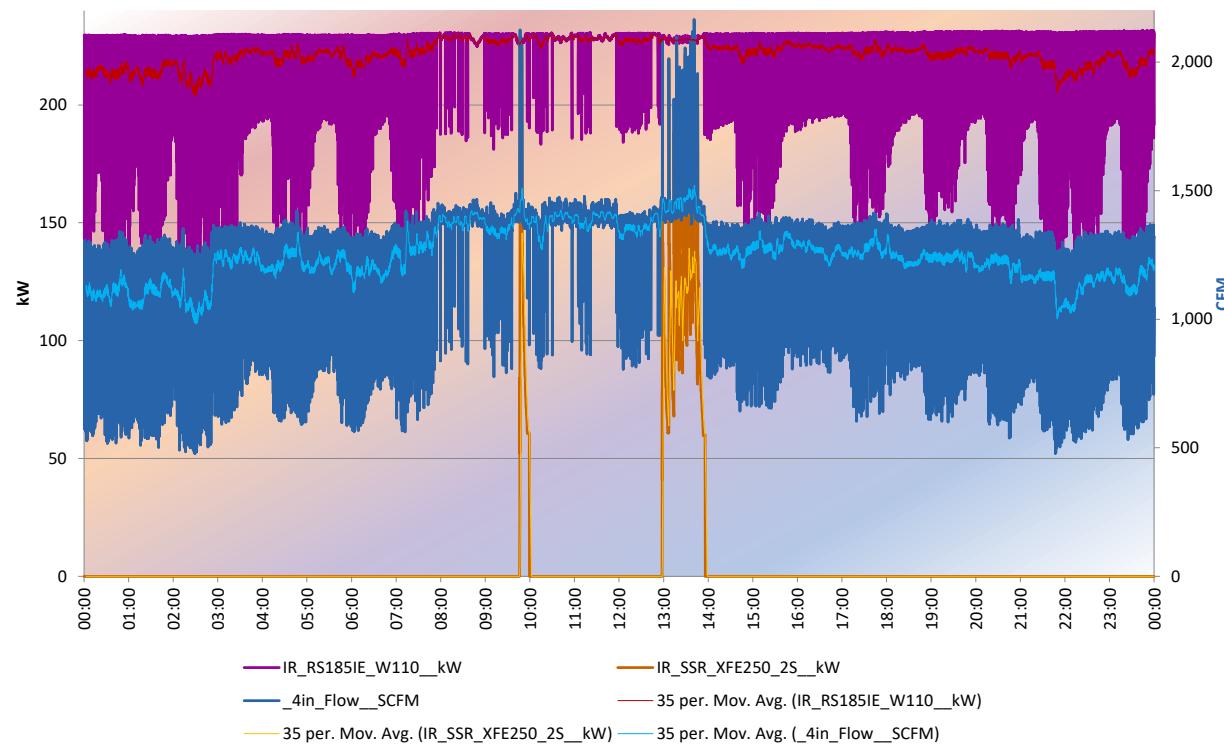


**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Power by Compressor**  
**Thursday, Mar 03, 2022**

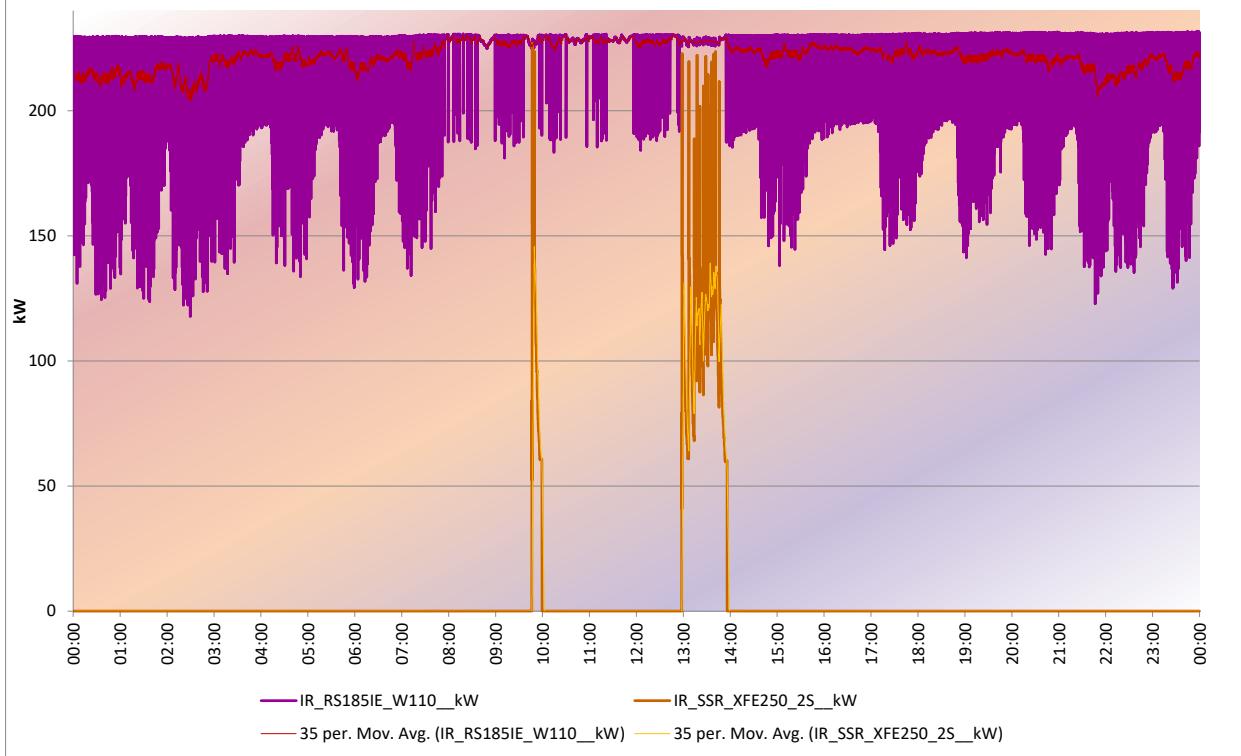


**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Flow & Pressure**  
**Thursday, Mar 03, 2022**

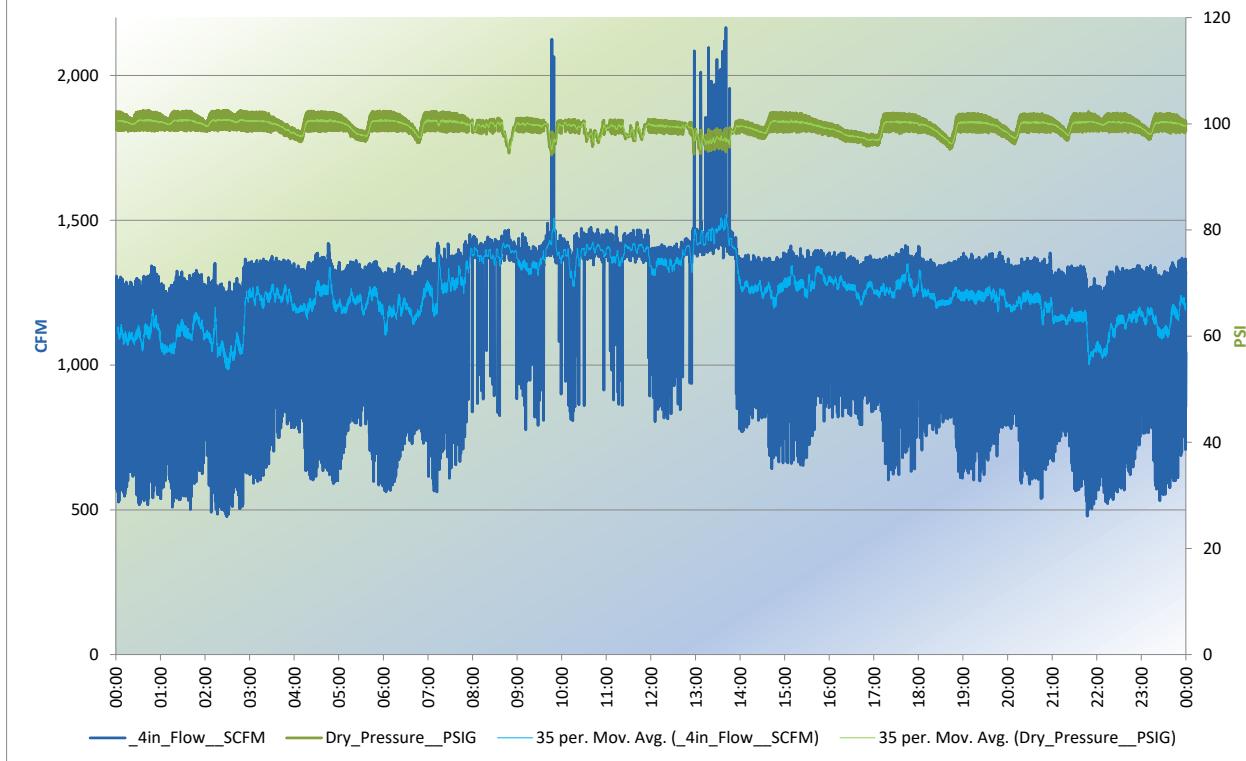

**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**

**Nichols Portland, LLC - Portland, ME**  
**Compressed Air System Data - Pressure by Location**  
**Thursday, Mar 03, 2022**

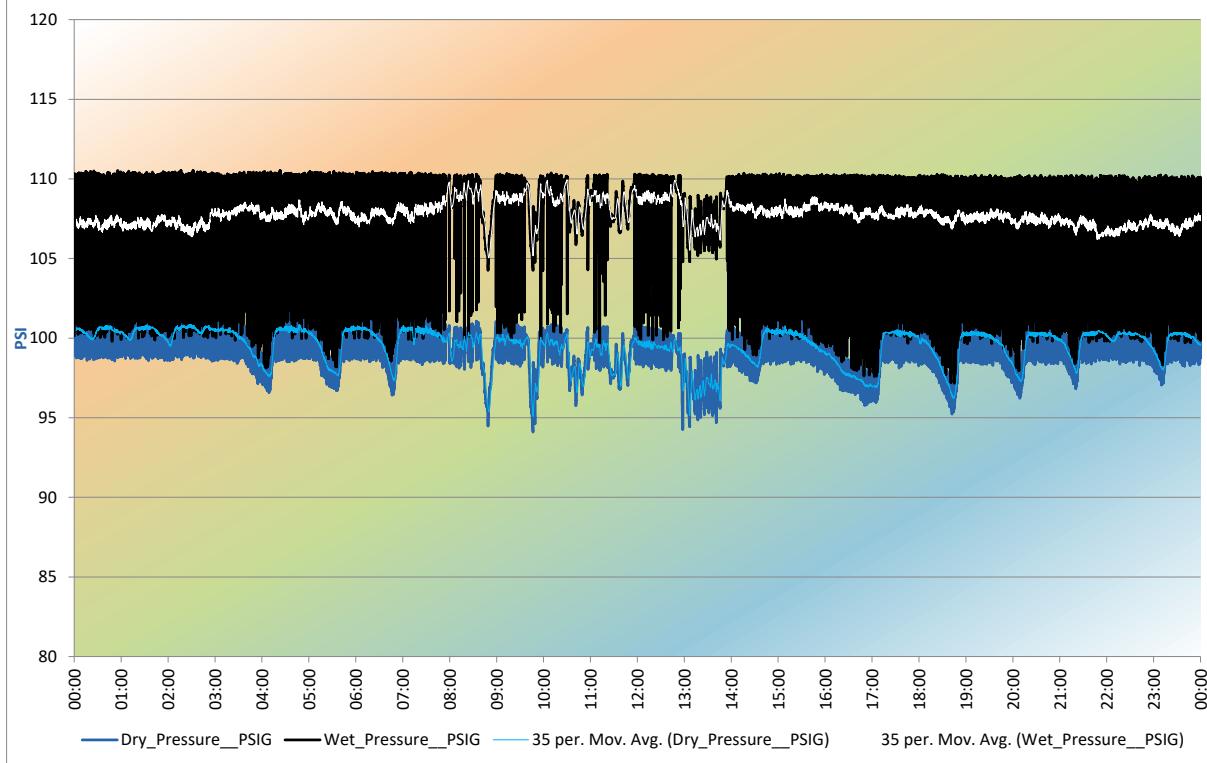

**"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".**