

Compressed Air Analytics

prepared for



Nichols Portland, LLC

Portland, ME

March, 2021

sponsored by



prepared by



Vendor Neutral, Energy Biased

Compressor Energy Services
395 Daniel Webster Highway, Unit 1
Merrimack, NH
(888) 788-6188
CompressorENERGY.com

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".




New ES Dash Board

Summary of System

\$285,116
Nichols Portland, LLC – Portland, ME

# of Compressors in System	3
Combined System Capacity at Full Load (SCFM)	2824
Average Measured Flow (SCFM) ¹	1155
Non-Productive Measured Flow (SCFM) ²	830
Cost of Non-Productive Demand (\$/Year) ³	\$ 204,868.91
Combined System Power at Full Load (kW)	440.0
Average Measured Power (kW) ⁴	217.0
Total kWh Consumption (kWh Annually) ⁵	1,900,770

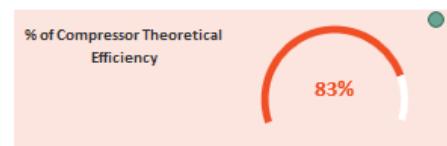

¹ See Power, Flow & Pressure Graph on Data Summary Page


² See Air System Information Page

830 X 246,83001710736

³ See Power, Flow & Pressure Graph on Data Summary Page


216,382838816603 X 8760

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power, Flow & Pressure
Feb 25, 2022 to Mar 04, 2022

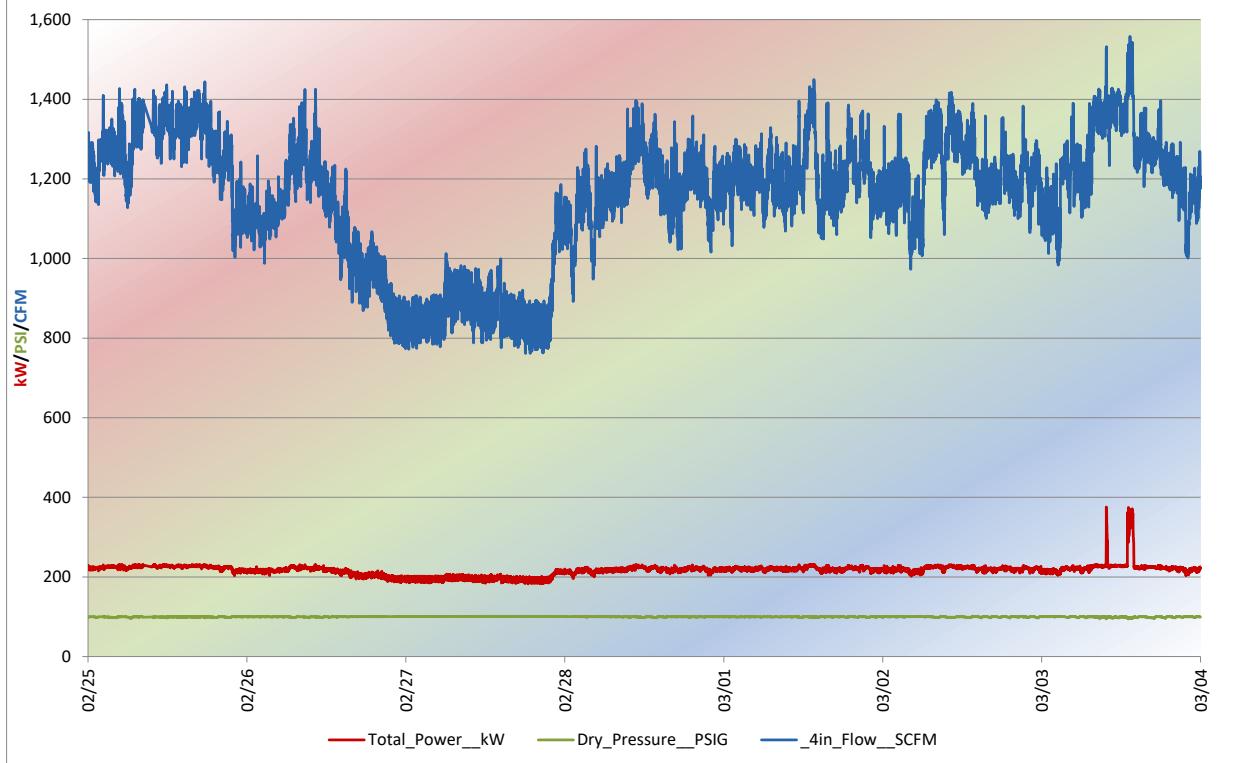


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow:Power Ratio
Feb 25, 2022 to Mar 04, 2022

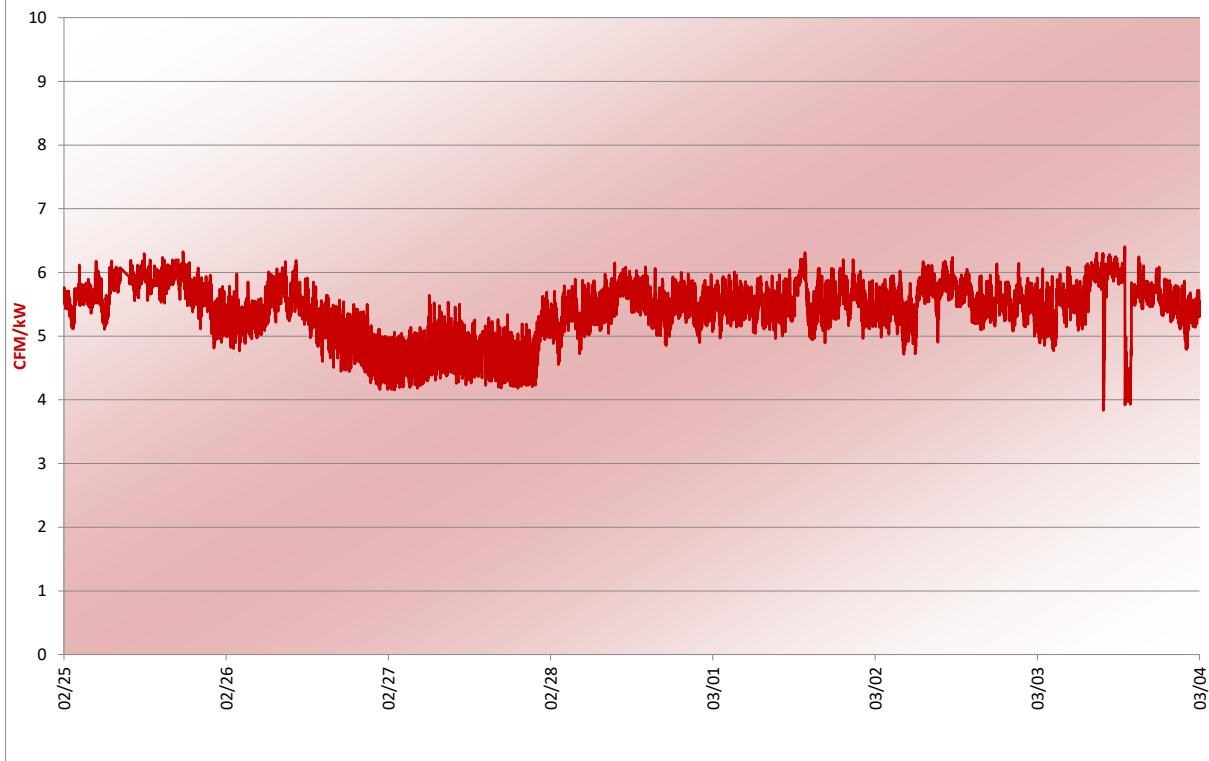


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor and Flow
Feb 25, 2022 to Mar 04, 2022

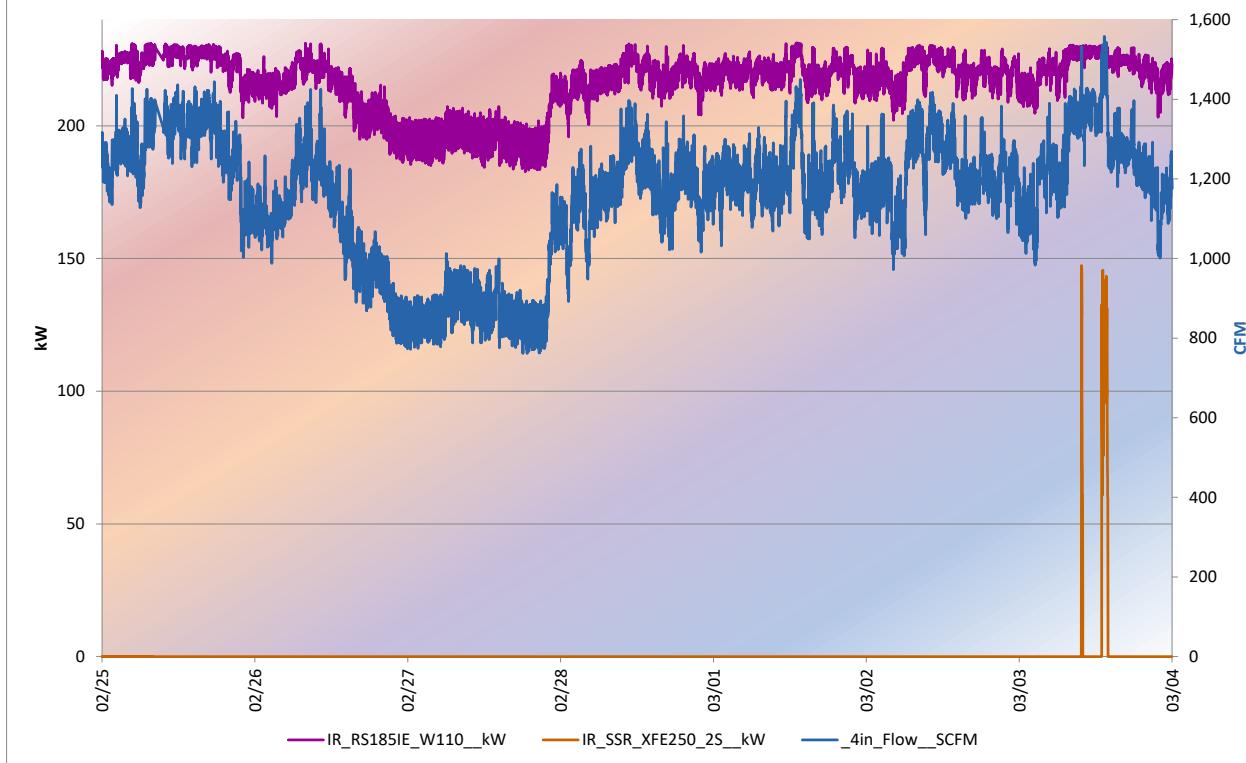


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor
Feb 25, 2022 to Mar 04, 2022

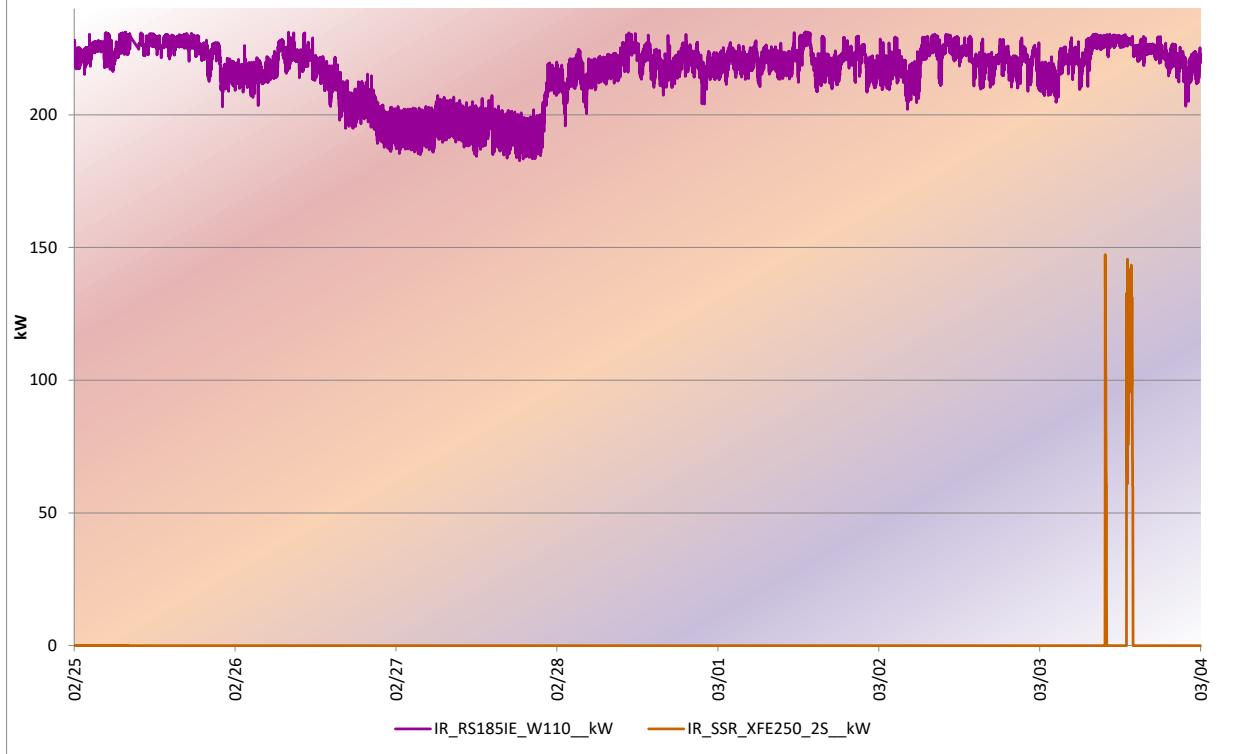


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow & Pressure
Feb 25, 2022 to Mar 04, 2022

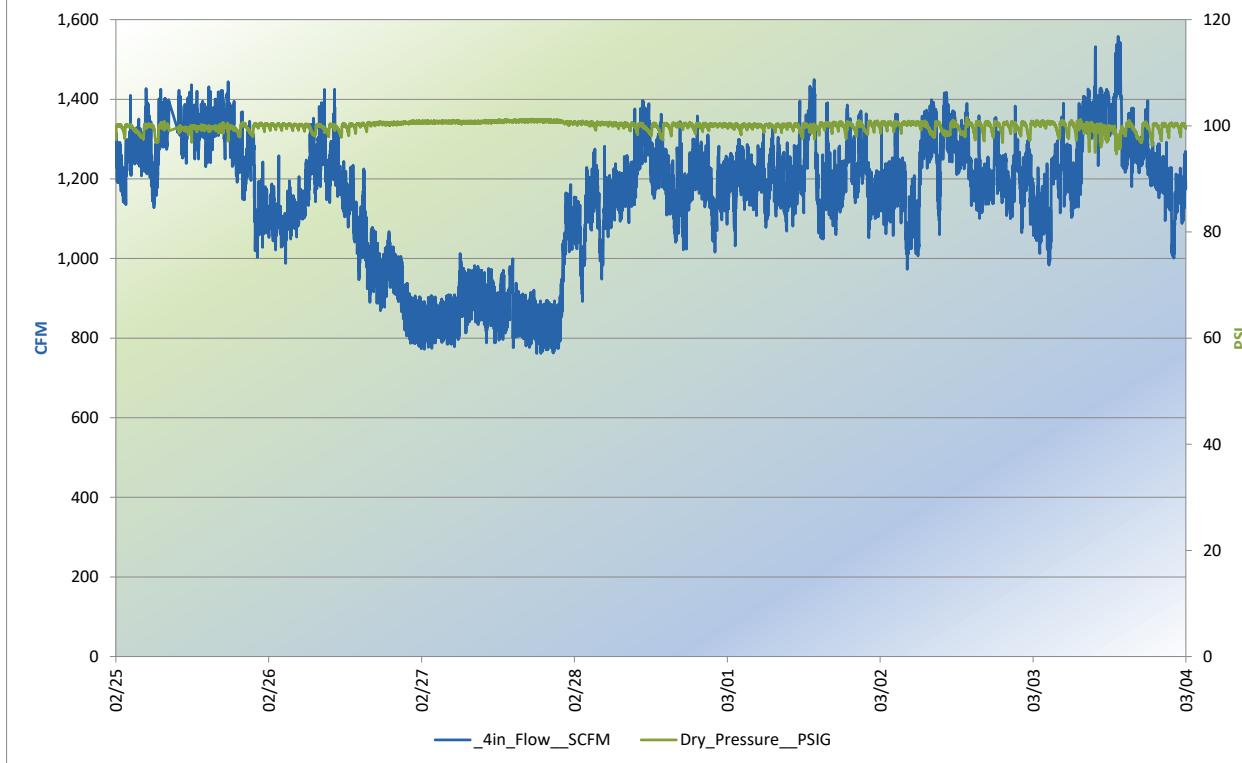

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Pressure by Location
Feb 25, 2022 to Mar 04, 2022

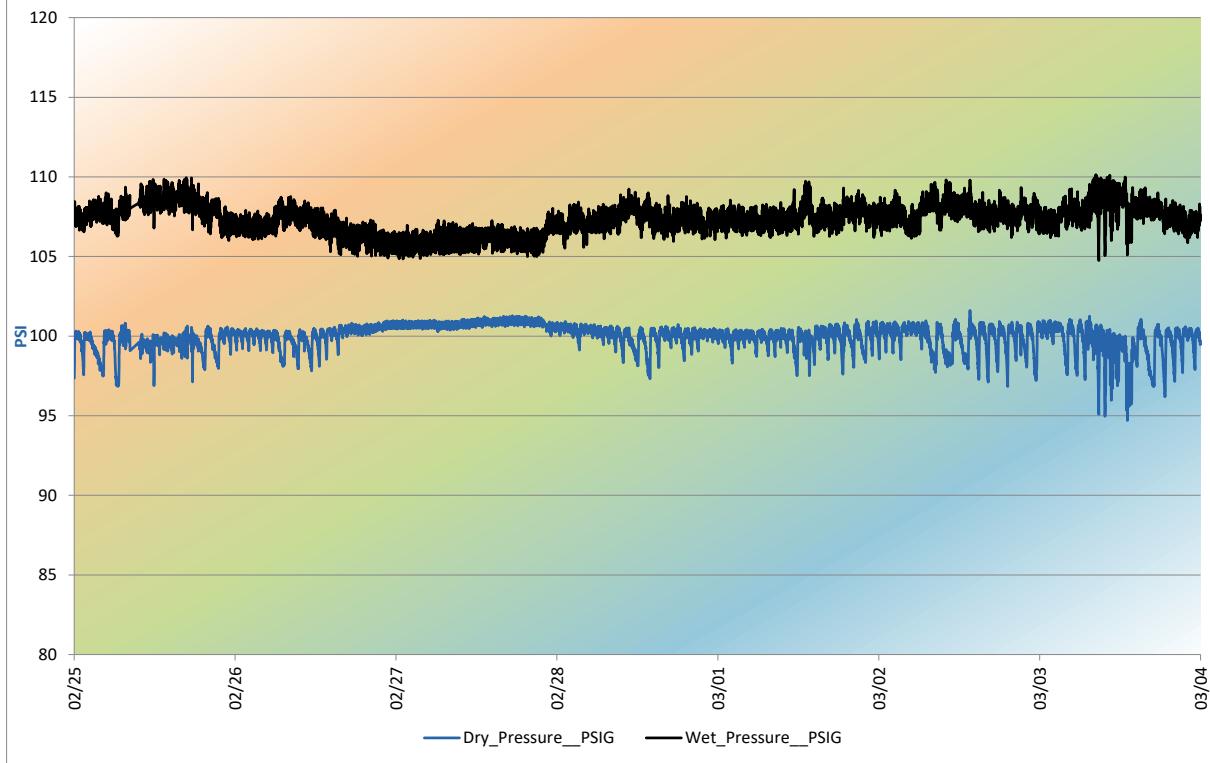


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Full Deck: 2/25/2022 to 3/3/2022 - 1-Minute Averages								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	761.39	3.83	94.70	182.65	0.00	182.65	104.75	
Avg	1,155.11	5.40	99.93	216.22	0.76	216.98	107.34	
Max	1,557.77	6.40	101.62	231.34	147.30	375.52	110.13	
Friday, 2/25/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	1,002.67	4.81	96.85	203.01	0.00	203.01	106.00	
Avg	1,278.61	5.71	99.52	224.10	0.01	224.11	108.03	
Max	1,444.26	6.32	100.81	231.13	0.04	231.14	109.96	
Saturday, 2/26/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	773.36	4.16	97.81	186.14	0.00	186.14	104.91	
Avg	1,079.09	5.22	100.03	212.12	0.00	212.12	106.81	
Max	1,425.49	6.19	100.97	231.13	0.00	231.13	108.76	
Sunday, 2/27/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	761.39	4.15	100.01	182.65	0.00	182.65	104.84	
Avg	883.06	4.74	100.79	196.95	0.00	196.95	106.11	
Max	1,185.66	5.69	101.28	219.93	0.00	219.93	108.03	
Monday, 2/28/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	891.83	4.55	97.33	195.80	0.00	195.80	105.52	
Avg	1,175.43	5.47	100.00	218.07	0.00	218.07	107.35	
Max	1,397.17	6.15	100.93	230.85	0.00	230.85	109.23	
Tuesday, 3/1/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	1,032.09	4.90	97.51	208.50	0.00	208.50	106.15	
Avg	1,209.19	5.55	99.85	220.48	0.00	220.48	107.51	
Max	1,449.38	6.31	101.05	231.34	0.00	231.34	109.73	
Wednesday, 3/2/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	972.68	4.71	96.84	202.12	0.00	202.12	106.14	
Avg	1,217.68	5.58	99.81	220.31	0.00	220.31	107.80	
Max	1,417.92	6.23	101.62	230.37	0.00	230.37	109.81	
Thursday, 3/3/2022								
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG	
Min	983.24	3.83	94.70	203.22	0.00	203.22	104.75	
Avg	1,249.48	5.57	99.48	221.97	5.26	227.24	107.79	
Max	1,557.77	6.40	101.26	230.39	147.30	375.52	110.13	

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power, Flow & Pressure
Friday, Feb 25, 2022

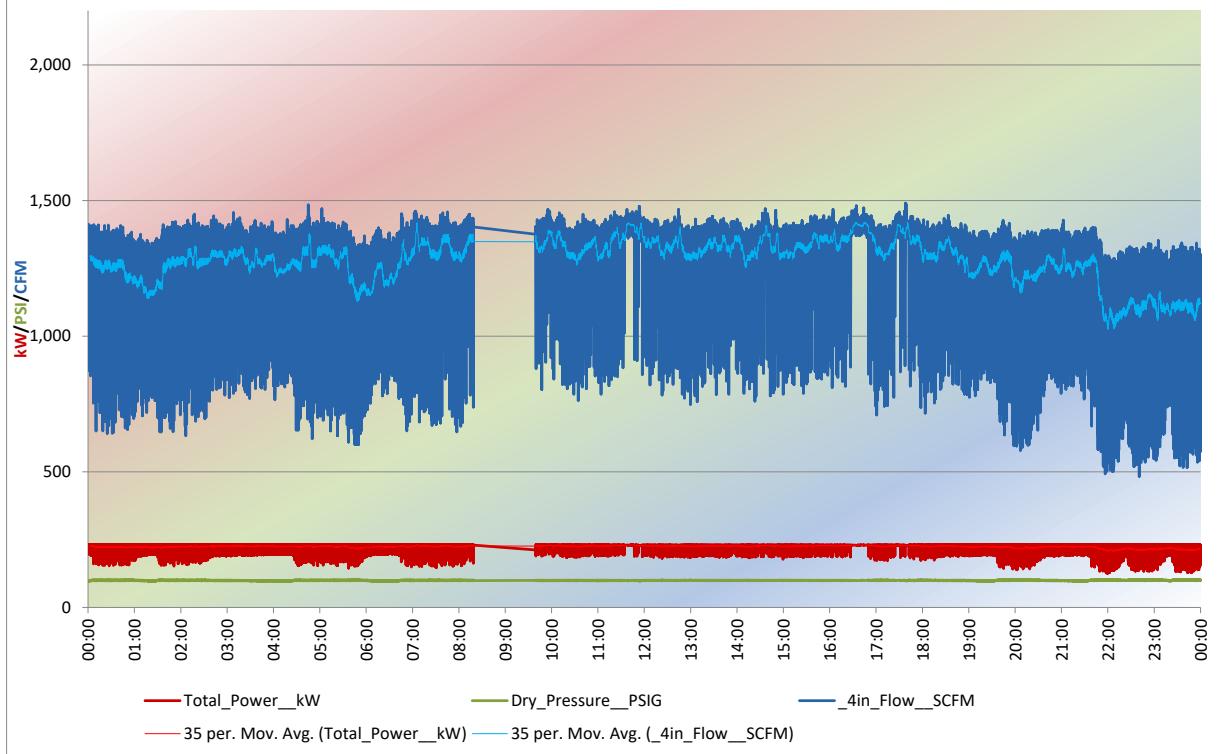

Friday, 2/25/2022									
First (1st) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,230.64	5.52	96.89	220.97	0.00	220.97	106.79		
Avg	1,334.88	5.90	99.53	226.74	0.00	226.74	108.60		
Max	1,436.27	6.29	100.37	230.92	0.03	230.92	109.85		
Second (2nd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,002.67	4.81	97.13	203.01	0.00	203.01	106.00		
Avg	1,243.75	5.65	99.63	221.92	0.00	221.92	107.87		
Max	1,444.26	6.32	100.63	230.77	0.00	230.77	109.96		
Third (3rd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,127.45	5.11	96.85	215.23	0.00	215.25	106.27		
Avg	1,266.47	5.62	99.38	224.07	0.02	224.09	107.70		
Max	1,427.09	6.18	100.81	231.13	0.04	231.14	109.36		


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow:Power Ratio
Friday, Feb 25, 2022

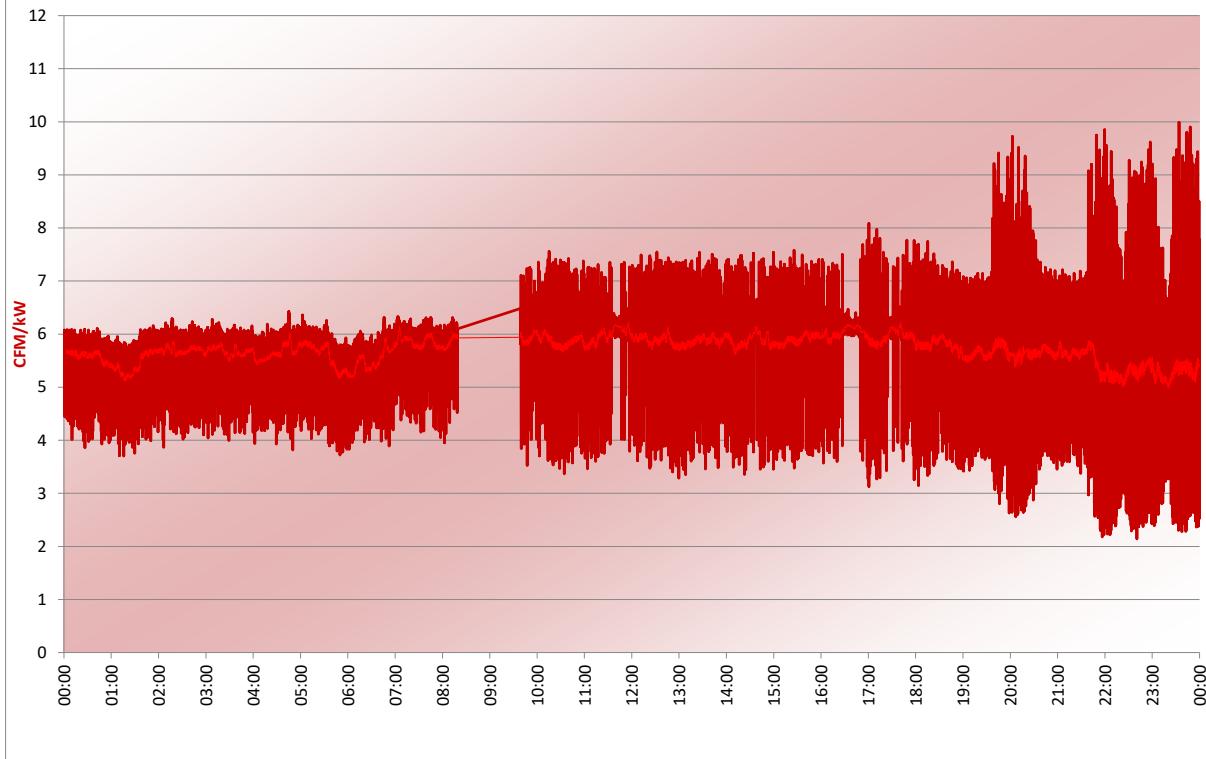


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor and Flow
Friday, Feb 25, 2022

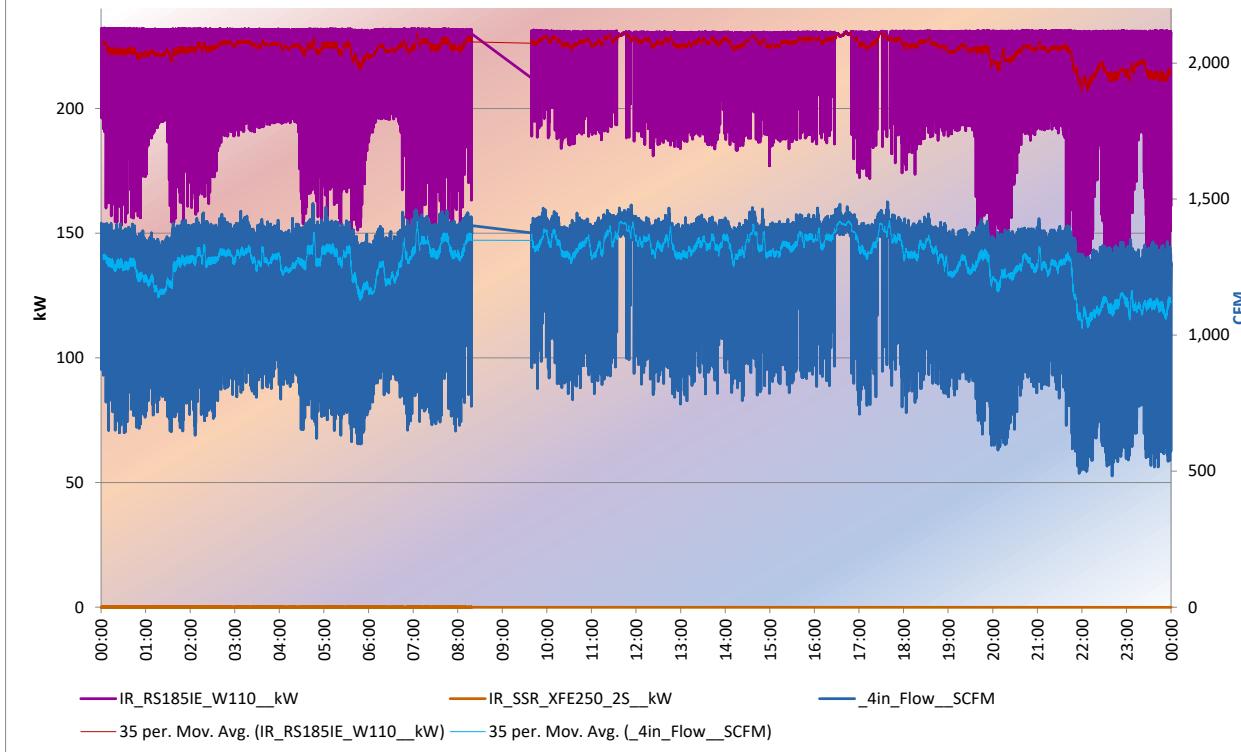


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor
Friday, Feb 25, 2022

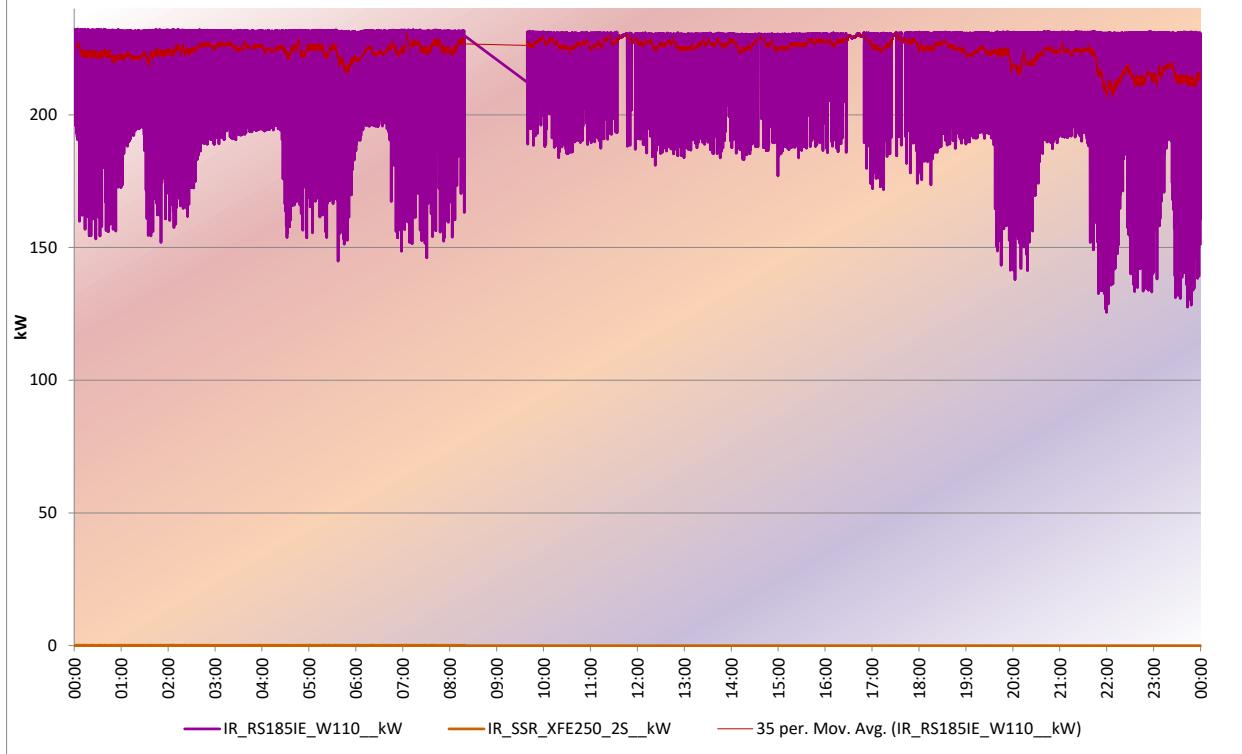


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow & Pressure
Friday, Feb 25, 2022

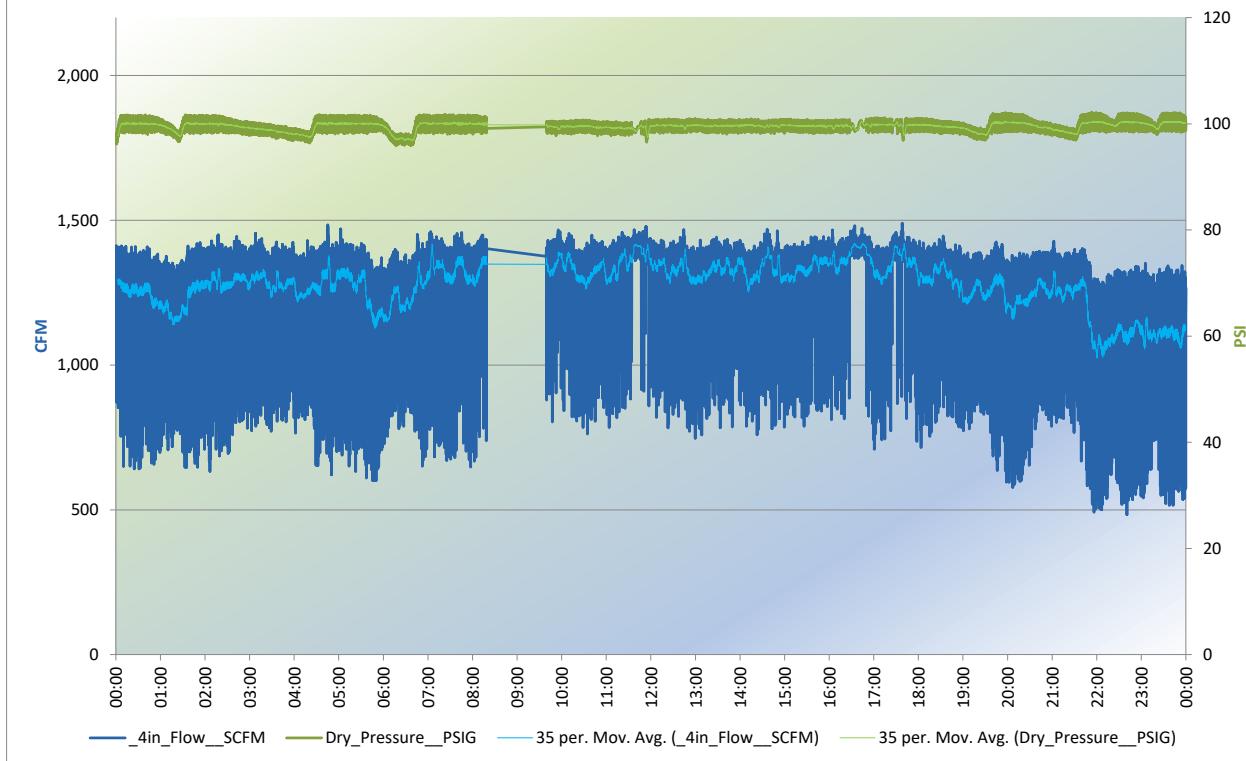


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Pressure by Location
Friday, Feb 25, 2022

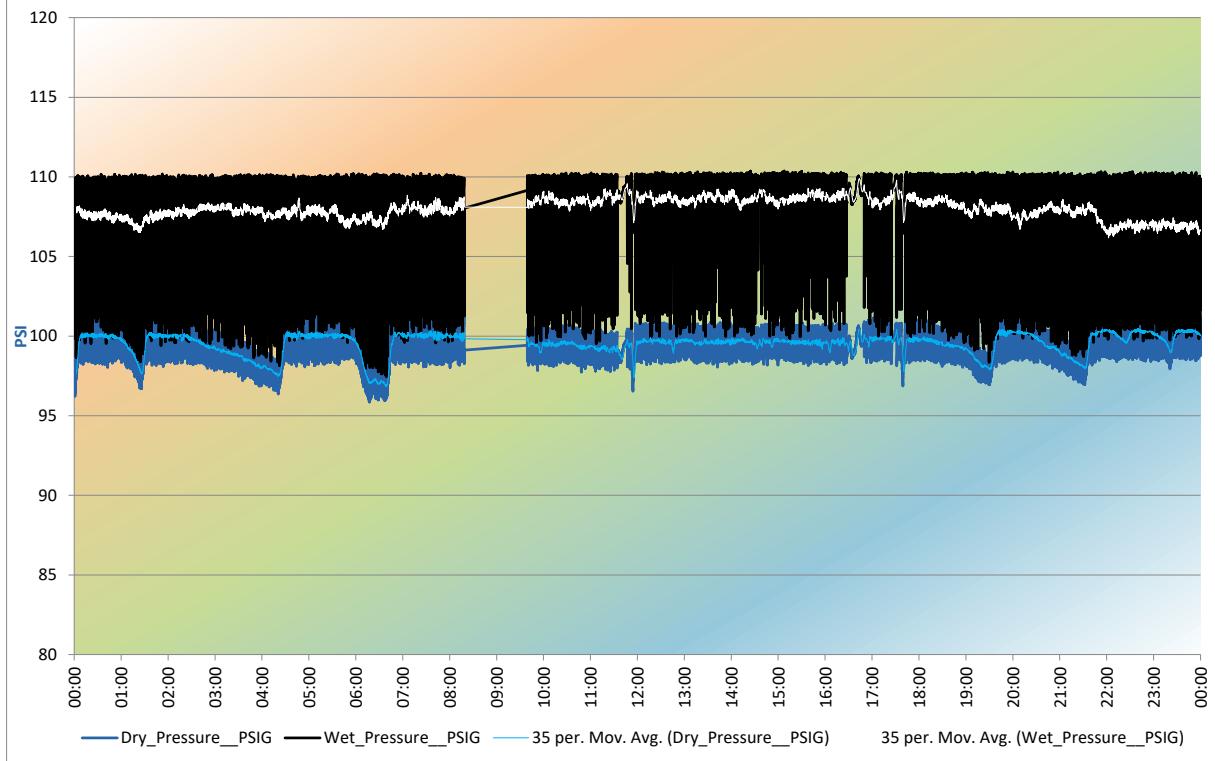

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power, Flow & Pressure
Saturday, Feb 26, 2022

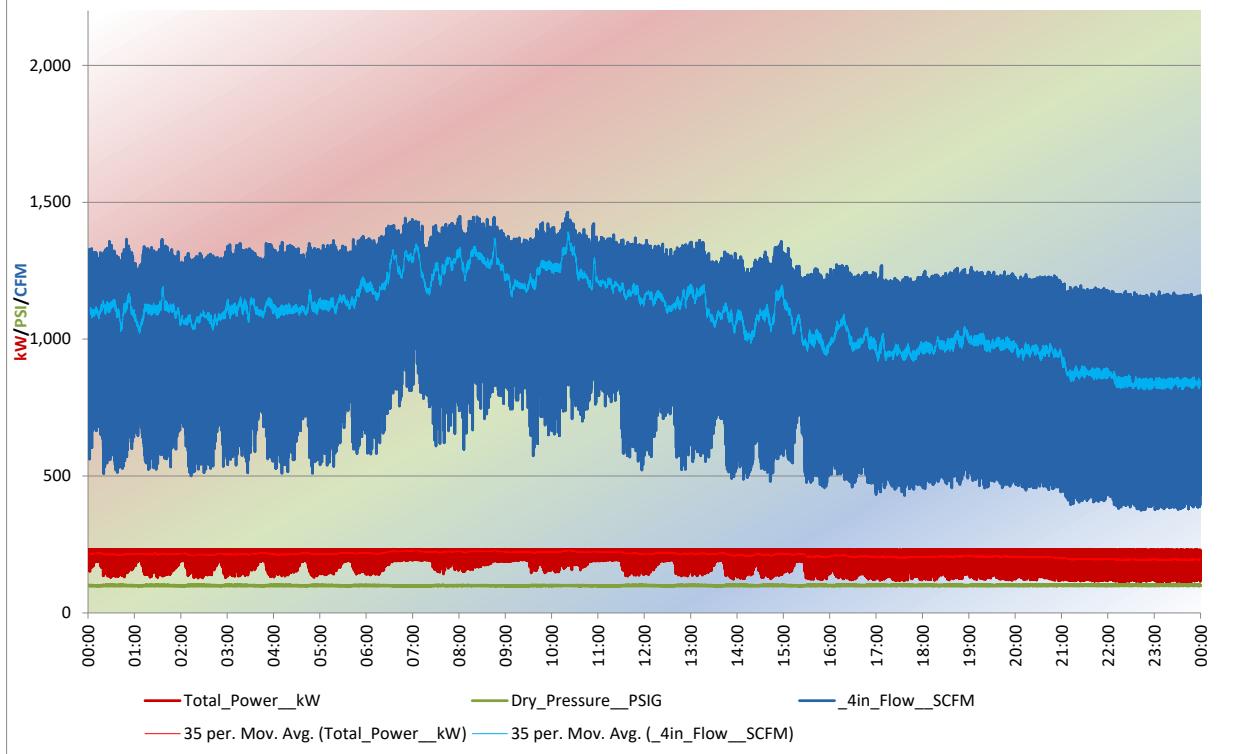


Saturday, 2/26/2022									
First (1st) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSI	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSI		
Min	890.07	4.51	97.81	197.98	0.00	197.98	105.11		
Avg	1,163.26	5.43	99.75	217.87	0.00	217.87	107.20		
Max	1,425.49	6.19	100.70	230.92	0.00	230.92	108.76		
Second (2nd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSI	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSI		
Min	773.36	4.16	99.88	186.14	0.00	186.14	104.91		
Avg	930.56	4.86	100.50	201.45	0.00	201.45	106.13		
Max	1,078.81	5.57	100.97	215.35	0.00	215.35	107.41		
Third (3rd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSI	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSI		
Min	987.62	4.77	98.09	203.49	0.00	203.49	106.07		
Avg	1,143.45	5.37	99.84	217.03	0.00	217.03	107.09		
Max	1,381.98	6.06	100.48	231.13	0.00	231.13	108.73		

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow:Power Ratio
Saturday, Feb 26, 2022

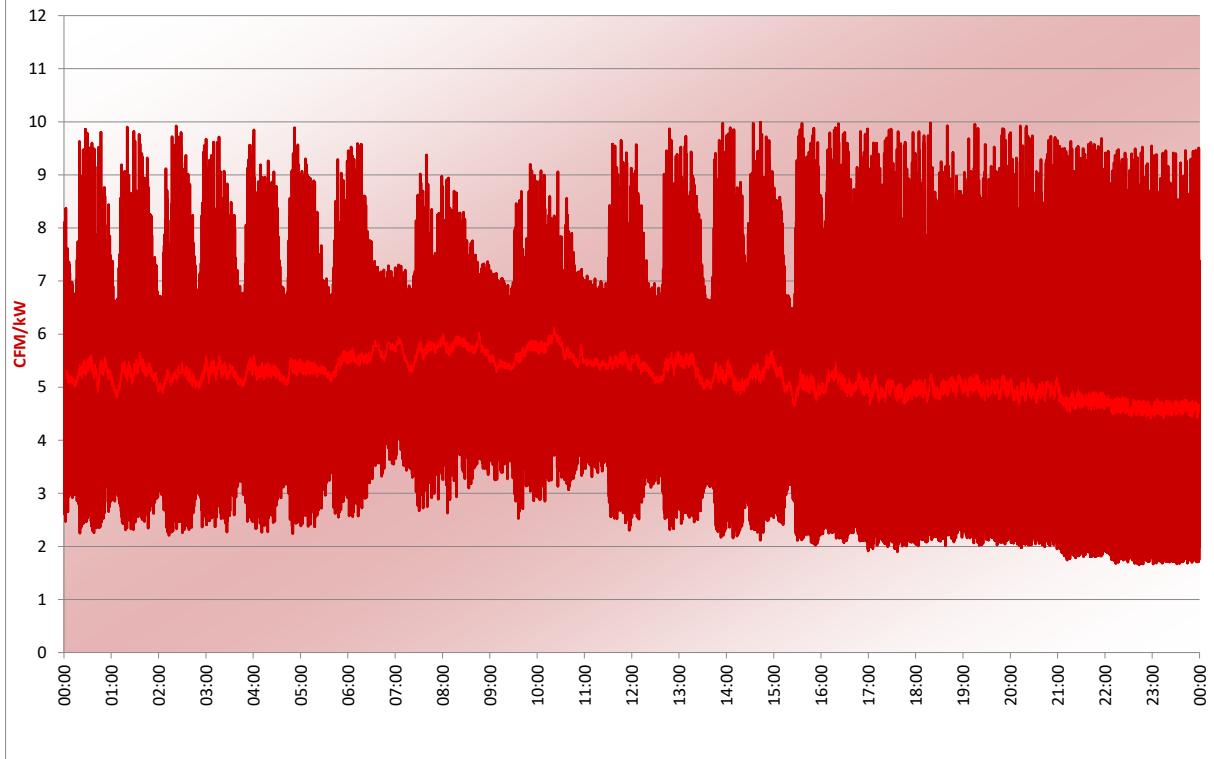


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor and Flow
Saturday, Feb 26, 2022

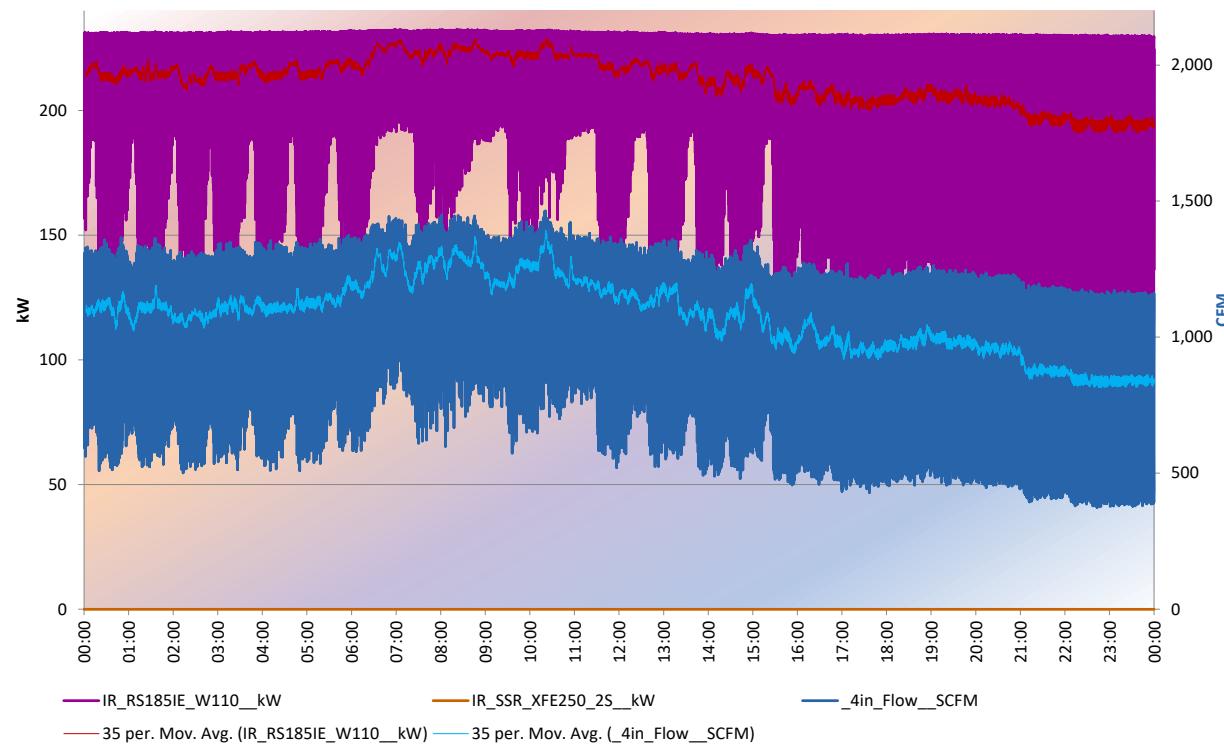


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor
Saturday, Feb 26, 2022

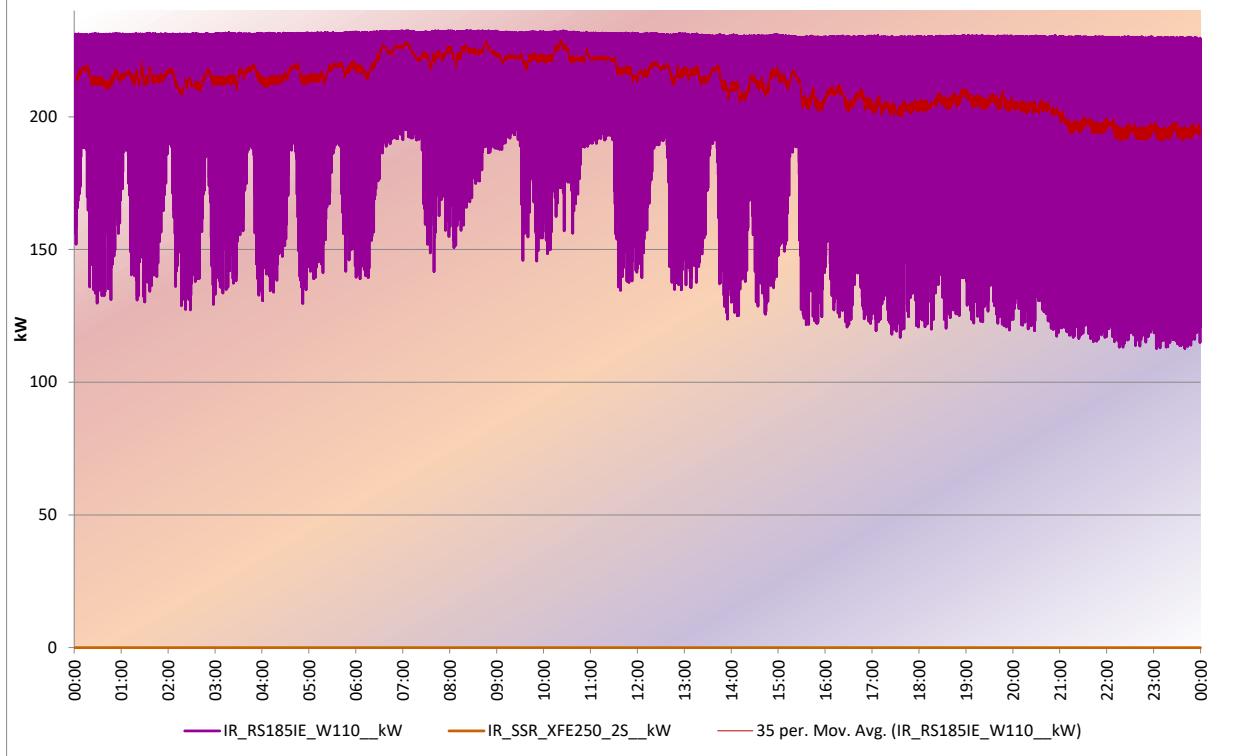


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow & Pressure
Saturday, Feb 26, 2022

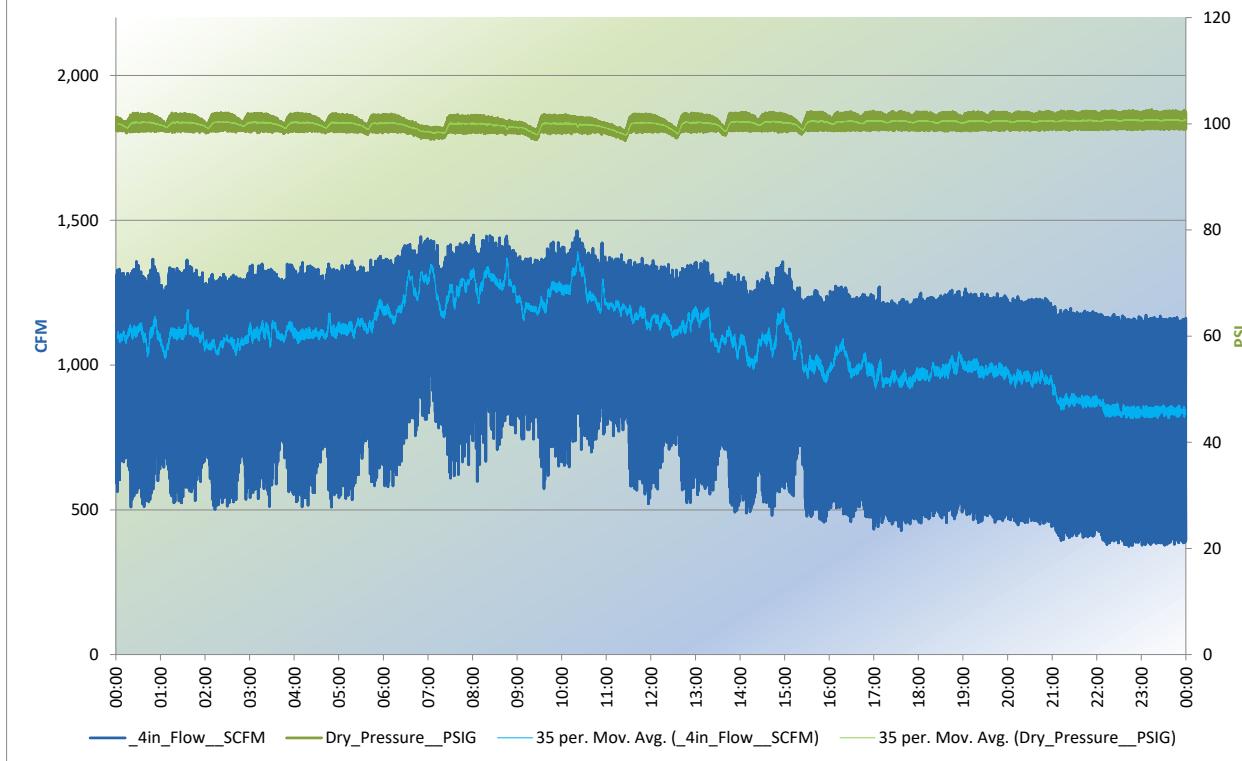


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Pressure by Location
Saturday, Feb 26, 2022

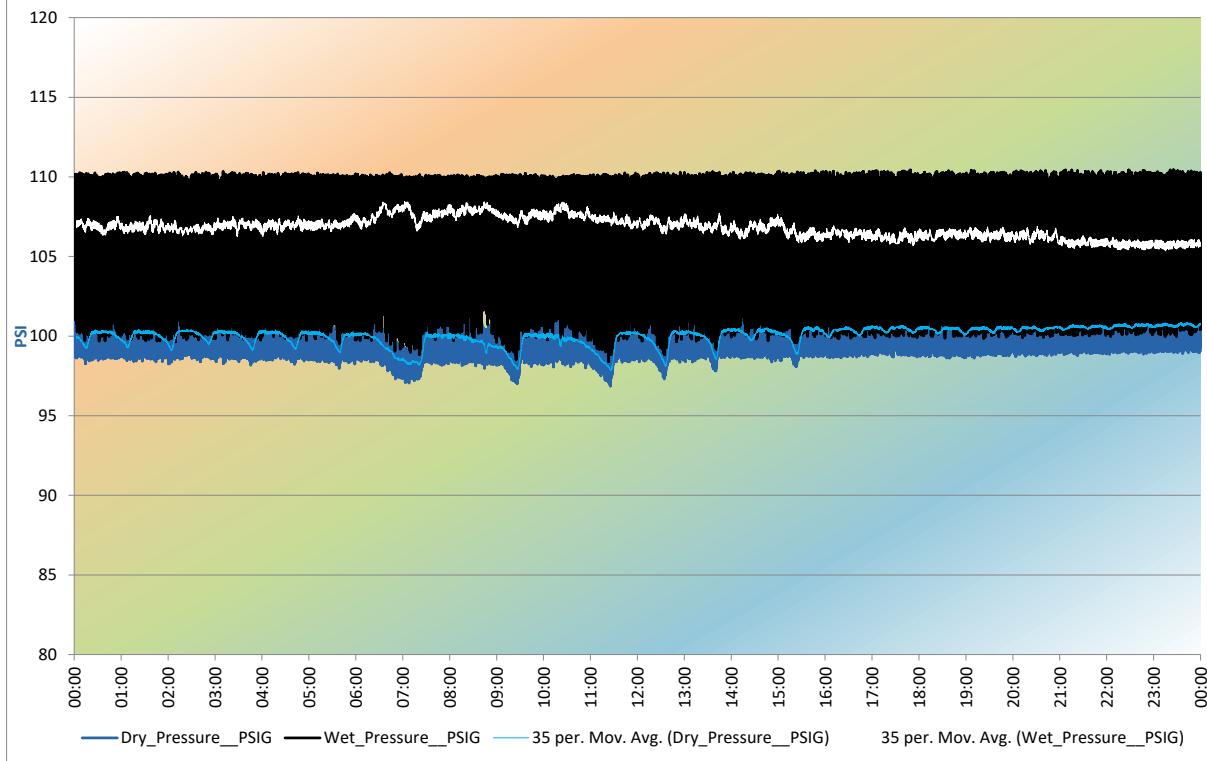

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power, Flow & Pressure
Sunday, Feb 27, 2022

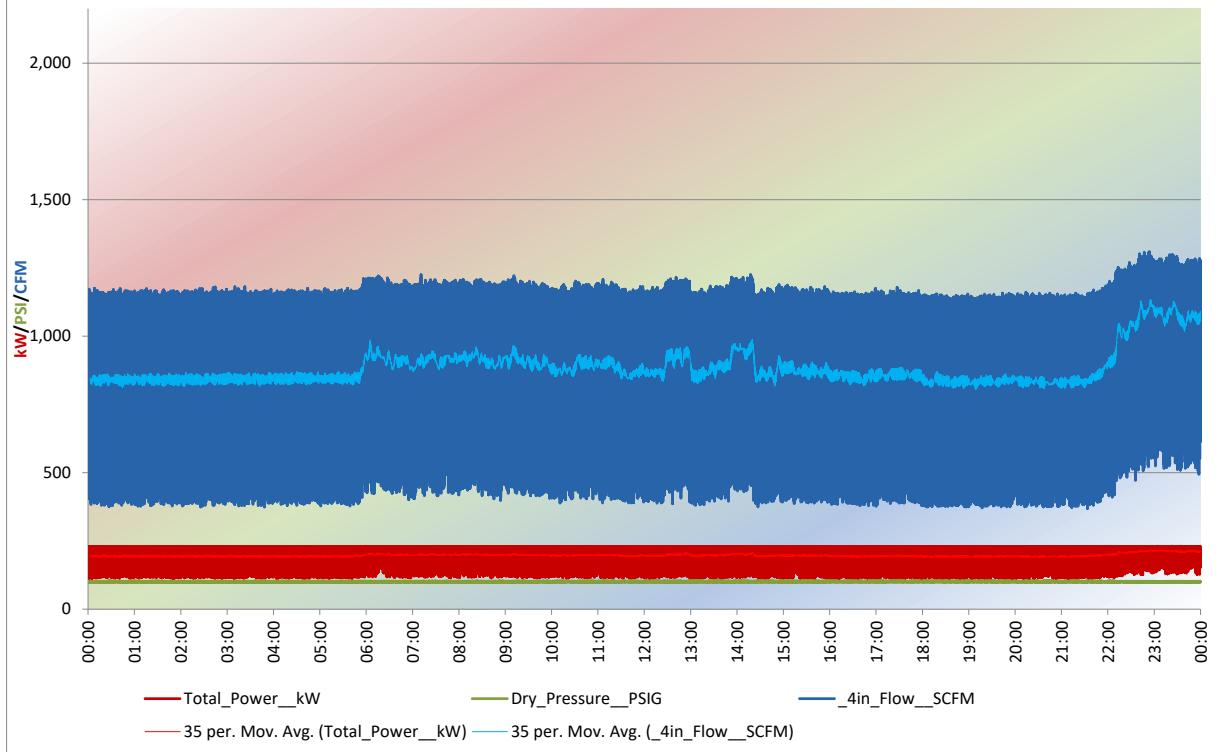

Sunday, 2/27/2022									
First (1st) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	775.69	4.23	100.38	184.35	0.00	184.35	105.13		
Avg	892.19	4.77	100.83	197.52	0.00	197.52	106.20		
Max	999.56	5.54	101.22	207.28	0.00	207.28	107.25		
Second (2nd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	761.39	4.18	100.01	182.65	0.00	182.65	105.00		
Avg	895.34	4.75	100.84	197.75	0.00	197.75	106.22		
Max	1,185.66	5.69	101.28	219.93	0.00	219.93	108.03		
Third (3rd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	772.14	4.15	100.29	184.99	0.00	184.99	104.84		
Avg	861.65	4.69	100.70	195.57	0.00	195.57	105.91		
Max	1,012.67	5.64	101.00	207.32	0.00	207.32	107.28		


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow:Power Ratio
Sunday, Feb 27, 2022

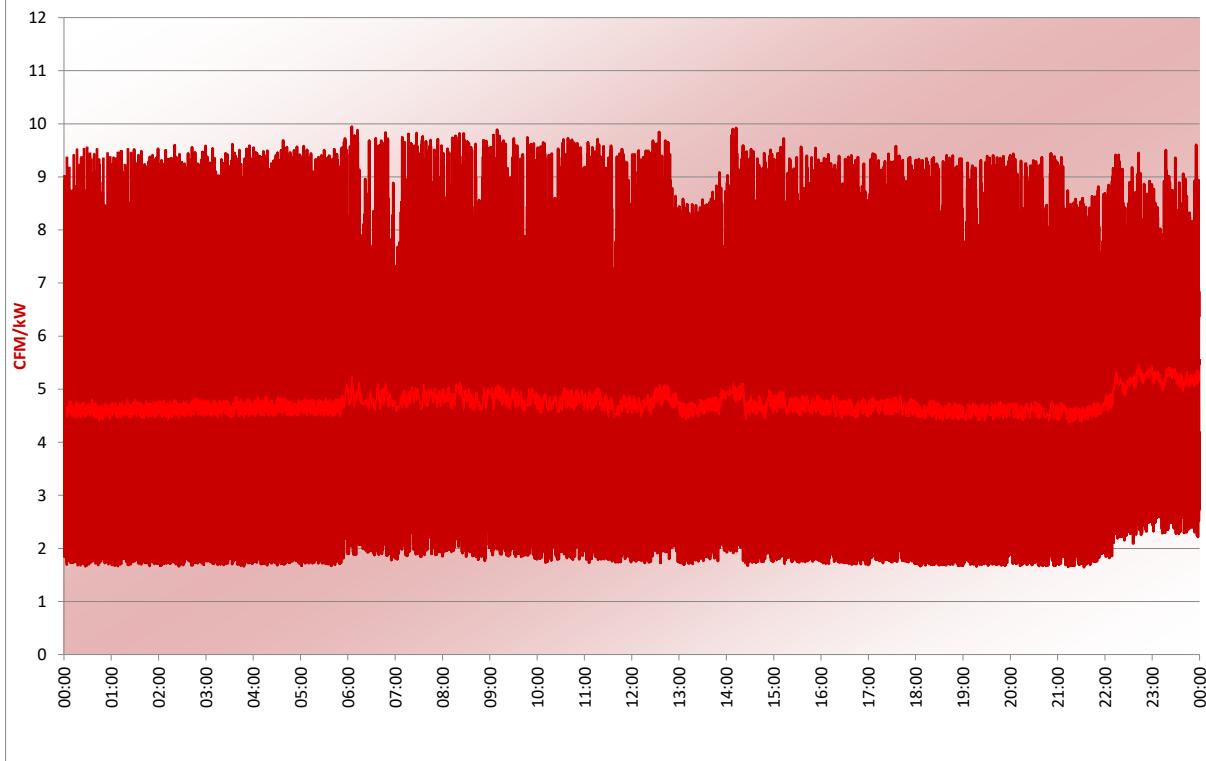


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor and Flow
Sunday, Feb 27, 2022

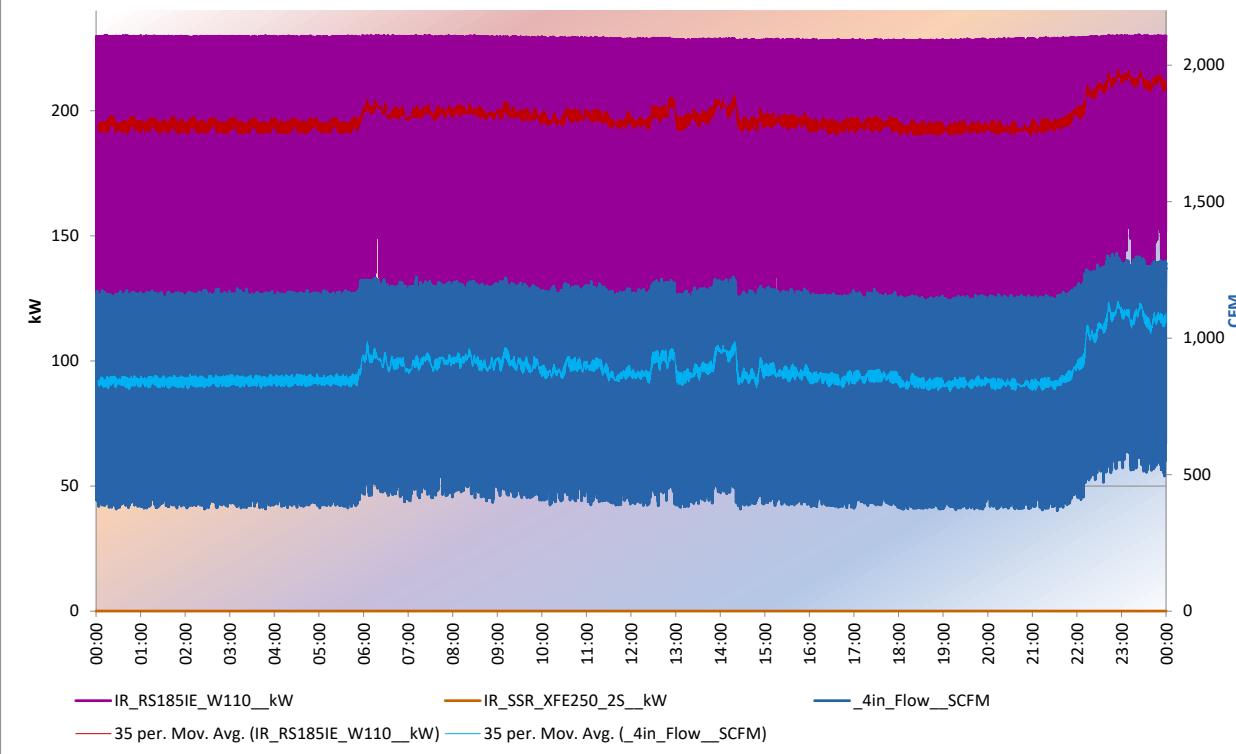


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor
Sunday, Feb 27, 2022

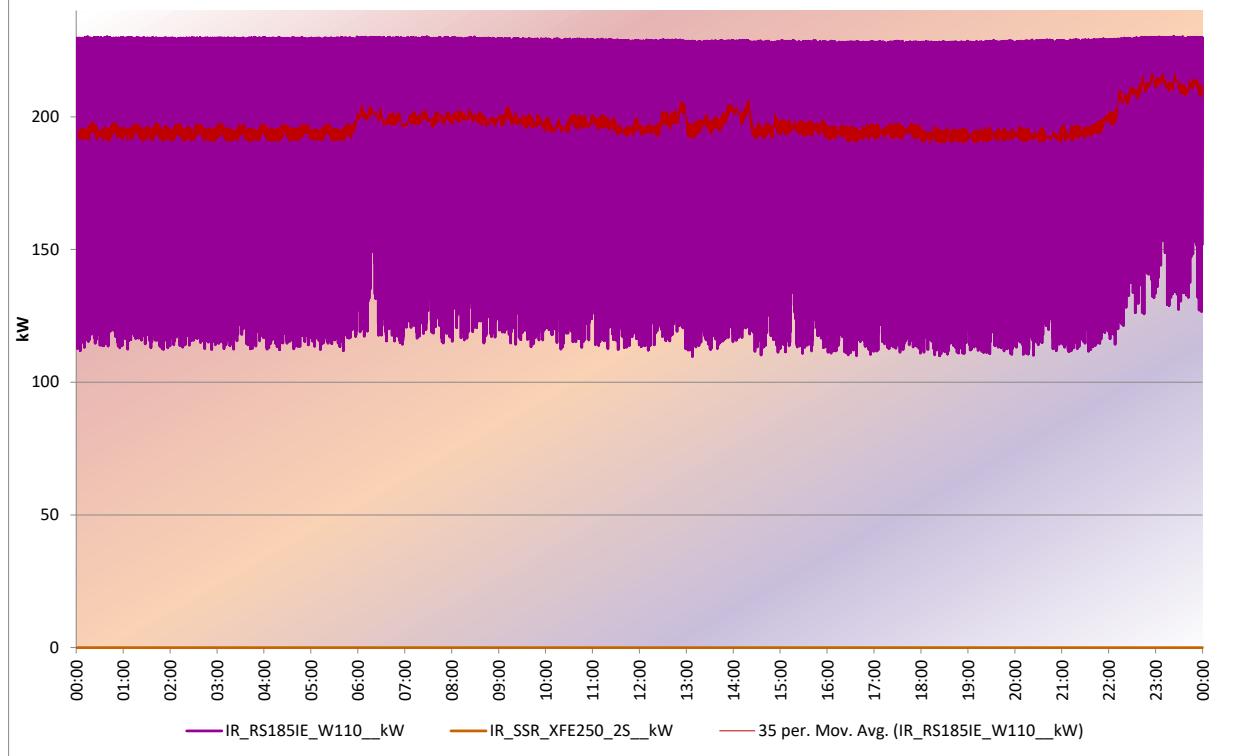


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow & Pressure
Sunday, Feb 27, 2022

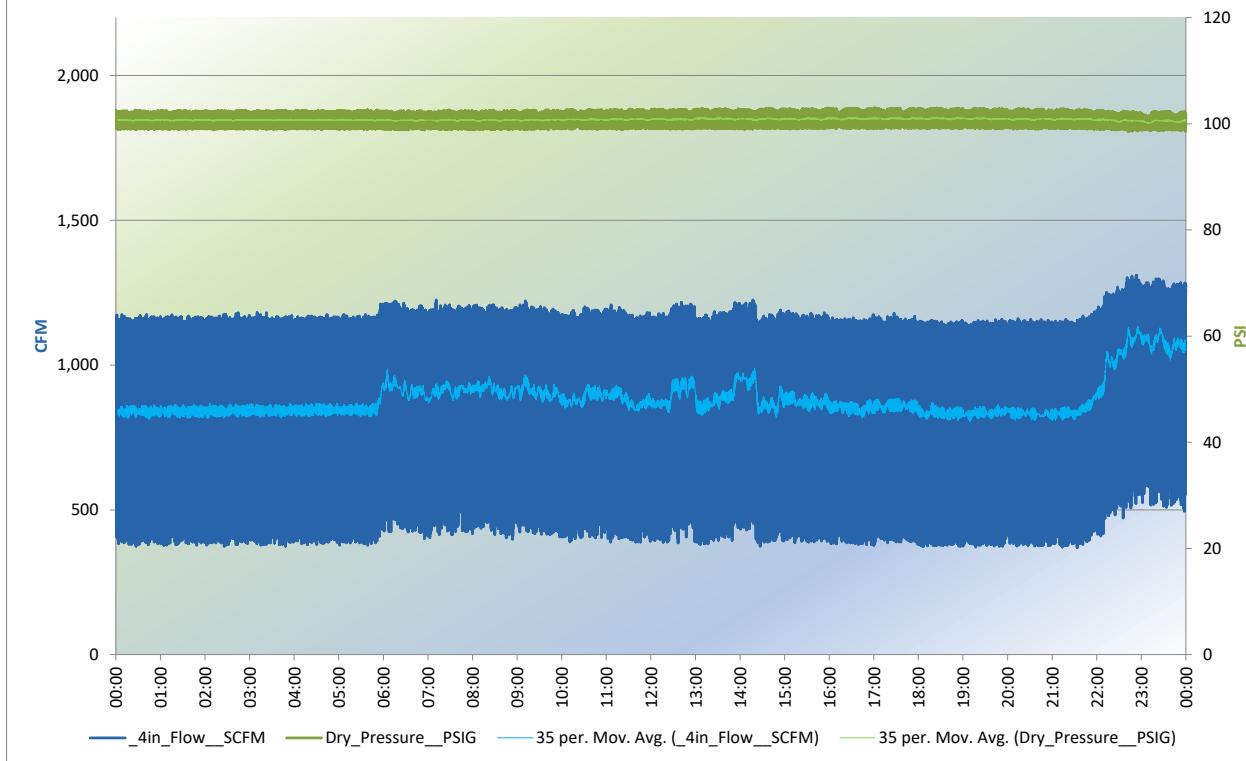


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Pressure by Location
Sunday, Feb 27, 2022

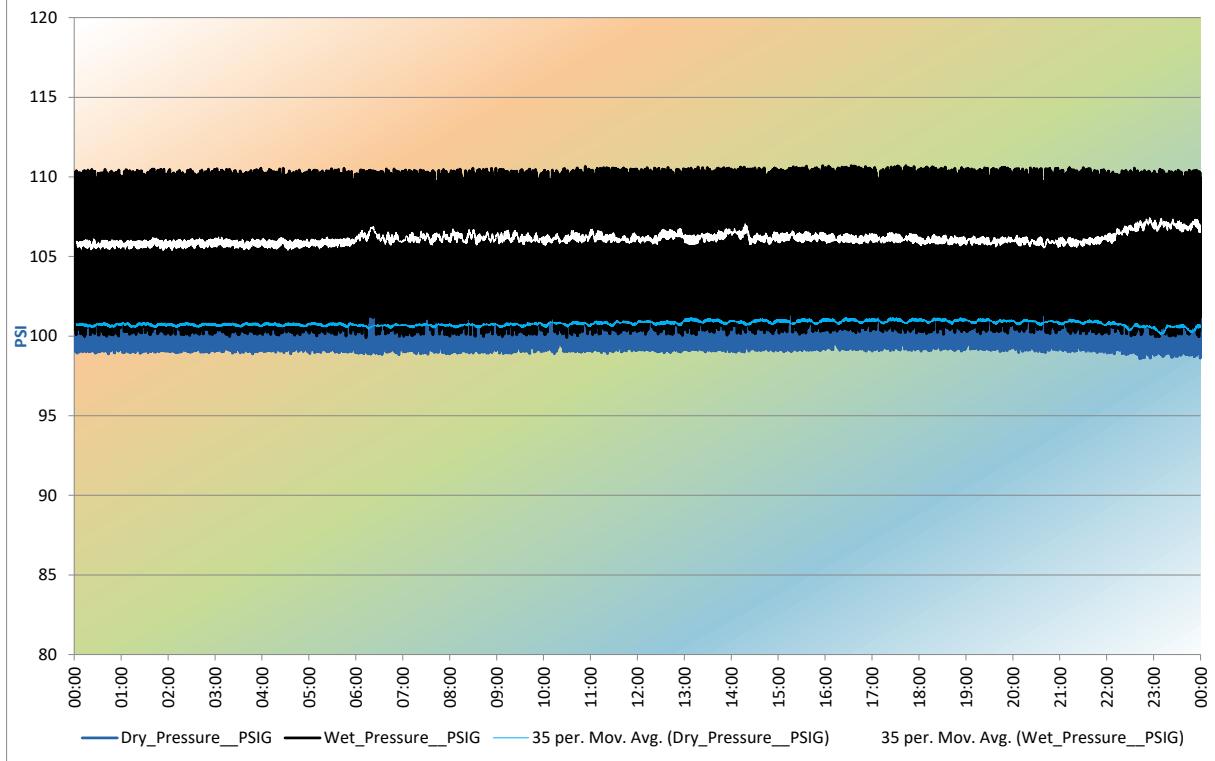

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power, Flow & Pressure
Monday, Feb 28, 2022

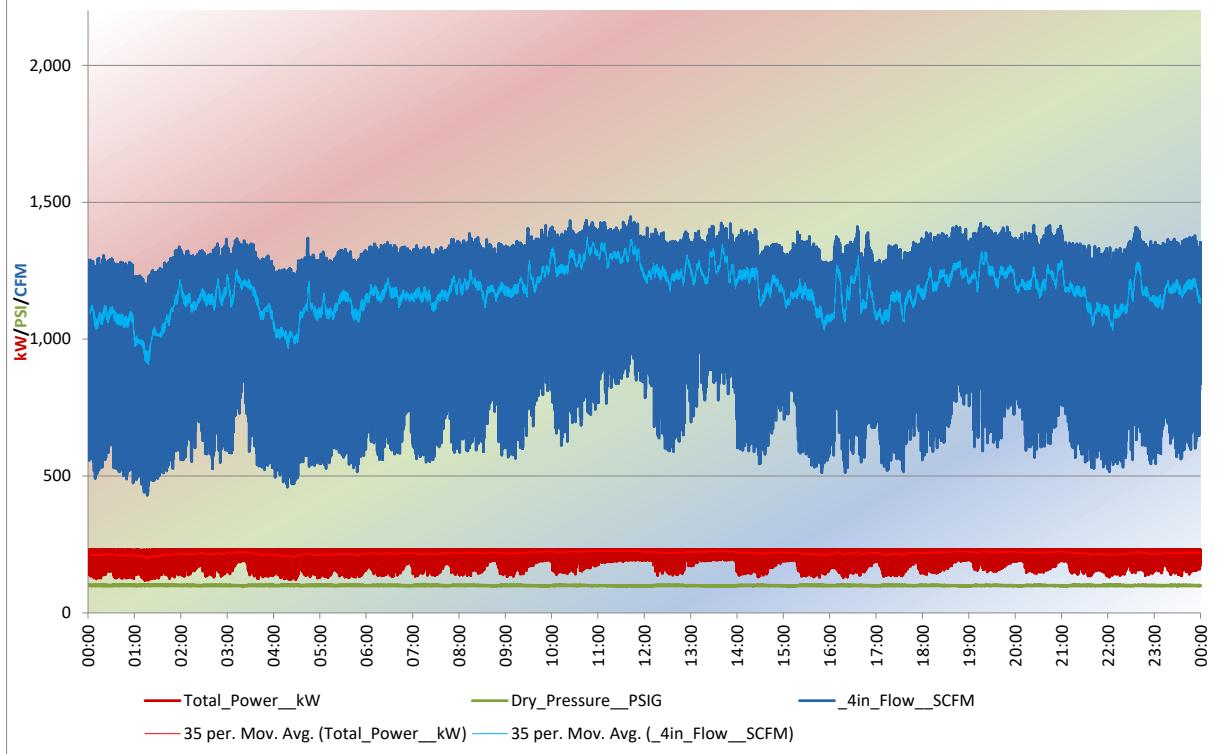


Monday, 2/28/2022									
First (1st) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,040.87	5.01	97.33	207.35	0.00	207.35	106.08		
Avg	1,228.93	5.62	99.66	221.17	0.00	221.17	107.66		
Max	1,397.17	6.15	100.65	230.85	0.00	230.85	109.23		
Second (2nd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,015.78	4.85	98.45	204.10	0.00	204.10	105.94		
Avg	1,180.51	5.47	100.01	218.82	0.00	218.82	107.28		
Max	1,358.09	6.00	100.73	230.34	0.00	230.34	108.82		
Third (3rd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	891.83	4.55	99.12	195.80	0.00	195.80	105.52		
Avg	1,116.84	5.33	100.32	214.22	0.00	214.22	107.13		
Max	1,282.14	5.89	100.93	224.71	0.00	224.71	108.43		

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow:Power Ratio
Monday, Feb 28, 2022

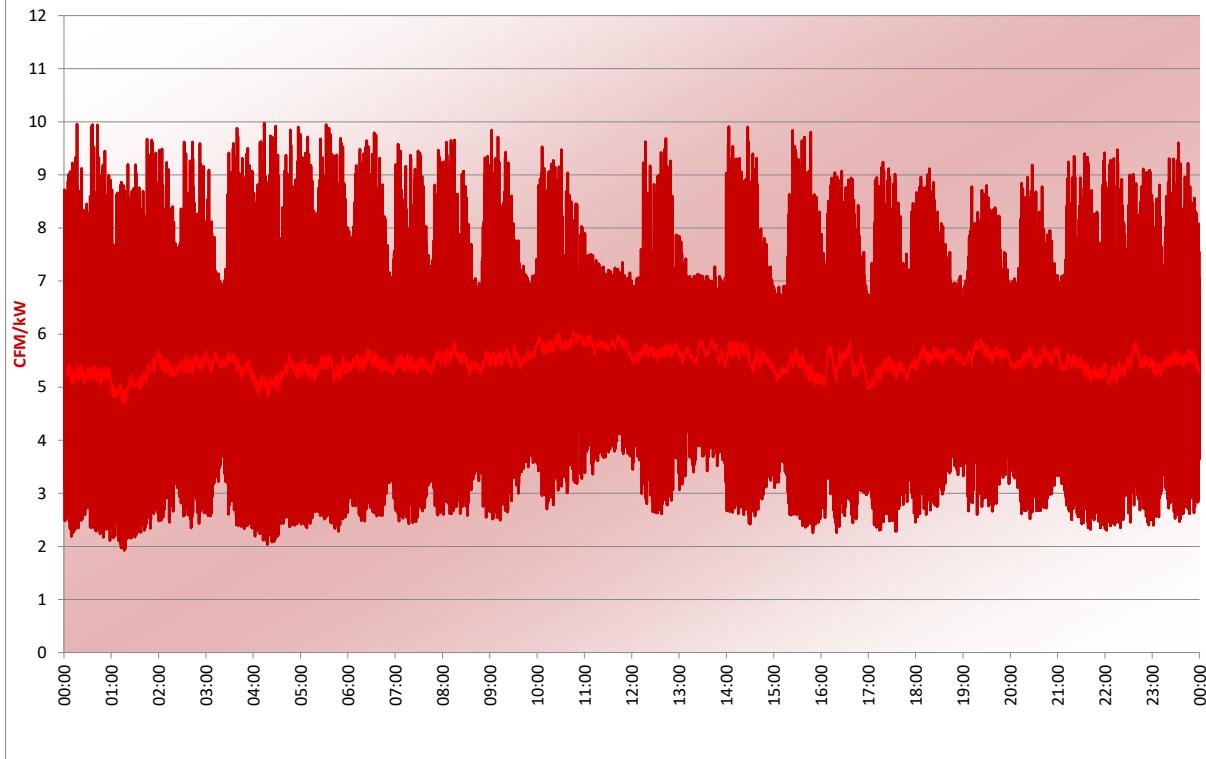

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor and Flow
Monday, Feb 28, 2022

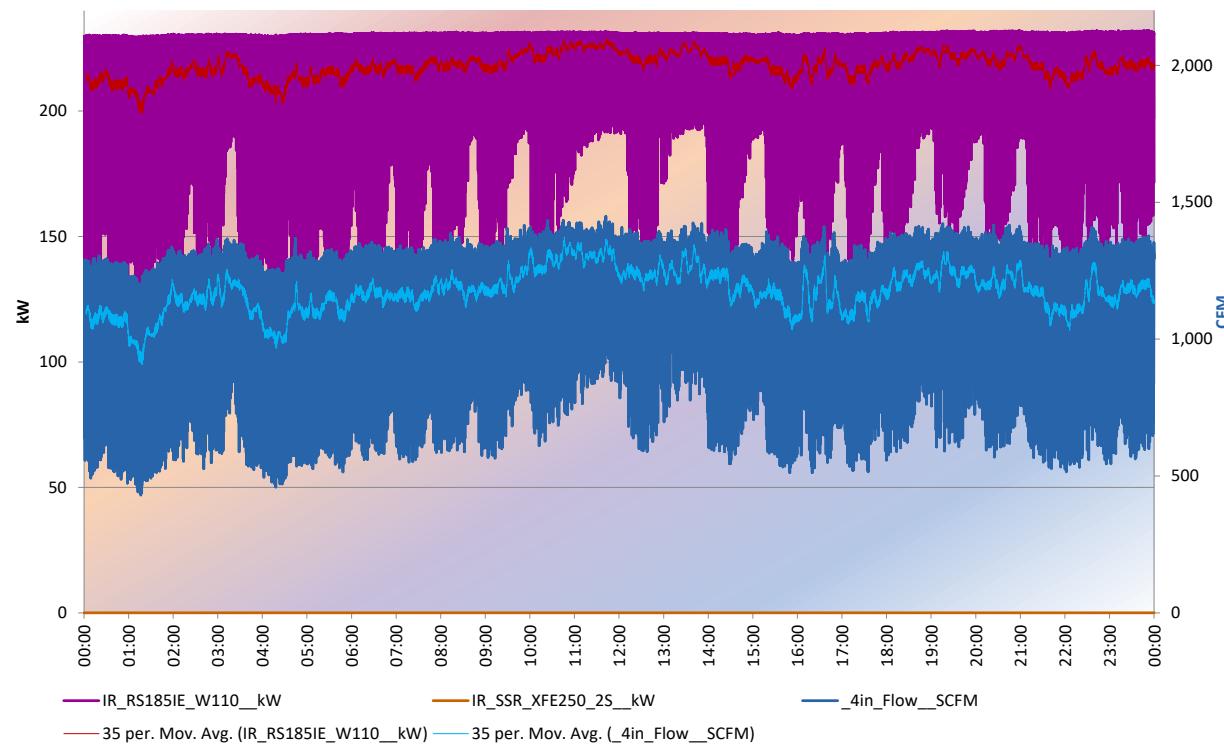


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor
Monday, Feb 28, 2022

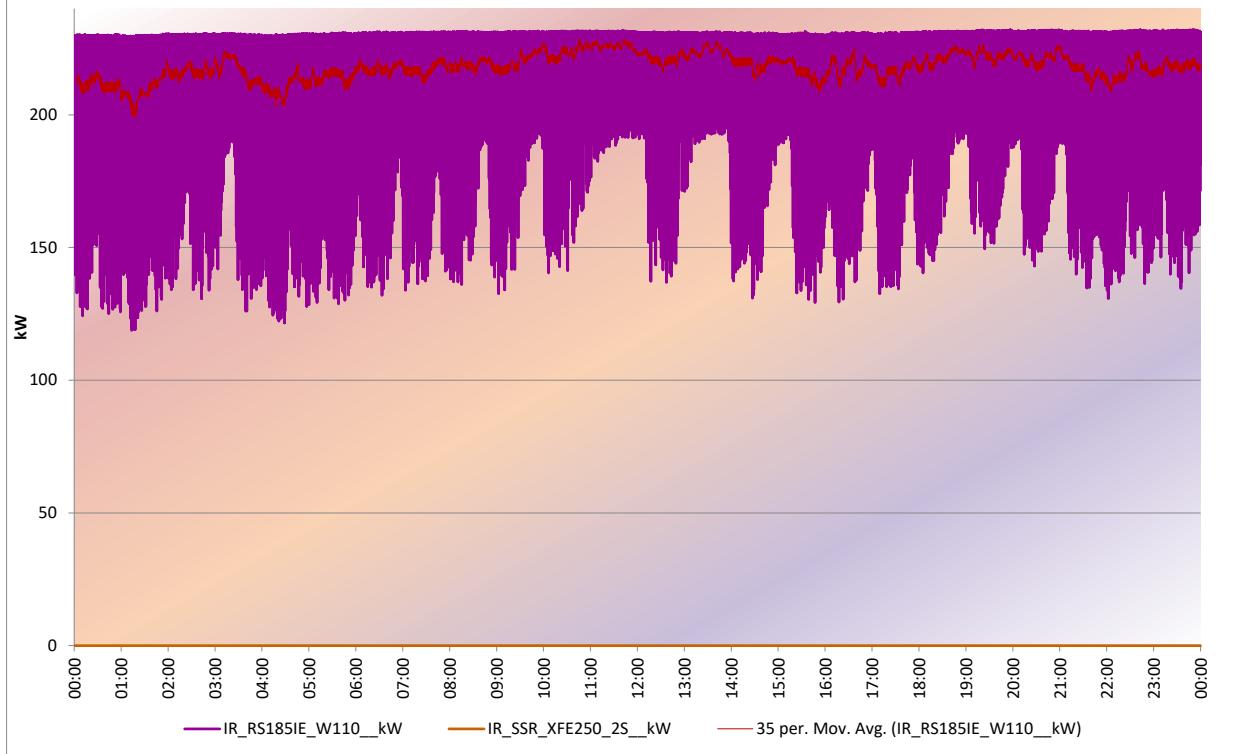


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow & Pressure
Monday, Feb 28, 2022

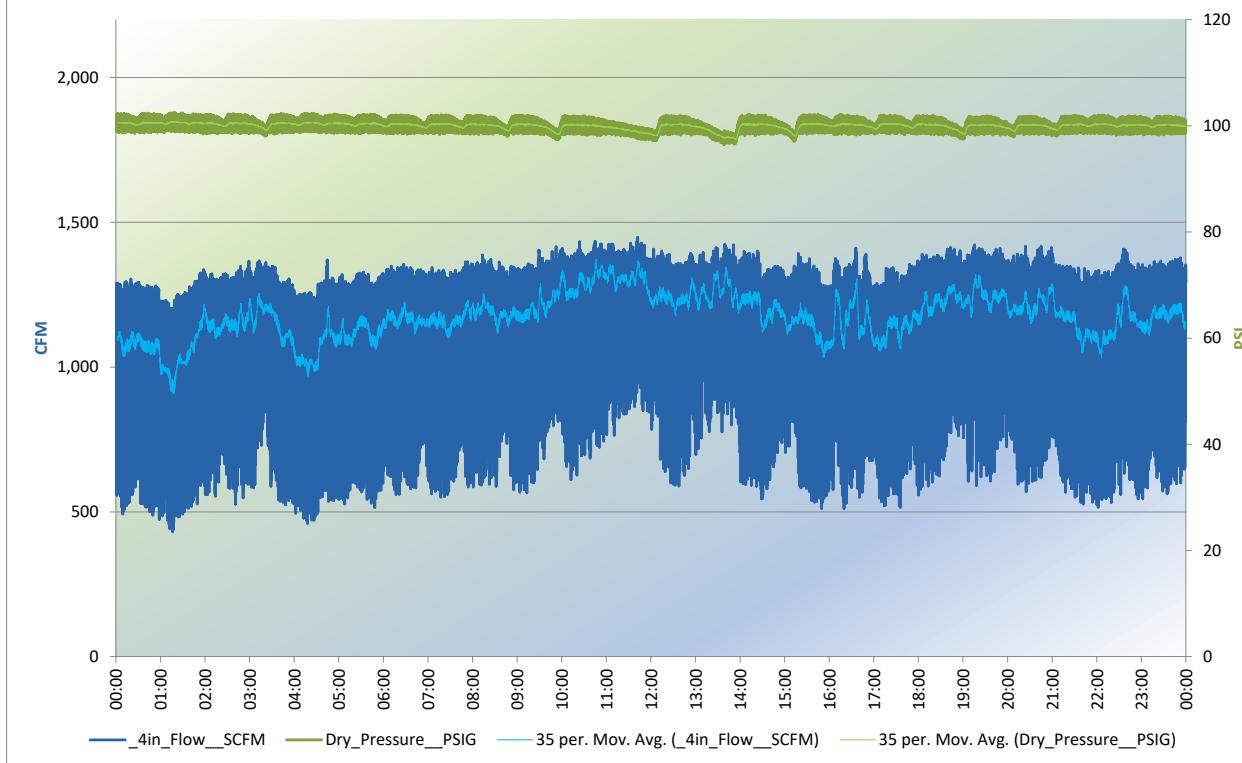


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Pressure by Location
Monday, Feb 28, 2022

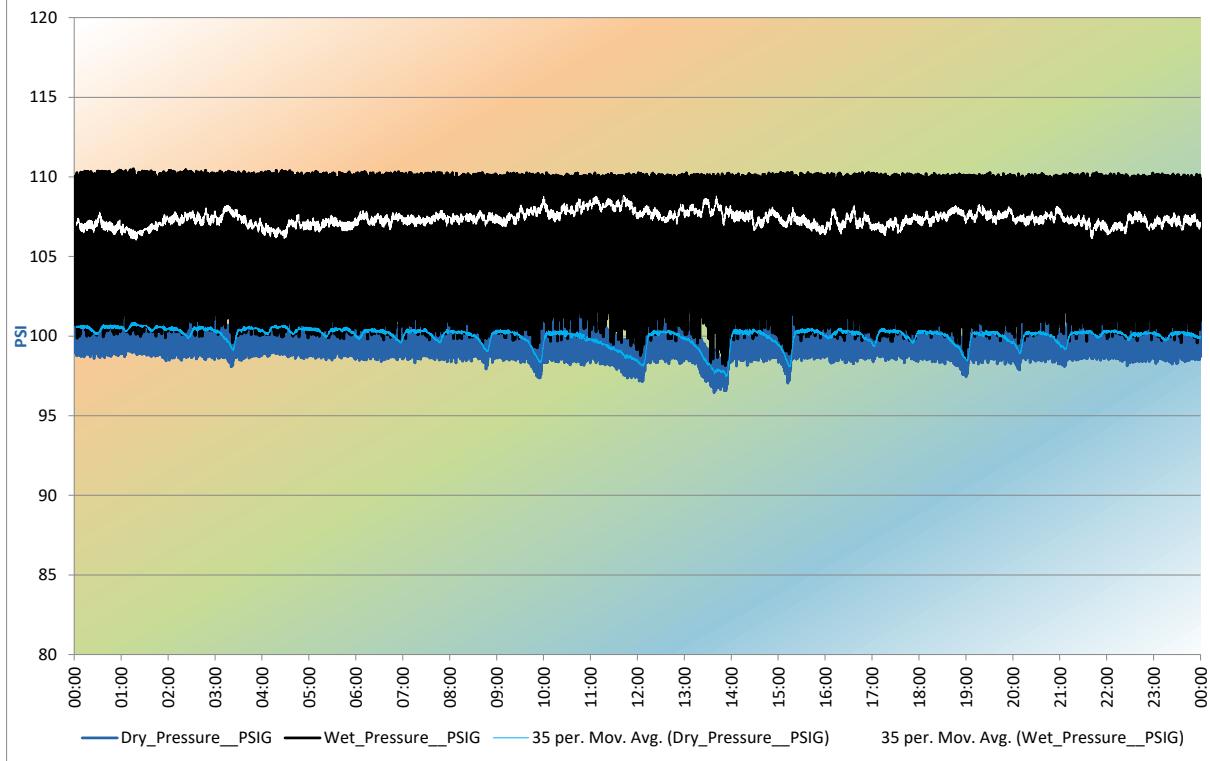

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power, Flow & Pressure
Tuesday, Mar 01, 2022

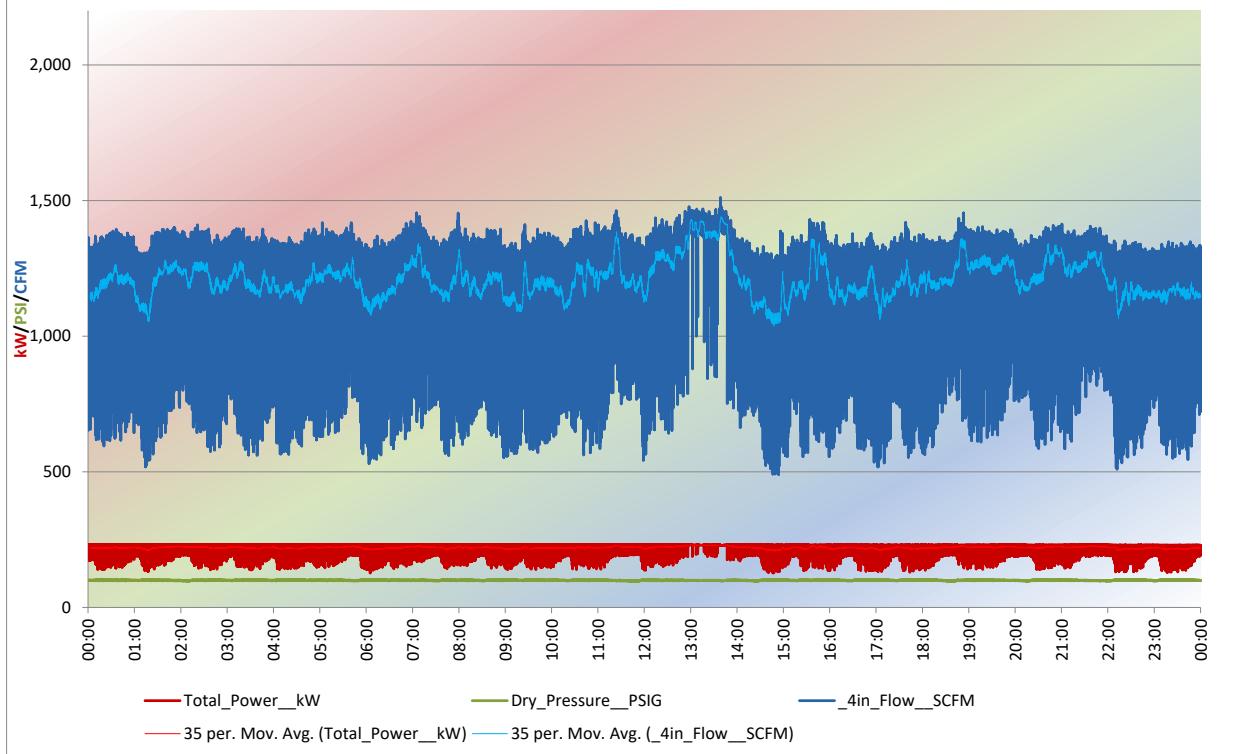


Tuesday, 3/1/2022									
First (1st) Shift									
Statistics	_4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	1,048.96	4.95	97.51	208.69	0.00	208.69	106.27		
Avg	1,222.67	5.58	99.78	221.30	0.00	221.30	107.54		
Max	1,449.38	6.31	100.66	231.34	0.00	231.34	109.73		
Second (2nd) Shift									
Statistics	_4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	1,052.08	4.90	97.61	208.50	0.00	208.50	106.19		
Avg	1,206.34	5.55	99.89	219.88	0.00	219.88	107.70		
Max	1,395.77	6.20	101.05	229.67	0.00	229.67	109.30		
Third (3rd) Shift									
Statistics	_4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	1,032.09	4.97	98.29	210.58	0.00	210.58	106.15		
Avg	1,198.58	5.51	99.89	220.27	0.00	220.27	107.31		
Max	1,328.91	6.01	100.46	227.89	0.00	227.89	108.54		

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow:Power Ratio
Tuesday, Mar 01, 2022

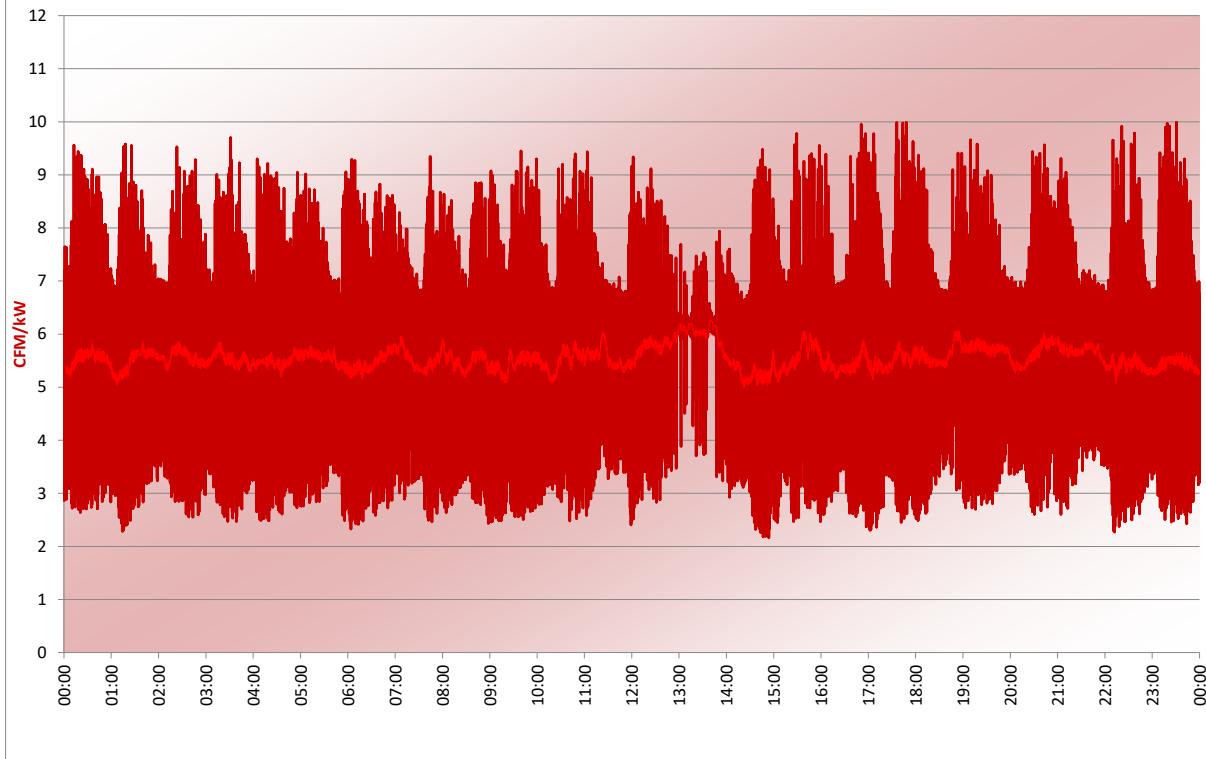


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor and Flow
Tuesday, Mar 01, 2022

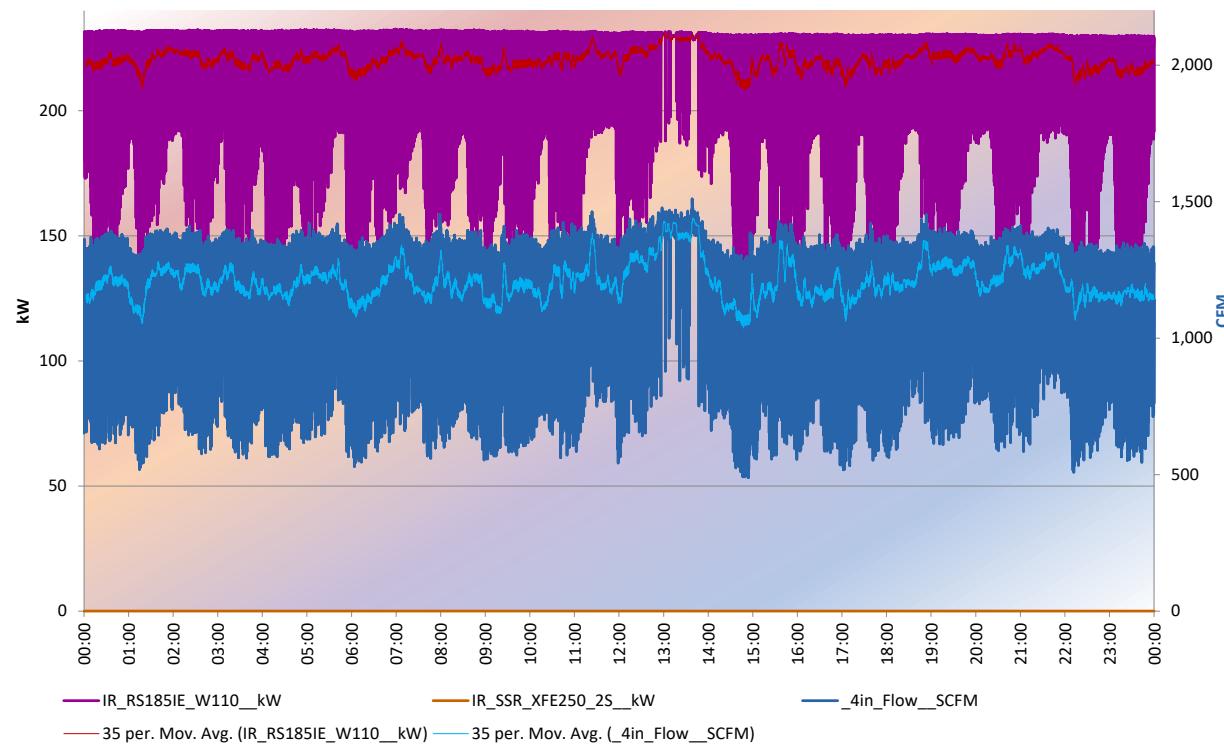


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor
Tuesday, Mar 01, 2022

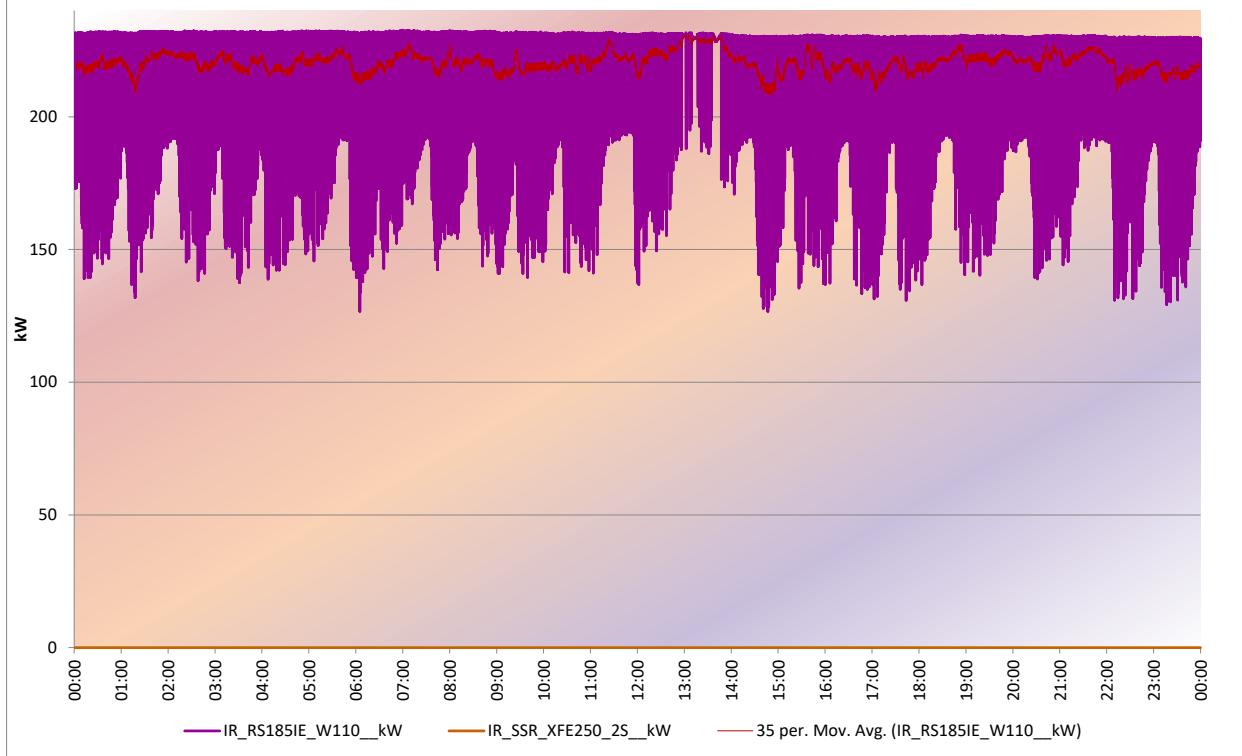


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow & Pressure
Tuesday, Mar 01, 2022

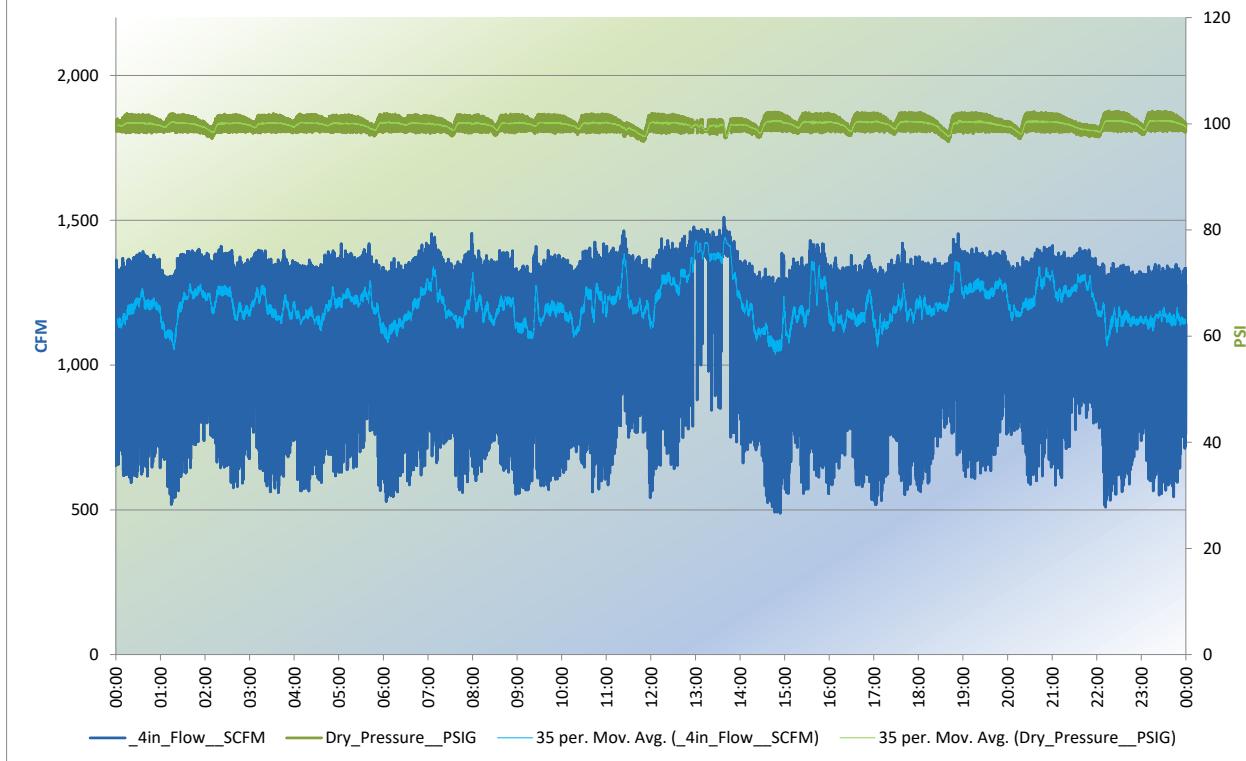


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Pressure by Location
Tuesday, Mar 01, 2022

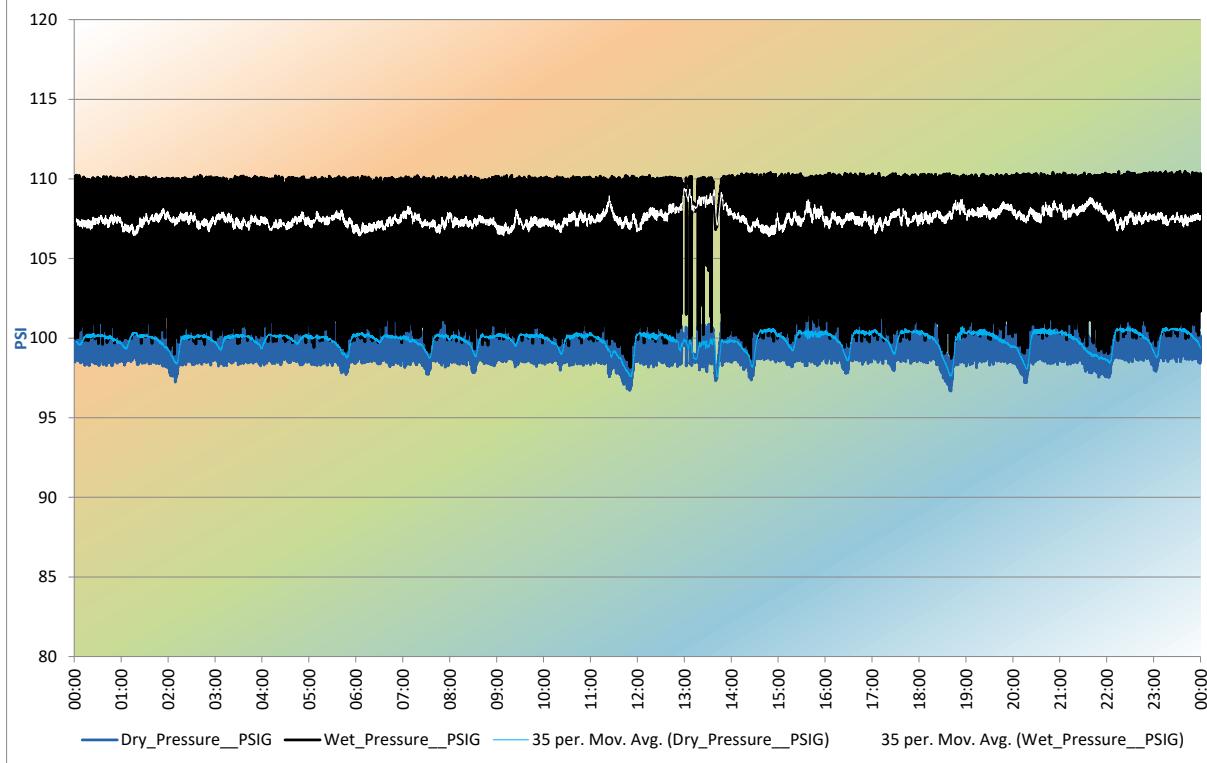

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power, Flow & Pressure
Wednesday, Mar 02, 2022

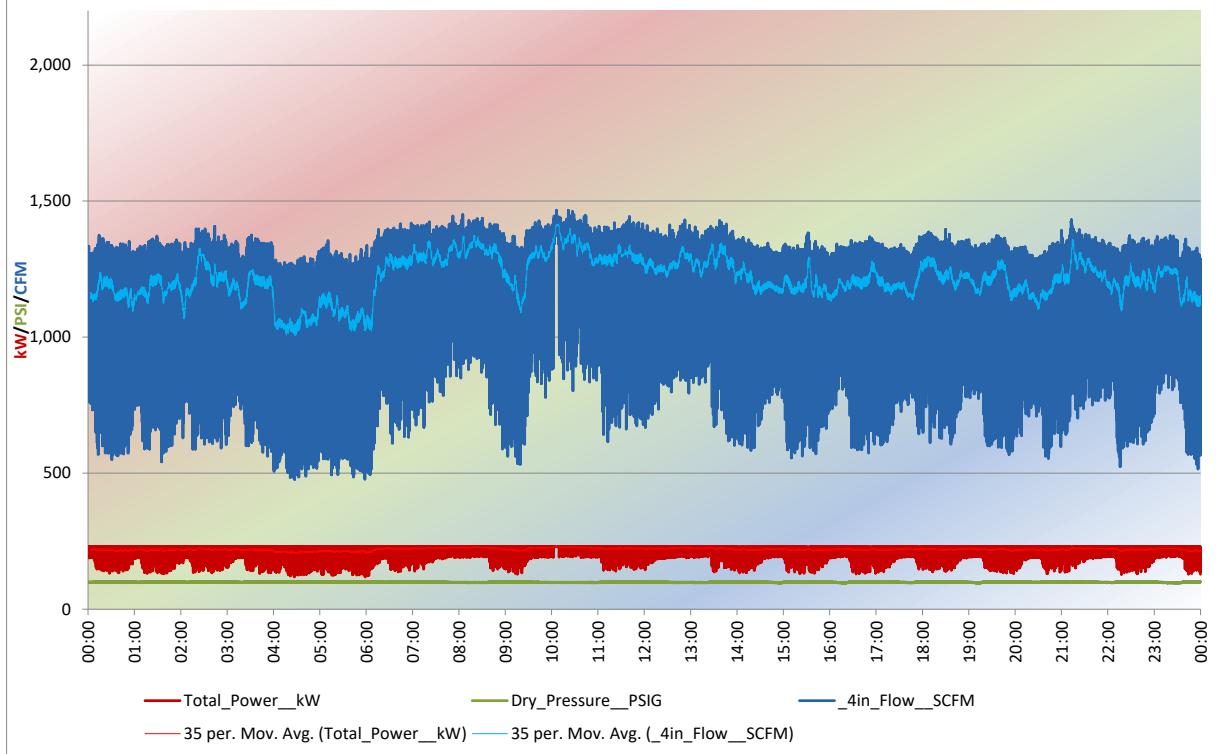

Wednesday, 3/2/2022									
First (1st) Shift									
Statistics	_4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	1,059.63	4.90	97.28	209.67	0.00	209.67	106.55		
Avg	1,265.89	5.71	99.54	222.96	0.00	222.96	108.12		
Max	1,417.92	6.23	101.62	230.37	0.00	230.37	109.81		
Second (2nd) Shift									
Statistics	_4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	1,064.88	5.00	96.84	208.88	0.00	208.88	106.20		
Avg	1,207.02	5.54	99.70	220.09	0.00	220.09	107.68		
Max	1,393.02	6.14	100.93	228.97	0.00	228.97	109.33		
Third (3rd) Shift									
Statistics	_4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSiG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSiG		
Min	972.68	4.71	98.35	202.12	0.00	202.12	106.14		
Avg	1,180.12	5.49	100.20	217.89	0.00	217.89	107.61		
Max	1,383.65	6.17	100.96	229.65	0.00	229.65	109.54		


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow:Power Ratio
Wednesday, Mar 02, 2022

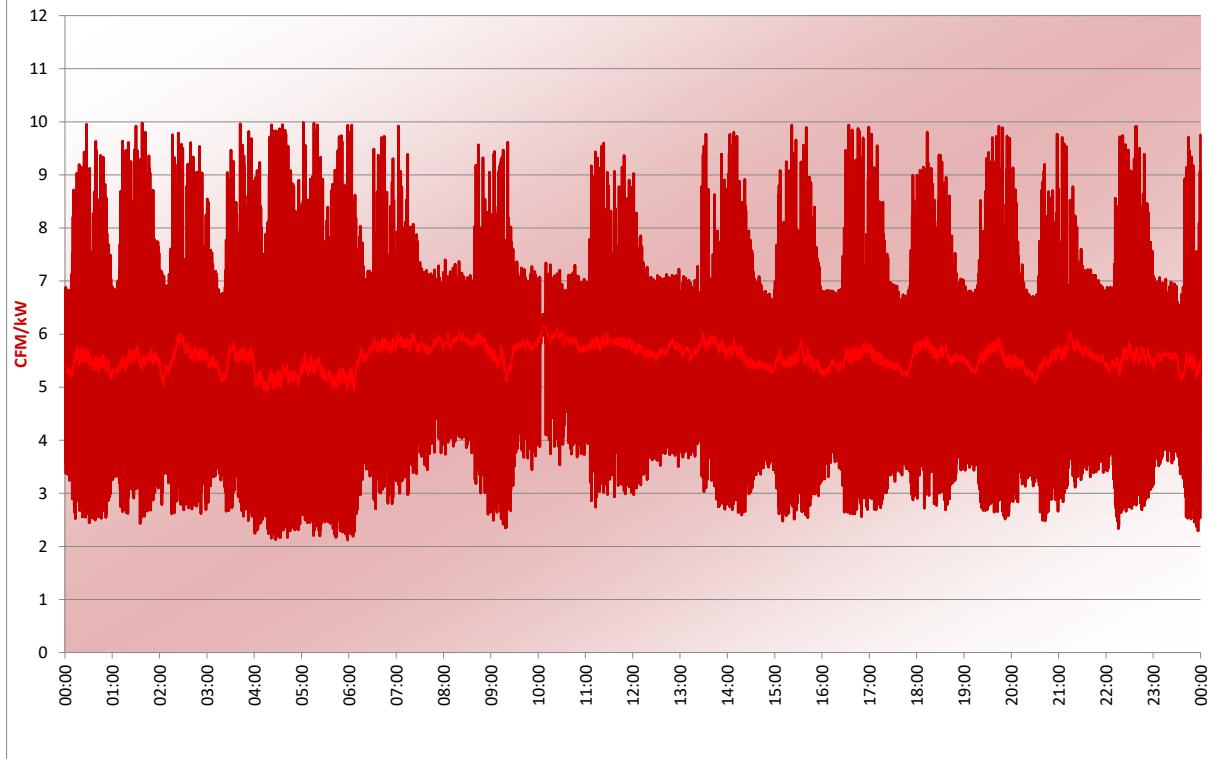


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor and Flow
Wednesday, Mar 02, 2022

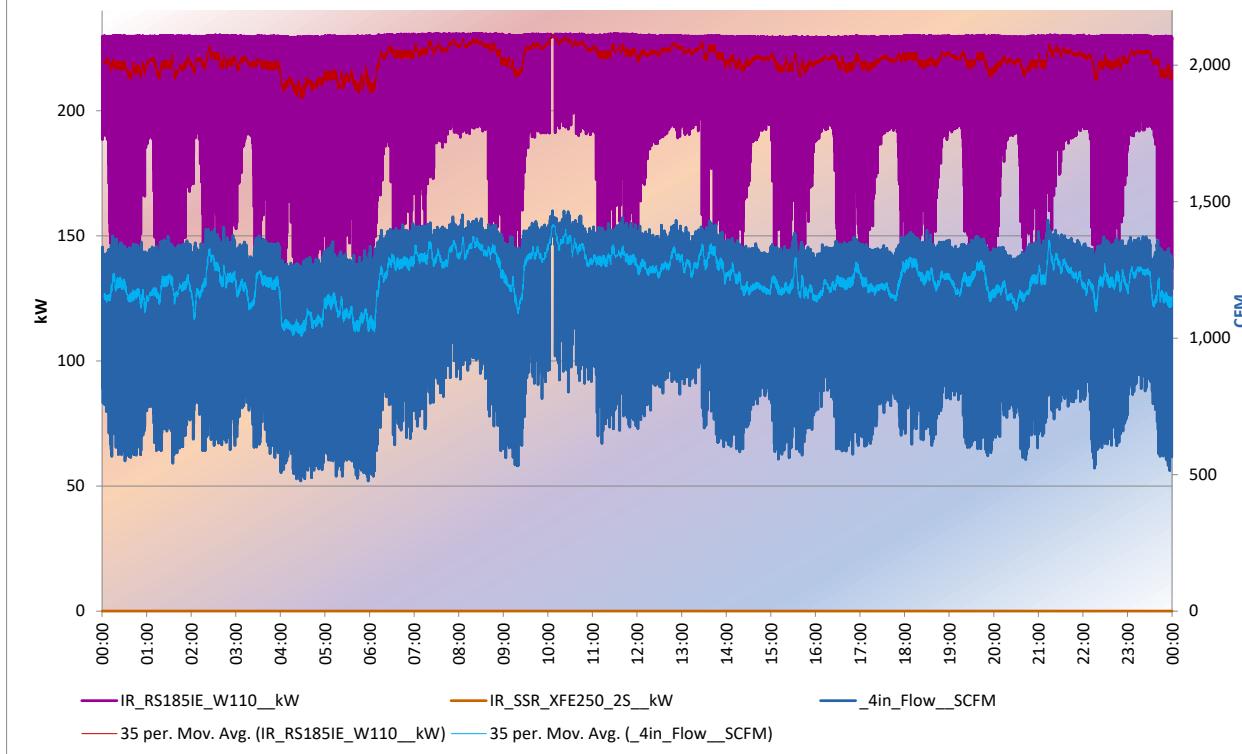


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor
Wednesday, Mar 02, 2022

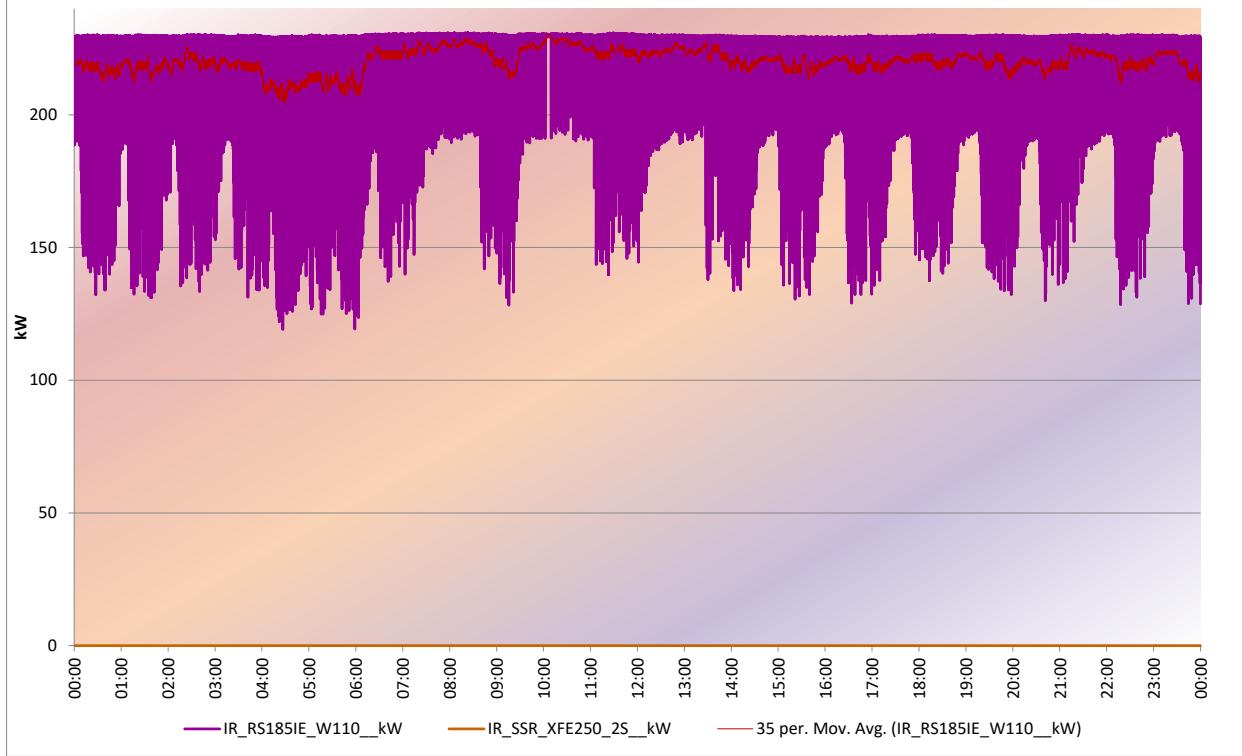


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow & Pressure
Wednesday, Mar 02, 2022

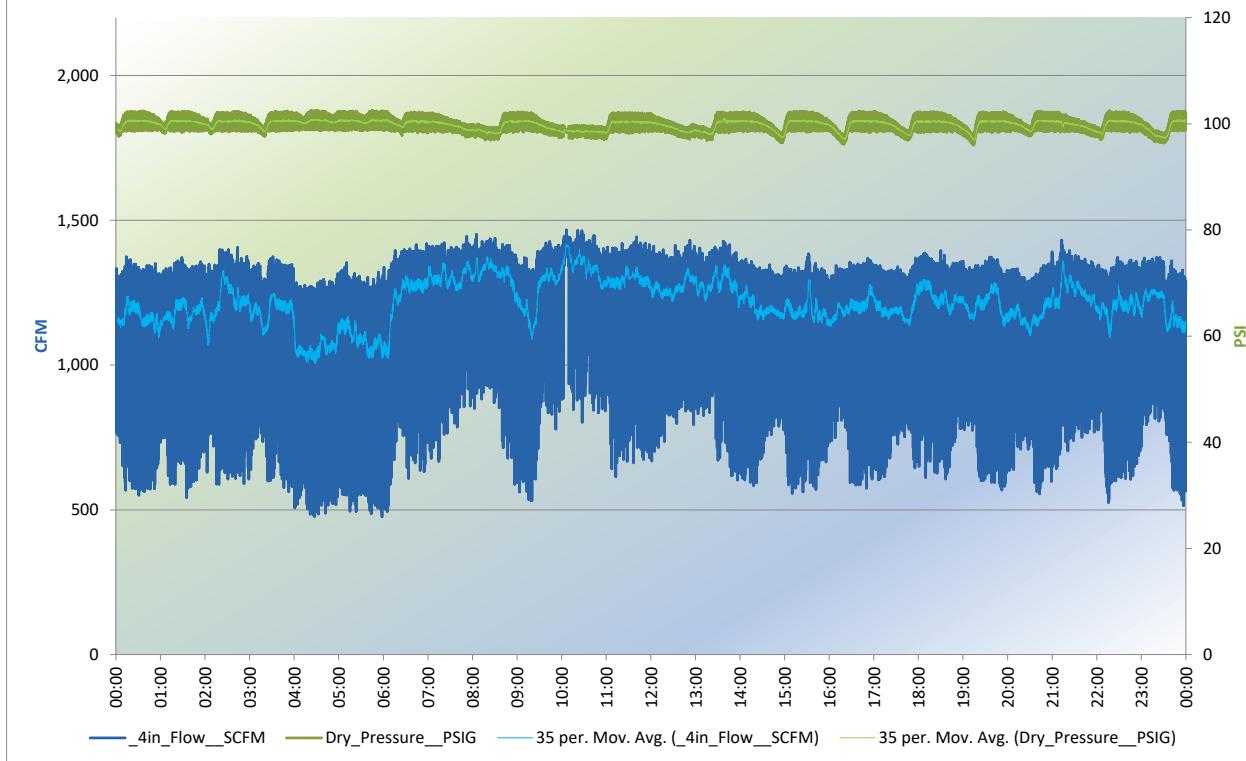


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Pressure by Location
Wednesday, Mar 02, 2022

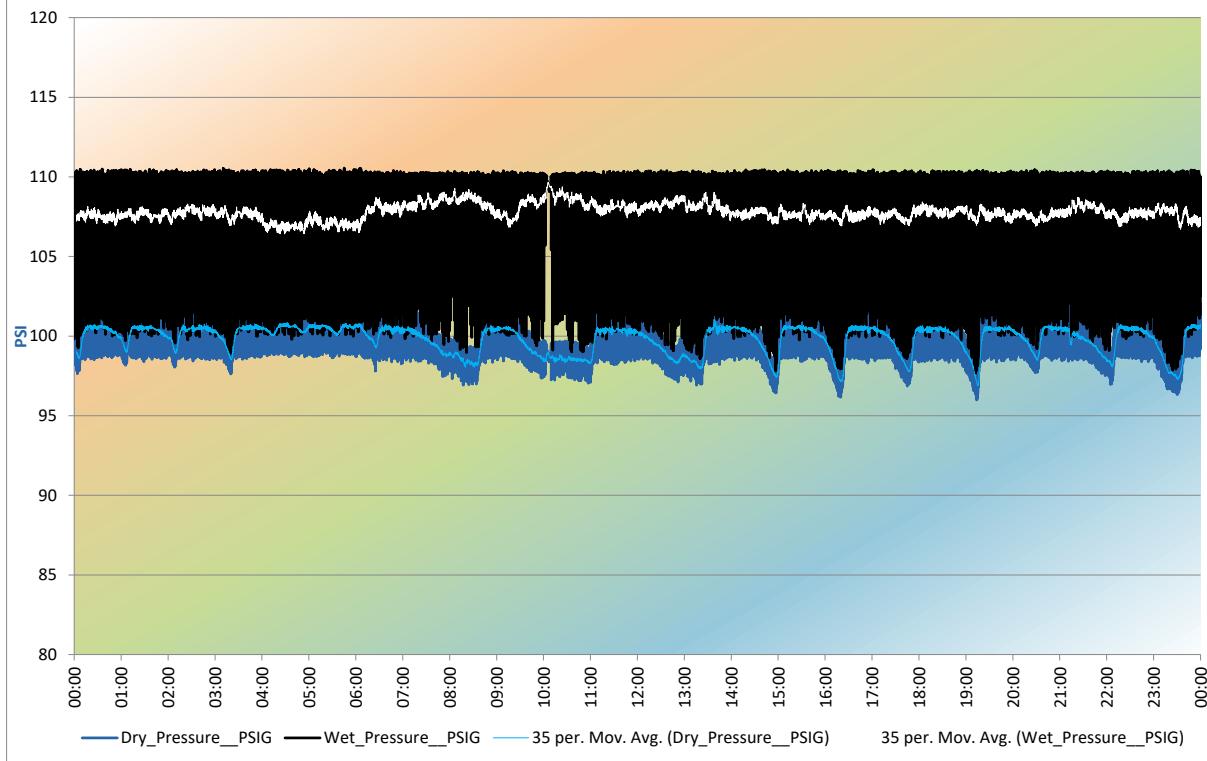


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power, Flow & Pressure
Thursday, Mar 03, 2022

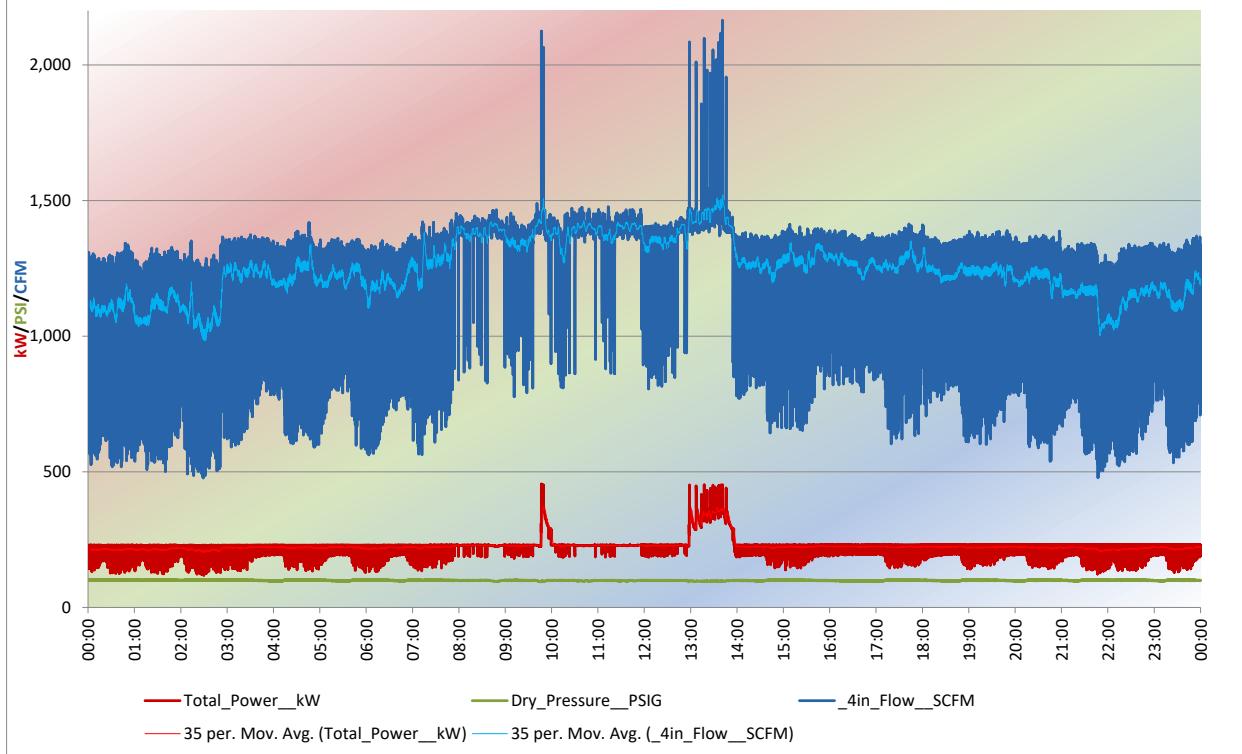


Thursday, 3/3/2022									
First (1st) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,180.38	3.83	94.70	218.48	0.00	218.48	104.75		
Avg	1,359.21	5.71	99.02	226.79	15.79	242.58	108.27		
Max	1,557.77	6.40	101.06	230.39	147.30	375.52	110.13		
Second (2nd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	1,001.11	4.79	96.19	203.22	0.00	203.22	105.86		
Avg	1,206.60	5.52	99.37	220.73	0.00	220.73	107.45		
Max	1,396.58	6.09	100.75	229.49	0.00	229.49	109.00		
Third (3rd) Shift									
Statistics	4in_Flow_SCFM	CFM_kW	Dry_Pressure_PSIG	IR_RS185IE_W110_kW	IR_SSR_XFE250_2S_kW	Total_Power_kW	Wet_Pressure_PSIG		
Min	983.24	4.77	97.26	204.77	0.00	204.77	106.18		
Avg	1,182.62	5.48	100.05	218.39	0.00	218.39	107.63		
Max	1,406.95	6.14	101.26	230.28	0.00	230.28	109.81		


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow:Power Ratio
Thursday, Mar 03, 2022

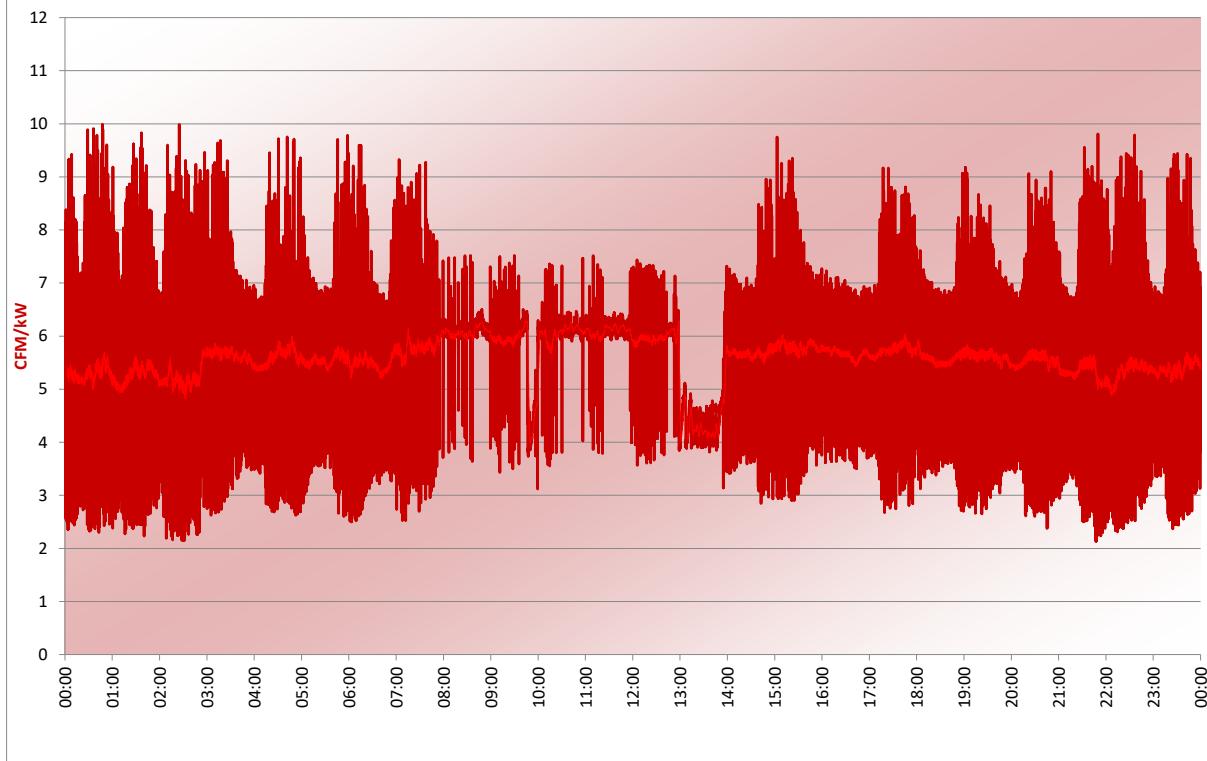

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor and Flow
Thursday, Mar 03, 2022

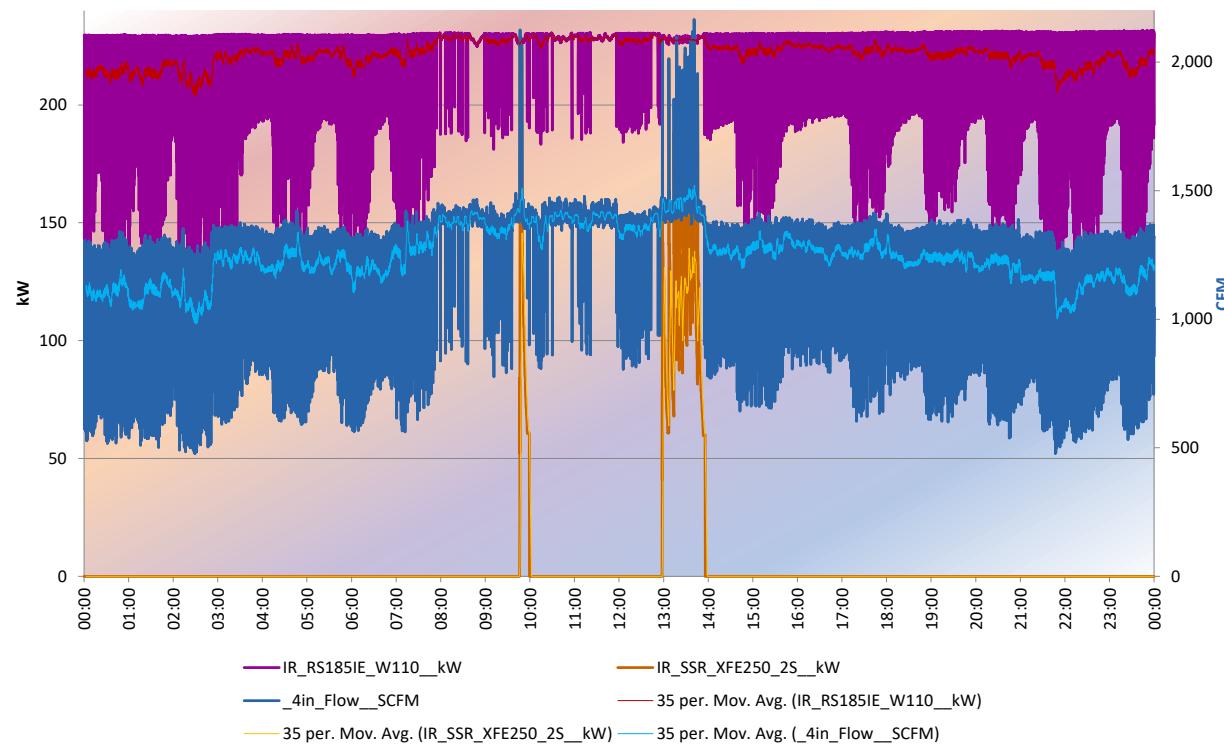


Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Power by Compressor
Thursday, Mar 03, 2022

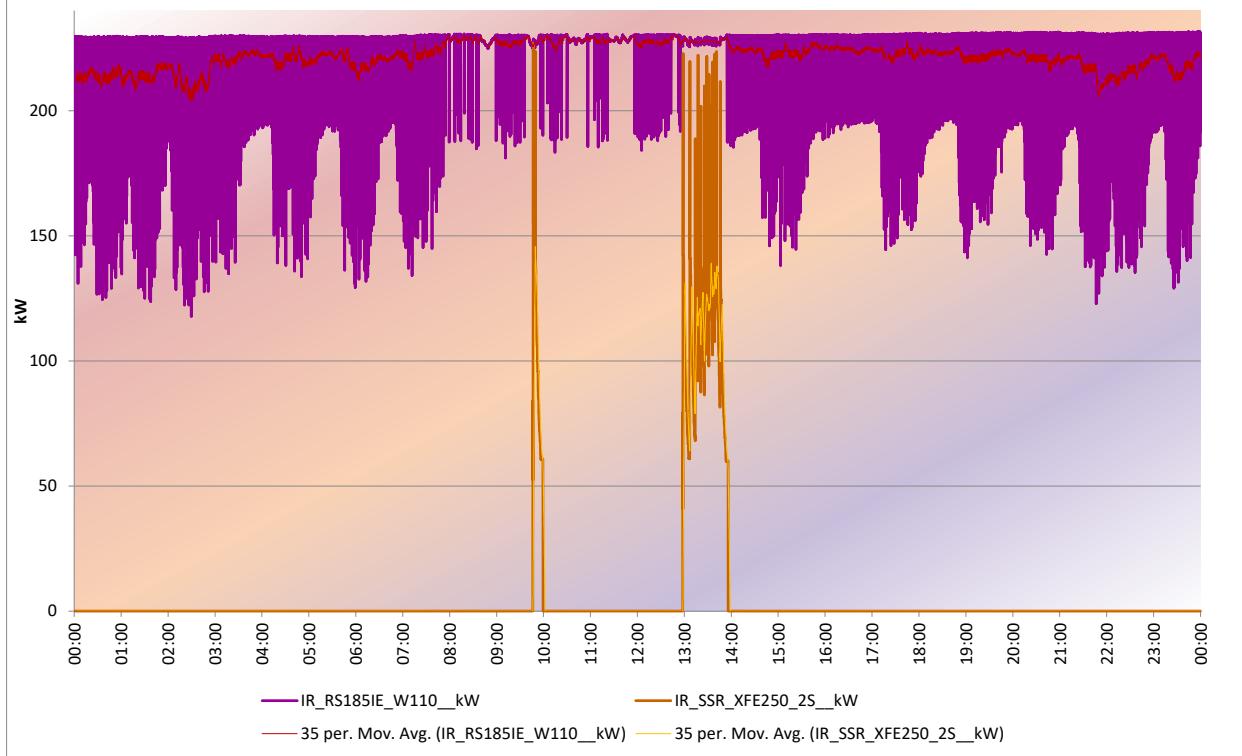


"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Flow & Pressure
Thursday, Mar 03, 2022

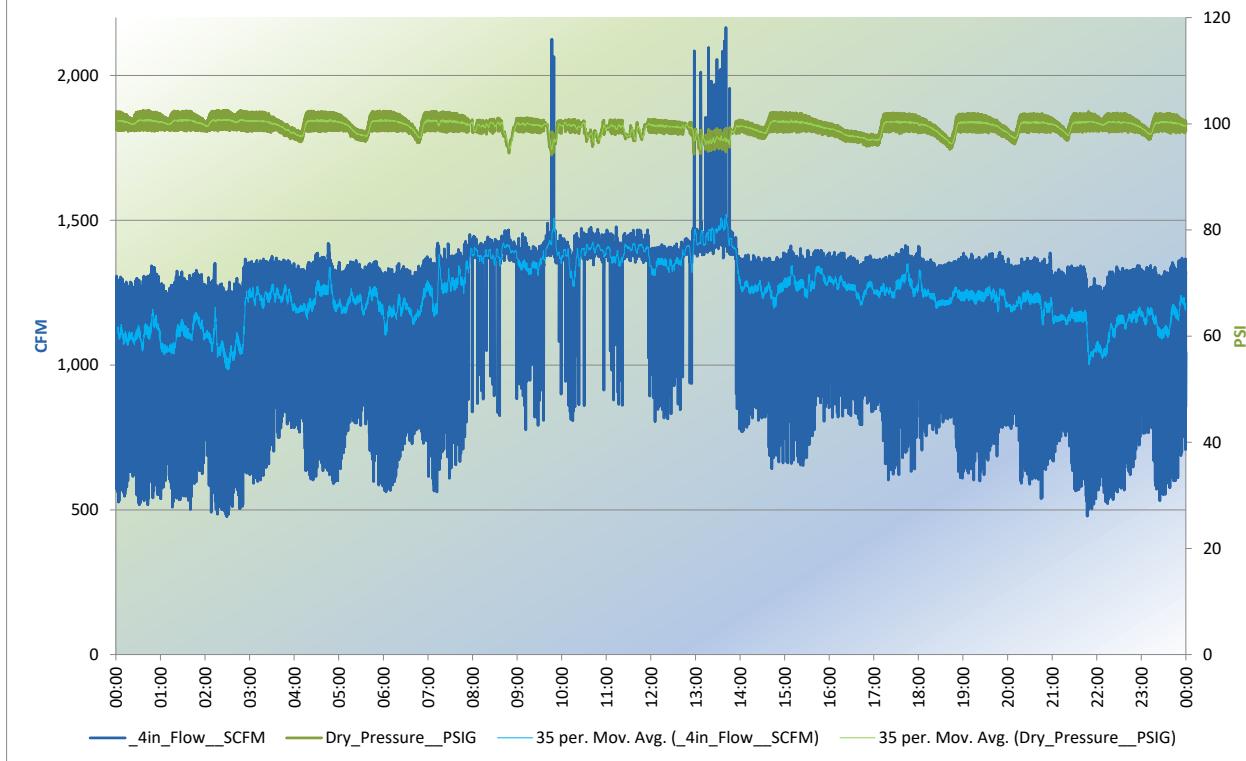

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".

Nichols Portland, LLC - Portland, ME
Compressed Air System Data - Pressure by Location
Thursday, Mar 03, 2022

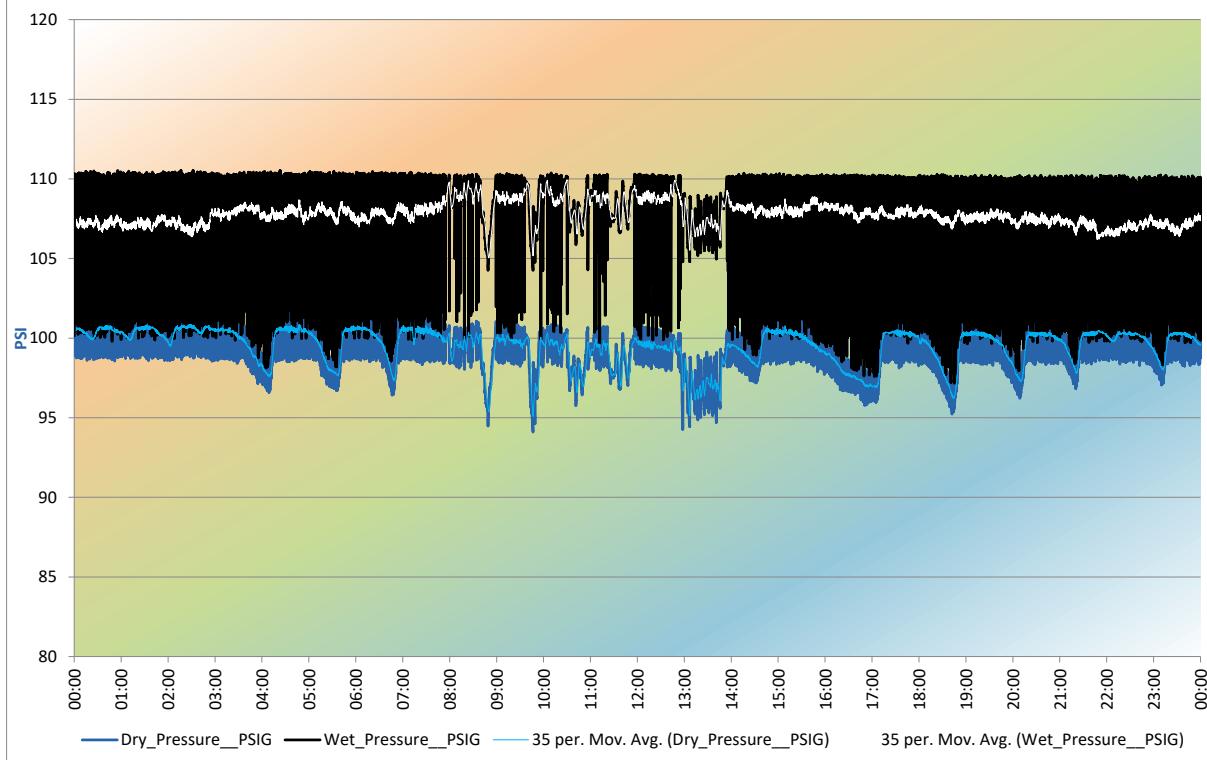

"The information in this document is proprietary to Compressor Energy Services. It may not be used, reproduced, disclosed, or exported without the written approval of CES".