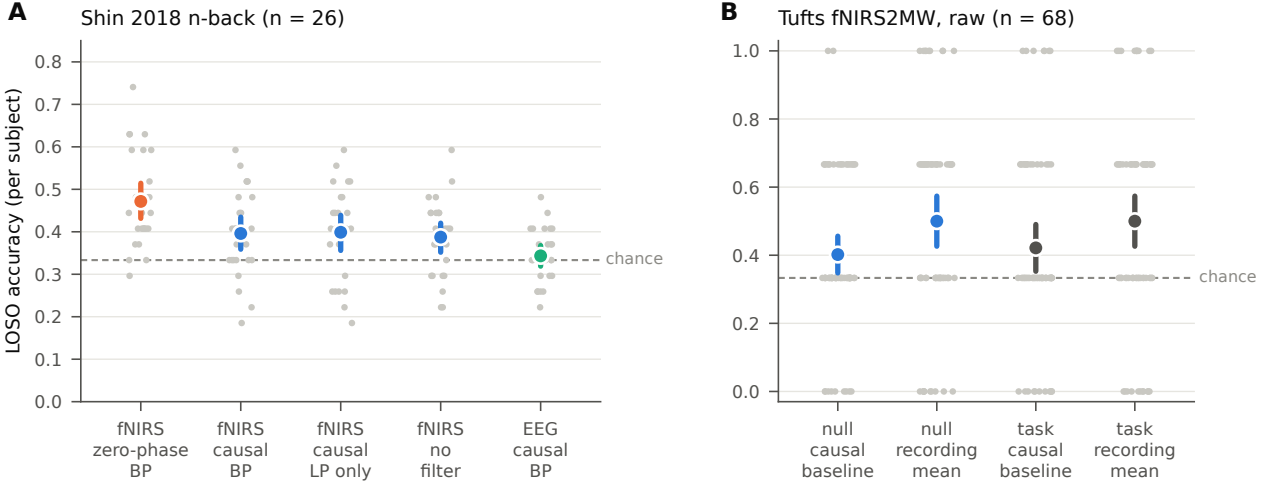
A
Shin 2018 n-back (n = 26)
LOSO accuracy (per subject)
0.0
0.1
0.2
0.3
0.4
0.5
0.6
0.7
0.8
chance
fNIRS zero-phase BP
fNIRS causal BP
fNIRS causal LP only
fNIRS no filter
EEG causal BP
B
Tufts fNIRS2MW, raw (n = 68)
0.0
0.2
0.4
0.6
0.8
1.0
chance
null causal baseline
null recording mean
task causal baseline
task recording mean