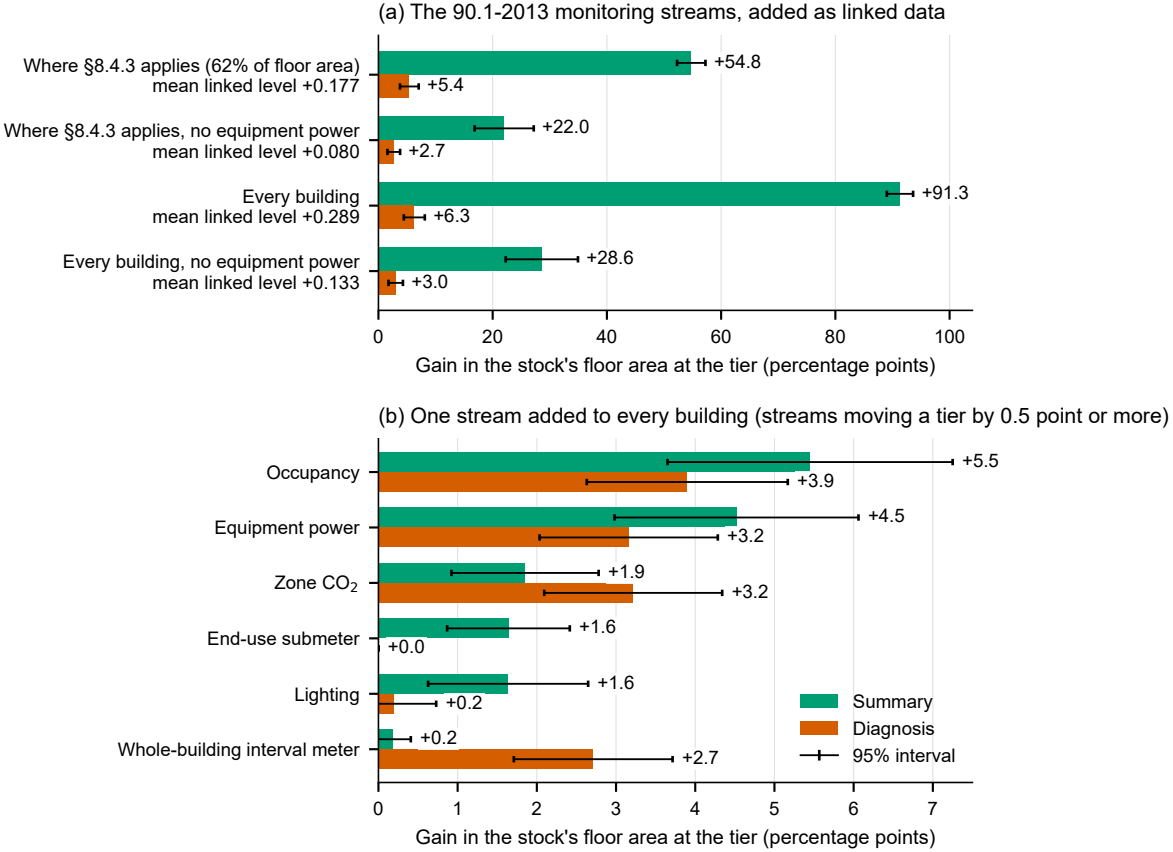
(a) The 90.1-2013 monitoring streams, added as linked data
Where §8.4.3 applies (62% of floor area)
mean linked level +0.177
+54.8
+5.4
Where §8.4.3 applies, no equipment power
mean linked level +0.080
+22.0
+2.7
Every building
mean linked level +0.289
+91.3
+6.3
Every building, no equipment power
mean linked level +0.133
+28.6
+3.0
0
20
40
60
80
100
Gain in the stock's floor area at the tier (percentage points)
(b) One stream added to every building (streams moving a tier by 0.5 point or more)
Occupancy
+5.5
+3.9
Equipment power
+4.5
+3.2
Zone CO2
+1.9
+3.2
End-use submeter
+1.6
+0.0
Lighting
+1.6
+0.2
Whole-building interval meter
+0.2
+2.7
Summary
Diagnosis
95% interval
0
1
2
3
4
5
6
7
Gain in the stock's floor area at the tier (percentage points)