


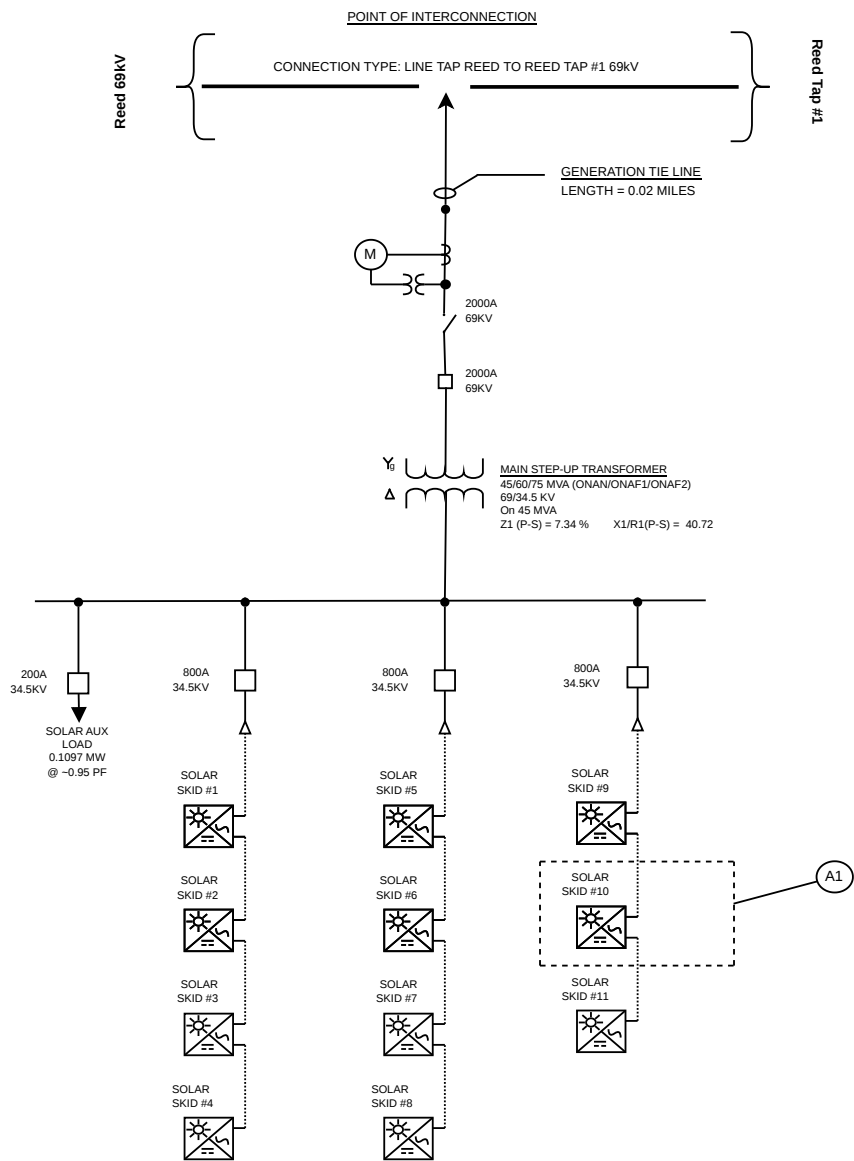


GENERAL NOTES

- ① SOLAR NET FACILITY OUTPUT LIMITED TO 40 MW @ ± 0.95 PF BY PLANT CONTROLLER
- ② SOLAR INVERTERS OUTPUT CAPABILITY @ 35°C: 41.0161 MW, ± 21.2631 MVAR
- ③ INVERTER SMA SC 4200-UP-US INVERTERS RATED AT 4200 KVA @ 35°C
- ④ SOLAR INVERTER QUANTITY = 11, PAD MOUNT TRANSFORMER QUANTITY = 11
- ⑤ PRELIMINARY DESIGN AND NOT FOR CONSTRUCTION

SYMBOLS AND LEGEND

	TWO WINDING TRANSFORMER		ABOVE GROUND
	POTENTIAL TRANSFORMER, PT		UNDERGROUND CABLE
	CURRENT TRANSFORMER, CT		UNDERGROUND CABLE TERMINATION
	REVENUE METER		STRING OF PHOTOVOLTAIC (PV) PANELS
	BREAKER		SOLAR SKID
	SWITCH		FUSED SWITCH

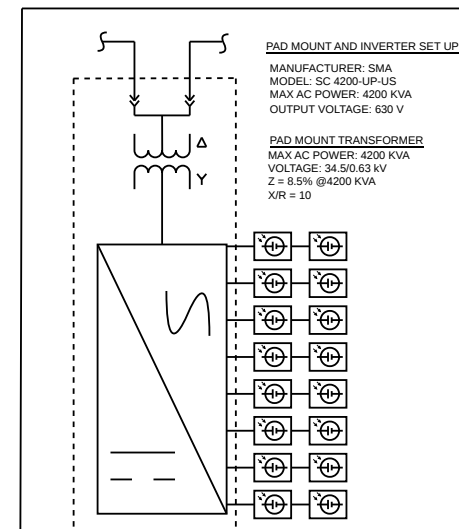

A1

SOLAR SKID DETAIL

Rev	Issued For	Date Issued
A	DP2 Revision Request	05/15/2026
B	DP2 Revision Request - Deficiency Update	08/17/2026

Project:	SHAMROCK SOLAR 40 MW QUEUE ID: AF2-424 & AF2-425 NORTHUMBERLAND, PA
----------	---

Drawing Title:	Electrical Single-Line Diagram	Drawing by: Vivek
----------------	--------------------------------	-------------------

Revision	Page
B	1

