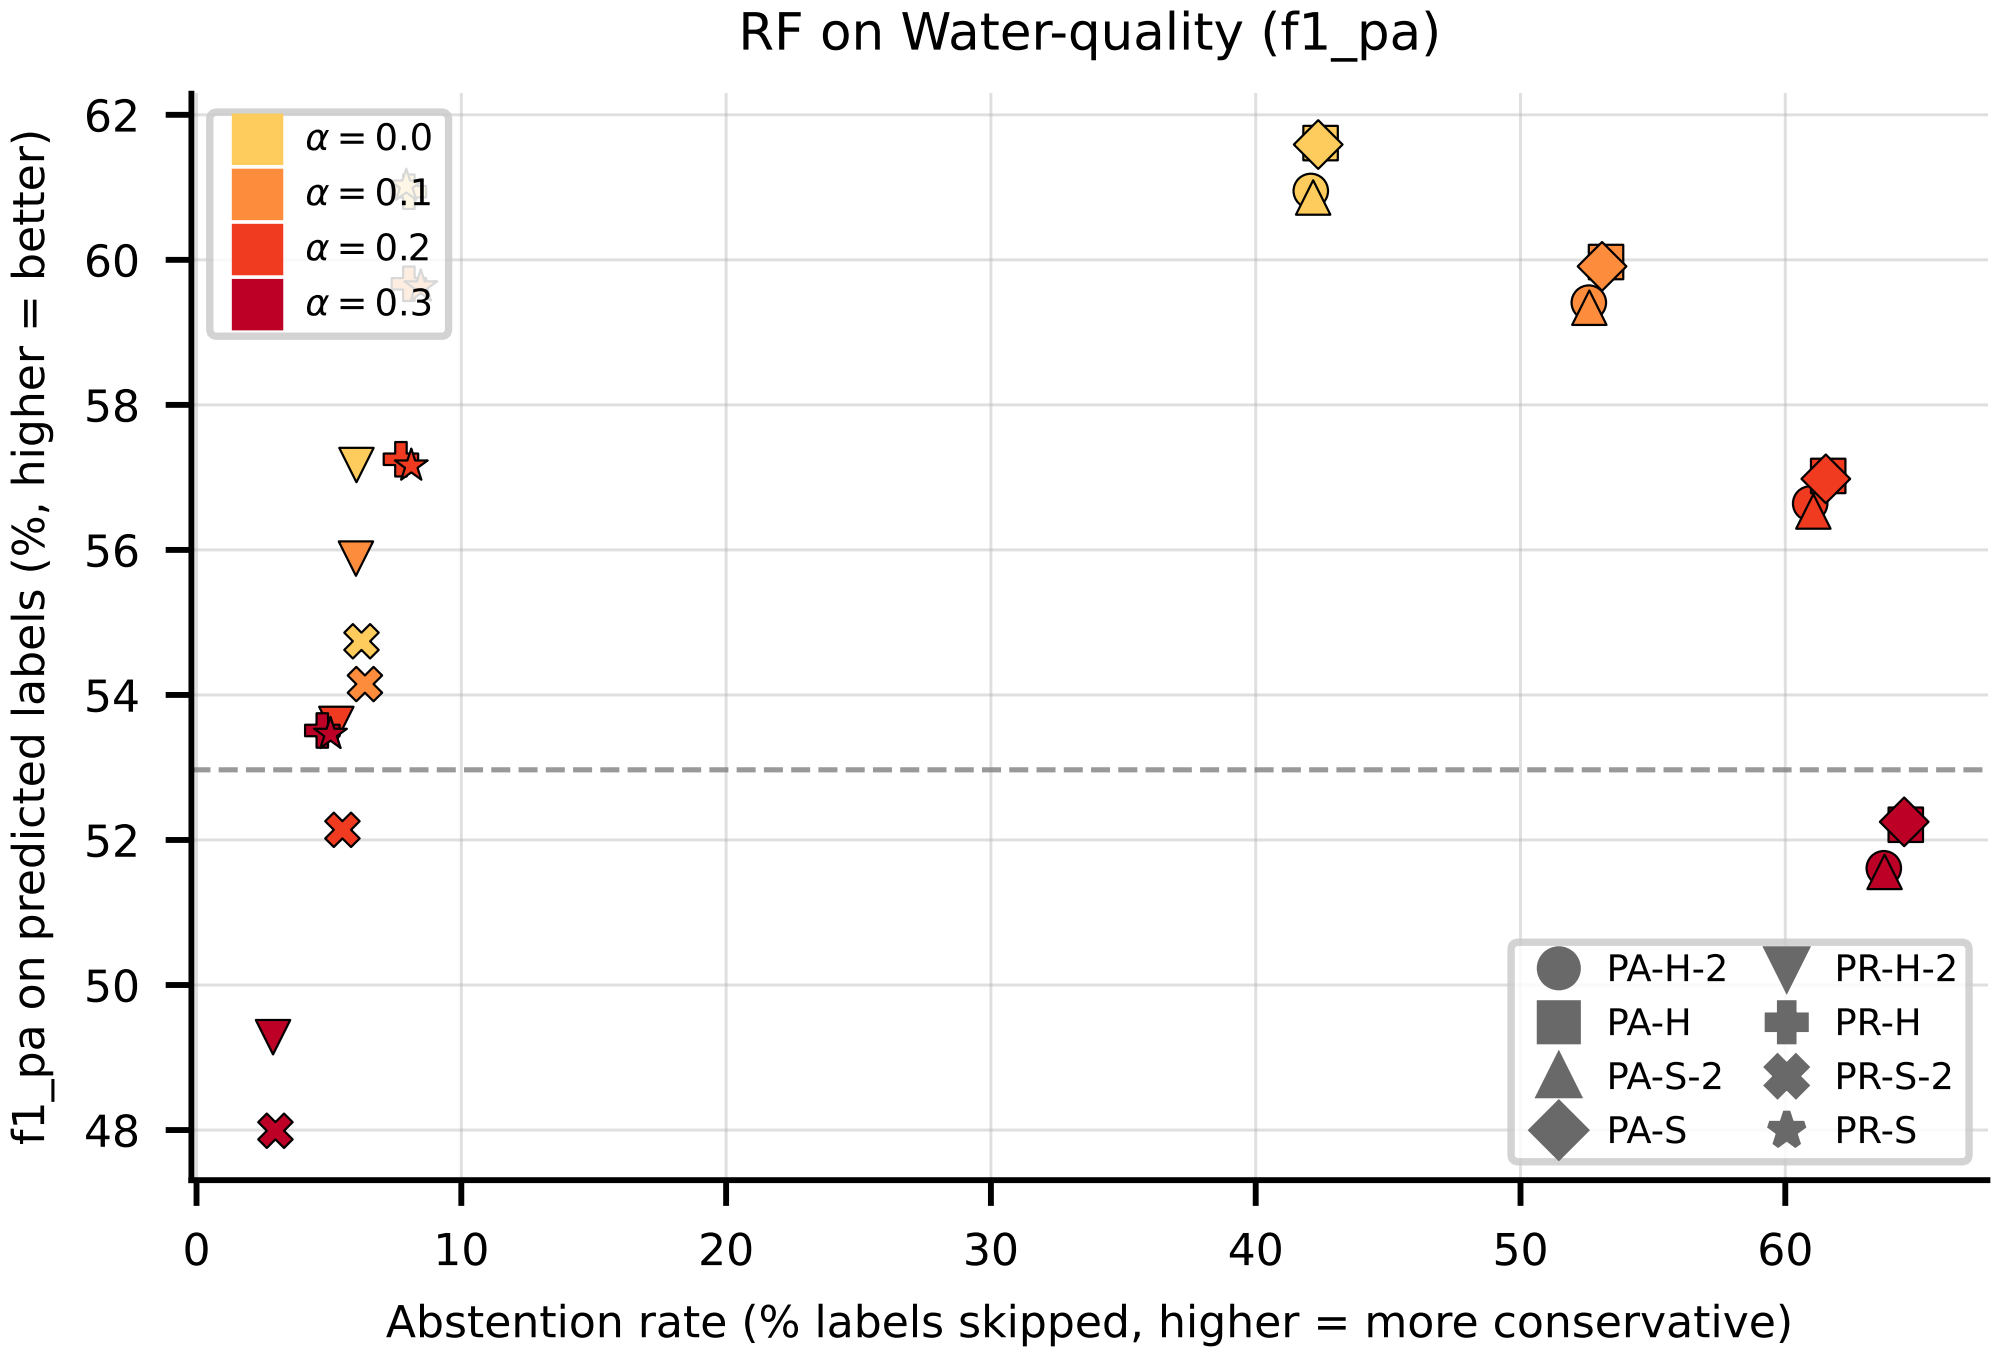

RF on Water-quality (f1_pa)
f1_pa on predicted labels (%, higher = better)
Abstention rate (% labels skipped, higher = more conservative)
α = 0.0
α = 0.1
α = 0.2
α = 0.3
PA-H-2
PA-H
PA-S-2
PA-S
PR-H-2
PR-H
PR-S-2
PR-S
62
60
58
56
54
52
50
48
0
10
20
30
40
50
60