FIG20: Fixed-SD vs. estimated-tau future generators

G0: neutral | G1: fixed SD=0.40 (existing Y1) | G2: estimated tau_year

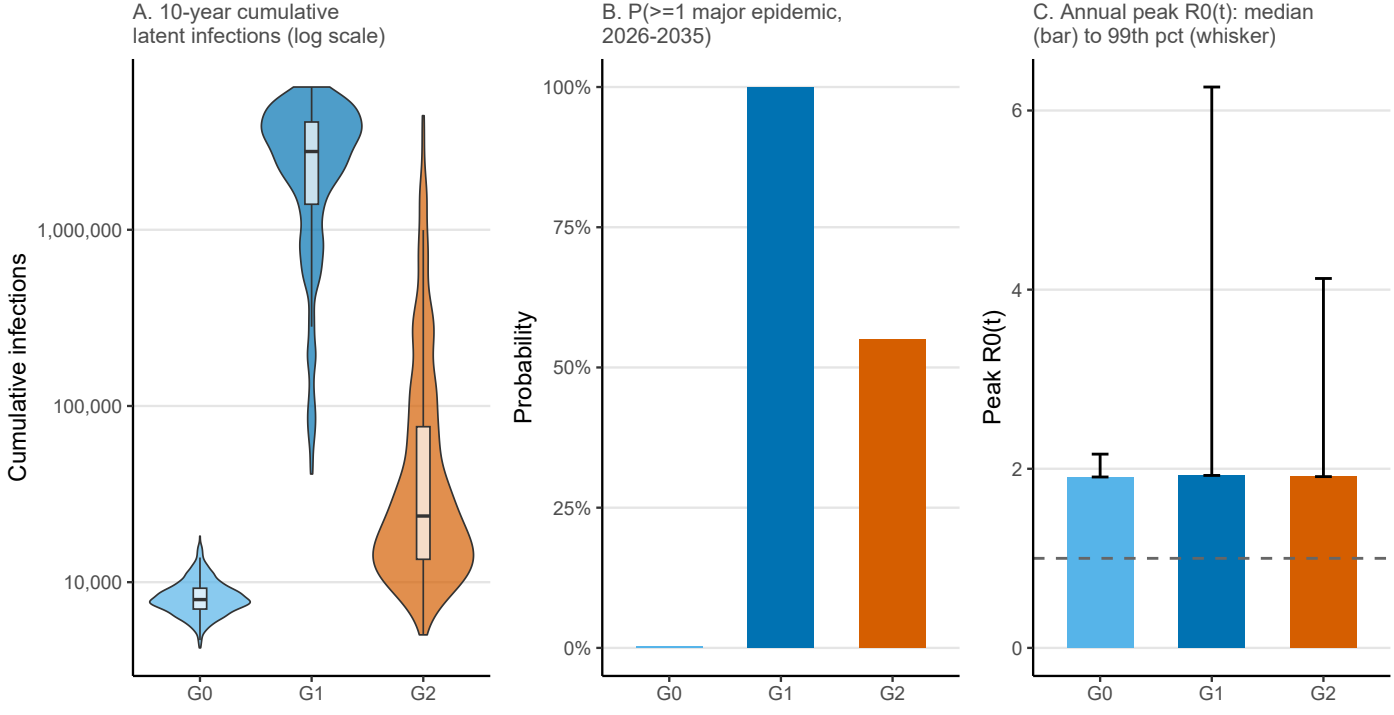

Illustrative scenario simulation; no SSP forcing or vaccination applied.