
FIG_S75_2. Constant vs. episodic introduction, identical expected pressure (H1/G2)

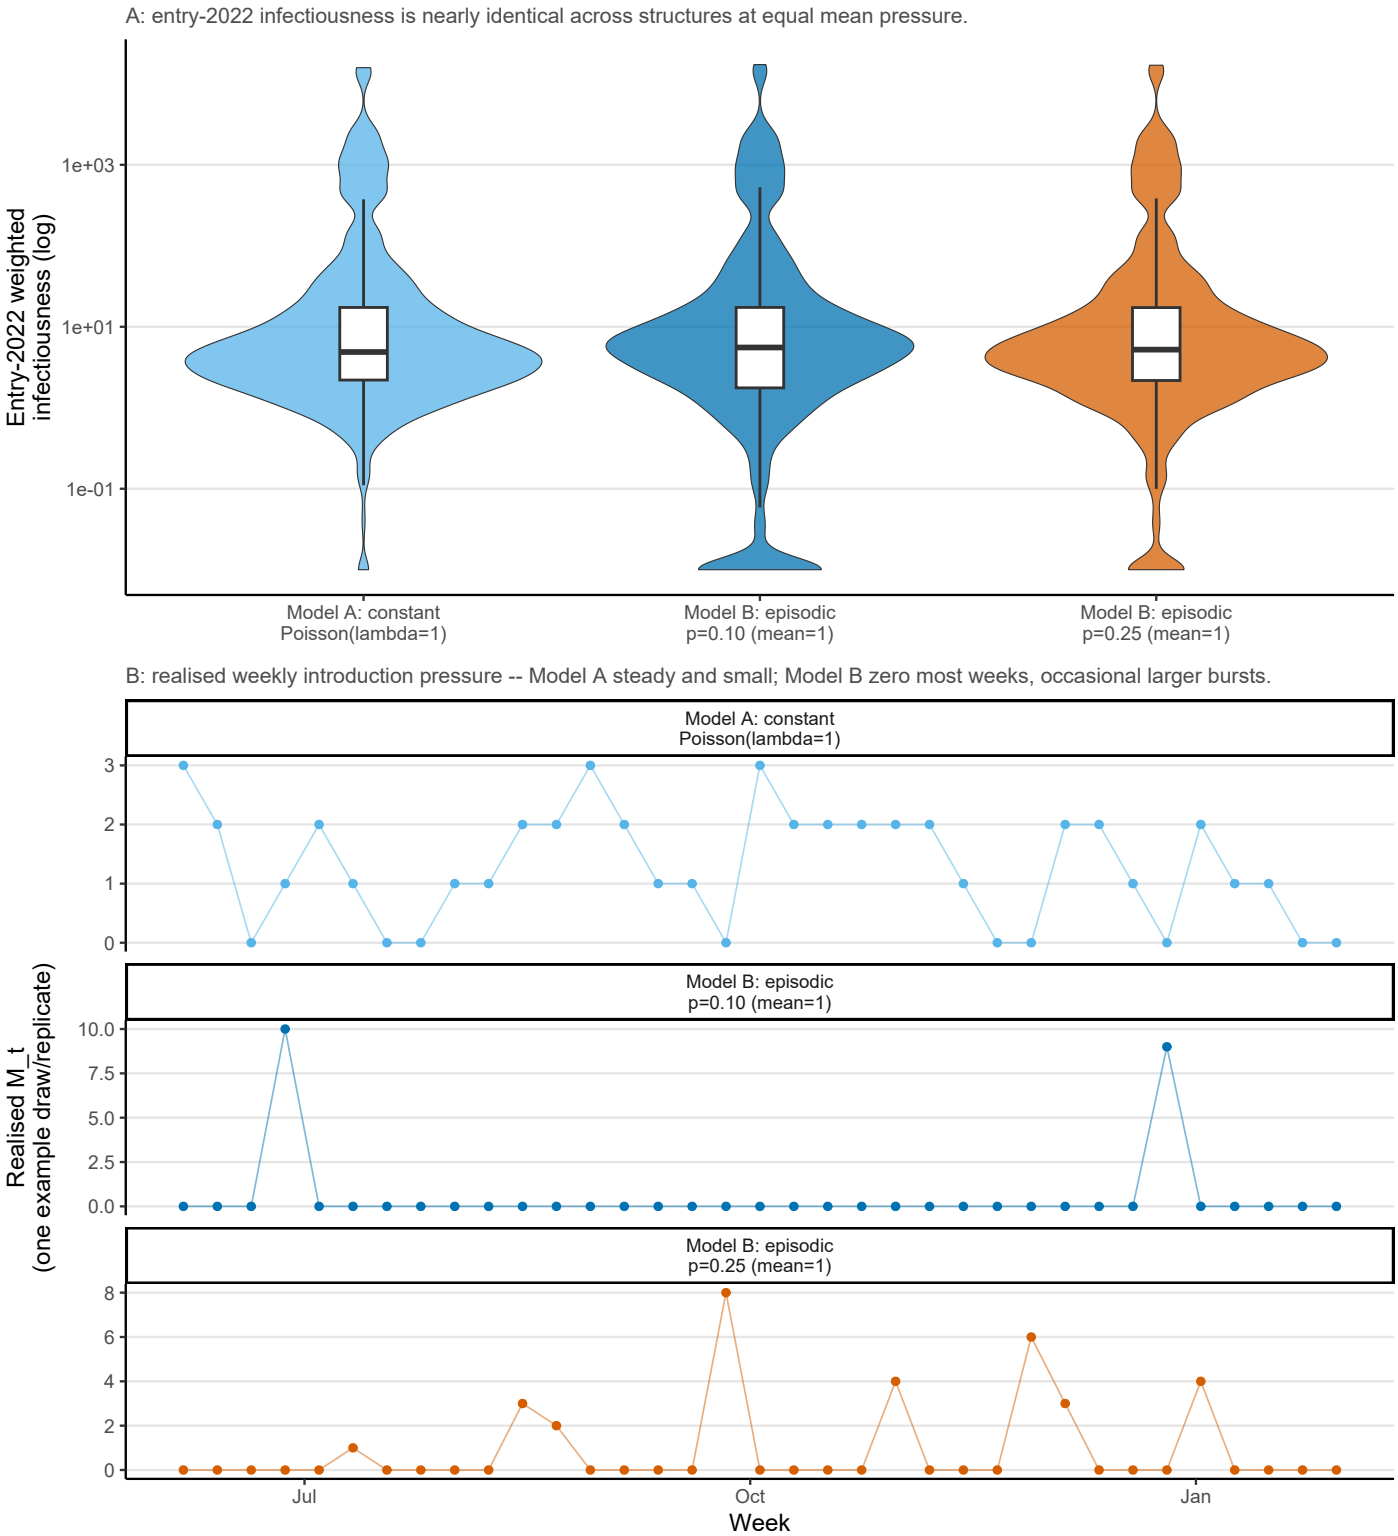

PROVISIONAL: H1/H2 have low but nonzero divergences and incomplete mixing; tau_year upper-tail reliability is not fully established. Diagnostic structural arms (p=0.10/0.25 prespecified, NOT fit); no lambda or process is chosen as a new reference.