






나무 건축사 사무소

TEL: 031)955-5780
FAX: 070)4324-5045
E-Mail: Nambuarc@Naver.com

PROJECT TITLE
공 사 명

아람동 226-94
근영 및 다세대주택 신축공사

NOTE
기 사

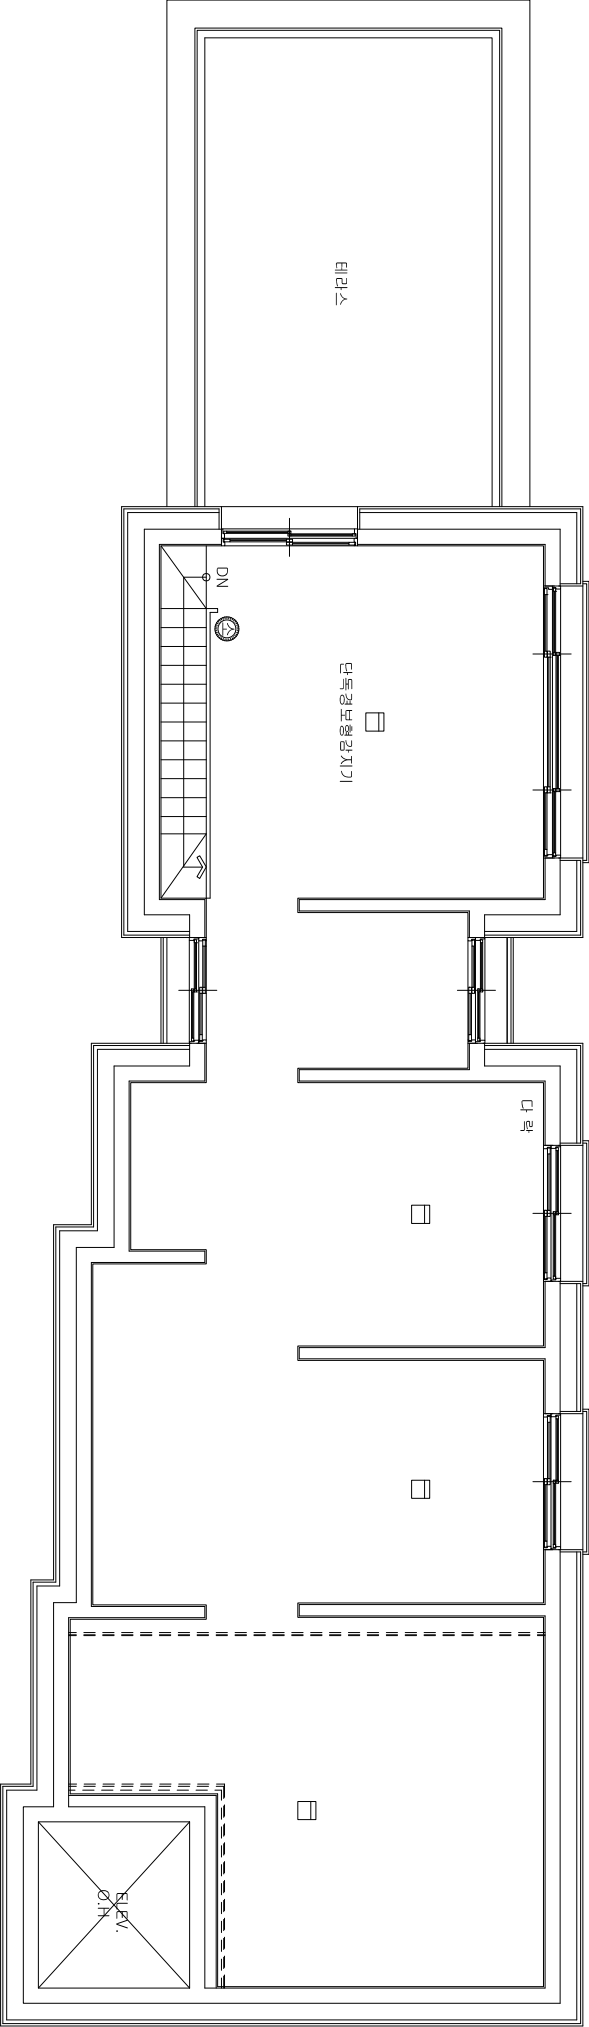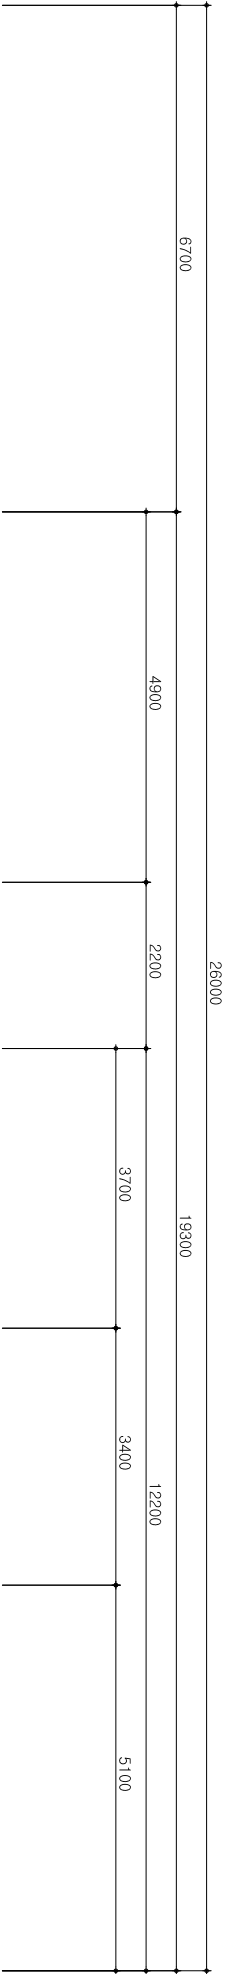

	단독경보 감지기	4 개
	ABC 분말 소화기 3 단위 <3.3 Kg>	1 개

● NOTE ●

- 별도의 영기없는 전선관은 단면 OD전선관 또는 HI-PVC 전선관을 사용한다.
- 별시기간 배관 및 배선은 계통도를 참조한다.
- 본 도서의 영기없는 배관 및 배선은 하기와 같다.
[유도등 배관 배선]
ex ——— HFIX 2-2.5mm² , E(HFIX) 1-2.5mm² 16C
- E(HFIX)는 접지선으로 녹색의 HFIX 전선을 사용한다.
- 본 도서의 영기없는 배스류 규격은 하기와 같다.
☒_{Per} : PULL BOX 150x150x100 ☒_{Per} : PULL BOX 400x400x200
☒_{Per} : PULL BOX 200x200x100 ☒_{Per} : PULL BOX 500x500x300
☒_{Per} : PULL BOX 300x300x200 ☒_{Per} : PULL BOX 600x600x300



다락 소방설비 평면도

SCALE : 1 / 100



(주) 지 엠 이 엠 씨

ENGINEERING & CONSULTANT
TEL : 031)938-0999 , FAX : 031)938-0998

전문소방시설설계업 제 2020-01-00106 호
경기도 고양시 일신동구 호수로 358-25 822호(백석동)

대표이사 강원구
소방기출사 한옥순



다락 소방설비 평면도

DRAWING NO.
도면 번호
EF - 07

SHEET NO.
발판 번호
000

DATE
날짜
2022. 05.

NAME OF DRAWING
도면명
다락 소방설비 평면도

SCALE
축척
1 / 100

CHECKED BY
검토인
N

APPROVED BY
승인인
N

DRAWN BY
제
N

DESIGNED BY
설계
N

MECH. BY
기계
N

ARCH. BY
건축
N

STRUCT. BY
구조
N

PLUMB. BY
배관
N

ELECT. BY
전기
N

PAINT. BY
도장
N

LANDSCAPE BY
경관
N

INTERIOR BY
내부
N

EXTERIOR BY
외부
N

ROOF BY
지붕
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N

FOUNDATION BY
기초
N