


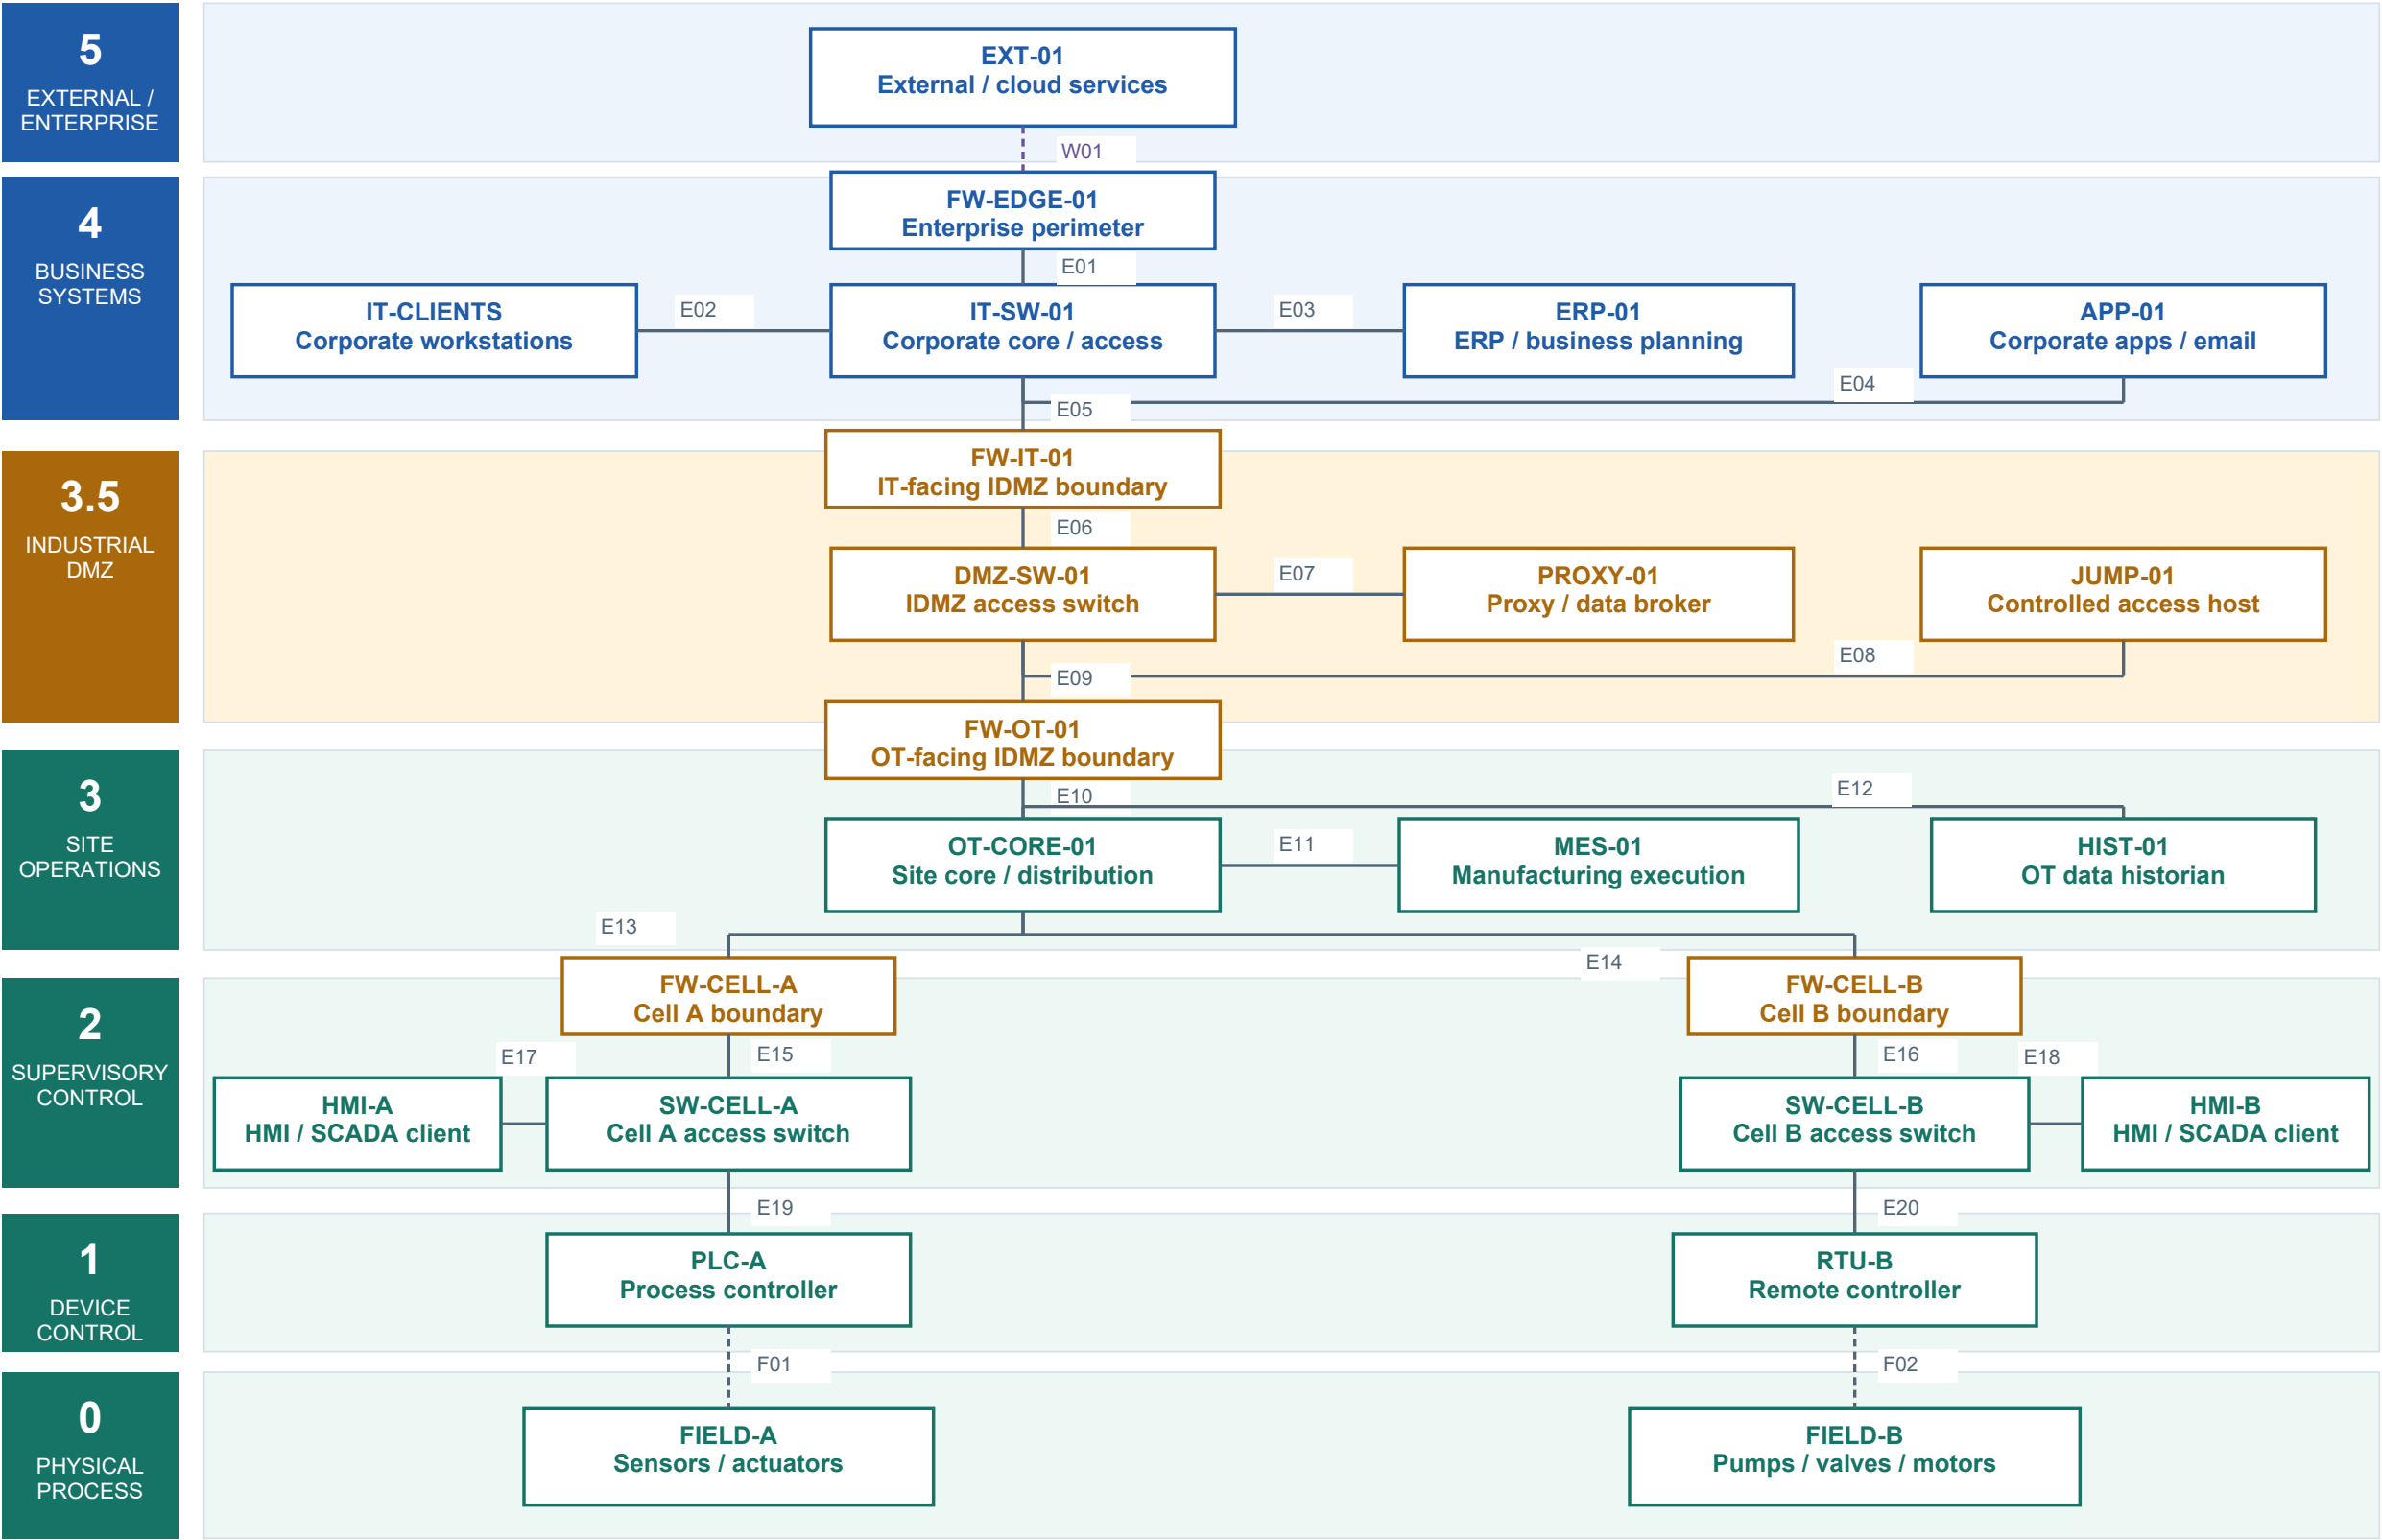

DRAWING KEY

- Logical Ethernet link
- External / WAN link
- Field I/O or fieldbus
- Firewall boundary

IDs cross-reference sheet 2.
Lines do not grant network access.

SECURITY INTENT

IT and OT sessions terminate at approved IDMZ services. No direct IT-to-controller route is implied by these links.

Define permitted source, destination, protocol and direction separately. Remote access requires approved identity and session controls.

Cell boundaries are illustrative; confirm with the site risk review.

DOCUMENT STATUS

Reference topology / Rev A
Site: not supplied
Device inventory: unverified
IP plan / VLANs: not supplied
Ports / cabling: not supplied
Redundancy: not specified
Approved by: pending

Use sheet 2 for the site survey.

All identifiers below are illustrative drawing references. TBD means not supplied or not verified; it is not an assigned value.

DEVICE ID	LEVEL	FUNCTION	ADDRESS / VLAN	PORTS / MEDIA	MODEL / LOCATION
EXT-01	5	External / cloud services	TBD / not supplied	TBD / survey required	TBD / survey required
FW-EDGE-01	4	Enterprise perimeter	TBD / not supplied	TBD / survey required	TBD / survey required
IT-SW-01	4	Corporate core / access	TBD / not supplied	TBD / survey required	TBD / survey required
IT-CLIENTS	4	Corporate workstations	TBD / not supplied	TBD / survey required	TBD / survey required
ERP-01	4	ERP / business planning	TBD / not supplied	TBD / survey required	TBD / survey required
APP-01	4	Corporate apps / email	TBD / not supplied	TBD / survey required	TBD / survey required
FW-IT-01	3.5	IT-facing IDMZ boundary	TBD / not supplied	TBD / survey required	TBD / survey required
DMZ-SW-01	3.5	IDMZ access switch	TBD / not supplied	TBD / survey required	TBD / survey required
PROXY-01	3.5	Proxy / data broker	TBD / not supplied	TBD / survey required	TBD / survey required
JUMP-01	3.5	Controlled access host	TBD / not supplied	TBD / survey required	TBD / survey required
FW-OT-01	3.5	OT-facing IDMZ boundary	TBD / not supplied	TBD / survey required	TBD / survey required
OT-CORE-01	3	Site core / distribution	TBD / not supplied	TBD / survey required	TBD / survey required
MES-01	3	Manufacturing execution	TBD / not supplied	TBD / survey required	TBD / survey required
HIST-01	3	OT data historian	TBD / not supplied	TBD / survey required	TBD / survey required
FW-CELL-A	2	Cell A boundary	TBD / not supplied	TBD / survey required	TBD / survey required
FW-CELL-B	2	Cell B boundary	TBD / not supplied	TBD / survey required	TBD / survey required
SW-CELL-A	2	Cell A access switch	TBD / not supplied	TBD / survey required	TBD / survey required
SW-CELL-B	2	Cell B access switch	TBD / not supplied	TBD / survey required	TBD / survey required
HMI-A	2	HMI / SCADA client	TBD / not supplied	TBD / survey required	TBD / survey required
HMI-B	2	HMI / SCADA client	TBD / not supplied	TBD / survey required	TBD / survey required
PLC-A	1	Process controller	TBD / not supplied	TBD / survey required	TBD / survey required
RTU-B	1	Remote controller	TBD / not supplied	TBD / survey required	TBD / survey required
FIELD-A	0	Sensors / actuators	TBD / not supplied	TBD / survey required	TBD / survey required
FIELD-B	0	Pumps / valves / motors	TBD / not supplied	TBD / survey required	TBD / survey required

CONNECTION SCHEDULE

W01 / E01	External service to enterprise perimeter and core
E02–E04	Corporate core to workstations and business servers
E05–E10	IT boundary, IDMZ services and OT boundary
E11–E14	Site servers and cell/area boundary uplinks
E15–E20	Cell switches, operator interfaces and controllers
F01–F02	Controller-to-process I/O / fieldbus connections

REQUIRED TO ISSUE AS-BUILT

1. Confirm devices, locations, owners and software roles.
2. Record exact switch ports, media, speeds, VLANs and subnets.
3. Validate firewall rules, remote access and IDMZ session endpoints.
4. Record redundancy, link paths, routing and process dependencies.
5. Reconcile against configuration exports and site observations.
6. Add reviewer, approval date, revision history and evidence references.

REFERENCE ONLY - device IDs and links are illustrative; addresses, ports and hardware are unverified.

Prepared for IT/OT Express LLC | Based on the Purdue Model | Validate against site evidence before use.

Sources: NIST SP 800-82 Rev. 3; Cisco CPwE IDMZ Overview. No live discovery or network configuration performed.