Sliding System

AL - JAZIRAH ALUMINIUM PLANT
SLIDING WINDOW

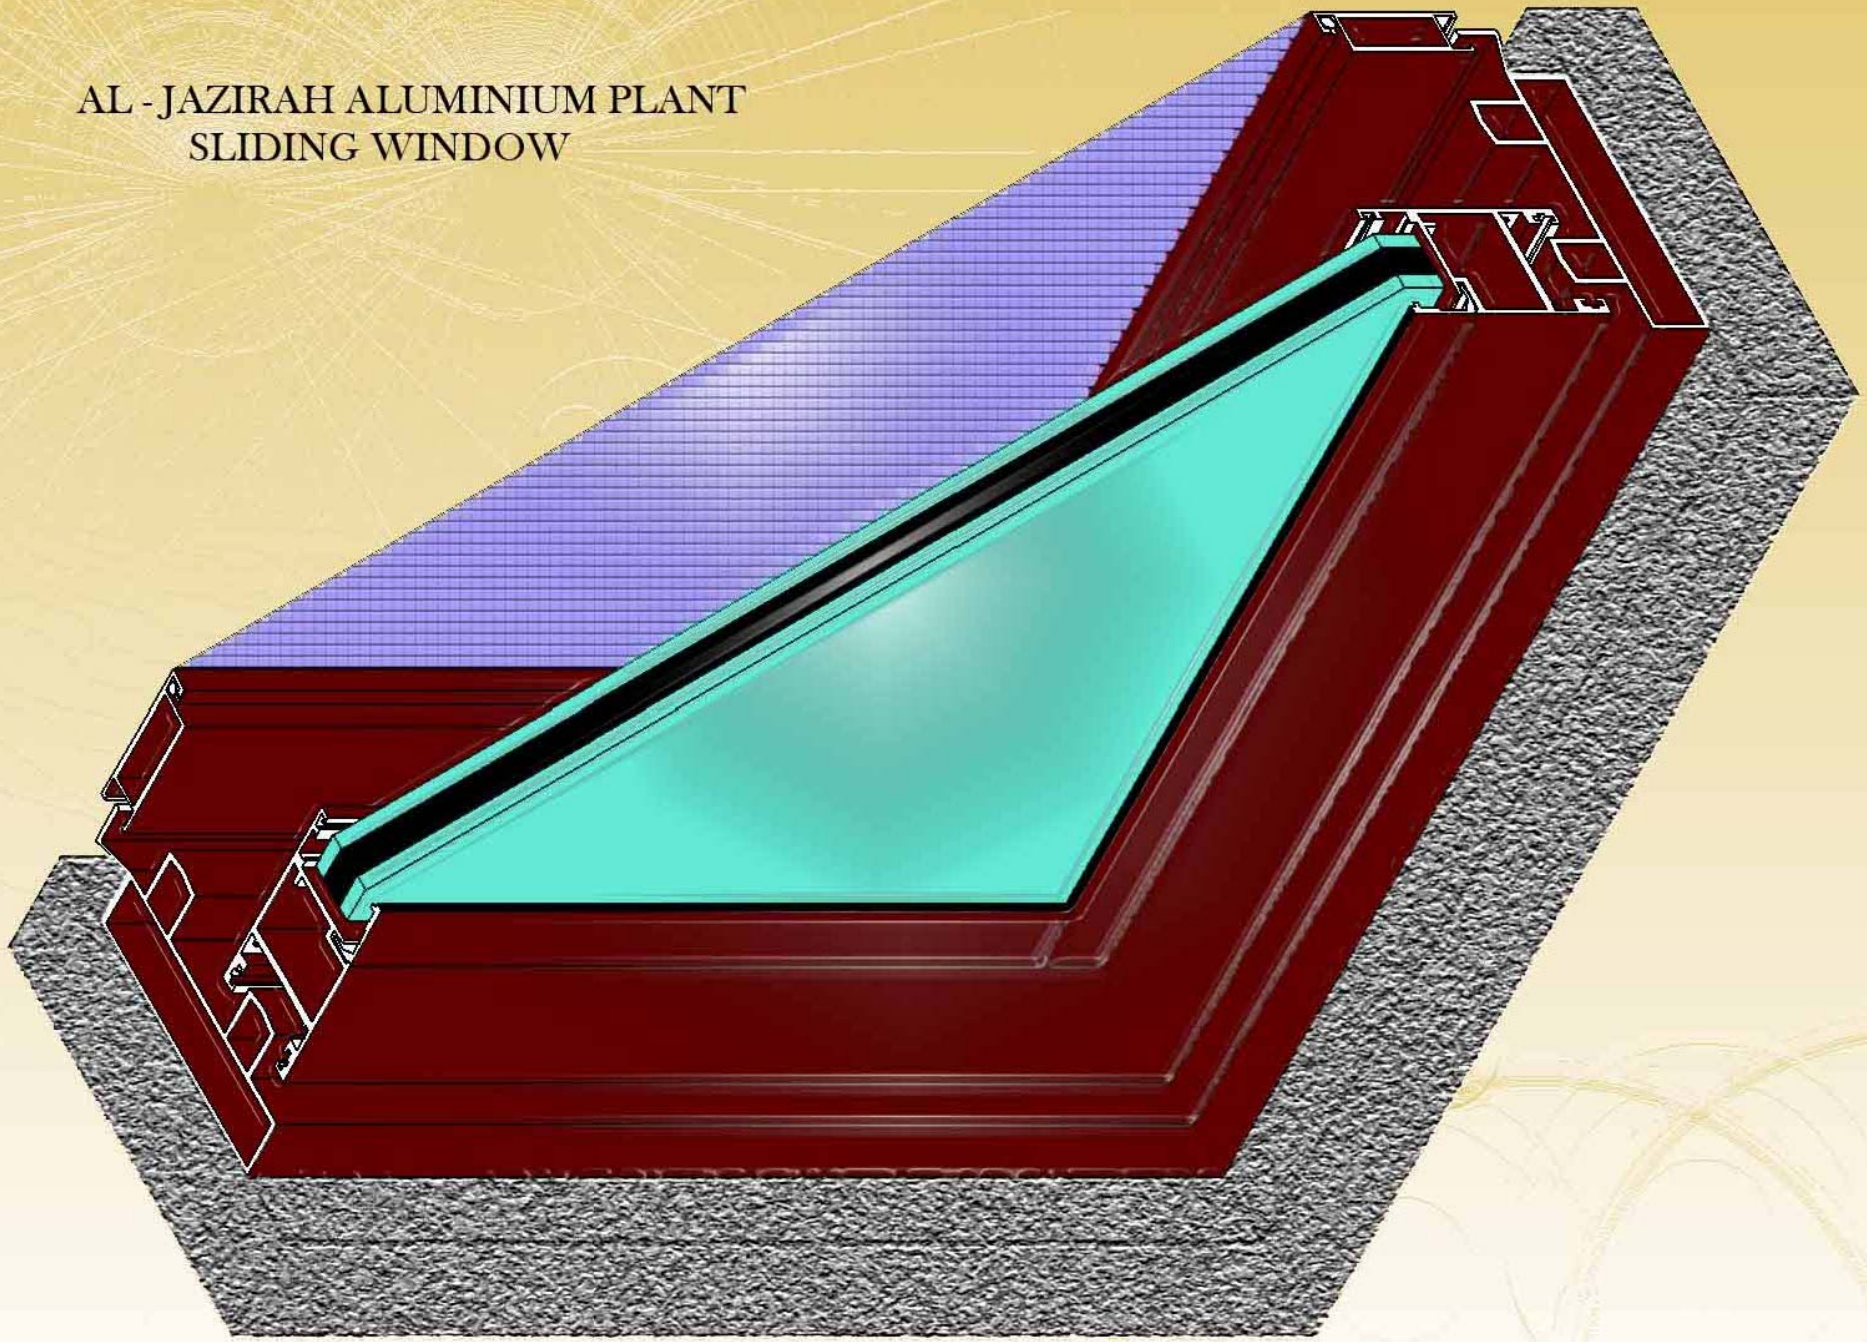

DH

مصنع ألمنيوم الجزيرة

Al Jazirah Aluminium Plant

Sliding Window :

1 - Extra strength through braces and beads in profile design .
2 - Heavy duty corner cleats used for the frame and sash assembly to prevent leakages .
3 - No visible screws .
4 - All screws stainless steel .
5 - Good quality gaskets for prevention of water leakages .
6 - Italian or other European handle and hardware .
7 - Prohibition of any screw at sill to prevent leakages .
8 - Possibility of addition of flashings and decorative profiles .
9 - Alum. fly screen mesh to prevent rust .
10 - Alum. wall thickness starting from 2.2 up to 3 mm for strength & quality .
11 - Special locking system to avoid removal of shutter from inside or outside .
12 - Special design to avoid fly screen vibration against wind pressure .
13 - Hi-fin-system brushes to avoid any dust or insect penetration .
14 - Possibility to change the glass without dismantling the shutters .
15 - Availability of special plugs to cover any holes .
16 - Special plugs to prevent air entry and whistling sound .
17 - Availability of any powder coated color, including wooden shades .
18 - Double-glazed glass ranging in thickness from 18 to 24 mm .
19 - Controlled sound penetration .
20 - All gaskets are from EPDM material that can resist Desert climate .
21 - Fully guaranteed against wind, water and dust penetration .
22 - Corners clamped with solid alum-cleats. No screws used .

النوافذ السحاب :

1 - تمتاز بوجود الأعصاب للمتانة والقوة في تصميم القطاعات .
2 - تمتاز بزاوية تجميع مخفية لمنع التسربات .
3 - تمتاز بإخفاء البراغي وعدم إظهارها .
4 - تمتاز باستخدام براغي ستانلس ستيل .
5 - وجود ربل لمنع تسربات المياه .
6 - المقبض و الإكسسورات اوروبية اصلية الصنع .
7 - لا وجود لمسامير في الأسفل لمنع التسربات .
8 - إمكانية اضافة الحواجب او البراويز الديكورية .
9 - مواد شبك الناموس مصنعة من الألمنيوم الخالص لمنع الصدأ .
10 - سماكة الألمنيوم من 2.2 إلى 3 مم للمتانة والقوة .
11 - نظام النوافذ خاص يمنع انتزاع الدرف من الخارج أو الداخل .
12 - نظام النوافذ خاص يمنع إهتزاز درفة شبك الناموس بضغط الهواء .
13 - نظام النوافذ الاول والافضل لمنع دخول الغبار أو الحشرات .
14 - سهولة تغيير الزجاج دون الحاجة إلى فك الدرف .
15 - استخدام الربلات البلاستيكية لاخفاء أخرام البراغي .
16 - صمام ضد دخول الهواء لمنع الصفير .
17 - توافر كافة الوان الدهان العادي والخشابي بشتى انواعه .
18 - سماكة الزجاج المزدوج بين 18 و 24 مم .
19 - منع إختراق الصوت الخارجي .
20 - جميع الربلات من نوع "إي.بي.دي.إيم" المقاومة للظروف الصحراوية .
21 - الضمان الكامل ضد الهواء، الماء، والغبار .
22 - الزوايا مكبسة عن طريق الضغط الهيدروليكي دون الحاجة لبراغي .

P.O. 2166 Dammam 31451 - 1st Industrial - Saudi Arabia
Tel : 8472040 - 8471514 Fax : 8473927
Show Room : 8654387 - E-Mail : aj32_aj45@yahoo.com

ص.ب 2166 الدمام 31451 المدينة الصناعية الاولى تلفون : 8472040
8471514 - فاكس : 8473927 - المعرض : 8654387
المملكة العربية السعودية.

SLIDING SYSTEMS
AJ - 32

GENERAL

DESCRIPTION

Work Included: Furnish all necessary materials, labors and equipment for the complete installation of the Sliding Doors & windows as shown on the architectural drawings & specification.

Work Not Included: Structural support of the framing system, interior metal sub-sills. (Specified lists other exclusions).

Quality Assurance:

Drawings and specifications are based upon the AJ32 Sliding Door & windows manufactured by the AL-JAZIRAH Plant, supported by technical literature samples, shop drawings & performance data Performance Requirements:

- Air infiltration shall be tested in accordance with ASTM E-283-84. Infiltration shall not exceed 0.37 CFM per square foot (.0003 M3/SM2) of frame area.

- Water infiltration shall be tested in accordance with ASTM E-331-86 for uniform static air pressure and ASTM E-547- 86 for cyclic air pressure differential No water penetration at a test pressure of 10 PSF.

- De-glazing force shall be tested in accordance with ASTM E-987-88, Force to de-glaze panels shall be not less than 70 lbs (32 Kg) on vertical members and not less than 50 lbs. (22 Kg) on horizontal members.

- Forced entry resistance shall be tested in accordance with AAMA1303.5-76.

- Structural performance shall be tested in accordance with ASTM E-330-84 and AAMA 101-88.

When tested at the design pressures defined below applied for a period of 1 0 seconds, there shall be no permanent deformation of any frame or panel member in excess of 0.4% of its Span also, there shall be no glass breakage, permanent damage to fasteners, hardware parts, actuating mechanisms, or other damage which would cause the door to be inoperable. Sliding panel must be opened with a force not to exceed 40 lbs (18 Kg) C-30 rating of 30 PSF (1.264 Kg/ M2) positive and negative design load.

11. PRODUCTS

Materials:

Extrusions shall be 6063-T6 alloy and temper (ASTM B-221 alloy G.S lOA-T6).
Fasteners, where exposed, shall be aluminum, stainless steel or. Plated steel in accordance with ASTM A-164, Perimeter anchors shall be aluminum or steel, providing the steel is properly isolated from the aluminum Glazing gaskets shall be EPDM extrusions.

Rubber Gaskets:

Tightness of all operable sashes (SLIDING), and of glazing is assured by EPDM gaskets.

EPDM (Ethylene Propylene Diene Monomer) is a rubber mixture extremely resistant to Severe weather changes. Acids, alkaline, Ozone, salts, heat, cold, or moisture does not affect it.

Specifications of rubber gaskets can be as follows:

The gaskets' material shall consist of at least 50% by weight of basic rubber hydrocarbon.

The material shall not contain any crude or reclaimed rubber.

The material shall be homogeneous, and free from defects.

Cured EPDM shall meet the following properties when tested in accordance with ASTM Test slabs and compression set plugs:

Property
Test Procedure
Typical Values

Hardness ((5)
ASTM D - 2000
50

Tensile Strength (N/ sq.mm)
ASTM D - 2000
11.2 (12.4

Elongation (%)
ASTM D - 412
400

Heat Aging
ASTM D - 865
Complies

Finish Specification:

All Exposed surface shall be free of scratches and other series blemishes and shall receive electrostatic powder coating 60 - 90 micron (see finishing specification)
Or by using the Anodizing surface finish process

Hardware:

1 set of heavy-duty nylon rollers with Needle-Bearing are used for sliding windows thus to enable the smooth movement of large sliding sashes (up to 2.50m x 2.20m for single sash).

1 set of latch lock self-closing in window leaf & manual closing in doors.

Fabrication:

Frame members shall have an overall depth of 100 mm including a built in fly screen track located to the in side face of the frame assembly and shall be meter cut connected with special aluminum corner cleat with the means of crimping to insure an additional strength, a minimum of two spilling screws per joint shall be applicable in sash assembly. Fixed and sliding panels shall have a nominal depth of 1 9/16" (40 mm) each and shall have overlapped joints to prevent racking and provide a positive weather-seal. Sliding panels shall be equipped with two polyamide wheel assemblies, each capable of supporting a moving weight of 275 pounds (124.7 Kg) and shall be equipped with two self- contained, needle point bearing rollers. Sliding panels shall not be removable when in a locked position.

III. EXECUTION

Installation:

All jambs, head and sill track shall be set in correct locations as shown in the details and shall be level, square, plumb and in alignment with other work in accordance with the manufacturer's installation instructions and. approved shop drawings. All joints between framing and the building structure shall be sealed in order to secure a watertight installation.

Protection & Cleaning:

After installation, the General Contractor shall adequately protect exposed portions of aluminum surfaces from damage by grinding and polishing compounds, plaster, lime, acid, cement, or other contaminants.

The General Contractor shall be responsible for final cleaning.