Timer ON Delay :

1. Double click on the register to which you want to assign variable
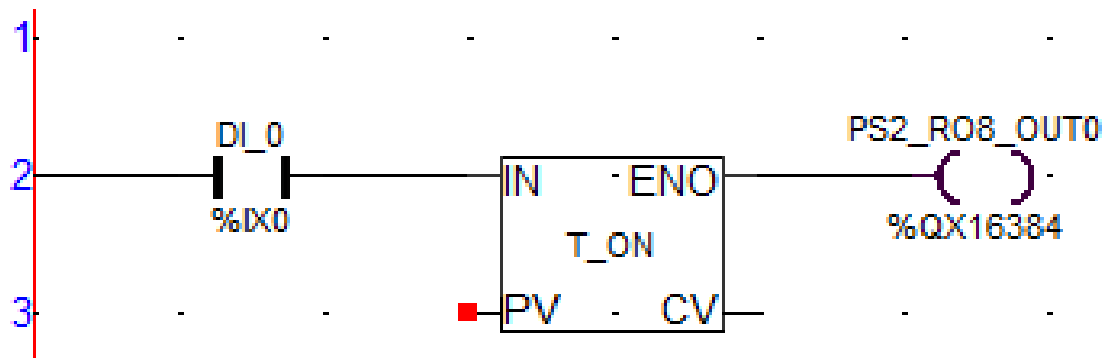
2. Click on Add Variable

3. Adding register

Scope:	Global	OK	Cancel
Select Variable:	GVar2	Edit Variable	Help

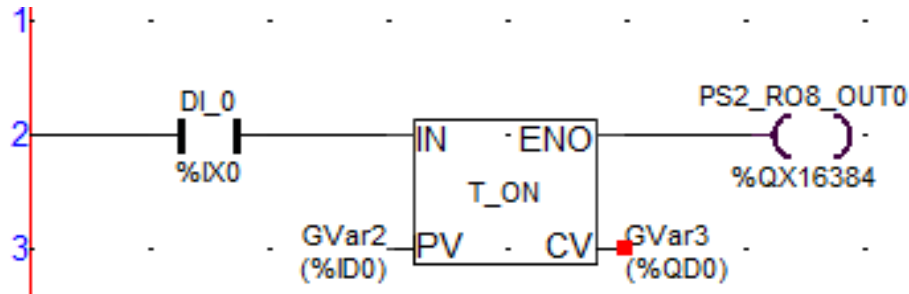|			
Variable Name:	GVar2	Address:	%ID0
Variable Type:	VAR_INPUT	Initial Value:	t#2h3m4s
Data Type:	TIME		
Retention:	NO		
Description:			

Variable will be initialized with time 2 hours 3 minutes and 4 seconds
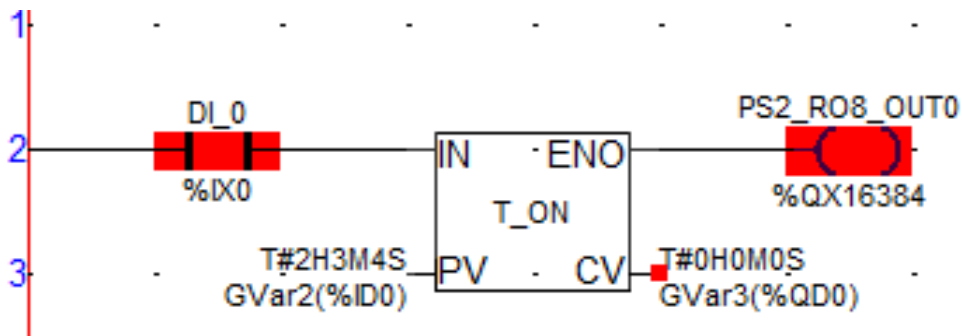
For only 4 seconds initial value will be t#4s

For only 3 minutes initial value will be t#3m

For only 2 hours initial value will be t#2h

4. After adding register

5. After simulating ladder

6. After triggering at DI_0 and when PV=CV then below result will be appear

EXIT